


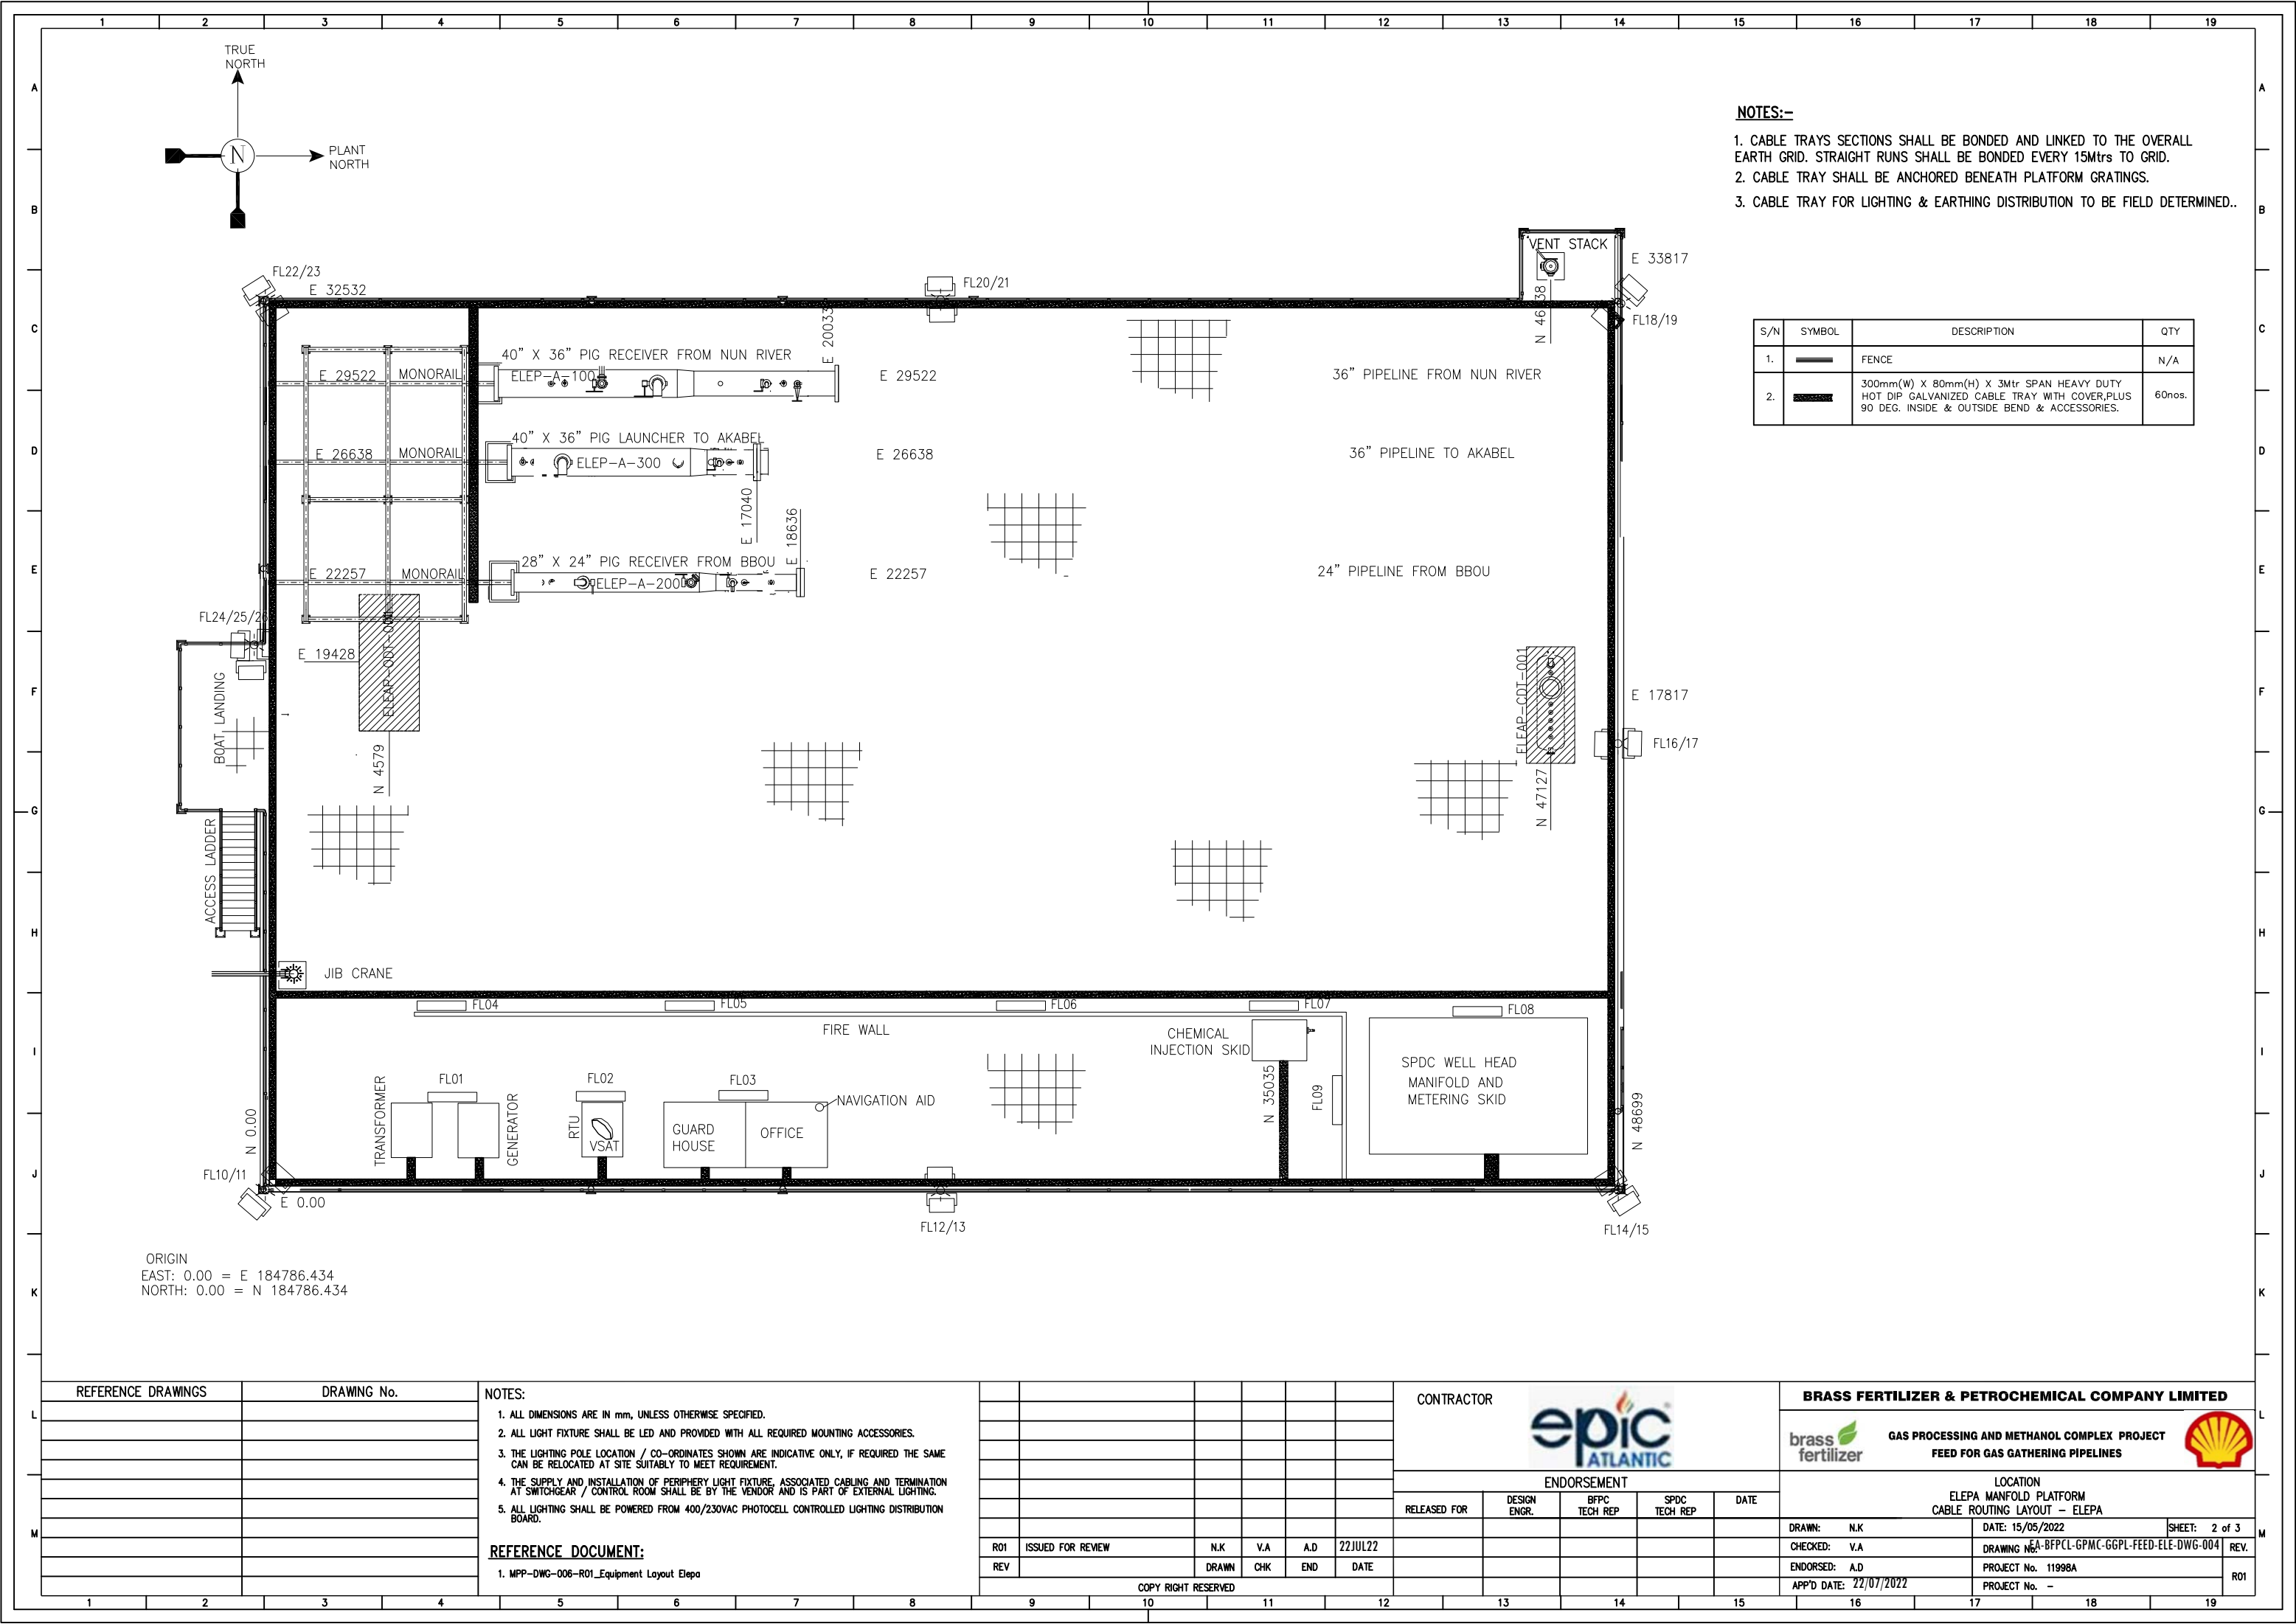


- NOTES:-**
- 1. CABLE TRAYS SECTIONS SHALL BE BONDED AND LINKED TO THE OVERALL EARTH GRID. STRAIGHT RUNS SHALL BE BONDED EVERY 15Mtrs TO GRID.
 - 2. CABLE TRAY SHALL BE ANCHORED BENEATH PLATFORM GRATINGS.
 - 3. CABLE TRAY FOR LIGHTING & EARTHING DISTRIBUTION TO BE FIELD DETERMINED..

S/N	SYMBOL	DESCRIPTION	QTY
1.		FENCE	N/A
2.		300mm(W) X 80mm(H) X 3Mtr SPAN HEAVY DUTY HOT DIP GALVANIZED CABLE TRAY WITH COVER, PLUS 90 DEG. INSIDE & OUTSIDE BEND & ACCESSORIES.	60nos.

ORIGIN
EAST: 0.00 = E 184786.434
NORTH: 0.00 = N 184786.434

REFERENCE DRAWINGS		DRAWING No.	NOTES: 1. ALL DIMENSIONS ARE IN mm, UNLESS OTHERWISE SPECIFIED. 2. ALL LIGHT FIXTURE SHALL BE LED AND PROVIDED WITH ALL REQUIRED MOUNTING ACCESSORIES. 3. THE LIGHTING POLE LOCATION / CO-ORDINATES SHOWN ARE INDICATIVE ONLY, IF REQUIRED THE SAME CAN BE RELOCATED AT SITE SUITABLY TO MEET REQUIREMENT. 4. THE SUPPLY AND INSTALLATION OF PERIPHERY LIGHT FIXTURE, ASSOCIATED CABLING AND TERMINATION AT SWITCHGEAR / CONTROL ROOM SHALL BE BY THE VENDOR AND IS PART OF EXTERNAL LIGHTING. 5. ALL LIGHTING SHALL BE POWERED FROM 400/230VAC PHOTOCCELL CONTROLLED LIGHTING DISTRIBUTION BOARD. REFERENCE DOCUMENT: 1. MPP-DWG-006-R01_Equipment Layout Elepa	CONTRACTOR						BRASS FERTILIZER & PETROCHEMICAL COMPANY LIMITED			
										GAS PROCESSING AND METHANOL COMPLEX PROJECT FEED FOR GAS GATHERING PIPELINES			
				ENDORSEMENT						LOCATION ELEPA MANFOLD PLATFORM CABLE ROUTING LAYOUT - ELEPA			
				RELEASED FOR	DESIGN ENGR.	BFFC TECH REP	SPDC TECH REP	DATE		DRAWN: N.K	DATE: 15/05/2022	SHEET: 2 of 3	
				R01 ISSUED FOR REVIEW	N.K	V.A	A.D	22JUL22		CHECKED: V.A	DRAWING No. A-BFPCL-GPMC-GGPL-FEED-ELE-DWG-004	REV.	
				REV		DRAWN	CHK	END	DATE	ENDORSED: A.D	PROJECT No. 11998A		R01
				COPY RIGHT RESERVED						APP'D DATE: 22/07/2022	PROJECT No. -		

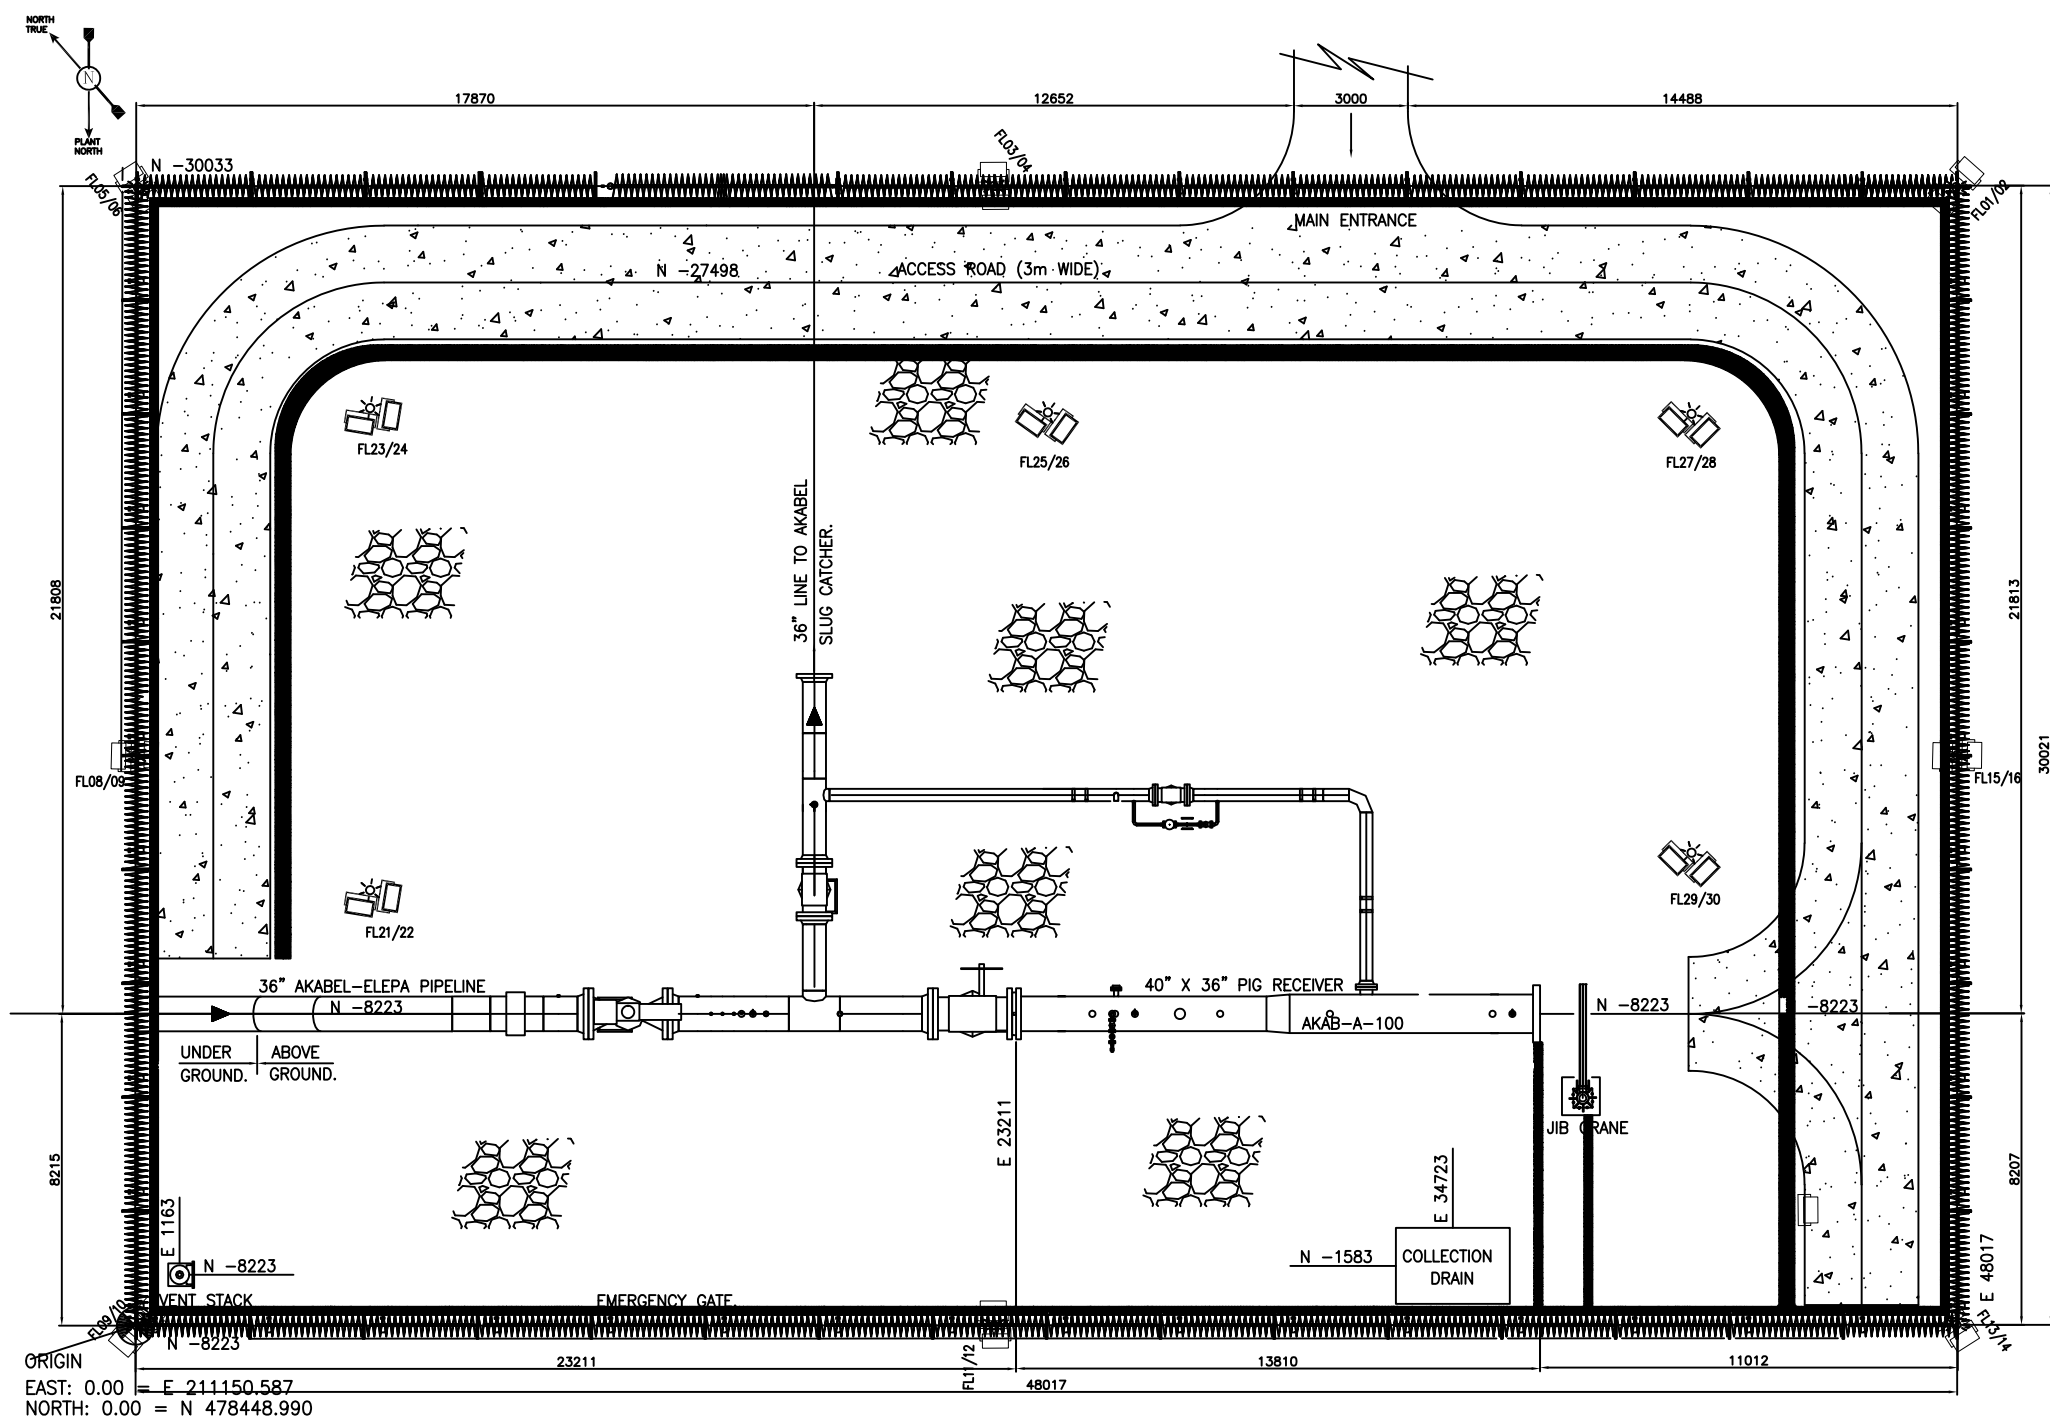

S/N	SYMBOL	DESCRIPTION	QTY
1.		FENCE	N/A
2.		300mm(W) X 800mm(D) CABLE TRENCH.	

ORIGIN
EAST: 0.00 = E 211150.587
NORTH: 0.00 = N 478448.990

REFERENCE DRAWINGS

DRAWING No.

NOTES:

1. CABLE TRAYS SECTIONS SHALL BE BONDED AND LINKED TO THE OVERALL EARTH GRID. STRAIGHT RUNS SHALL BE BONDED EVERY 15Mtrs TO GRID.
2. CABLE TRAY SHALL BE ANCHORED BENEATH PLATFORM GRATINGS.
3. CABLE TRAY FOR LIGHTING & EARTHING DISTRIBUTION TO BE FIELD DETERMINED..
4. ALL DIMENSIONS ARE IN mm, UNLESS OTHERWISE SPECIFIED.

REFERENCE DOCUMENT:

1. MPP-DWG-006-EQUIPMENT LAYOUT ELEPA

CONTRACTOR

ENDORSEMENT

RELEASED FOR	DESIGN ENGR.	BFPC TECH REP	SPDC TECH REP	DATE
R01 ISSUED FOR REVIEW	N.K	V.A	A.D	22JUL22
REV	DRAWN	CHK	END	DATE

COPY RIGHT RESERVED

BRASS FERTILIZER & PETROCHEMICAL COMPANY LIMITED

GAS PROCESSING AND METHANOL COMPLEX PROJECT
FEED FOR GAS GATHERING PIPELINES

LOCATION
AKABEL PIG RECEIVER
CABLE ROUTING LAYOUT PLAN - AKABEL

DRAWN: N.K	DATE: 23/07/2022	SHEET: 3 of 3
CHECKED: V.A	DRAWING No. EA-BFPC-GPMC-GGPL-FEED-ELE-DWG-004	REV.
ENDORSED: A.D	PROJECT No. 11998A	
APP'D DATE: 22/07/2022	PROJECT No. -	R01