


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----

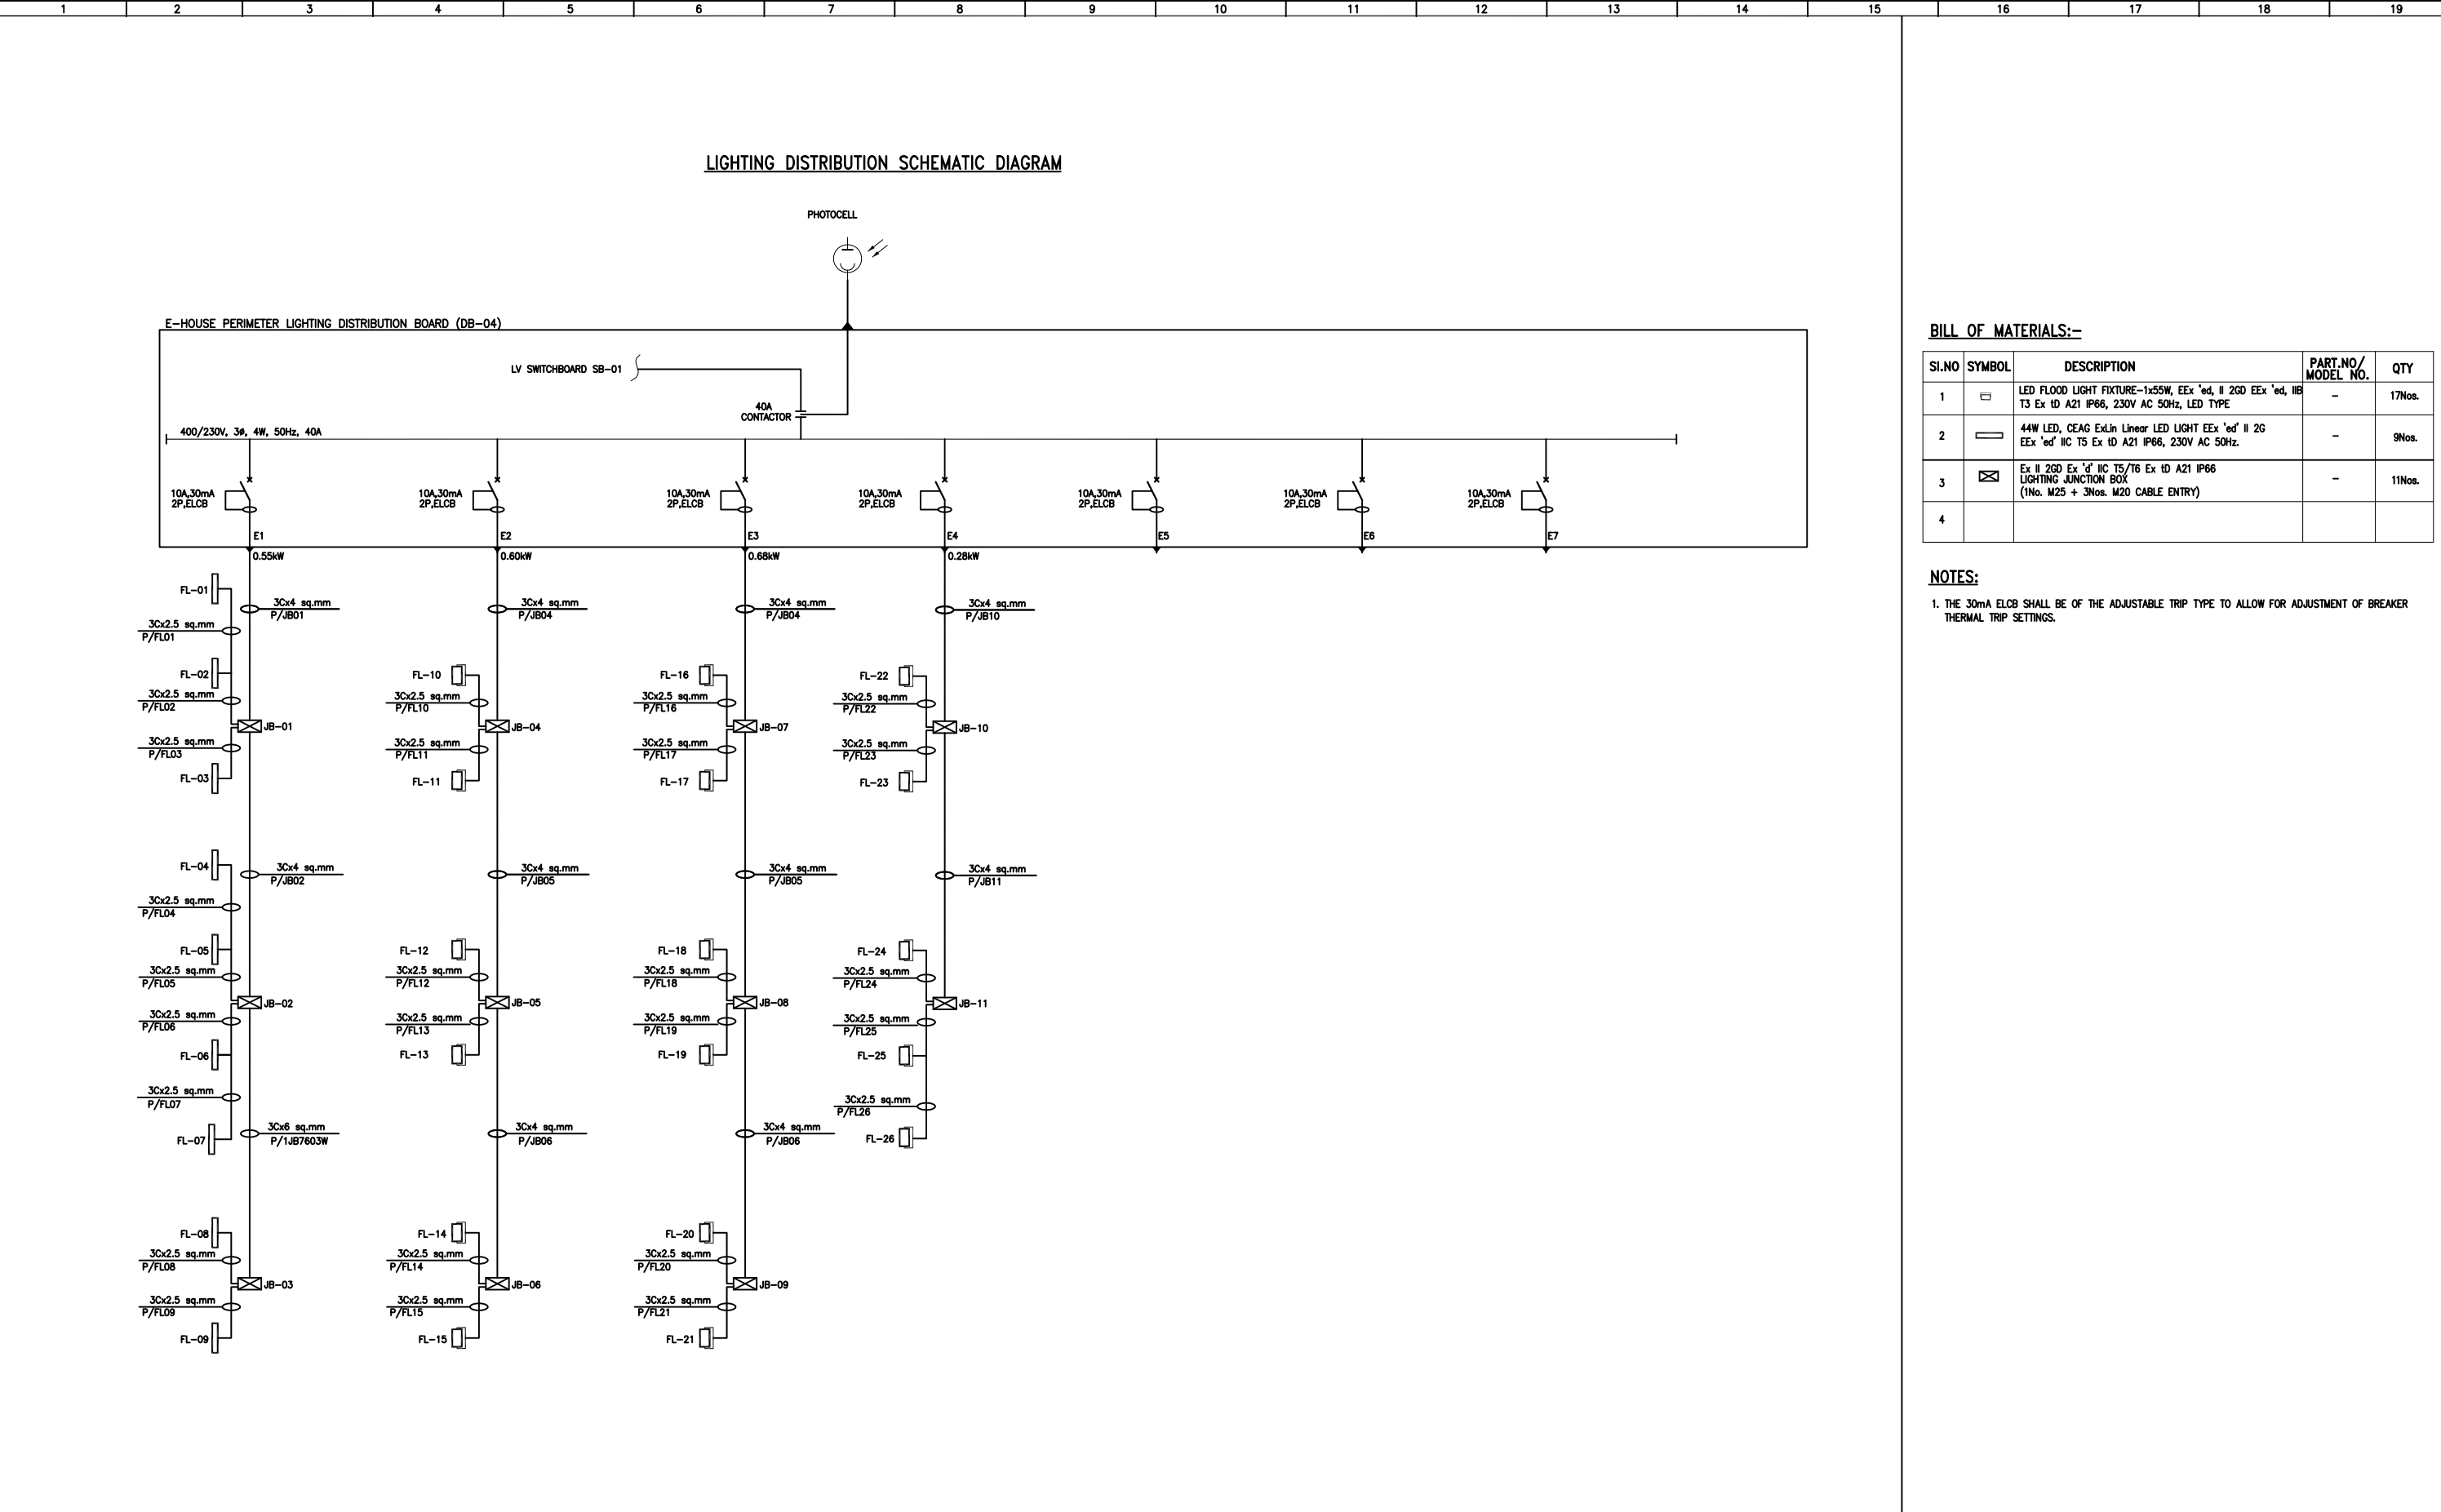


Sl.NO	SYMBOL	DESCRIPTION	PART.NO/ MODEL NO.	QTY
1		LED FLOOD LIGHT FIXTURE-1x55W, EE' 'ed, II 2GD EE' 'ed, IIB T3 Ex ID A21 IP66, 230V AC 50Hz, LED TYPE	-	17Nos.
2		44W LED, CEAG ExLin Linear LED LIGHT EE' 'ed II 2G EE' 'ed IIC T5 IIC ID A21 IP66, 230V AC 50Hz.	-	9Nos.
3		Ex II 2GD Ex 'd' IIC T5/T6 Ex ID A21 IP66 LIGHTING JUNCTION BOX (1No. M25 + 3Nos. M20 CABLE ENTRY)	-	11Nos.
4				

1. THE 30mA ELCB SHALL BE OF THE ADJUSTABLE TRIP TYPE TO ALLOW FOR ADJUSTMENT OF BREAKER THERMAL TRIP SETTINGS.

REFERENCE DRAWINGS	DRAWING No.	NOTES:								CONTRACTOR 	BRASS FERTILIZER & PETROCHEMICAL COMPANY LIMITED							
												GAS PROCESSING AND METHANOL COMPLEX PROJECT FEED FOR GAS GATHERING PIPELINES						
											LOCATION BBOU MANFOLD PLATFORM SCHEMATIC OF POWER PANEL (PERIMETER LIGHTING)							
											RELEASED FOR	DESIGN ENGR.	BFPCL TECH REP	SPDC TECH REP	DATE	DRAWN: NF	DATE: 22.07.2022	SHEET: 1 of 3
																CHECKED: VA	DRAWING No. EA-BFPCL-GPMC-GGPL-FEED-ELE-DWG-016	REV.
																ENDORSED: AD	PROJECT No. 11998A	R01
			REFERENCE DOCUMENT: 1. EA-BFPCL-GPMC-GGPL-FEED-ELE-DWG-007 Lighting Layout - BBOU	R01	ISSUED FOR REVIEW	NK	VA	AD	22.07.2022						APP'D DATE: 22.07.2022	PROJECT No. -		
				REV		DRAWN	CHK	END	DATE									
				COPY RIGHT RESERVED														

LIGHTING DISTRIBUTION SCHEMATIC DIAGRAM

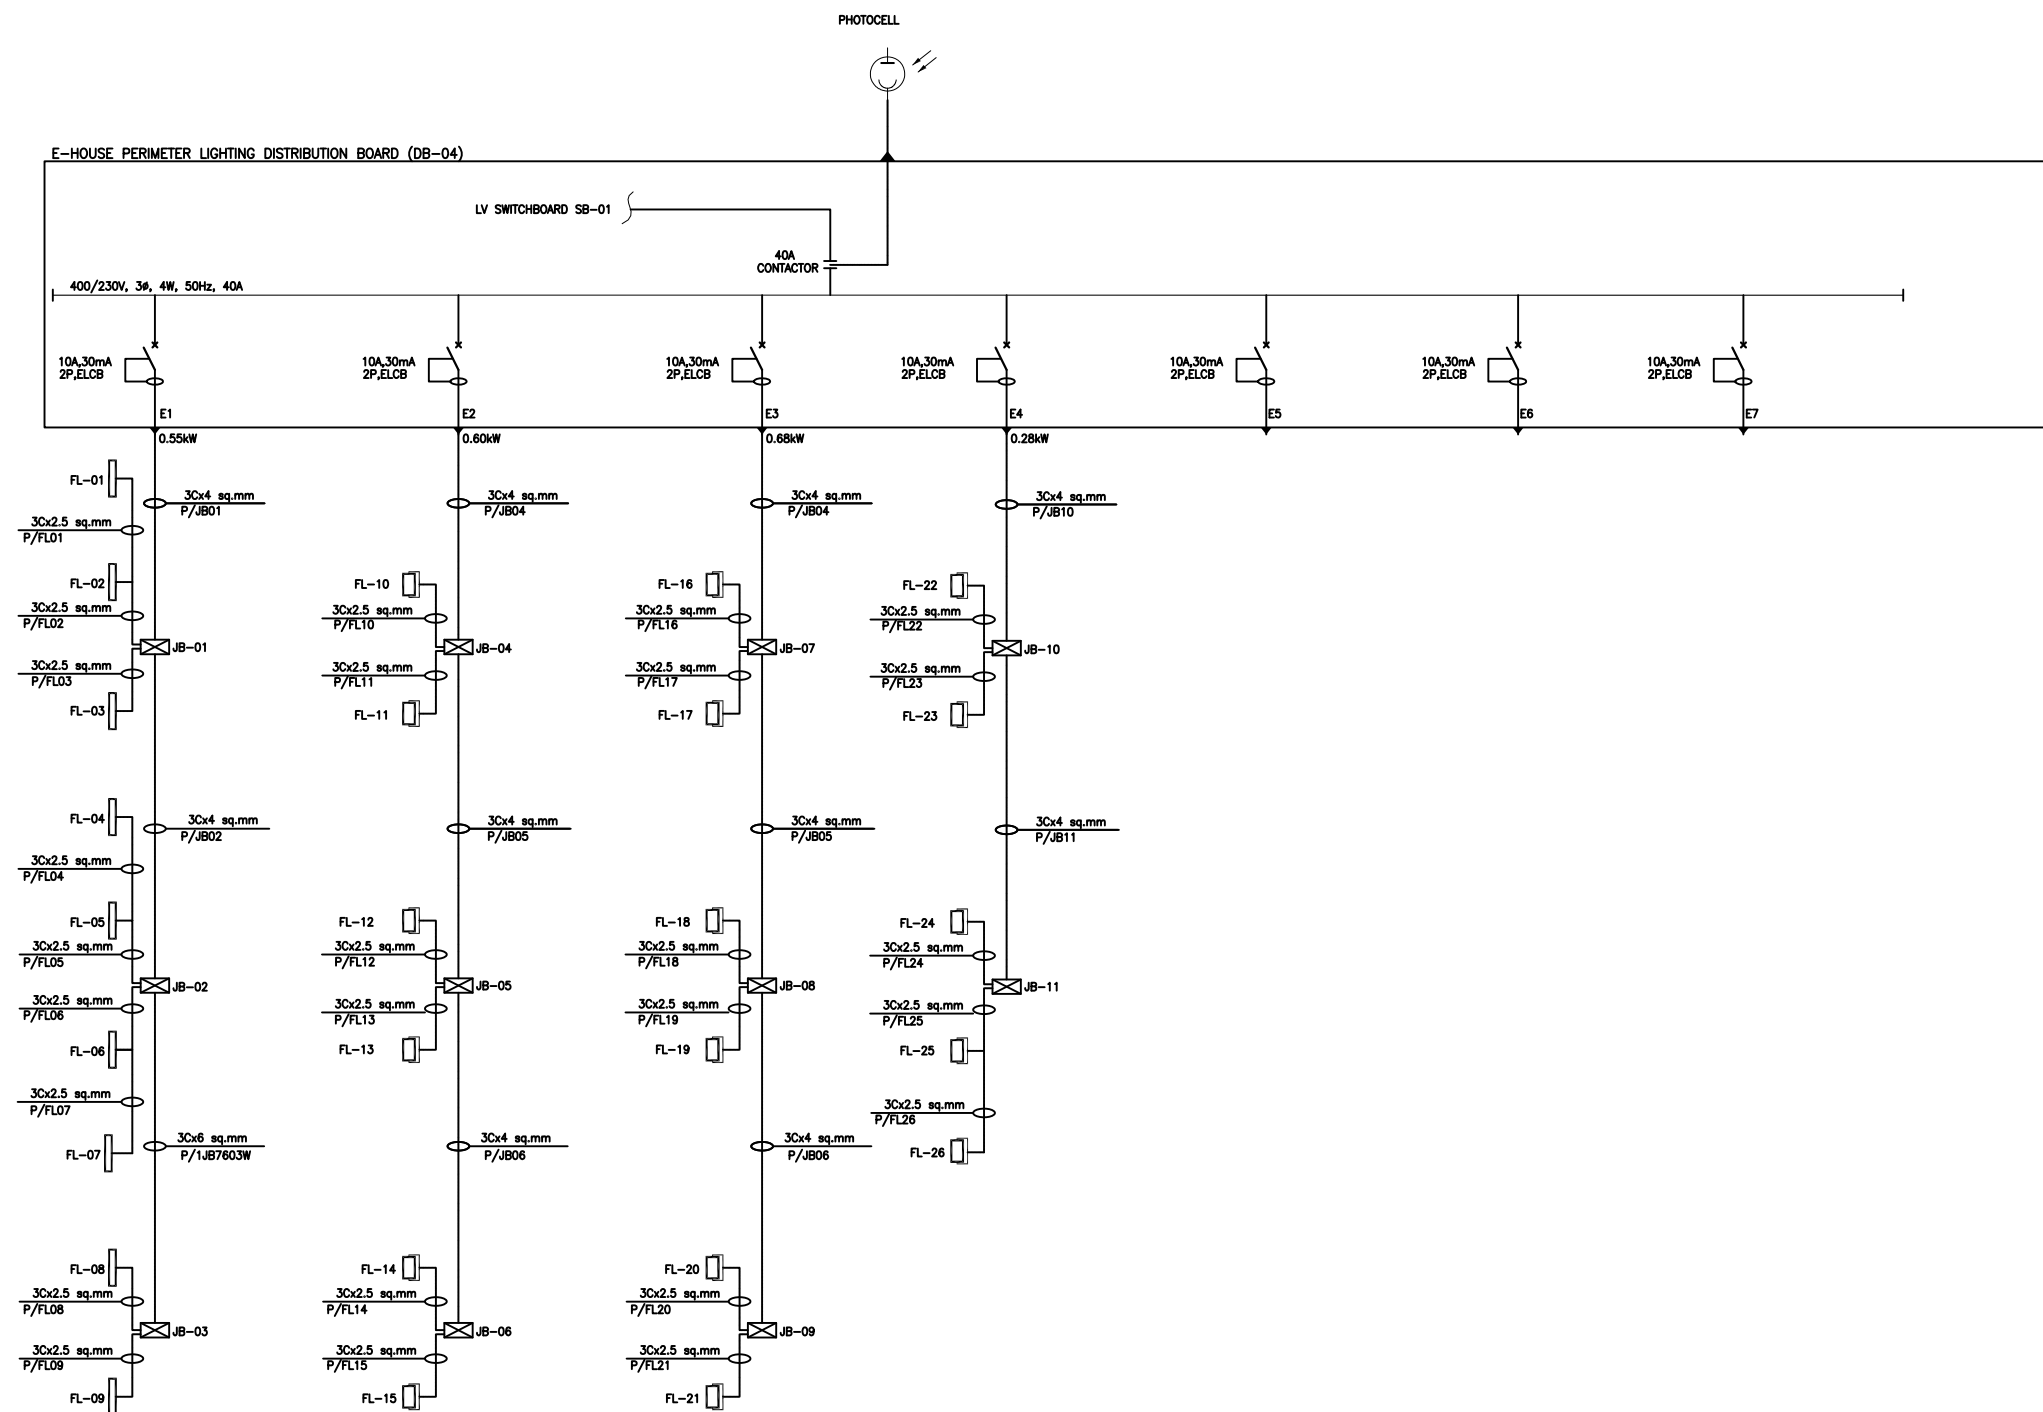

BILL OF MATERIALS:-

SL NO	SYMBOL	DESCRIPTION	PART NO / MODEL NO.	QTY
1		LED FLOOD LIGHT FIXTURE-1x55W, EEx 'ed, II 2GD EEx 'ed, IIE T3 Ex Id A21 IP66, 230V AC 50Hz, LED TYPE	-	17Nos
2		44W LED, CEAG ExLin Linear LED LIGHT EEx 'ed' II 2G EEx 'ed' IIC T5 Ex Id A21 IP66, 230V AC 50Hz.	-	9Nos
3		Ex II 2GD Ex 'd' IIC T5/T6 Ex Id A21 IP66 LIGHTING JUNCTION BOX (1No. M25 + 3Nos. M20 CABLE ENTRY)	-	11Nos
4				

NOTES:

1. THE 30mA ELCB SHALL BE OF THE ADJUSTABLE TRIP TYPE TO ALLOW FOR ADJUSTMENT OF BREAKER THERMAL TRIP SETTINGS.

[illegible]

LIGHTING DISTRIBUTION SCHEMATIC DIAGRAM

E-HOUSE PERIMETER LIGHTING DISTRIBUTION BOARD (DB-04)

LV SWITCHBOARD SB-01

40A CONTACTOR

PHOTOCELL

400/230V, 3ø, 4W, 50Hz, 40A

10A,30mA 2P,ELCB

E1

0.33kW

3Cx4 sq.mm P/JB01

FL-01

3Cx2.5 sq.mm P/FL01

JB-01

3Cx2.5 sq.mm P/FL02

FL-02

3Cx4 sq.mm P/JB02

FL-03

3Cx2.5 sq.mm P/FL03

JB-02

3Cx2.5 sq.mm P/FL04

FL-04

3Cx4 sq.mm P/JB03

FL-05

3Cx2.5 sq.mm P/FL05

JB-03

3Cx2.5 sq.mm P/FL06

FL-06

E2

0.33kW

3Cx4 sq.mm P/JB04

FL-07

3Cx2.5 sq.mm P/FL07

JB-04

3Cx2.5 sq.mm P/FL08

FL-08

3Cx4 sq.mm P/JB05

FL-09

3Cx2.5 sq.mm P/FL09

JB-05

3Cx2.5 sq.mm P/FL10

FL-10

3Cx4 sq.mm P/JB06

FL-11

3Cx2.5 sq.mm P/FL11

JB-06

3Cx2.5 sq.mm P/FL12

FL-12

E3

0.33kW

3Cx4 sq.mm P/JB07

FL-13

3Cx2.5 sq.mm P/FL13

JB-07

3Cx2.5 sq.mm P/FL14

FL-14

3Cx4 sq.mm P/JB08

FL-15

3Cx2.5 sq.mm P/FL15

JB-08

3Cx2.5 sq.mm P/FL16

FL-16

3Cx4 sq.mm P/JB09

FL-17

3Cx2.5 sq.mm P/FL20

JB-09

3Cx2.5 sq.mm P/FL21

FL-18

E4

0.33kW

3Cx4 sq.mm P/JB07

FL-19

3Cx2.5 sq.mm P/FL19

JB-10

3Cx2.5 sq.mm P/FL20

FL-20

3Cx4 sq.mm P/JB11

FL-21

3Cx2.5 sq.mm P/FL21

JB-11

3Cx2.5 sq.mm P/FL22

FL-22

3Cx4 sq.mm P/JB12

FL-23

3Cx2.5 sq.mm P/FL23

JB-12

3Cx2.5 sq.mm P/FL24

FL-24

E5

0.33kW

3Cx4 sq.mm P/JB13

FL-25

3Cx2.5 sq.mm P/FL25

JB-13

3Cx2.5 sq.mm P/FL26

FL-26

3Cx4 sq.mm P/JB14

FL-27

3Cx2.5 sq.mm P/FL27

JB-14

3Cx2.5 sq.mm P/FL28

FL-28

E6

SPARE

E7

SPARE

BILL OF MATERIALS:-				
SI.NO	SYMBOL	DESCRIPTION	PART.NO/ MODEL NO.	QTY
1		LED FLOOD LIGHT FIXTURE-1x55W, EEx 'ed, II 2GD EEx 'ed, IIB T3 Ex tD A21 IP66, 230V AC 50Hz, LED TYPE	-	28Nos.
2		Ex II 2GD Ex 'd IIC T5/T6 Ex tD A21 IP66 LIGHTING JUNCTION BOX (1No. M25 + 3Nos. M20 CABLE ENTRY)	-	14Nos.

NOTES:

1. THE 30mA ELCB SHALL BE OF THE ADJUSTABLE TRIP TYPE TO ALLOW FOR ADJUSTMENT OF BREAKER THERMAL TRIP SETTINGS.

Sl.NO	SYMBOL	DESCRIPTION	PART.NO/ MODEL NO.	QTY
1		LED FLOOD LIGHT FIXTURE-1x55W, EEx 'ed, II 2GD EEx 'ed, IIB T3 Ex td A21 IP66, 230V AC 50Hz, LED TYPE	-	28Nos.
2		Ex II 2GD Ex 'd' IIC T5/T6 Ex td A21 IP66 LIGHTING JUNCTION BOX (1No. M25 + 3Nos. M20 CABLE ENTRY)	-	14Nos.

1. THE 30ma ELCB SHALL BE OF THE ADJUSTABLE TRIP TYPE TO ALLOW FOR ADJUSTMENT OF BREAKER THERMAL TRIP SETTINGS.

[illegible]