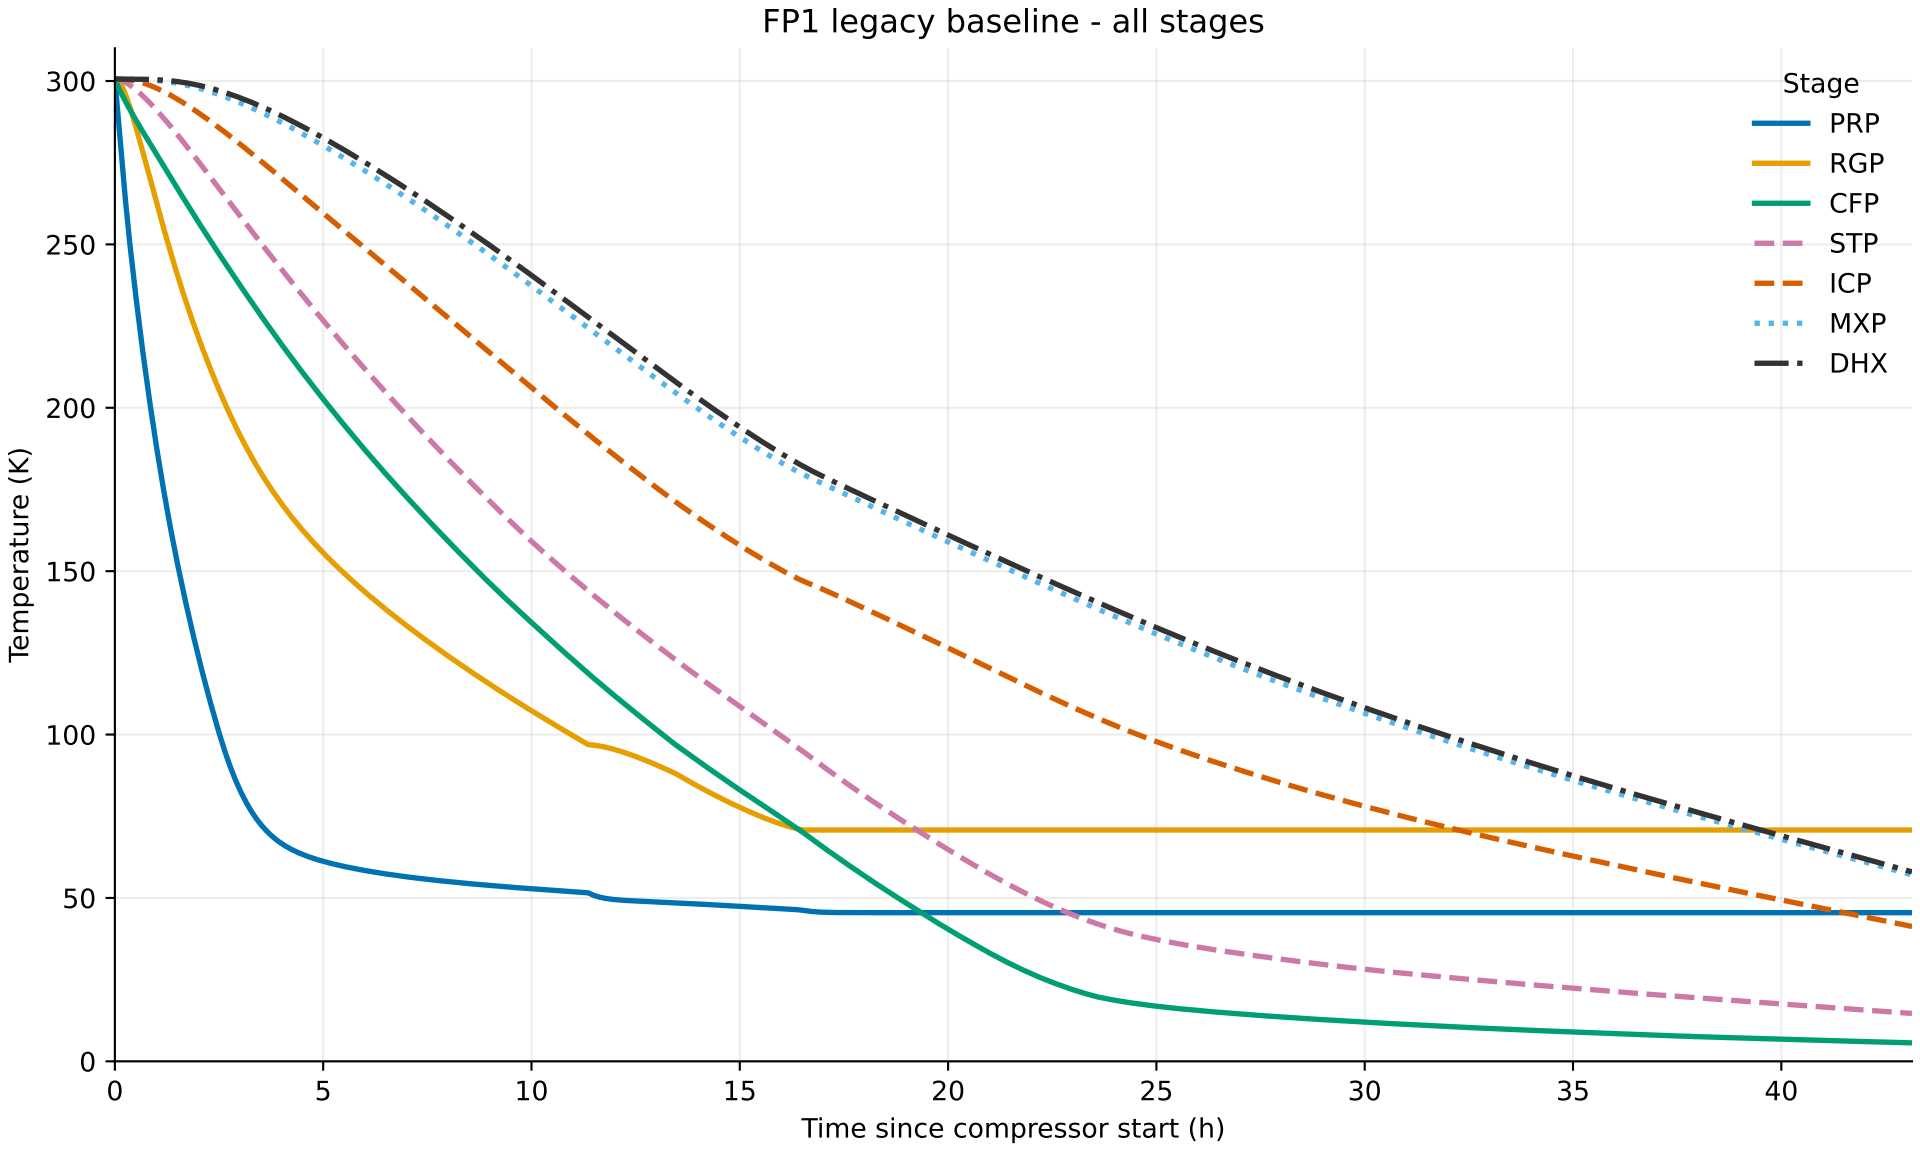
FP1 legacy baseline - all stages
Temperature (K)
Time since compressor start (h)
0
50
100
150
200
250
300
0
5
10
15
20
25
30
35
40
Stage
PRP
RGP
CFP
STP
ICP
MXP
DHX