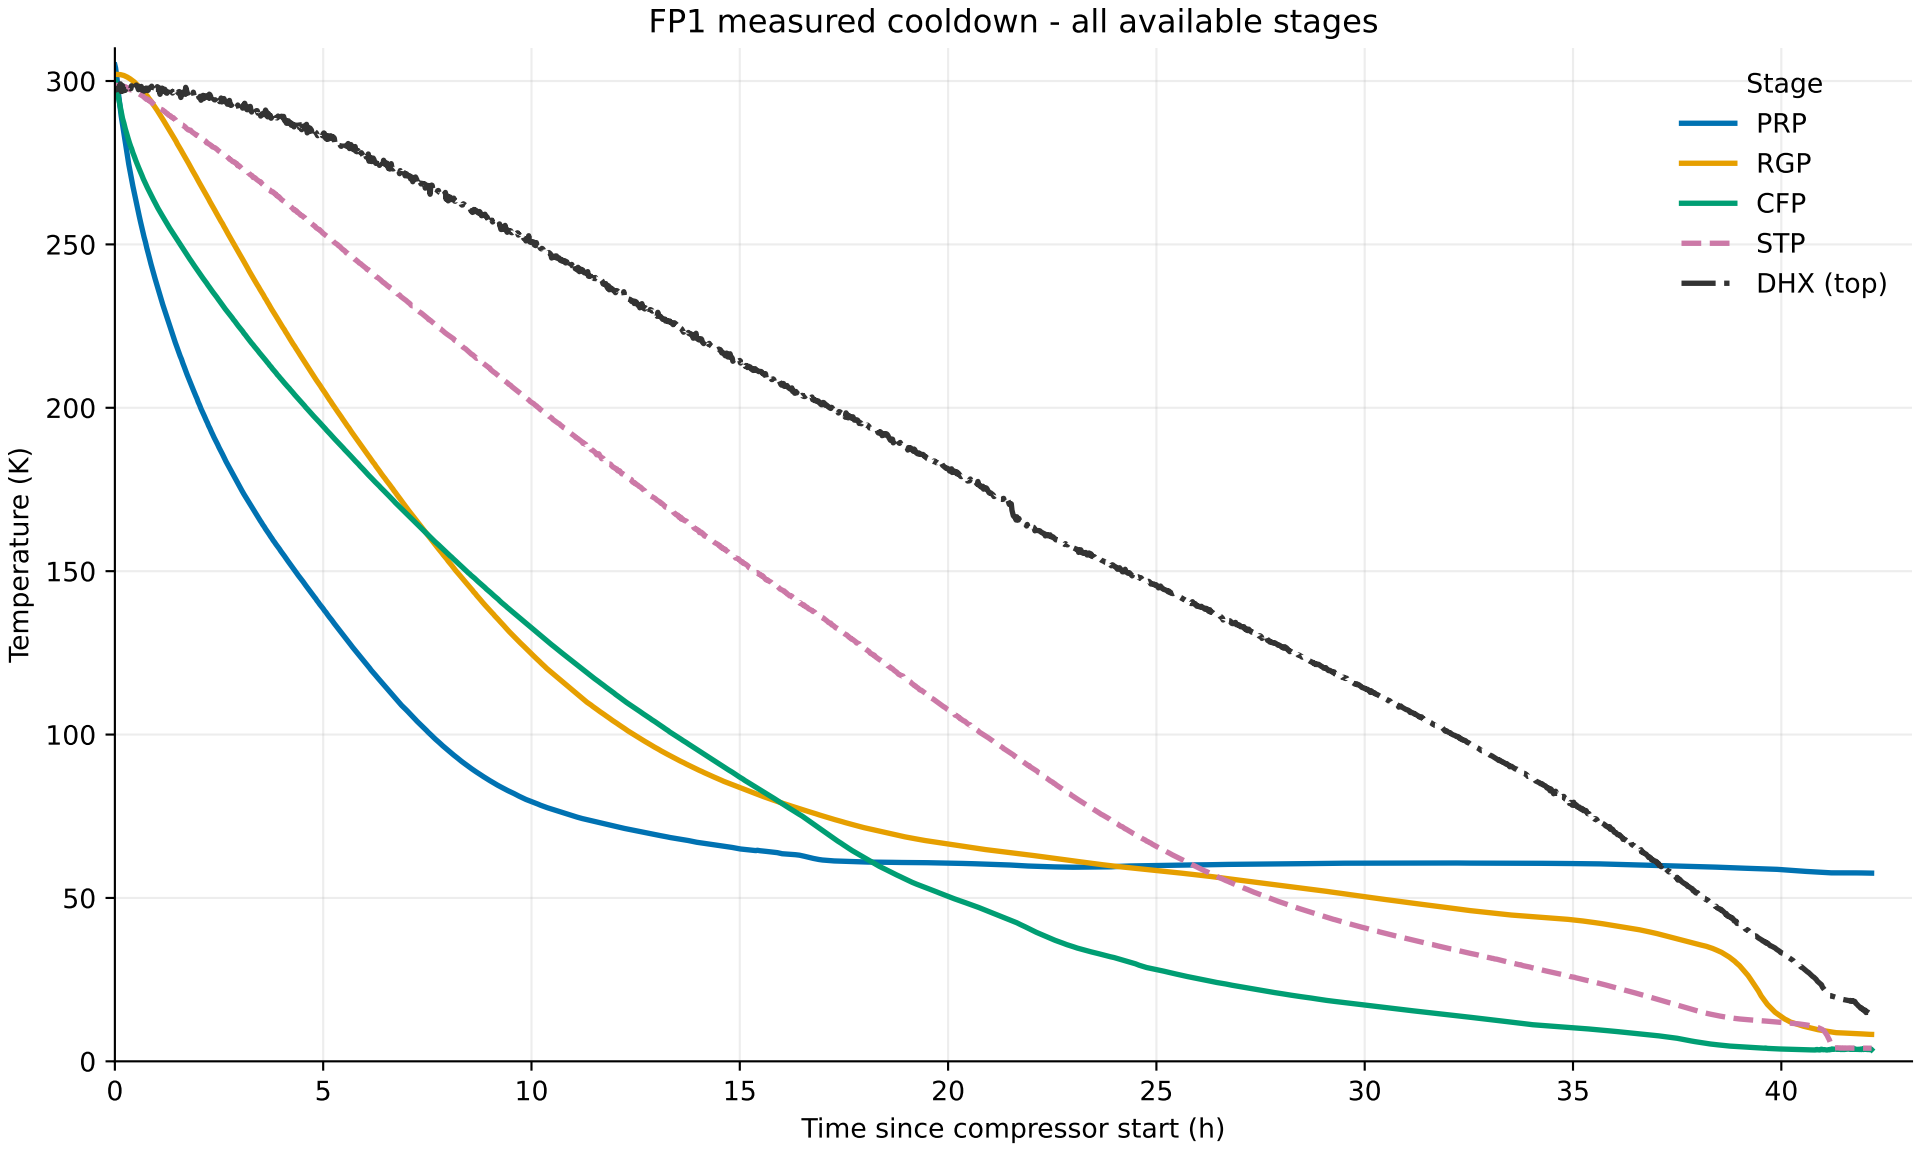
FP1 measured cooldown - all available stages
Stage
PRP
RGP
CFP
STP
DHX (top)
Temperature (K)
0
50
100
150
200
250
300
0
5
10
15
20
25
30
35
40
Time since compressor start (h)