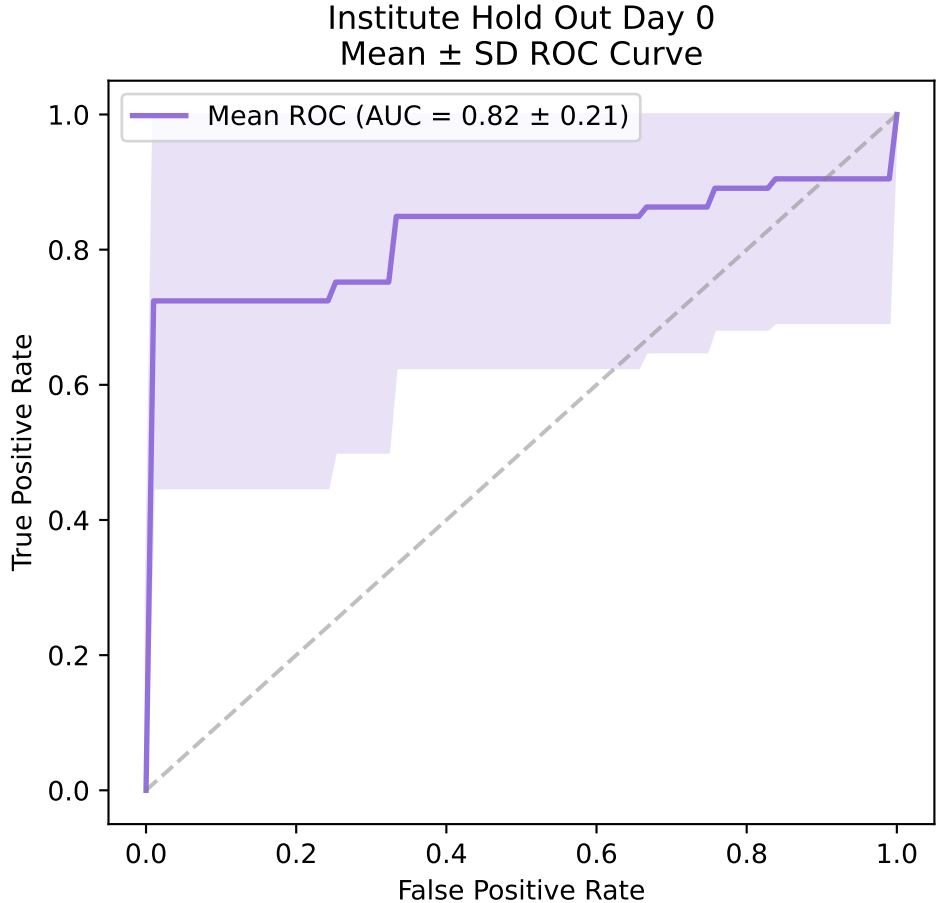
Institute Hold Out Day 0
Mean ± SD ROC Curve
Mean ROC (AUC = 0.82 ± 0.21)
True Positive Rate
False Positive Rate
0.0
0.2
0.4
0.6
0.8
1.0

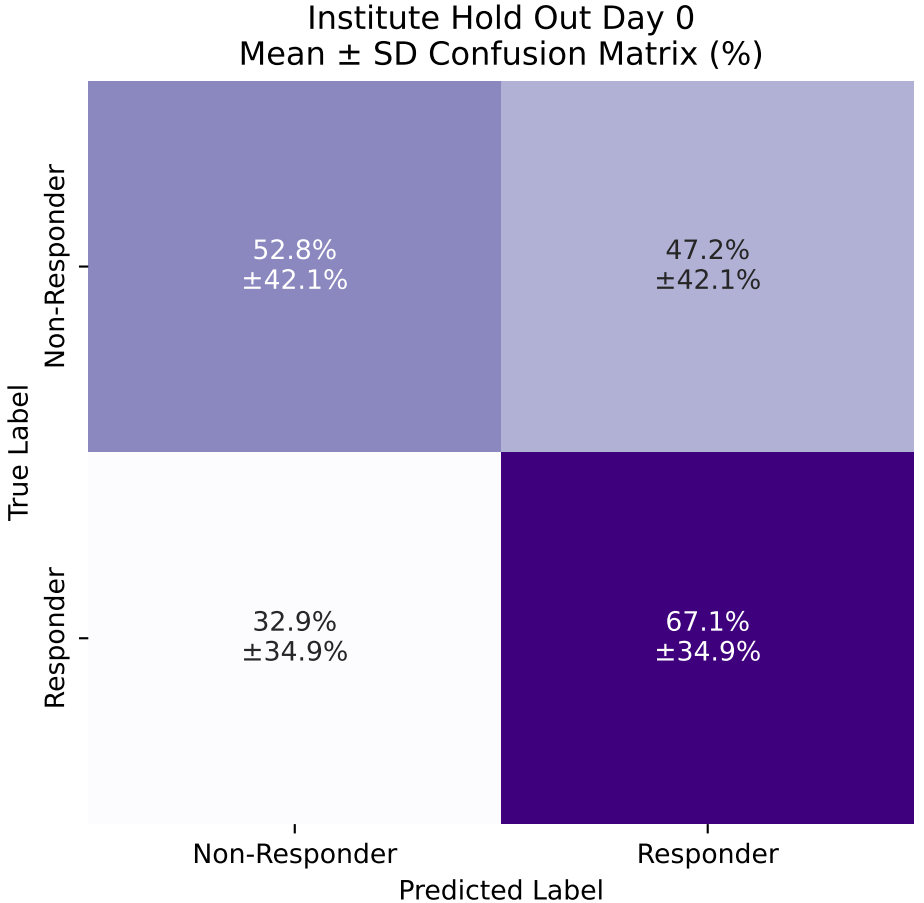
Institute Hold Out Day 0
Mean ± SD Confusion Matrix (%)
True Label
Non-Responder
Responder
52.8%
±42.1%
47.2%
±42.1%
32.9%
±34.9%
67.1%
±34.9%
Non-Responder
Responder
Predicted Label