


WEST SECTION · ROOF AND FRAMING CLEARANCES

Looking east · north at left · vertical dimensions to ROOF UNDERSIDE · conceptual member elevations

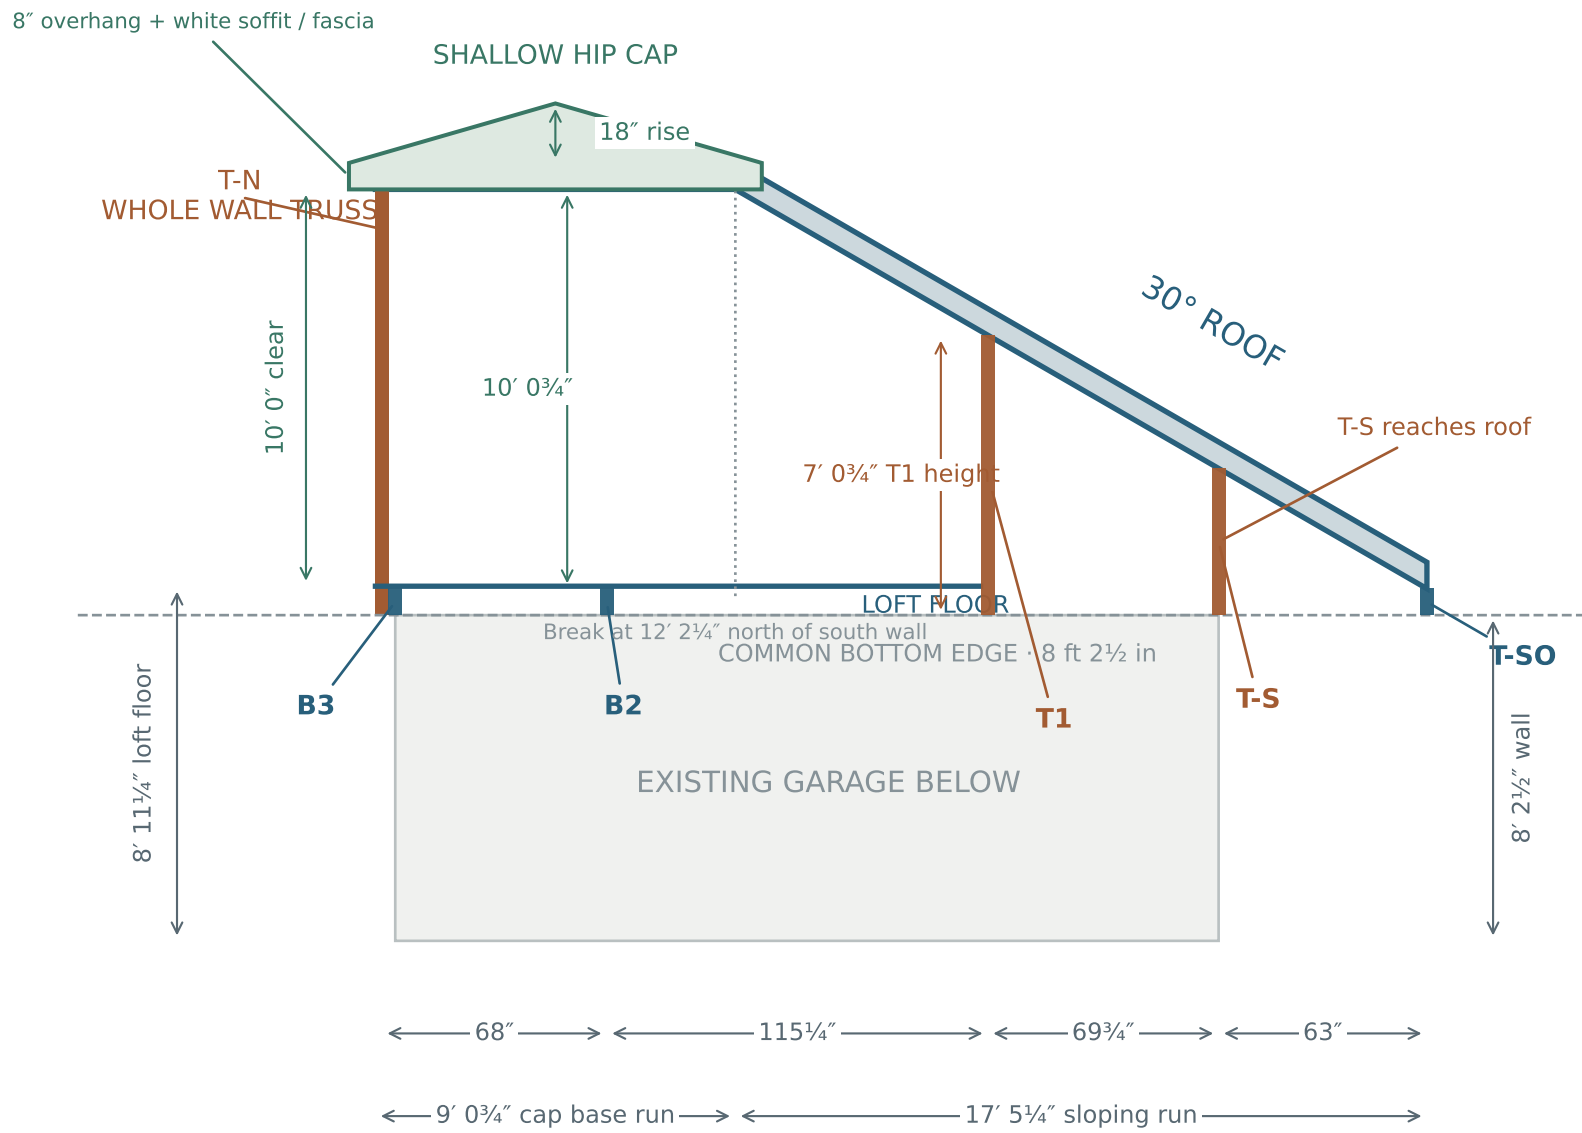


Datum: loft floor = 8' 11 1/4" above ground. Roof underside starts at T-SO top = 8' 10 1/2"; it rises to 10' 0" above loft floor.
ALL beam and truss bottoms = wall top, 8' 2 1/2". Columns carry the loads; existing walls are not assigned new gravity load.
Trial beam depths: T-SO / B2 / B3 = 8 in. T-S and T1 extend from wall-top datum to roof underside. Loft floor is 3/4 in above the 8-in beams. Roof band = 8 in, provisional.

Longitudinal T-W / T-E and B-WO are outside this interior cut; their BOTTOM edges share the same wall-top datum. Depths remain to be designed.
Hip cap: 18-in rise above eaves, 8-in overhang and fascia; rear ceiling datum unchanged. North wall edge = 255 in; cap eave = 263 in.

T1 · DIMENSIONED TRUSS CONCEPT

View from south looking north · west at left · T1 terminates at T-E · bottom edge at common wall-top datum · column-supported framing

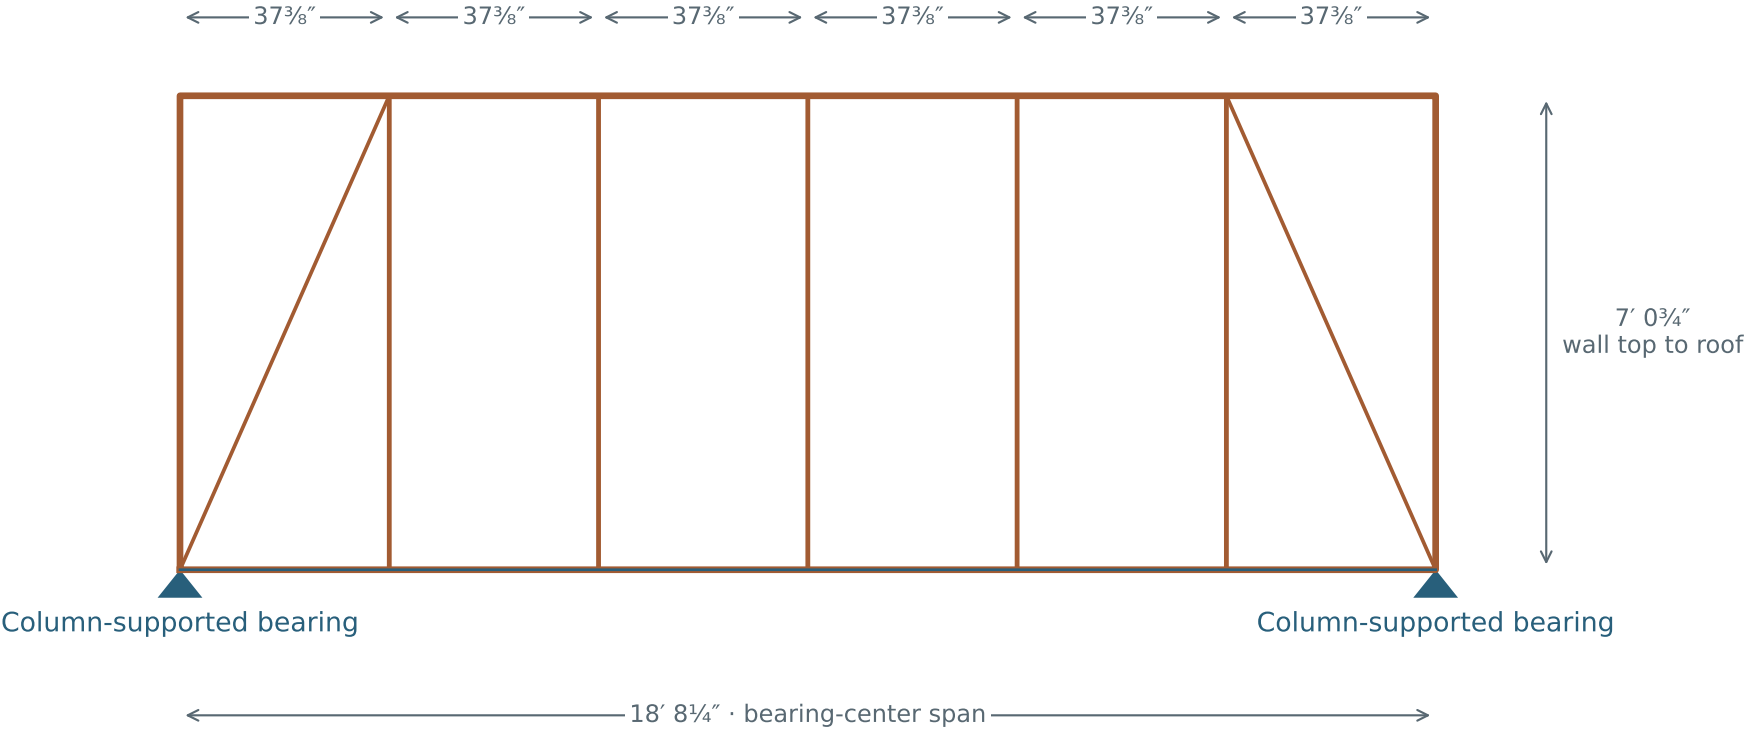


Height is set by the roof underside. Six equal panel bays are a drawing assumption. Panel dimensions are centerline spacing, not clear cabinet openings. Rectangular central bays require designed moment connections / Vierendeel action; end diagonals alone are not a complete truss design.

T1 bottom edge = 8 ft 2½ in; top edge = 15' 3¼" above ground, at the roof underside. No gap above T1. Loads go to column-supported framing. Member widths, welds, bearing seats, lateral bracing and cabinet loads remain to be designed.

T-N · NORTH WALL / DOOR TRUSS CONCEPT

View from inside looking north · west at left · loft floor is the zero datum

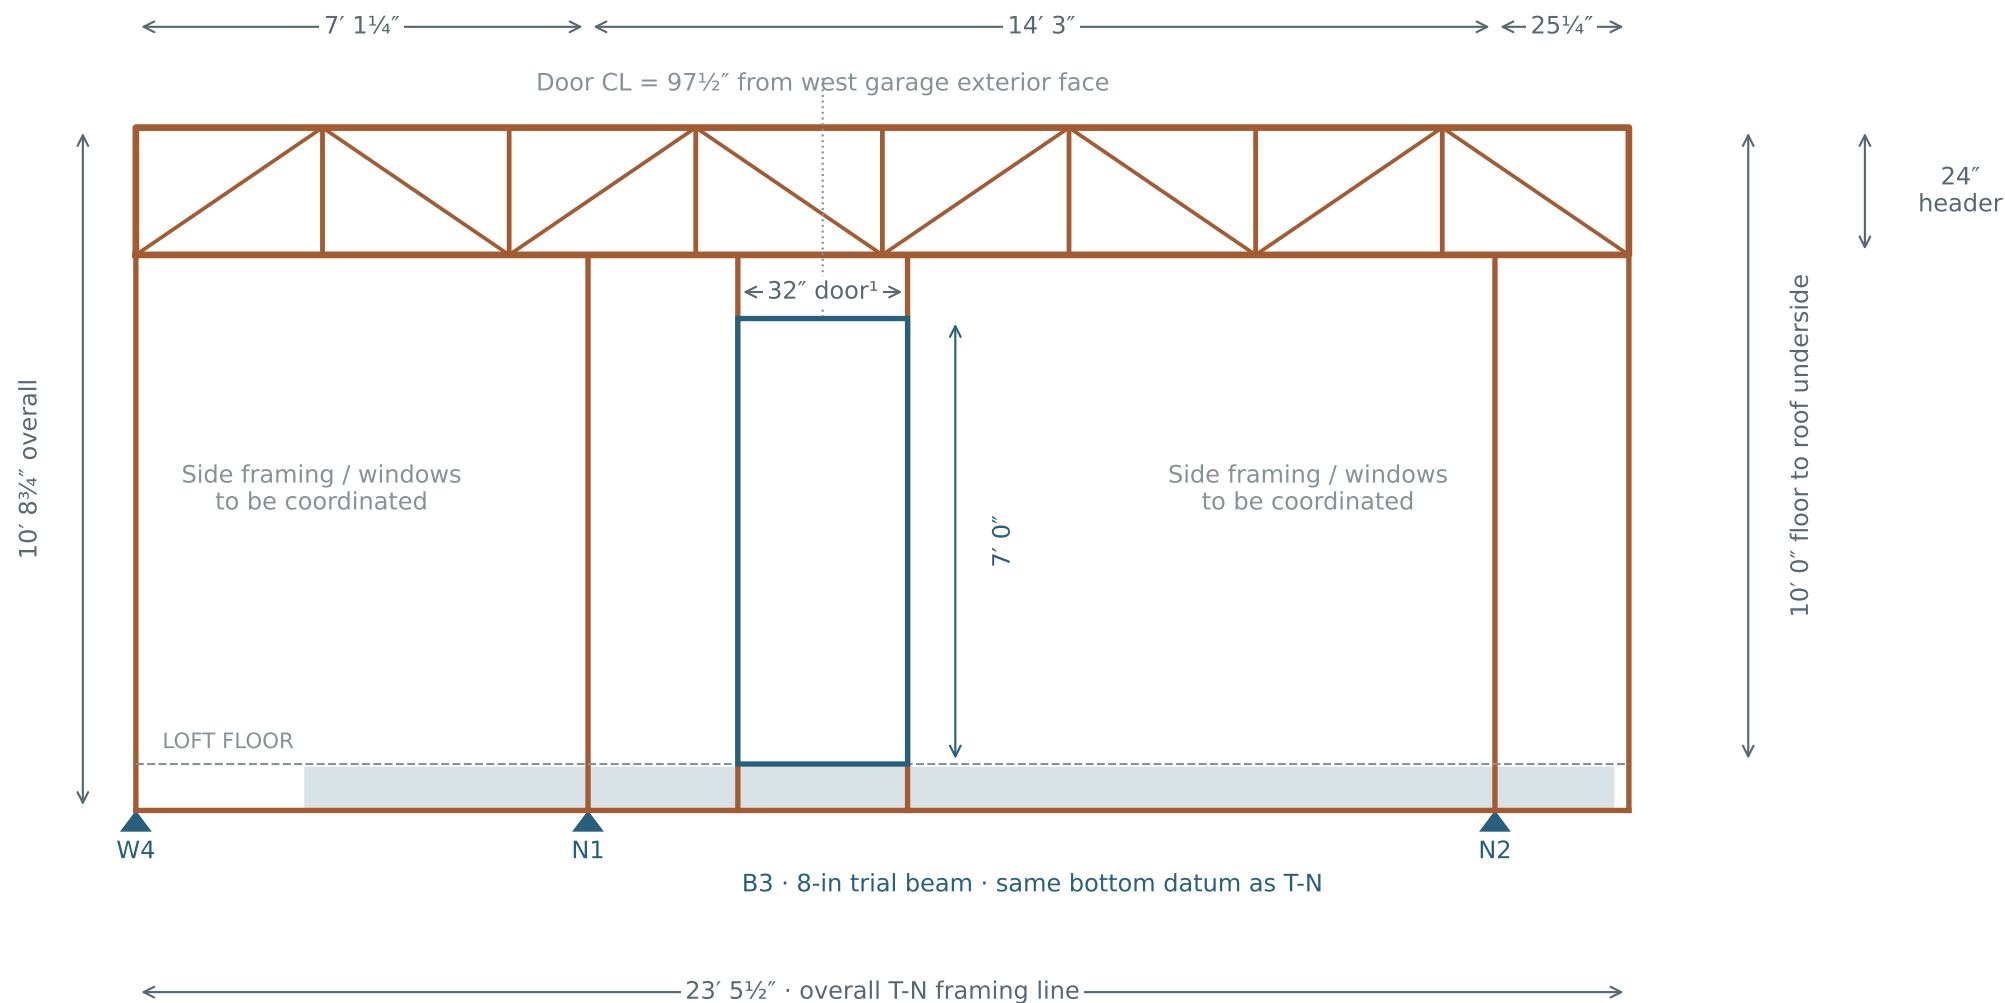

Seven-foot door retained under a trial 24-in trussed header. Header underside is 8 ft above floor: 12 in above nominal door top.

¹32-in door width retained from earlier drawing; actual rough opening and connection allowances are not yet specified.

T-N overall height = 10 ft 8 3/4 in, from common wall-top datum to roof underside; loft floor is 8 3/4 in above that datum.

Column-supported structure. Door threshold is at loft floor. Side-frame webs, windows, connections and beam depths remain conceptual.