

TN over-door mini-truss correction

The bottom chord/header now runs level between the support axes.
Four equal 25.5-inch panels span 102 inches (8 ft 6 in) between those axes.
Chord axes are at 207 and 224.25 inches above datum: 17.25 inches apart.
These are structural centerline dimensions, not the clear finished door opening.


All mini-truss diagonals and verticals now terminate exactly on chord nodes.
The east upper jamb reaches the upper chord. The short sloping header-end connection that caused the visible uptick has been removed.

N1 / U-W is 3.5 inches north of the TN plane. Its connection is an explicit out-of-plane centroid offset, not a gap or an upward-sloping header end.
The right jamb remains above the loft; no ground post was added in the door.

TE, TW and TS physical geometry and section choices are unchanged.
Both stages and the final second-order whole-frame analysis were rerun.
Connections, welds, bolts, foundations, roof-brace crossings and site/code requirements remain preliminary. These are analytical centerline drawings.



Export replay verified 70 combinations. Maximum partial second-order screen: 0.935.
The screen excludes the 125 psf storage sensitivity; it is not complete design approval.

TN Corrected over-door mini-truss

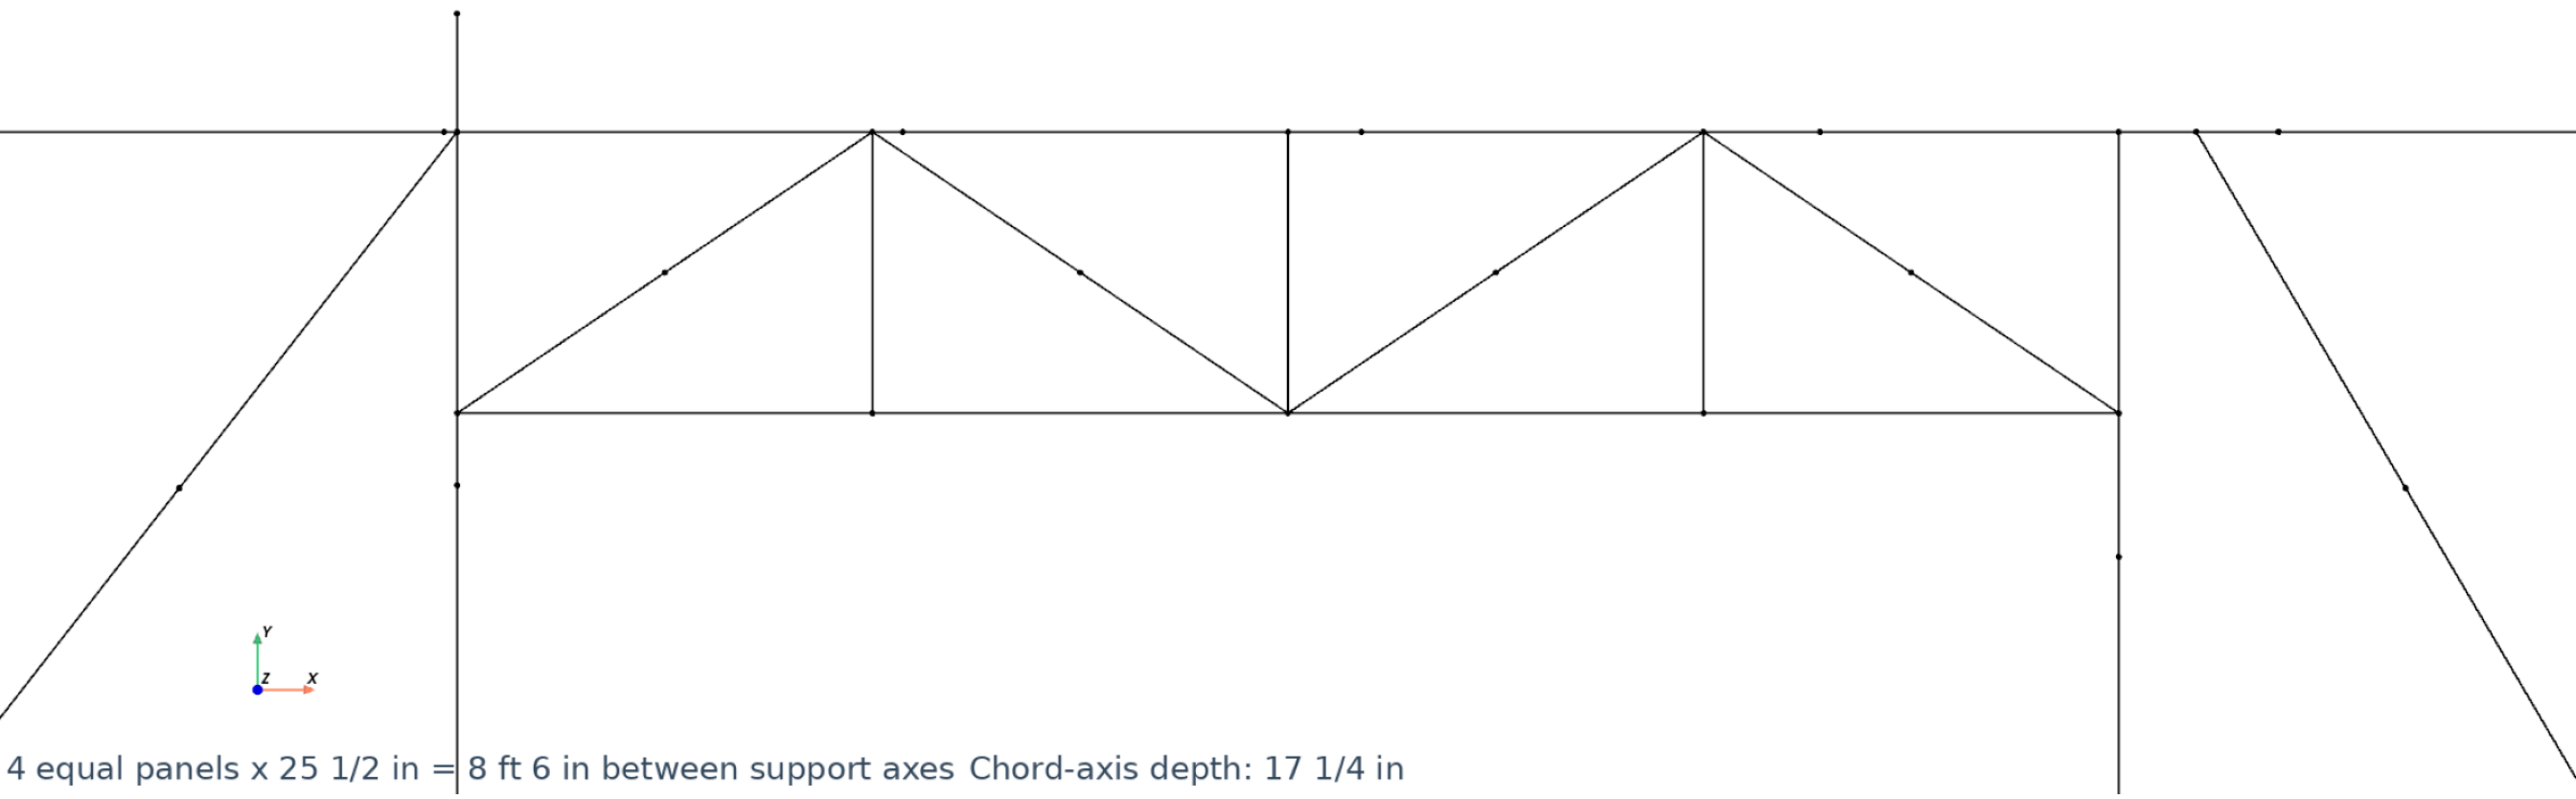



TN Corrected wall elevation

Flat upper chord axis: 18 ft 8 1/4 in
Lower chord axis: 9 ft 7 in
Overall chord run: 23 ft 5 1/2 in

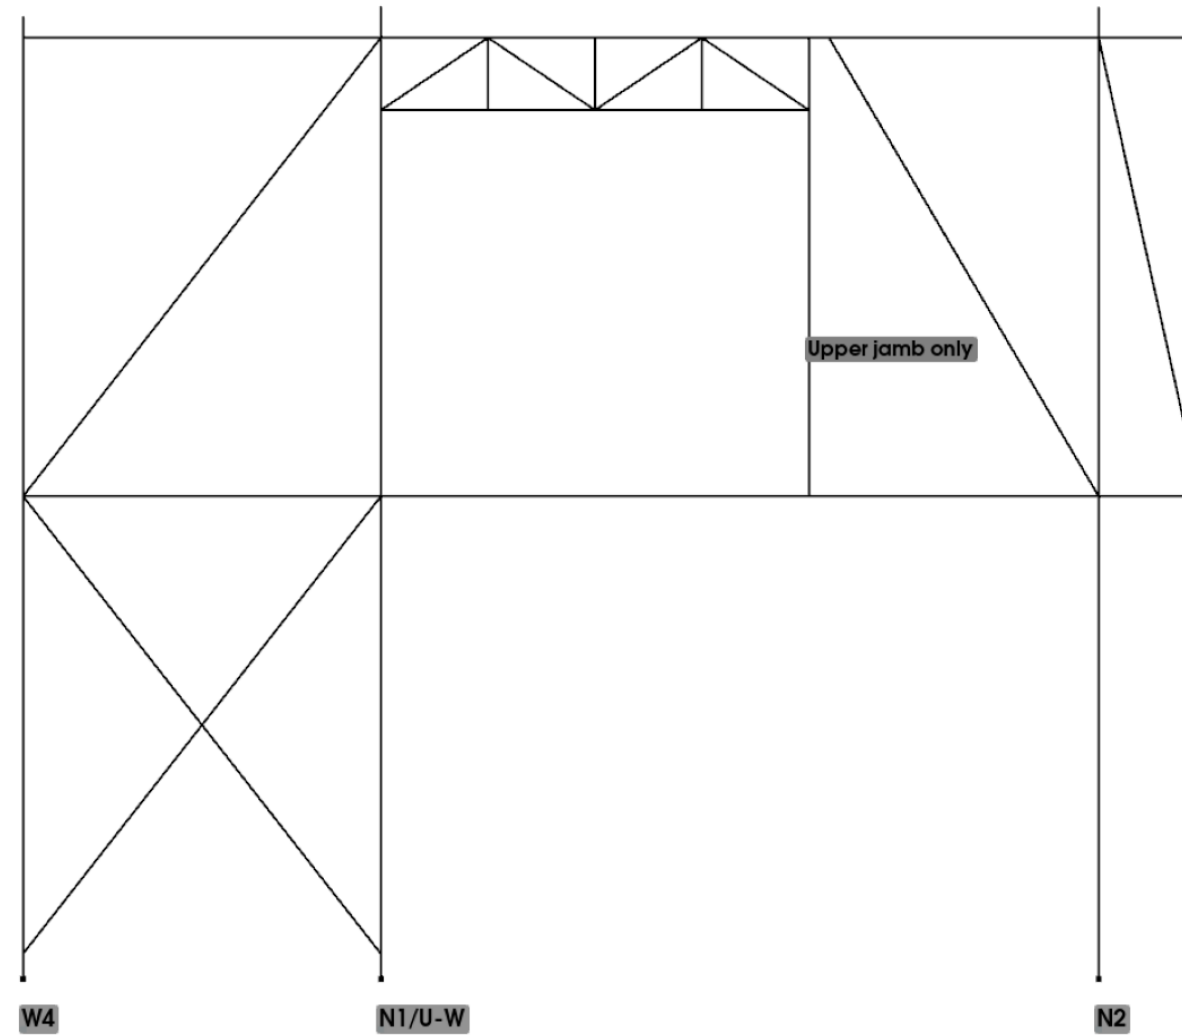



Shared columns replace duplicate truss uprights. Ground-level X bracing retained.
Preliminary fixed-base model; connection and foundation design remains.

TE Corrected wall elevation

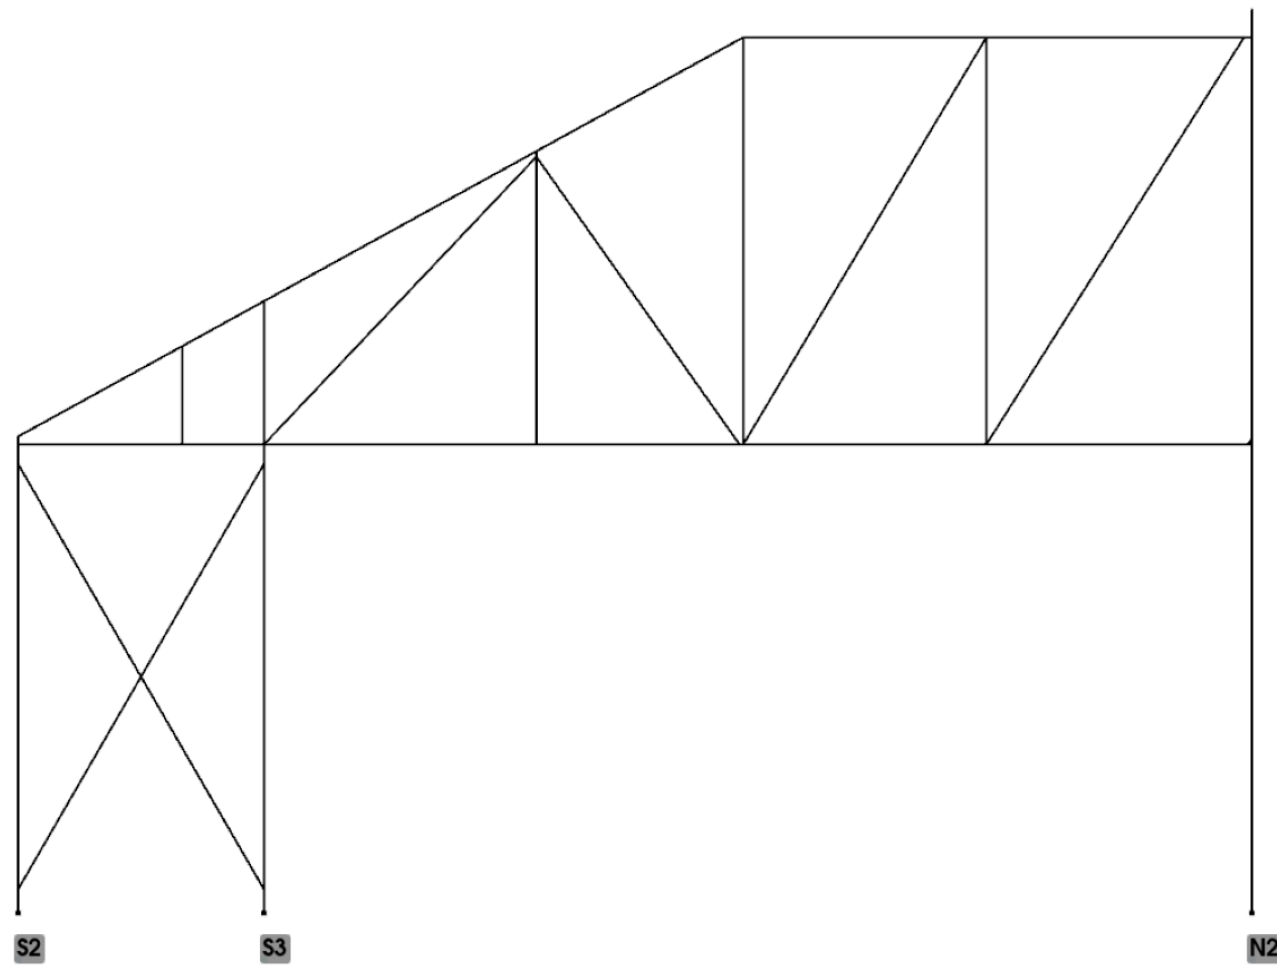



Shared columns replace duplicate truss uprights. Ground-level X bracing retained.
Preliminary fixed-base model; connection and foundation design remains.

TW Corrected wall elevation

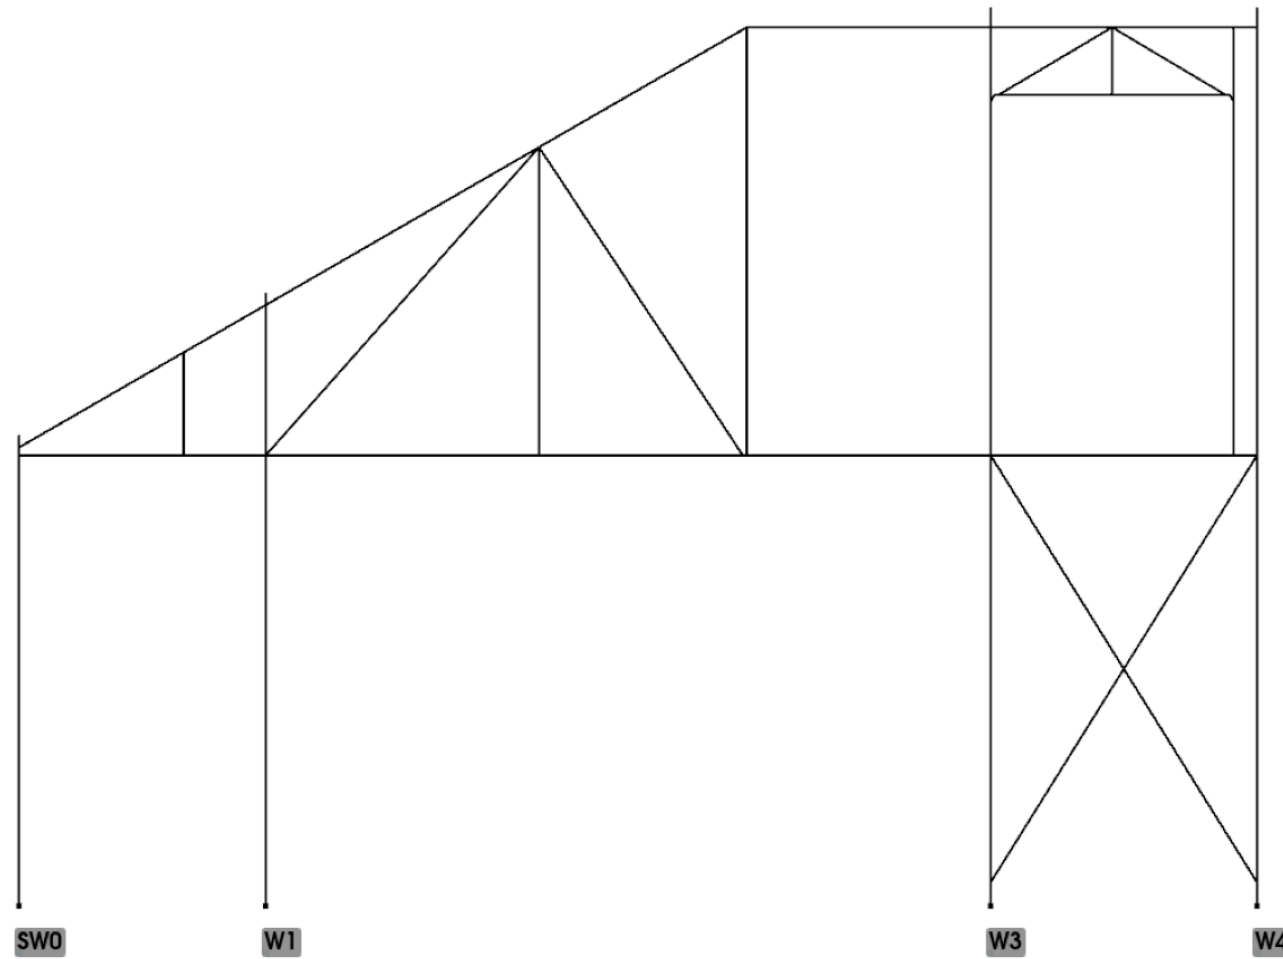



Shared columns replace duplicate truss uprights. Ground-level X bracing retained.
Preliminary fixed-base model; connection and foundation design remains.

TS Corrected wall elevation

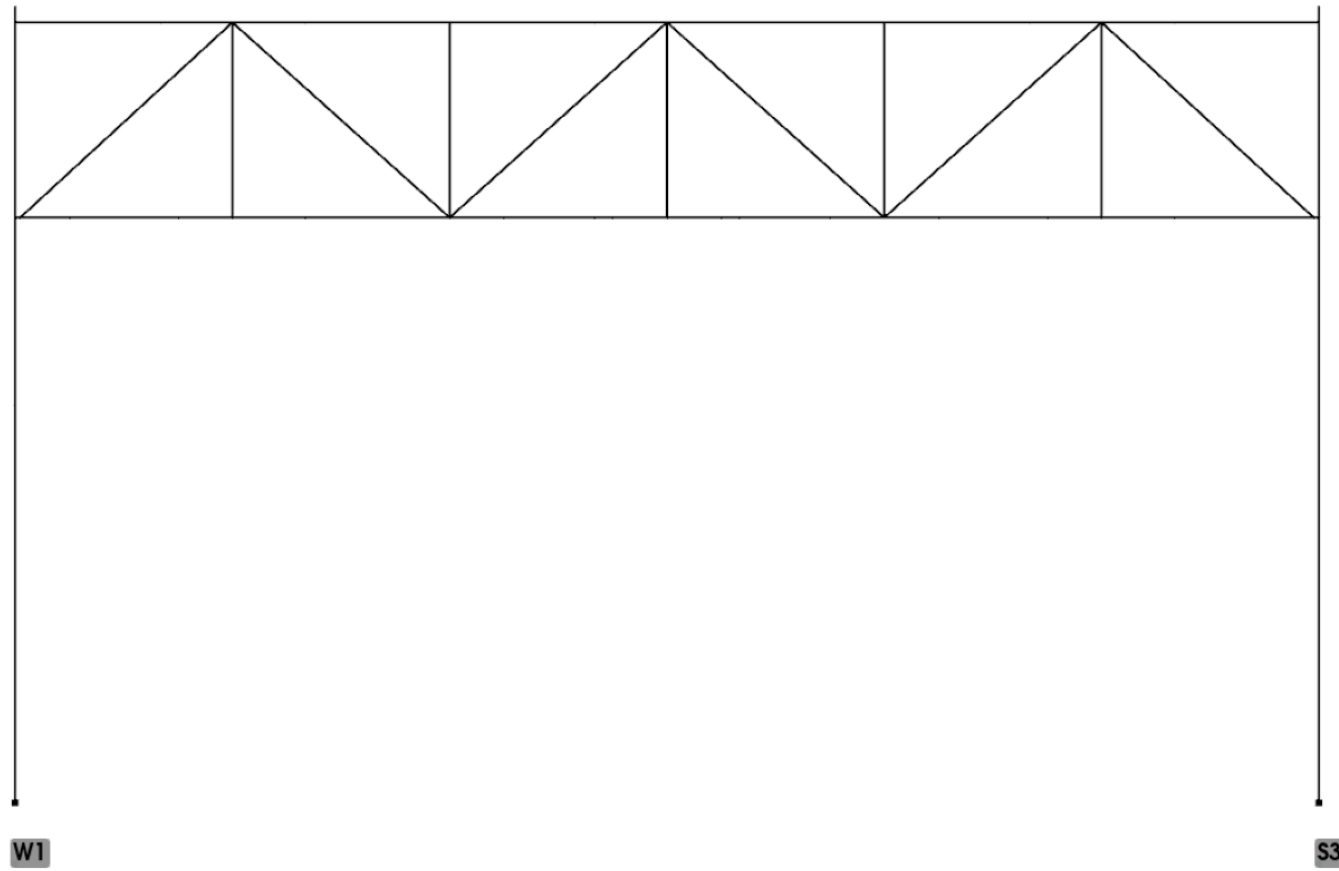


Shared columns replace duplicate truss uprights. Ground-level X bracing retained.
Preliminary fixed-base model; connection and foundation design remains.

T1 Support path

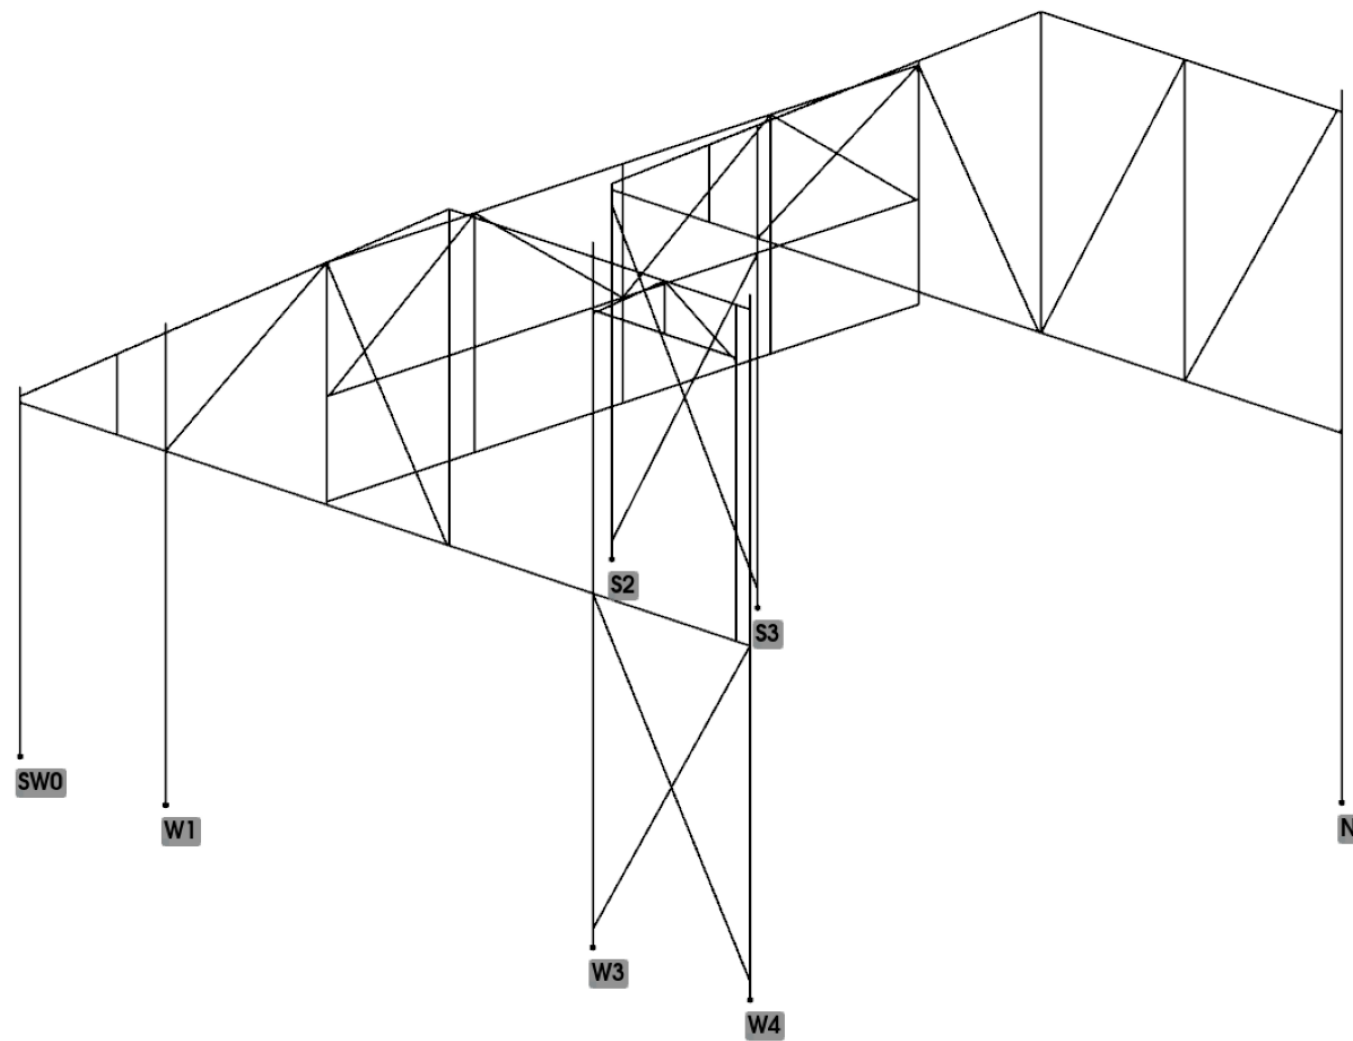

T1 bears on TE and TW; those trusses transfer its load to the ground columns.
No new posts beneath T1. This is a filtered 3D view of the globally solved frame.

ALL Support path

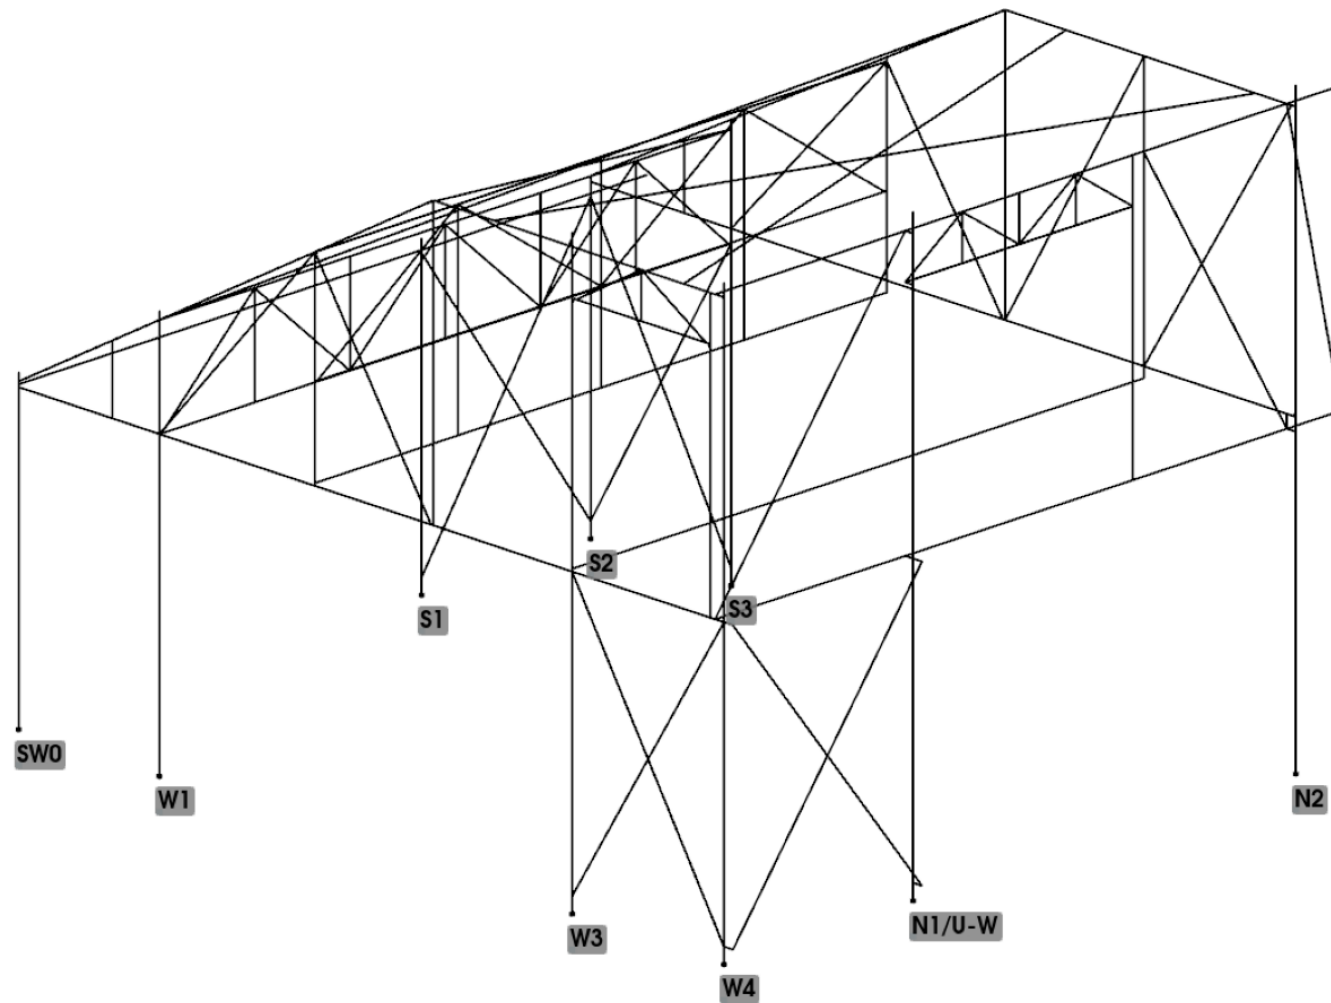

Shared columns replace duplicate truss uprights. Ground-level X bracing retained.
Preliminary fixed-base model; connection and foundation design remains.