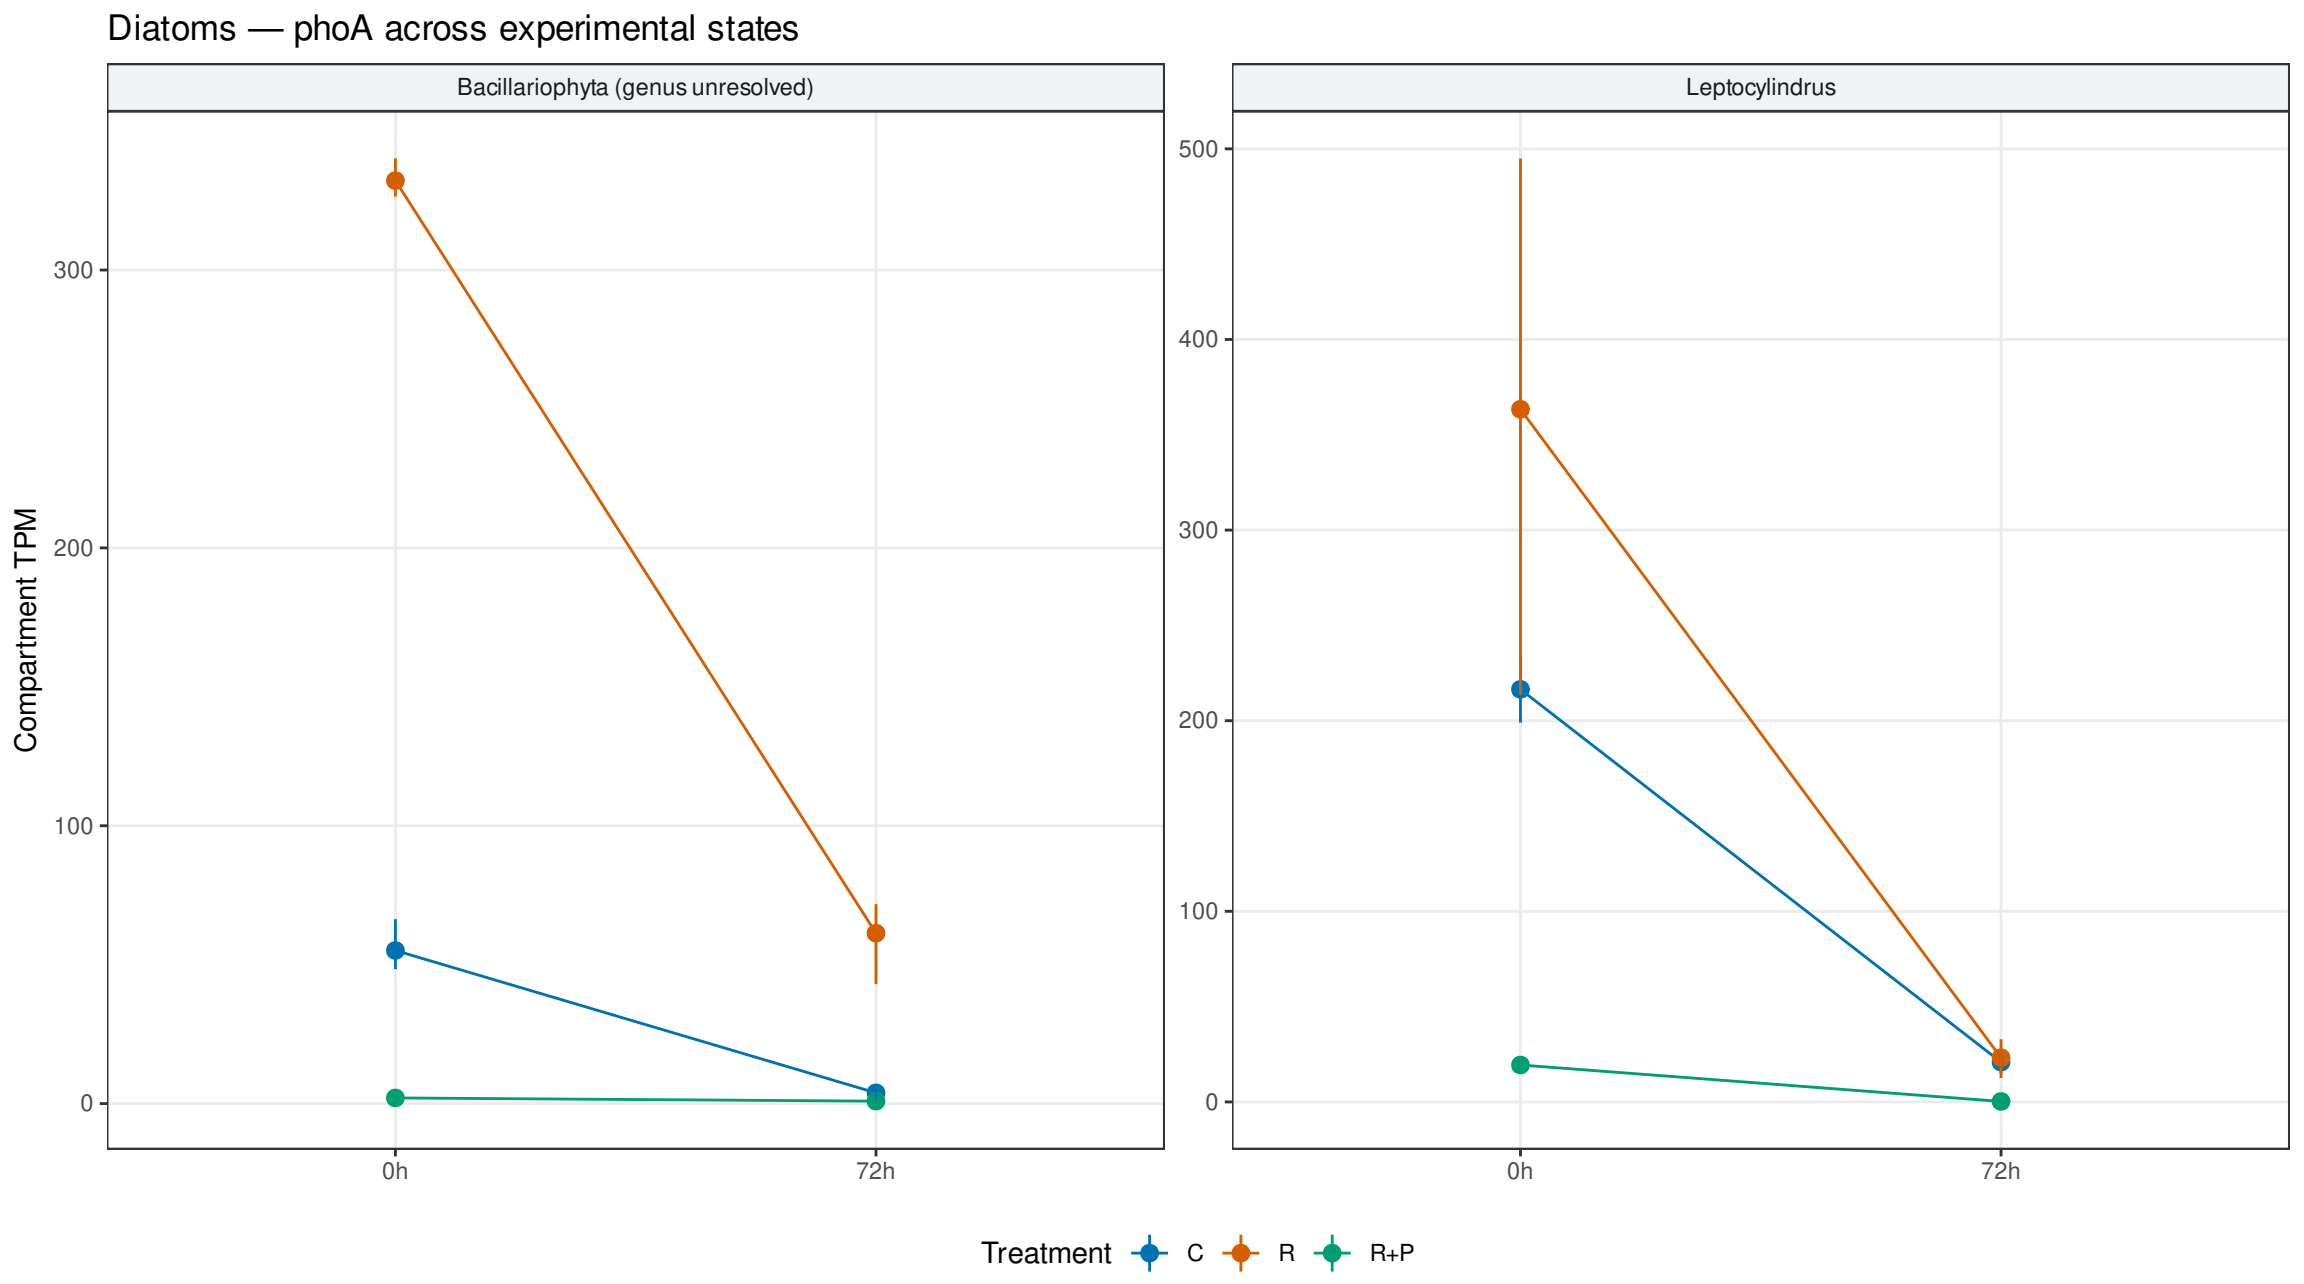

Means of technical libraries; one bag per treatment. Strict single-KO annotations; exploratory only. Ranges show technical min–max, not biological confidence intervals.