
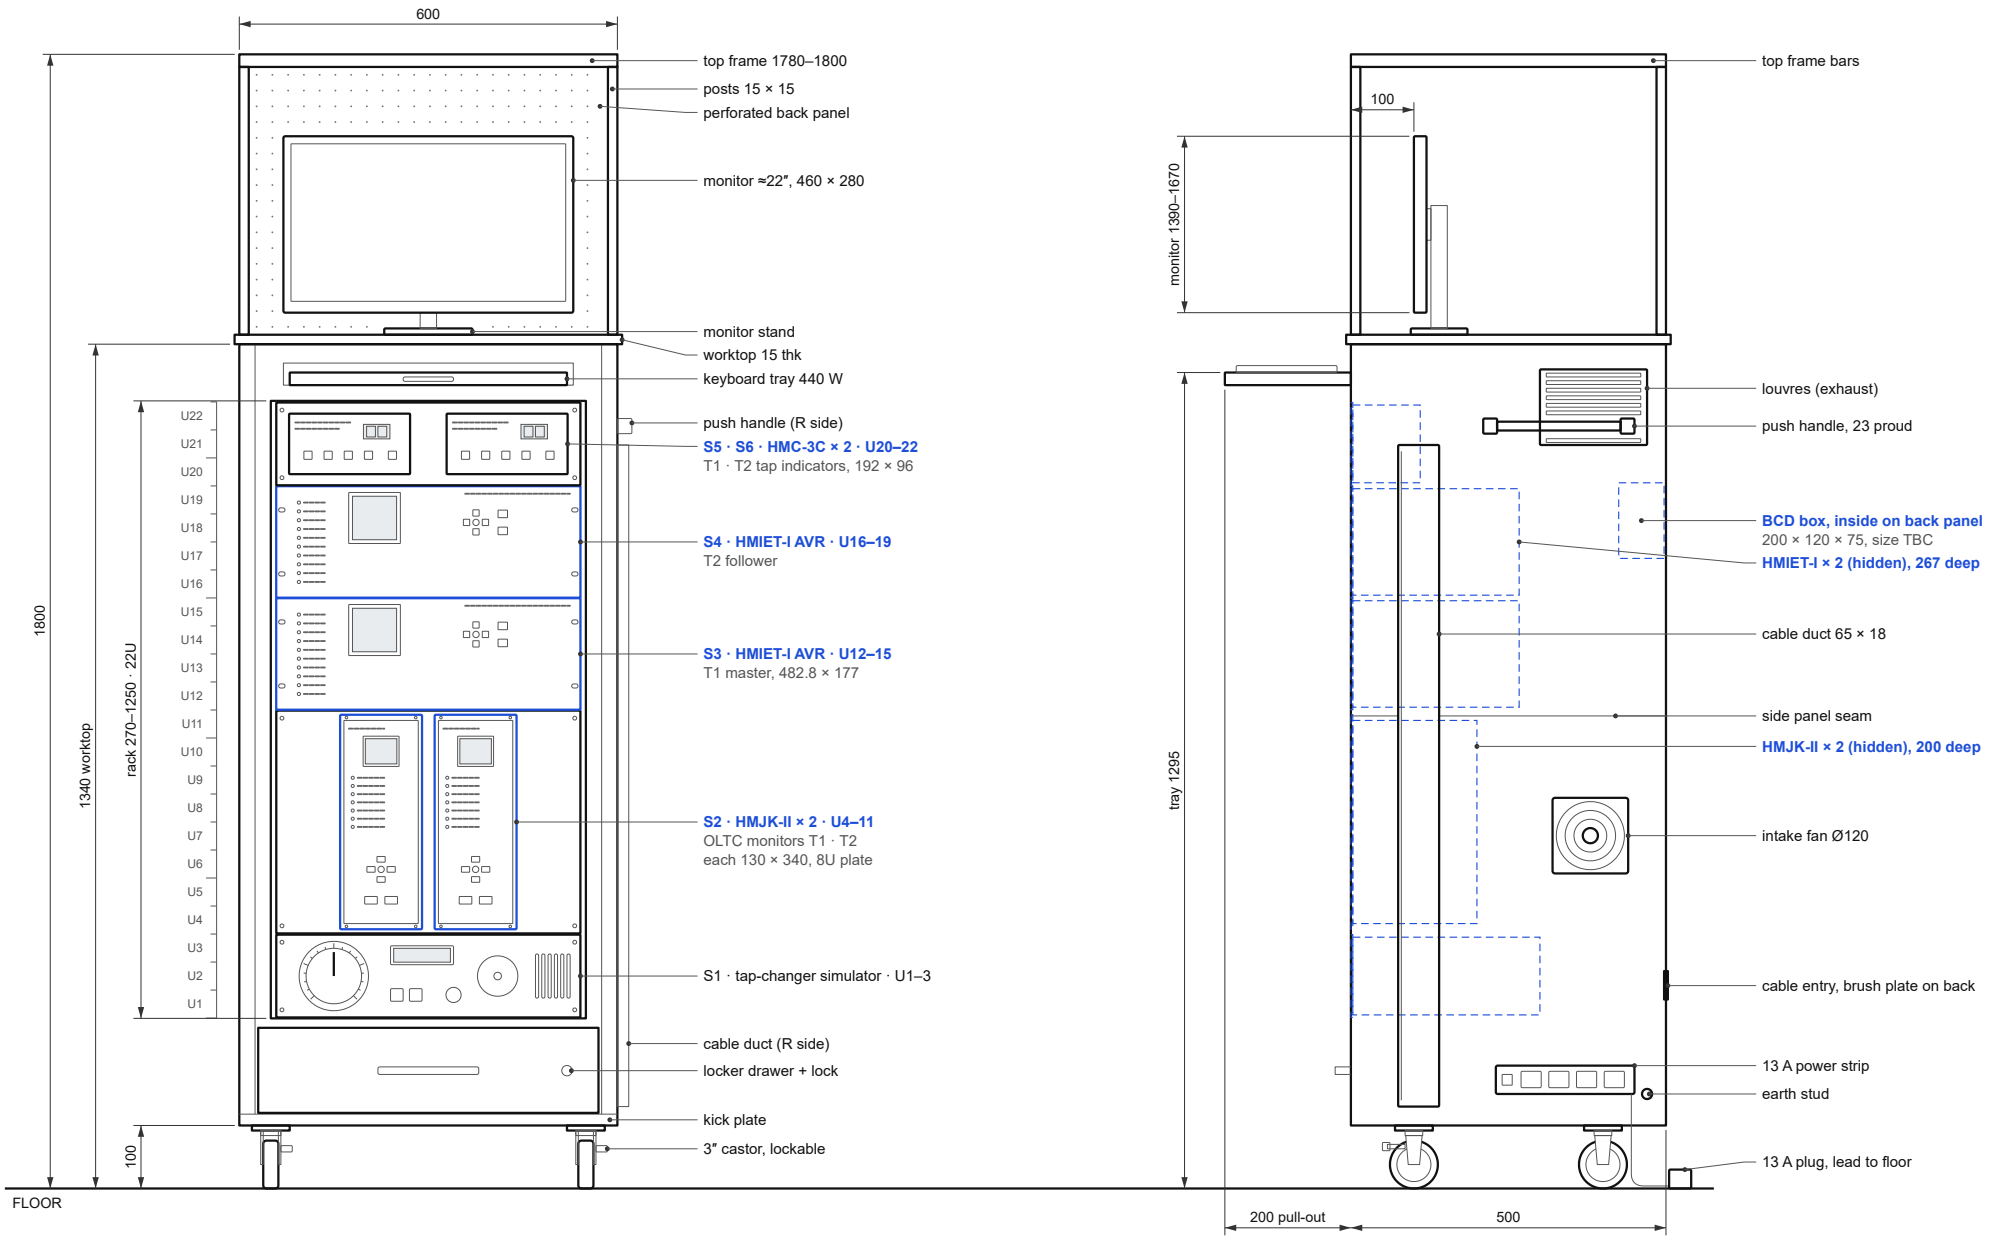



**FRONT ELEVATION**

**RIGHT SIDE ELEVATION**

| | | |
|---|---|---|
| **AVR DEMO CABINET** | SCALE 1:12 (A4) | SHEET 1 OF 3 |
| GENERAL ARRANGEMENT | UNITS mm | REV B · 11 NOV 2026 |

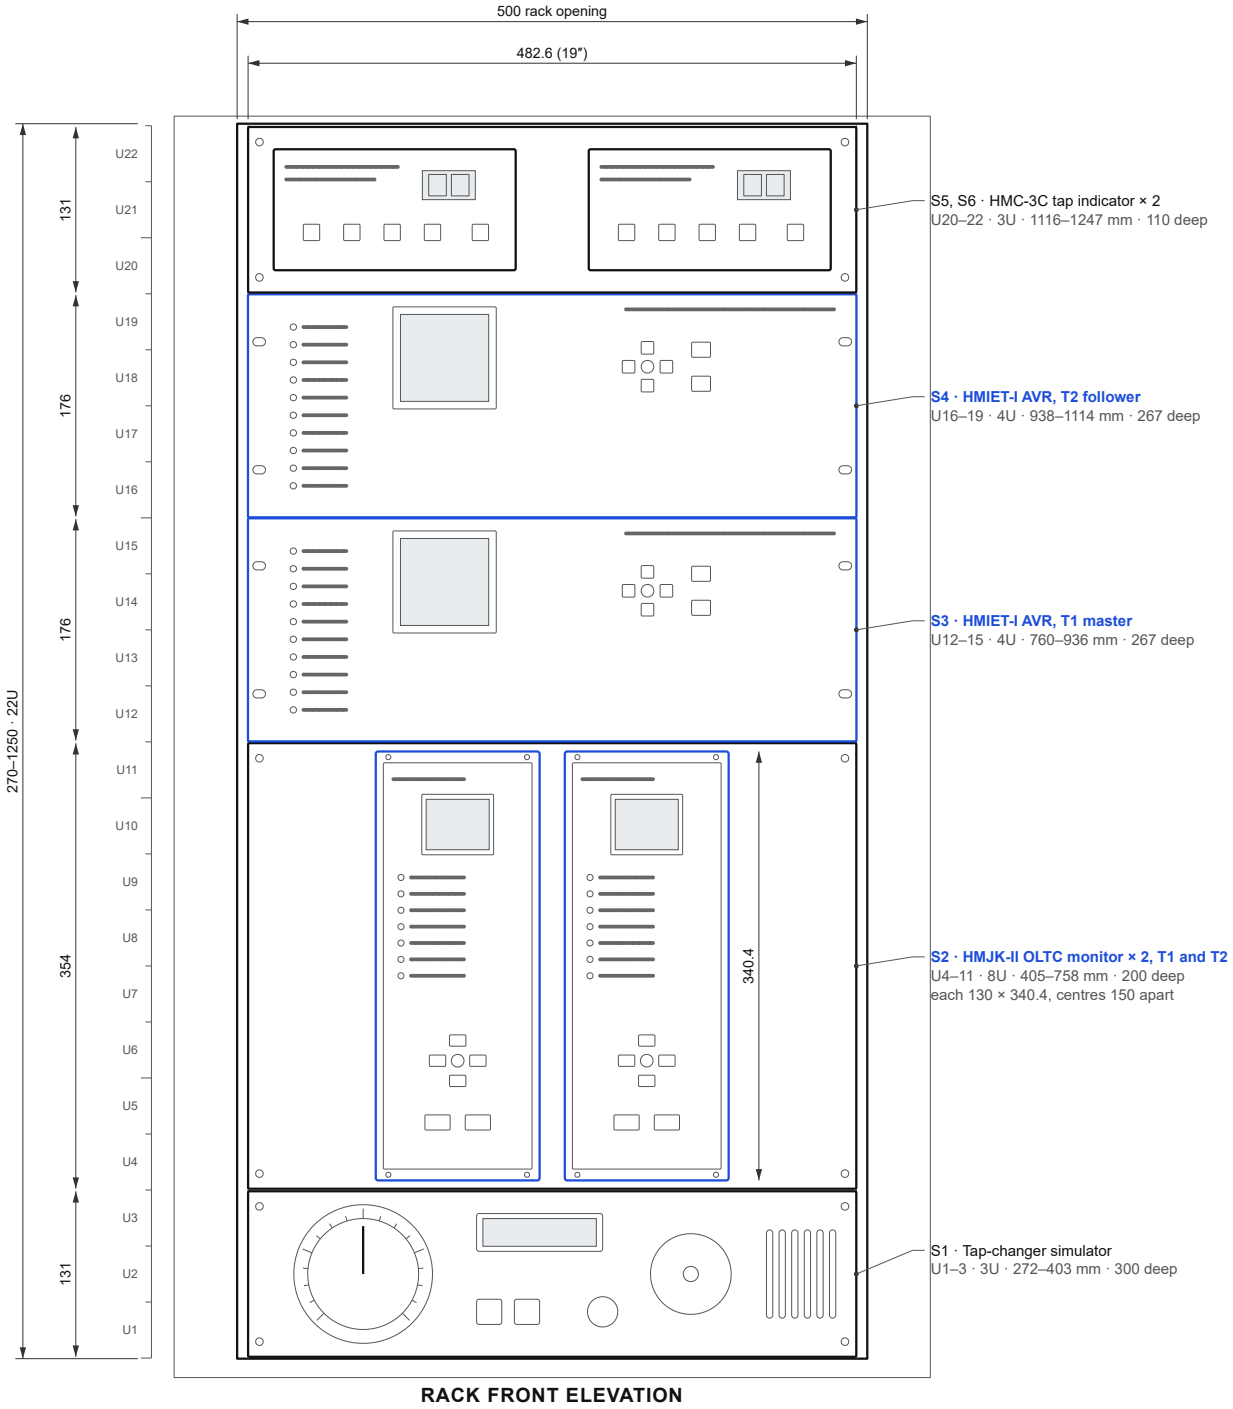


**RACK FRONT ELEVATION**

**Rev B changes**

Grid source removed.

Tap-changer simulator 4U → 3U.

HMJK-II × 2 added, upright on one 8U plate.


Rack 20U → 22U, top 1160 → 1250 mm;

fascia vents dropped, side louvres vent.

Front U20 brush panel moved to the back.

BCD box added inside, on the back panel.


| | | |
|---|---|---|
| **AVR DEMO CABINET** | SCALE 1:6 (A4) | SHEET 2 OF 3 |
| RACK FRONT | UNITS mm | REV B · 11 NOV 2026 |

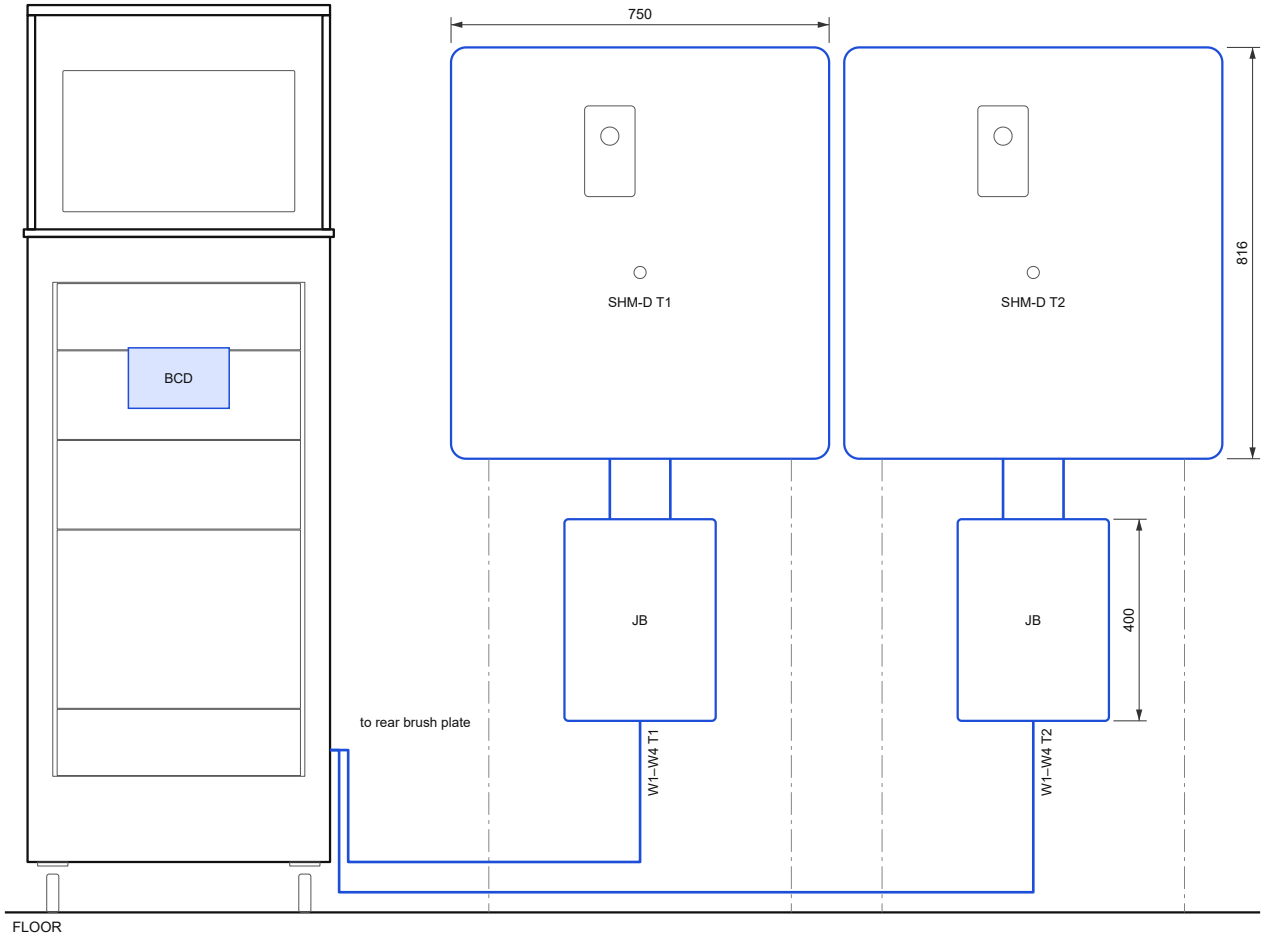



**DEMO CABINET**

**OUTSIDE: 2 × SHM-D, ONE JUNCTION BOX EACH**

positions schematic

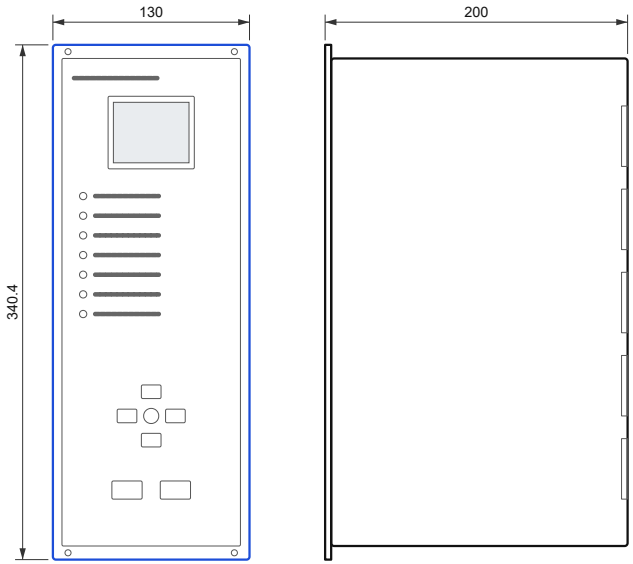


**HMJK-II OLTC MONITOR · 1:5**

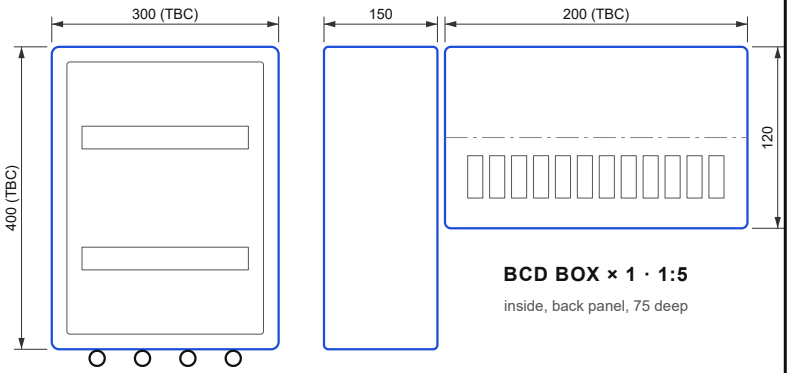


**BCD BOX × 1 · 1:5**

inside, back panel, 75 deep

**JUNCTION BOX × 2 · 1:10**

| Cable | From | To | Signal | Cores |
|---|---|---|---|---|
| W1 | Junction box | BCD box | BCD tap position | 10 × 1.5 |
| W2 | Junction box | HMJK-II | Motor voltage + current | 8 × 1.5 |
| W3 | Junction box | AVR | Raise / lower / status | TBC |
| W4 | Cabinet | Junction box → SHM-D | Supply 230 V | 3 × 2.5 |

One set per motor drive (T1, T2).

| | | |
|---|---|---|
| **AVR DEMO CABINET** | SCALE 1:15 (A4) | SHEET 3 OF 3 |
| SYSTEM LAYOUT | UNITS mm | REV B · 11 NOV 2026 |