


Phase 13 sensitivity and reliability atlas

Blue/+ = pass, orange/x = fail, gray/- = not evaluated; rows remain in frozen order


A

mDNA OXPHOS

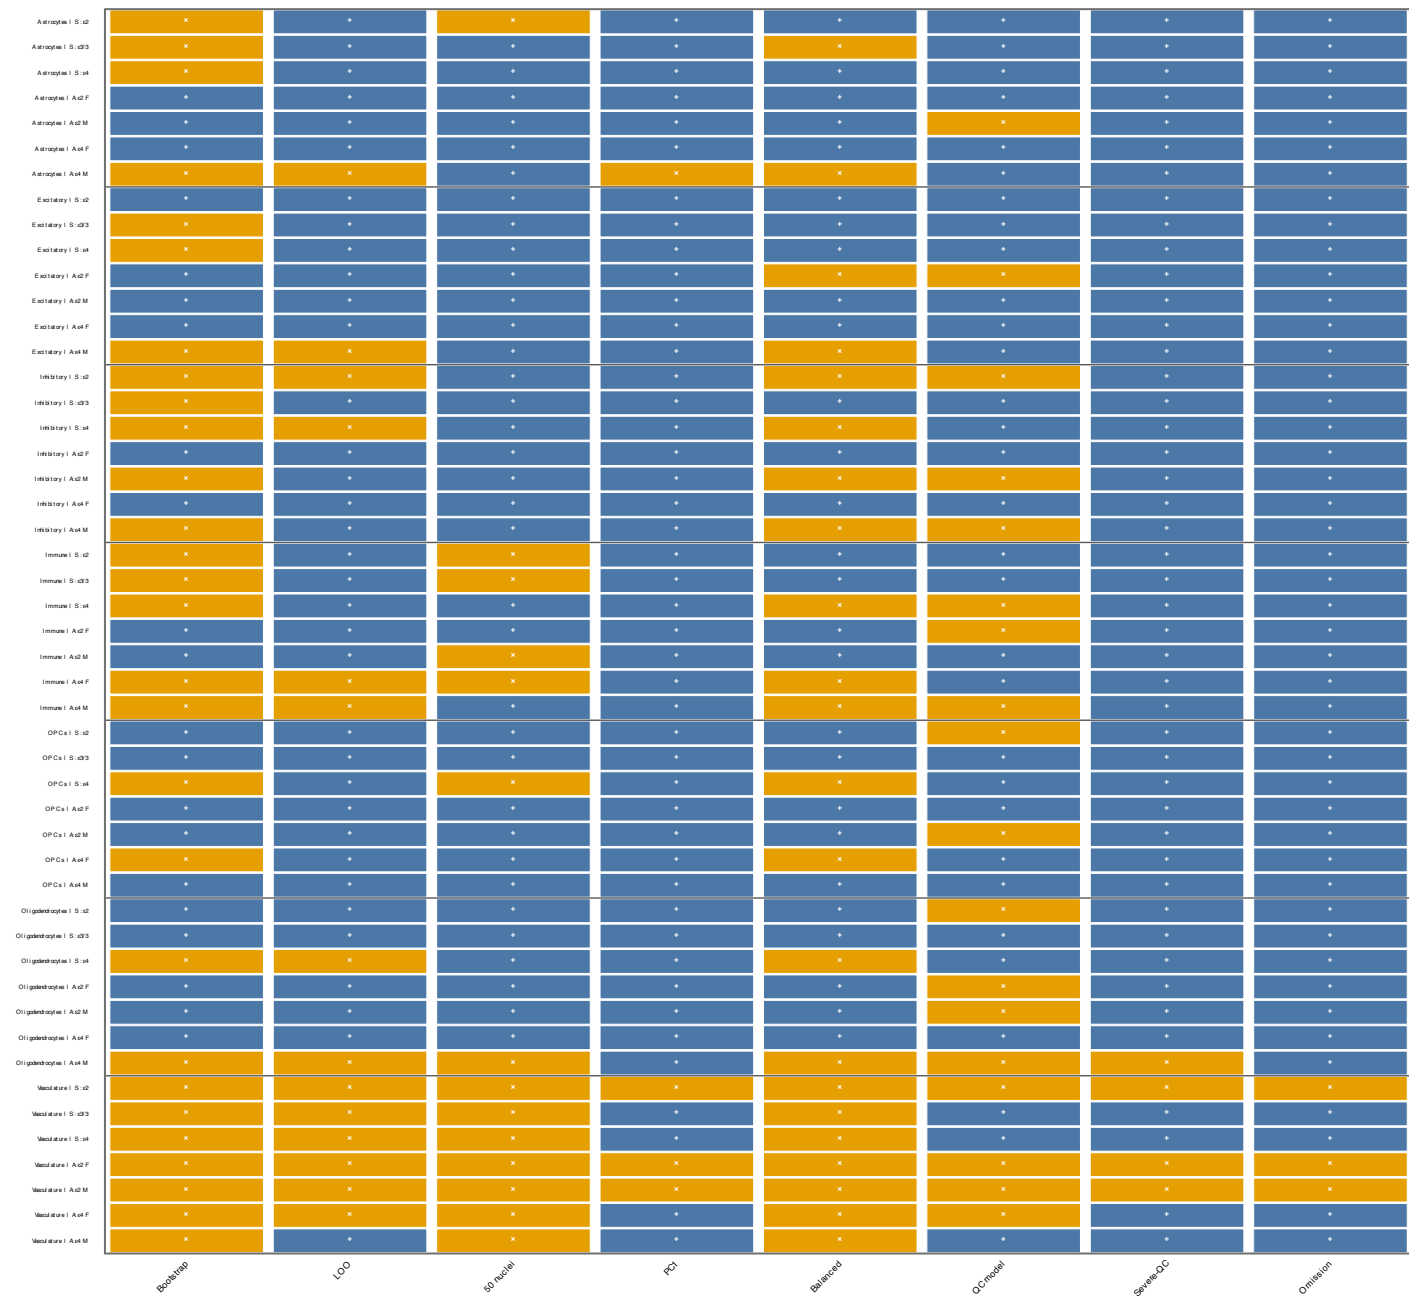


B

Nuclear OXPHOS structural

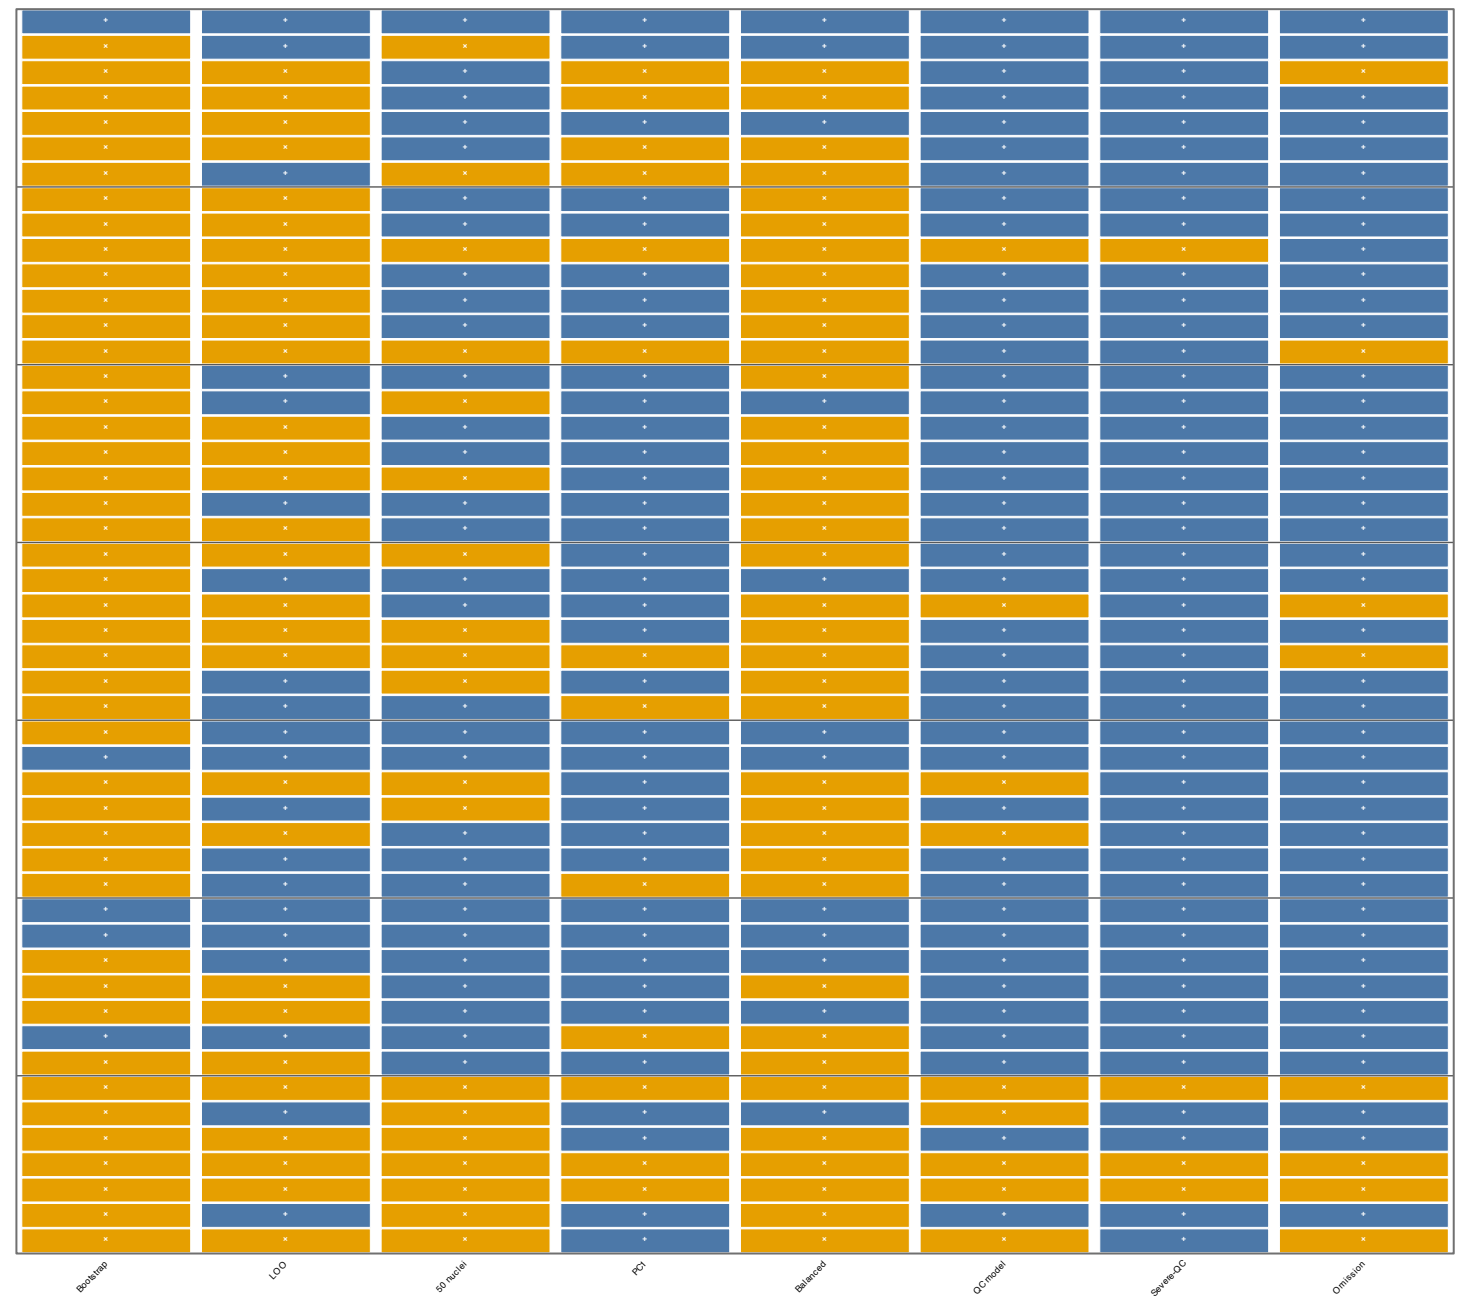


C

Mitochondrial translation

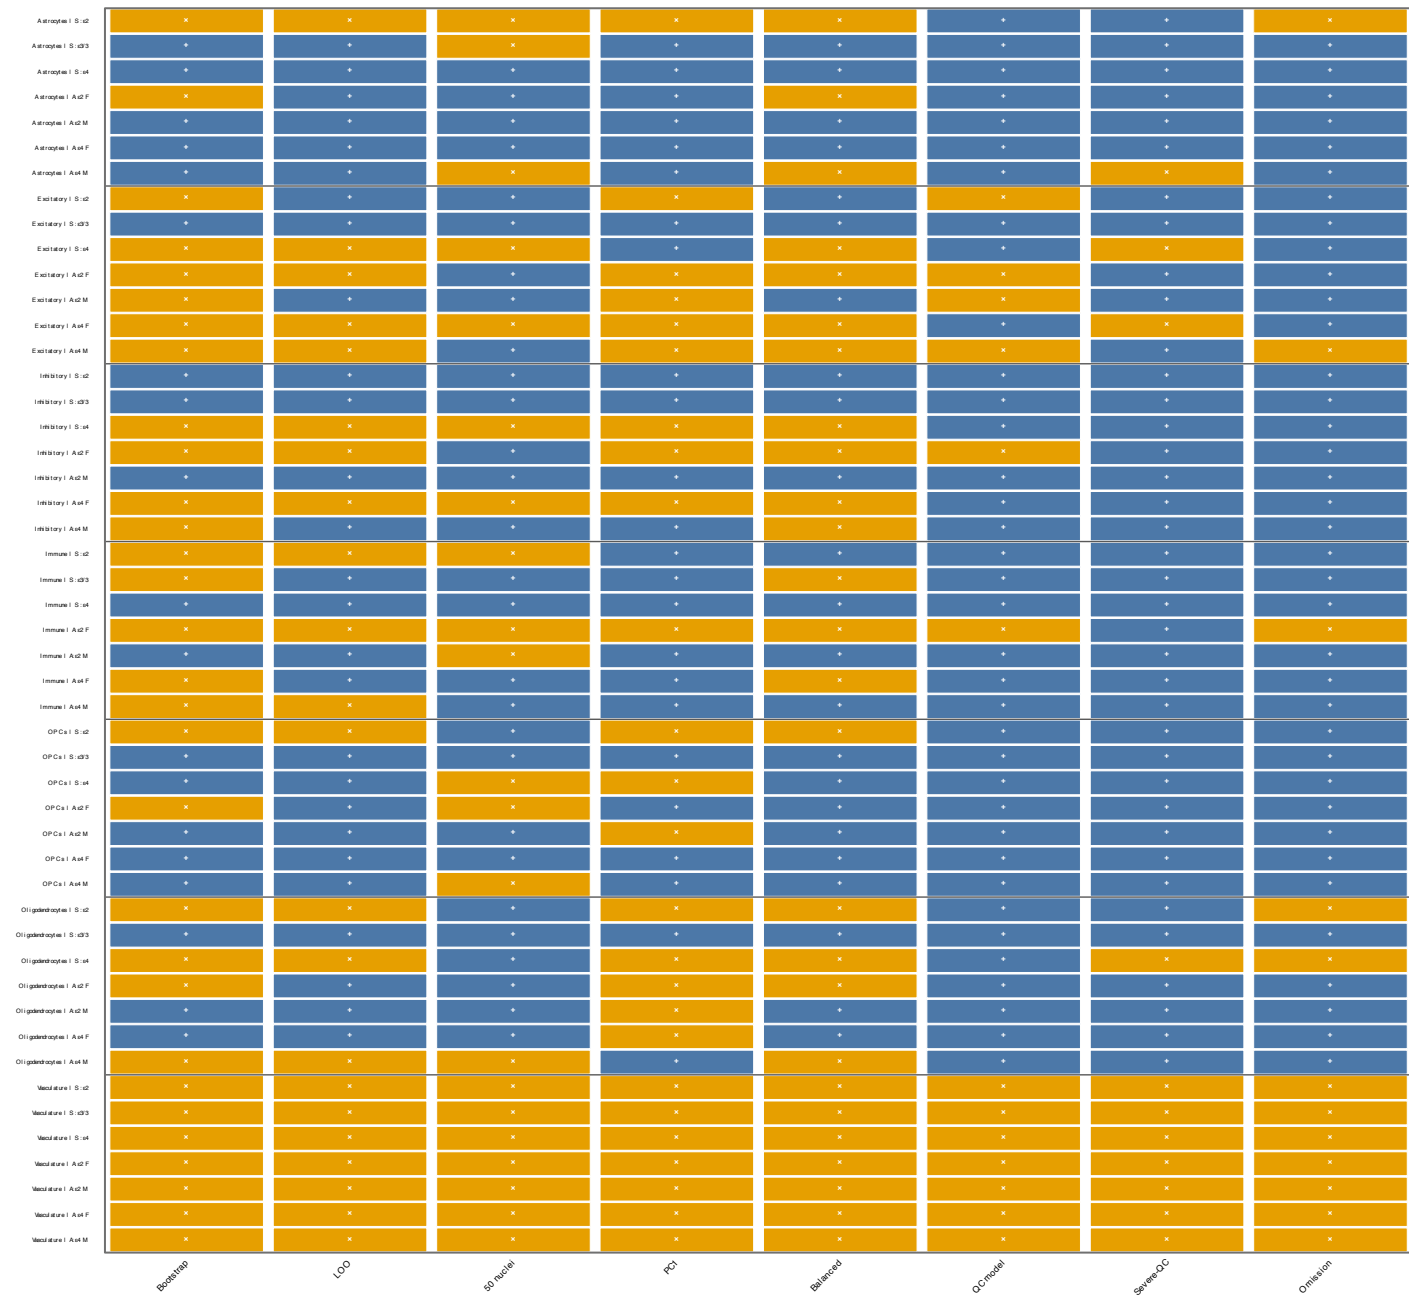

D

MIB/MICOS inner membrane

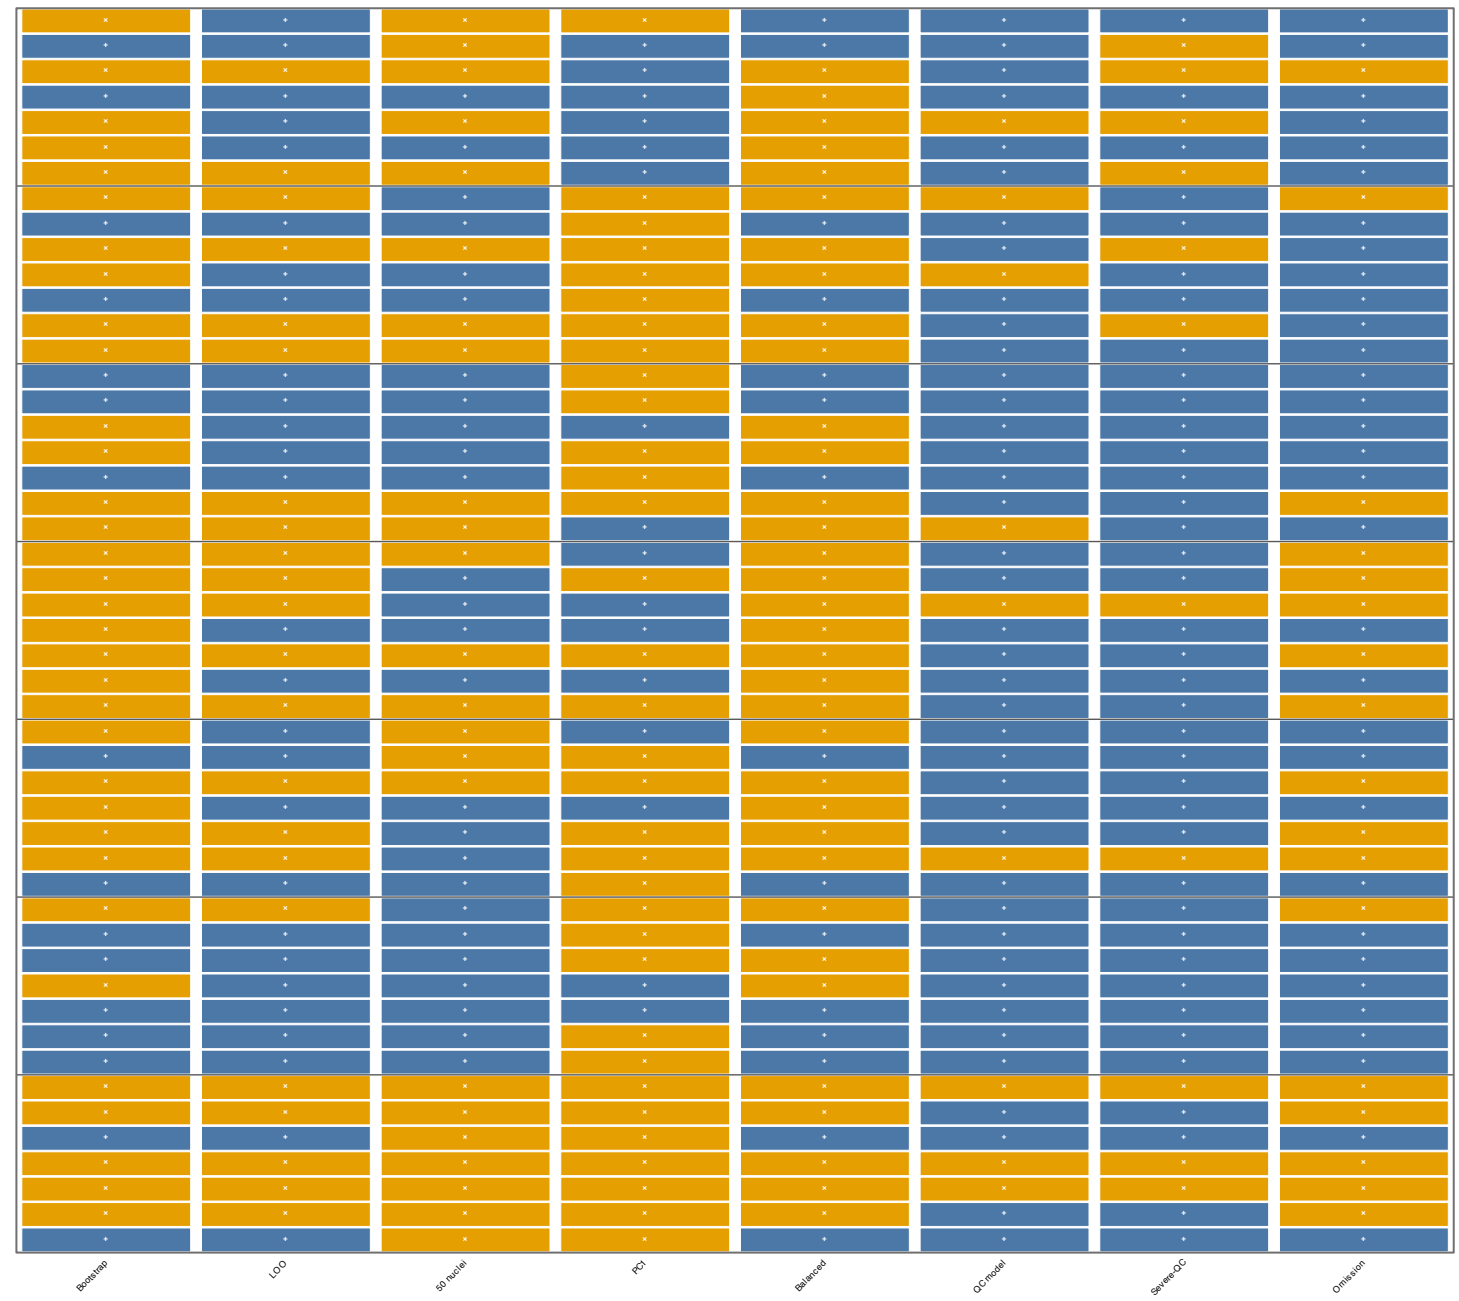

Module-score reliability

