

VERIFIED WORKED EXAMPLE


2,000 A Hybrid Service — Linked Plan + One-Line

Construction base-camp hybrid sized from a 2,000 A peak and 500 A continuous request at 480 V, three-phase. Ten 240 V single-phase trailer connection points are shown without inventing unprovided trailer loads.

Electrical One-Line Diagram

Recognized one-line symbols with 480 V generation, DEIF controls, step-down transformation, and ten field-verified 240 V single-phase connection points.

CONCEPTUAL · NOT FOR CONSTRUCTION

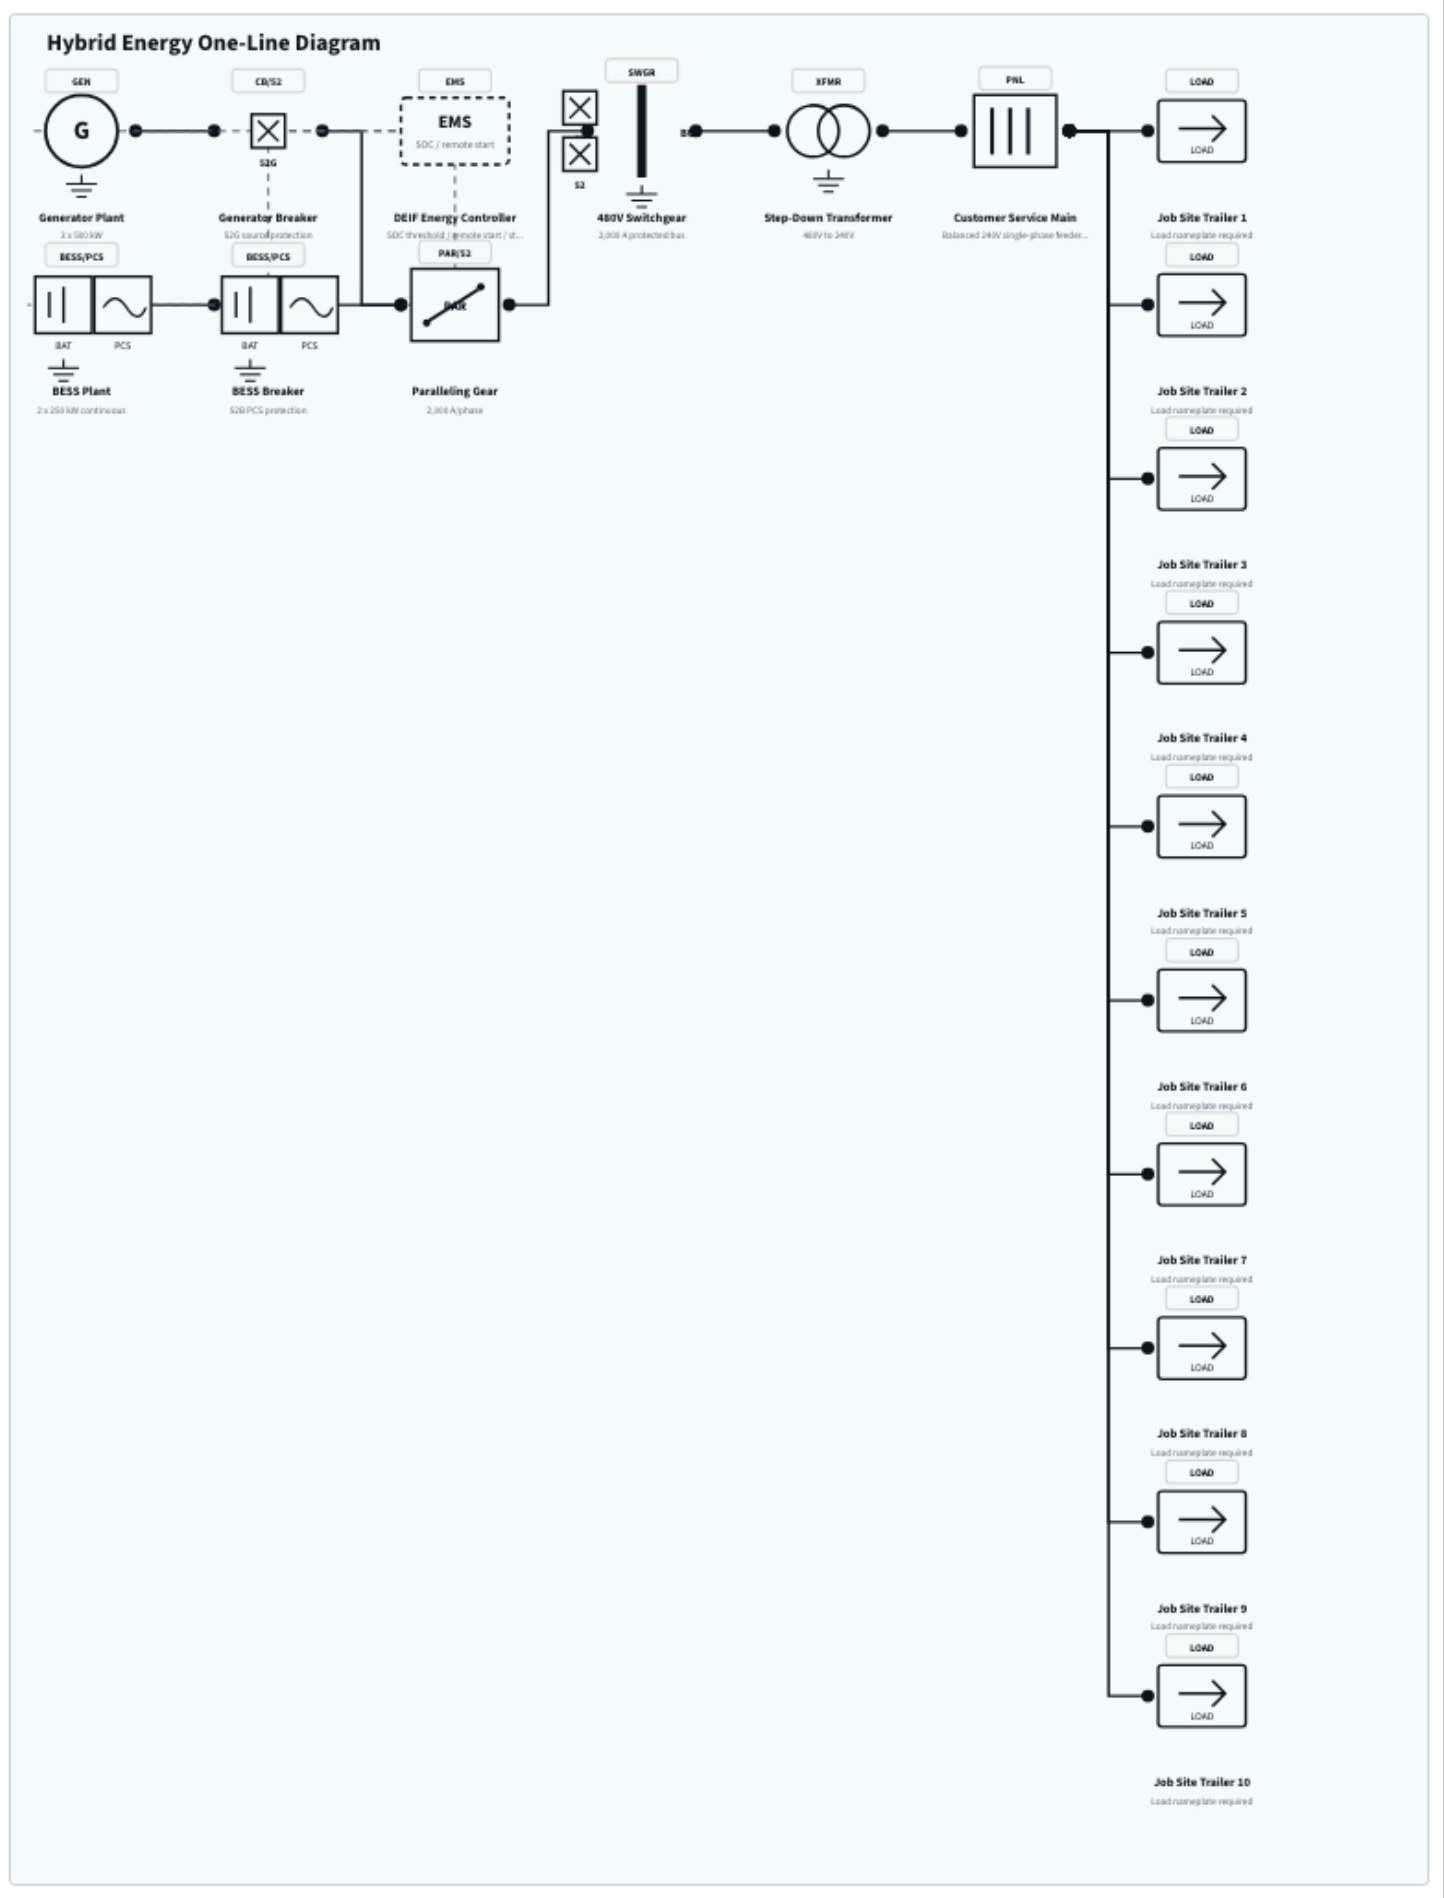

Sizing Summary

SERVICE BASIS

2,000 A

1662.8 kVA at 480 V, 3-phase

CONTINUOUS BASIS

500 A / 332.6 kW

Derived using the entered 0.80 power factor

PROTECTED PEAK BASIS

1330.2 kW

Generator and BESS ratings are not added as customer demand

GENERATION

3 × 500 kW

3 duty + 0 standby · 1,500 kW firm

BESS

2 × 250 kW

2 duty + 0 standby · 500 kW firm continuous

RENTAL ESTIMATE BASIS

One 28-day cycle

Enter one 28-day rate for each selected BESS and generator in the Hybrid Selector; no daily rental rate is inferred

SOURCE CONDUCTORS

5 × 400 A runs/phase

Main source schedule only; branch conductors remain withheld until trailer nameplates and locations are provided

DEIF RECHARGE CEILING

169.8 kW

Available while the generator plant carries the full requested peak; staged charging only


Automatic rental-fleet selection

EMaaS Pro compares all five governed BESS options and selects two Atlas Copco ZBC 250-575 units for 500 kW continuous capacity. Three 500 kW generators carry the 1,330.2 kW protected peak and retain controlled recharge headroom.

Known boundary

Individual trailer nameplates and locations were not provided. The one-line shows ten connection points, but per-trailer kW, branch current, conductor quantity, and phase assignment remain withheld until field verification.

Conceptual 3D equipment envelope

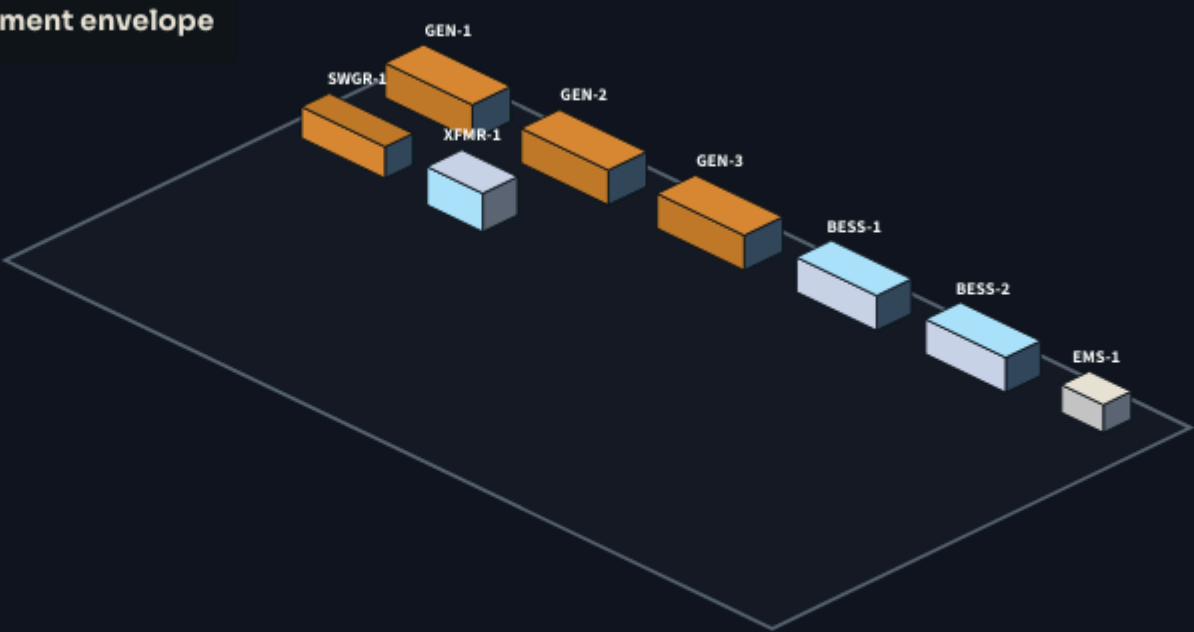

Planning visualization only - verify delivered dimensions, clearances, access, fire separation, soil bearing, and cable paths.