

OVERVIEW

EMaaS Dashboard

Start Here

GUIDANCE

Tutorials & Objectives

EMAAS WORKFLOWS

Temporary Power

Temporary Heating Plan

Build Estimate

Site Fit & One-Line

Hybrid EMaaS Strategy

BESS Project Evaluation

HVAC Load Assessment

BESS

Runtime

Multi-Unit Sizing

Revenue / ROI

ELECTRICAL POWER

Overview

General Power

Amperes

kW ↔ kVA

kW ↔ HP

kW ↔ Amps

Generator Power

UPS Power

Fuel Consumption

Lumens & Watts

kVA → Amps

HVAC

Overview

Cooling Load

Chiller Sizing

Psychrometrics

VERIFIED WORKED EXAMPLE

2,000 A Hybrid Service — Linked Plan + One-Line

480 V, three-phase temporary-power architecture sized from the service rating at 0.80 power factor. The service basis is deliberately conservative until measured load is available.


Print / Save PDF

PE verification required


Electrical One-Line Diagram

Recognized one-line symbols; no transformer is shown because source and service are both 480 V.

CONCEPTUAL · NOT FOR CONSTRUCTION

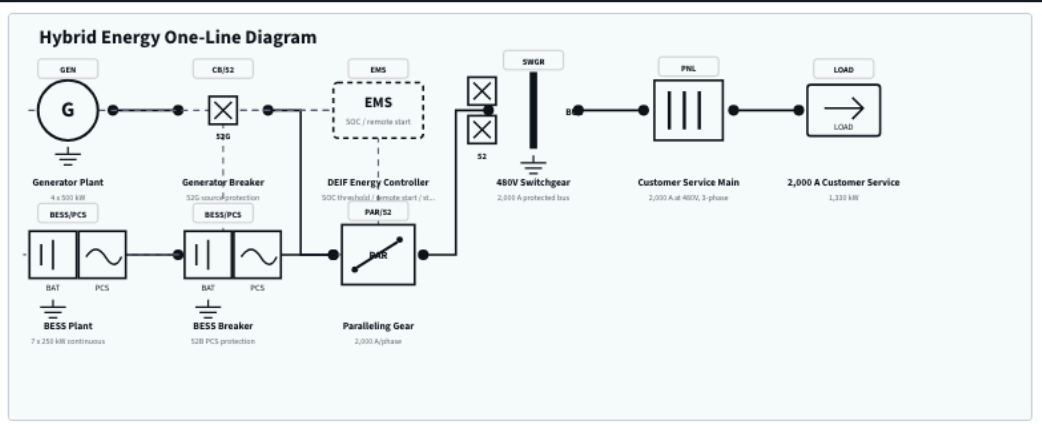

Conceptual 3D equipment envelope

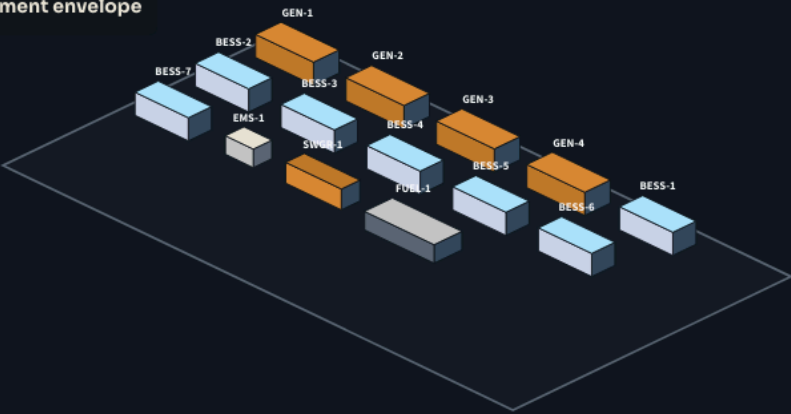

Planning visualization only · verify delivered dimensions, clearances, access, fire separation, soil bearing, and cable paths.

Sizing Summary

SERVICE BASIS

2,000 A

1662.8 kVA at 480 V, 3-phase

PROTECTED REAL-POWER BASIS

1330.2 kW

0.80 planning power factor; replace with measured demand when available

GENERATION

4 × 500 kW

3 duty + 1 standby · 1,500 kW firm

BESS

7 × 250 kW

6 duty + 1 standby · 1,500 kW firm continuous

DEIF RECHARGE CEILING

169.8 kW firm

669.8 kW with all four generators online; staged charging only

Why this is modular

One generator or one BESS unit may be unavailable while the remaining source plant still carries the 1,330.2 kW protected service basis. DEIF dispatch limits recharge to headroom after customer load.

Known boundary

A 2,000 A breaker is not proof of actual demand. This example sizes the requested service conservatively and does not claim fuel reduction without measured load telemetry.