SYNTHETIC UNIT B VARIANT - NOT A REAL PAYMENT DOCUMENT

DEMO TENANT - SYNTHETIC COPY
Sample Unit, Demo Property
Personal details and payment codes removed.

Billing Invoice

MANILA ELECTRIC COMPANY
LOPEZ BLDG., ORTIGAS AVENUE, PASIG CITY
VAT REG. TIN 000-101-528-00000
Registered Name: Not Provided
Registered Address: Not Provided

Customer TIN: Not Provided

Your electric bill

Billing Period
27 Aug 2026 to 26 Sep 2026

Bill Date
26 Sep 2026

Date of Meter Reading
26 Sep 2026

Date of Next Meter Reading
26 Oct 2026

Customer Type
Residential

Your rate this month
₱ 14.87 per kWh
See formula in Addtl Bill Information

Electric Meter Number
TEST-METER-01

1,056
\- Previous Reading 957
= Actual Consumption **99 kWh**

⚠ Please see the back page of your bill for more details about your meter reading and consumption.

Customer Account Number (CAN)
9990000002

Due Date
08 Oct 2026

Please Pay
₱ 1,567.17


Bill Computation Summary

Remaining Balance from previous bill *(see other bills due for payment under What Remains Unpaid; does not include bills under review and installment)*	0.00
Charges for this billing period	1,567.17
Generation	960.62
Transmission	126.98
System Loss	88.09
Distribution (Meralco)	100.29
Senior Citizen	0.00
Government Taxes	130.23
Universal Charges	31.84
FiT-All (Renewable)	33.25
GEA-All (Renewable)	0.00
Lifeline	0.99
Other Charges	94.88

Total Amount Due PHP 1,567.17

Your monthly consumption 27.6°C ▼

Ave. temp this month 1.3 deg lower than prev.

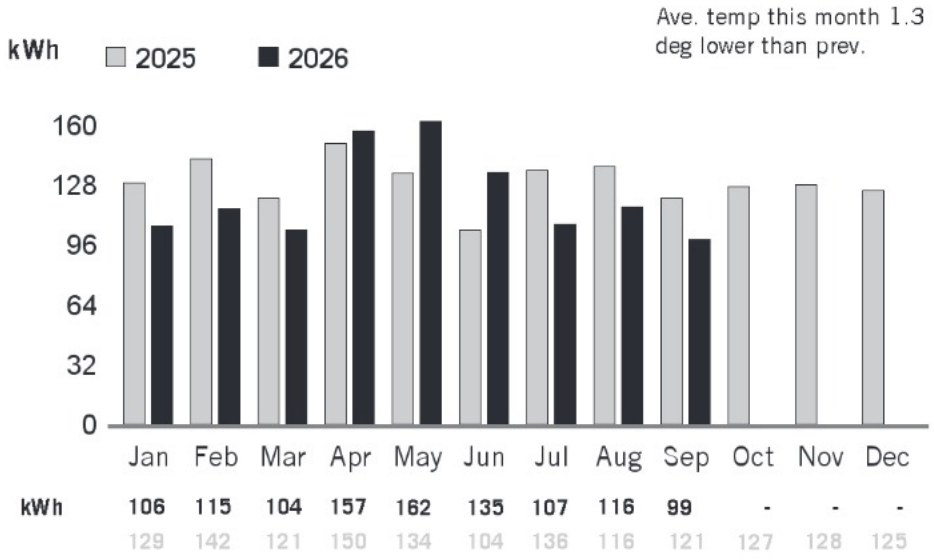

Your consumption explained

▼ This bill is 15% lower (-17kWh) vs previous billing period

▼ This bill is 18% lower (-22kWh) vs same period last year

Your typical consumption

123 kWh	3.19 kWh	₱ 47.5
Ave. monthly consumption (last 12 months)	Ave. daily consumption this bill period	Ave. daily cost this bill period

Environmental Impact

Be energy efficient. Save and help take care of our environment

99 kWh Electricity Used
0.0687 tCO_2* Equiv. GHG Emissions
3 tree/s** To Offset Emissions

*Using DOE's 2019-2021 Luzon-Visayas Grid Emission Grid Factor of 0.0006935 tCO_2/kWh
**Per Arbor Day Foundation, 1 mature tree can absorb 48 pounds (0.0218 tonnes) of CO_2/year



MERALCO BRIGHT IDEAS

Block floodwater, protect your power.

Set up flood barriers early.
Use a sump pump
to discharge trapped water
beyond the barrier.

Tested using a 1/3 HP Sump Pump w/ average cost of P8/hr of continuous operation.

Please be informed that MERALCO may conduct a routine maintenance/inspection of our customer metering facilities within your area this quarter.

TEST COPY - NOT VALID FOR PAYMENT

Account: 9990000002 | Original payment codes removed

ANONYMIZED TEST FIXTURE - DO NOT PAY - monetary values and dates retained for extraction testing