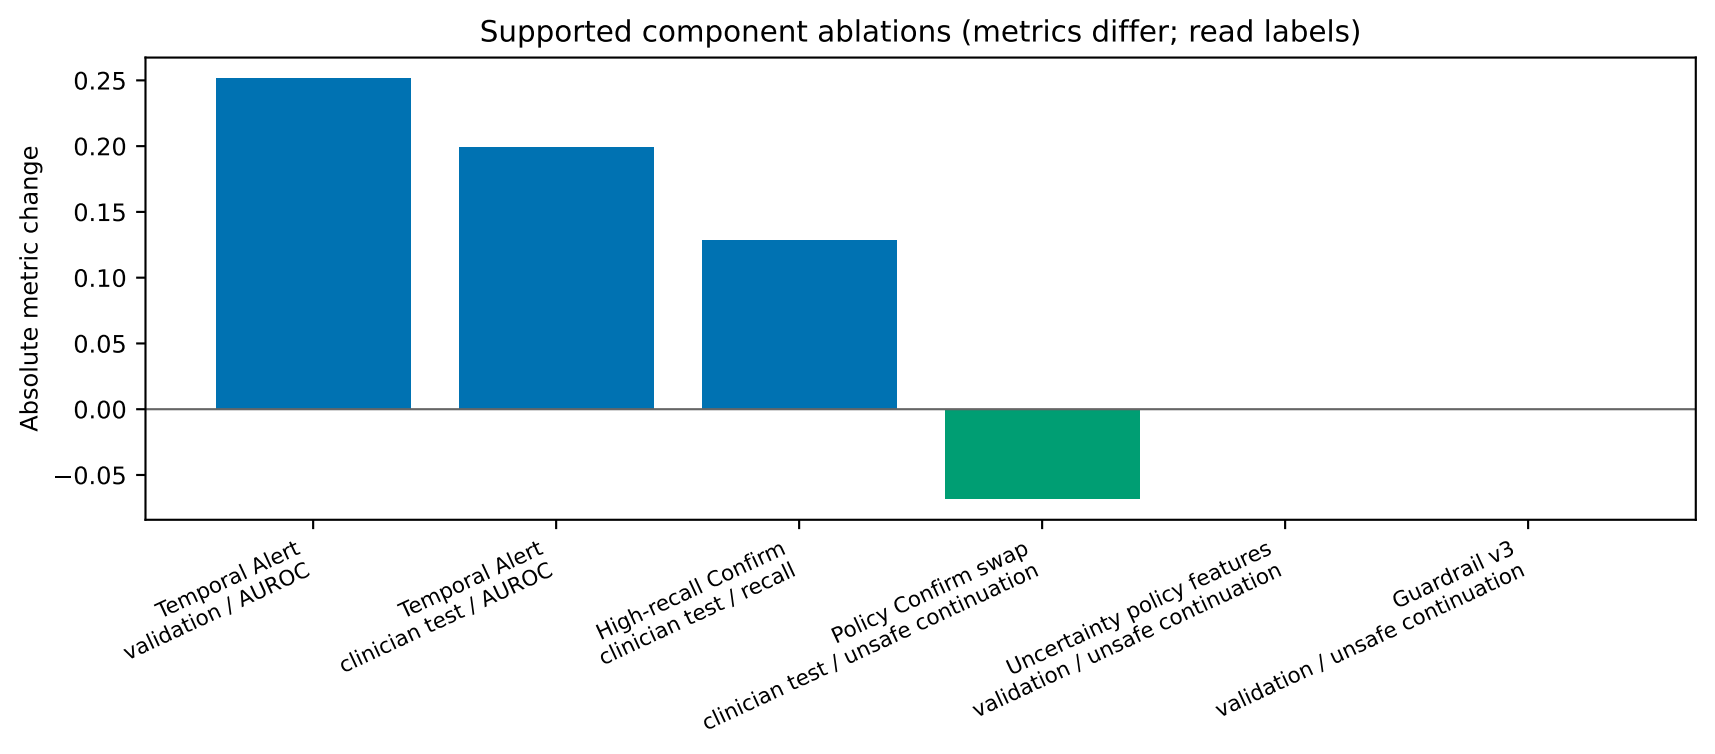
Supported component ablations (metrics differ; read labels)
Absolute metric change
0.25
0.20
0.15
0.10
0.05
0.00
−0.05
Temporal Alert
validation / AUROC
Temporal Alert
clinician test / AUROC
High-recall Confirm
clinician test / recall
Policy Confirm swap
clinician test / unsafe continuation
Uncertainty policy features
validation / unsafe continuation
Guardrail v3
validation / unsafe continuation