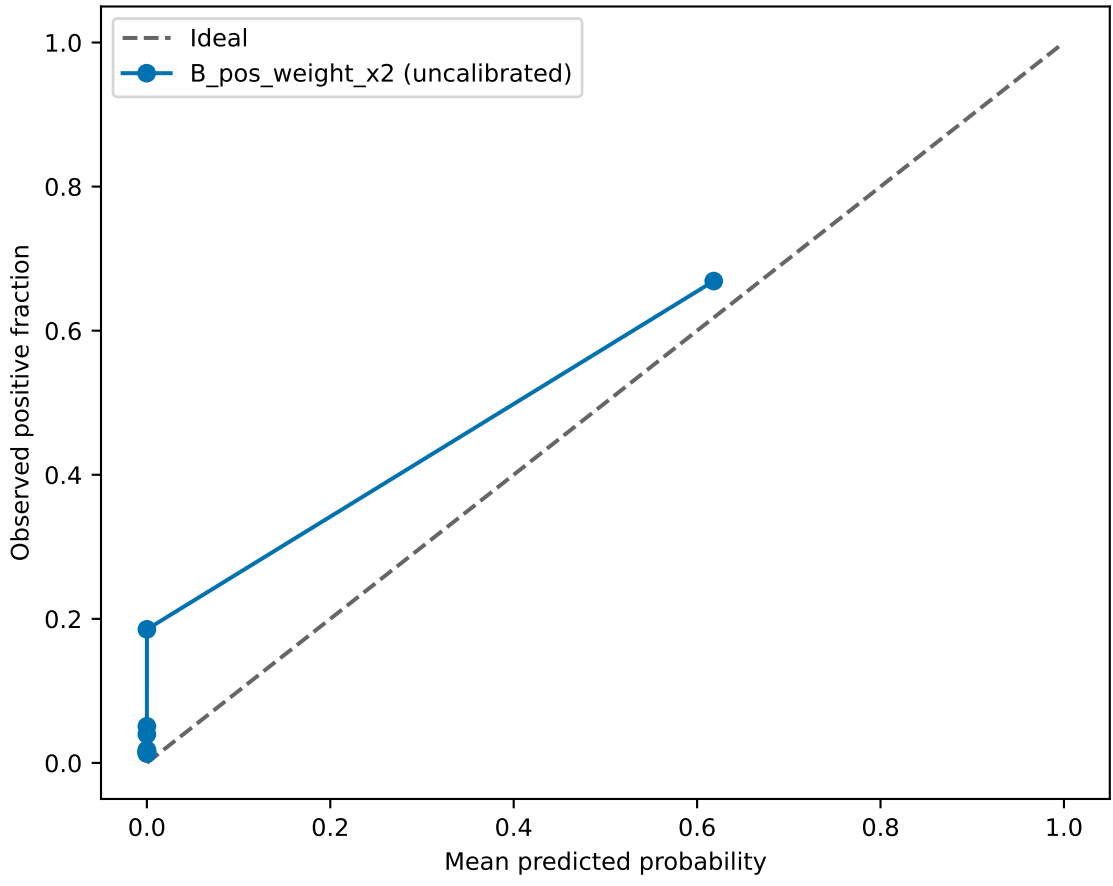
Final Confirm reliability (clinician test)
Ideal
B_pos_weight_x2 (uncalibrated)
Observed positive fraction
Mean predicted probability
0.0
0.2
0.4
0.6
0.8
1.0