


Standard vs off-label test set evaluation by KG

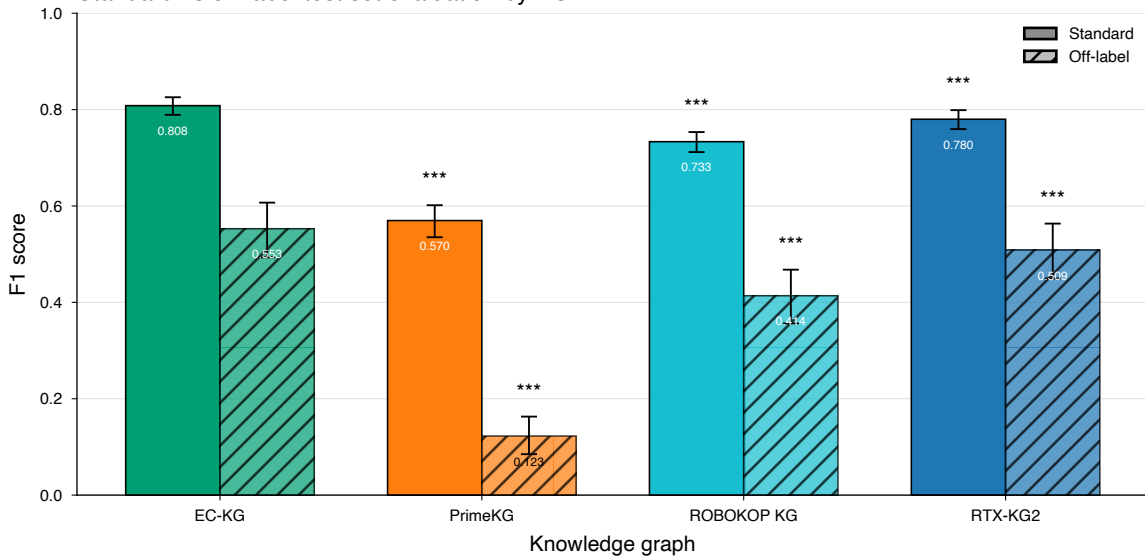

Bars: mean F1 across five CV folds; error bars: disease-bootstrap 95% CI. Asterisks: Holm-adjusted paired disease permutation test vs EC-KG within the same evaluation set (* $p < 0.05$, ** $p < 0.01$, *** $p < 0.001$; six comparisons).