JOB: 2F11

SABIZ 8000 Kg/h

SOLID DOSEX SYSTEM ITEM: 62WG4

WEIGHT TRANSMITTER INDICATOR: WIT-62.4

PNEUMATIC BOX: KC-62.4

(CUSTOMER'S SUPPLY)

ELECTRICAL & PNEUMATICAL DOCUMENTATION

	The master version of this document is stored as a digits	of file in a safferno continue	Amount of Linds of Li		
	L'originale del presente documento risiede in un detabas	se digitale. Il processo di ep	ouguar ino in a boundare accinive. Aptrioval process is aggirativ managed, details do not show on paper copies, Klabase digitale, il processo di approvazione è gestito via software e le firme non sana viaètali sula rimmimoni		
	Drawing supplier	Rev.	TELEPINAL PROPERTY AND ADDRESS OF THE PROPERTY ADDRESS OF THE PROPERTY AND ADDRESS OF THE PROPERTY ADD		
		0			
	Drawing	Sheets			
	2F11-85-081	1 of 13			
		<u> </u>			
desmet he exta	Plant SABIZ 8000 Kg/h		0 ISSUE FOR CUSTUMER USE	NOS	21.09.2012
		-	Rev. Issue description	Author	ote C

	Description	0	_	2	co
001	COVER PAGE (EXCEL 2000 Program)	×			
002	INDEX (EXCEL 2000 Program)	×			
003	INSTRUMENT LIST	×			
004	BLOCK DIAGRAM	×			
200	WIT-62.4 - WIRING DIAGRAM	×			
900	WK-62.4 - WIRING DIAGRAM	×			
200	WK-62.4 - PNEUMATIC DIAGRAM	×			
008	WK-62.4 - TERMINAL BLOCK	×			
600	WIT-62.4 - TOPOGRAPHIC VIEW	×			
010	KC-62,4 - INTERNAL VIEW	×			
011	KC-62.4 - EXTERNAL VIEW	×			
012	KC-62.4 - EQUIPMENT LIST	×			
013	KC-62.4 - EQUIPMENT LIST	×			
014			!		
015					
040		1			
210			I		
018					
019					
020					
021					
020					
022					
323					i
024					
025					
026					
027					
028					
020					
020					T
200					
U31					
032					
033					
034					
035					i
200					
000					
037					
038					
039					
040					
0.44		T			
- 5					
042					
043		_			
044					
		-			

N

0

Revisions

Sheet

Description


		t show on paper copies.	visibili sulle riproduzioni.				0 ISSUE FOR CUSTOMER USE	Revision Issue description	
060		digitally managed, details do no	via software e le firme non sonc	Plant	SABIZ 8000 Kg/h	Drawing's title	INDEX		
		Approval process is	provazione e gestito	Rev.	o		Sheet 2	Next 3	
	9 (4) 12 12 13 14 15 17 17 17 17 17 17 17	in reserver year out the document is stored as a digital me in a software archive. Approval process is digitally managed, details do not show on paper copies.	originare del presente documento nistede in un database digitale, il processo di approvazione è gestito via software e le firme non sono visibili sulle riproduzioni.	Drawing supplier		Drawing	2F11-85-081		
040	o notarou reference en	ne master version o	organian on present				Miles Maria	Tributa de Con	


21.09.2012 Date


SDM


= WKP-62.4 2F11-85-081 : 2F11 JOB The master version of this document is stored as a digital file in a software archive. Approval process is digitally managed, details do not show on paper copies. L'originale del presente documento risiede in un database digitale. Il processo di approvazione è gestito via software e le firme non sono visibili sulle riproduzioni. INSTRUMENT LIST JUNCTION BOX FOR ELECTRIC AND PNEUMATIC SIGNAL KC-62.4 drawing's title: CHARGING CONTROL 90 CONTACTS 90 110 BY CUSTOMER 8 WEIGHT TRANSMITTER INDICATOR WIT-62.4 WEIGHT TRANSMITTER 4-20mA CONTACTS 05 9 CUSTOMER 500 占 SABIZ 8000 Kg/h BASE/BASE FUSIBILE/FUSE PORTATA/CAP. VOLT_ HZ_ M DIS. Nr.
DWG. Nr.
INGRESSO/USCITA
INPUT/OUTPUT - -기심김 SIGLA / TAG 두 두 COMANDO / CONTROL VISUALIZZ / VISUAL (SINOTTICO / MIMIC DIS. N OVERALL DIM. FORATURA CUT OUT INSTRUMENTS TAG SIGLA STRUMENTO COSTRUTTORE STRUMENTO / MANUFACTURER MODEL RELE[†] AUSILIARI E/O TEMPORIZZATI AUX. RELAYS AND/OR TIMERS UNITA' DI ALLARME SEGNALI
INSTRUM. SIGNALS
ACCESSORR
ACCESSORR
CAVI DI USCITA
OUTSIDE CONNECTION CABLE 21-09-12 SCHEMA DI COLLEGAMENTO CONTROL DIAGRAM ALIMENTAZIONE STRUMENTO Date FUNZIONE STRUMENTO INSTRUMENTS SERVICE INSTRUMENT FEEDING FUSIBILI AUSILIARI SCHEMI PARTIC. PARTIC. DIAGRAMS AUXILIARY FUSES ALARMS POINTS SEGNALAZIONI B INSTRUMENT STRUMENTO SIGNALINGS COMANDO MODELLO ISSUE FOR CUSTOMER USE rev. Issue Description 0 12 4 5 16 Ø ∞ တ CARATTERISTICHE GENERALI GENERAL CHARACTERISTICS Back panel Retro Quadro FRONTE QUADRO MISCETTYM. VARIE

Ö

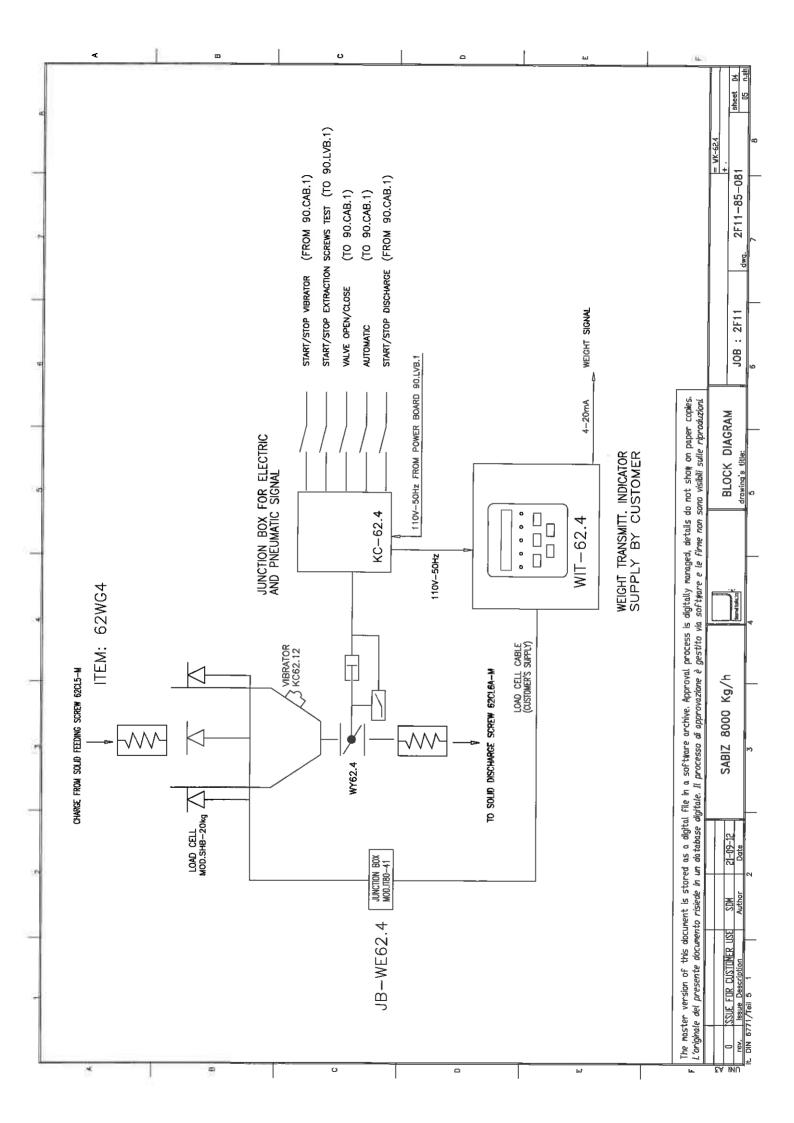


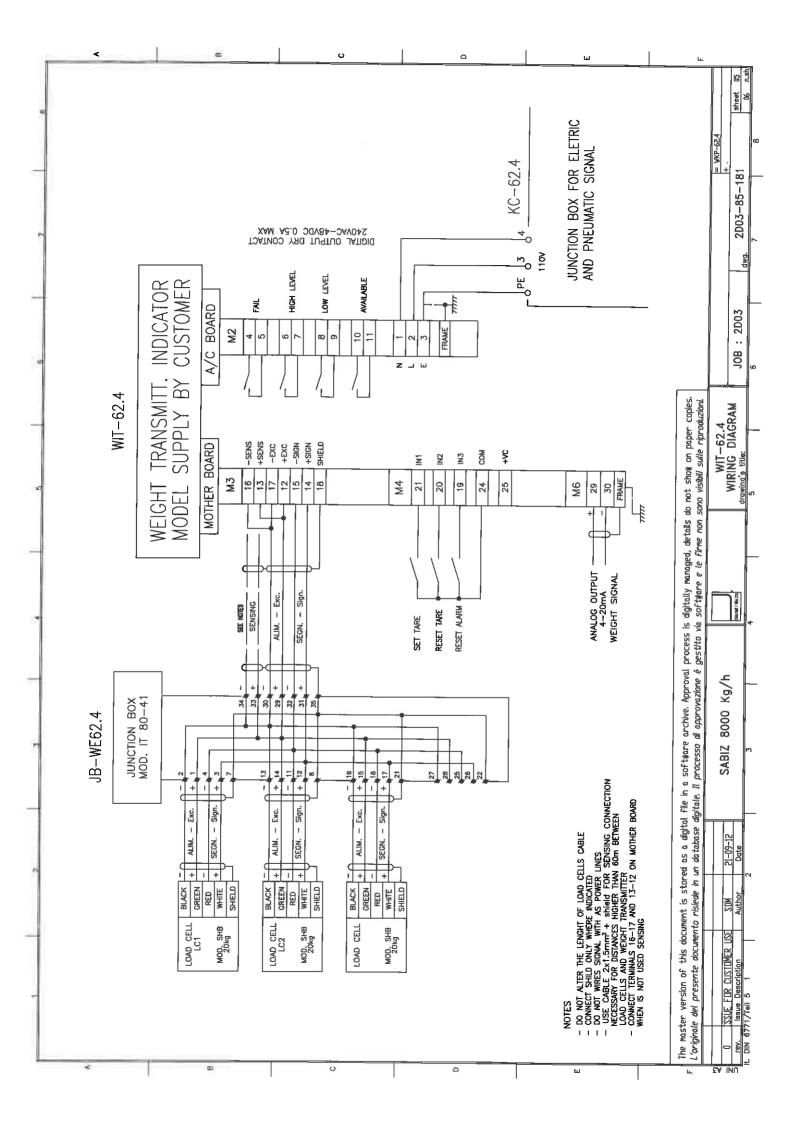


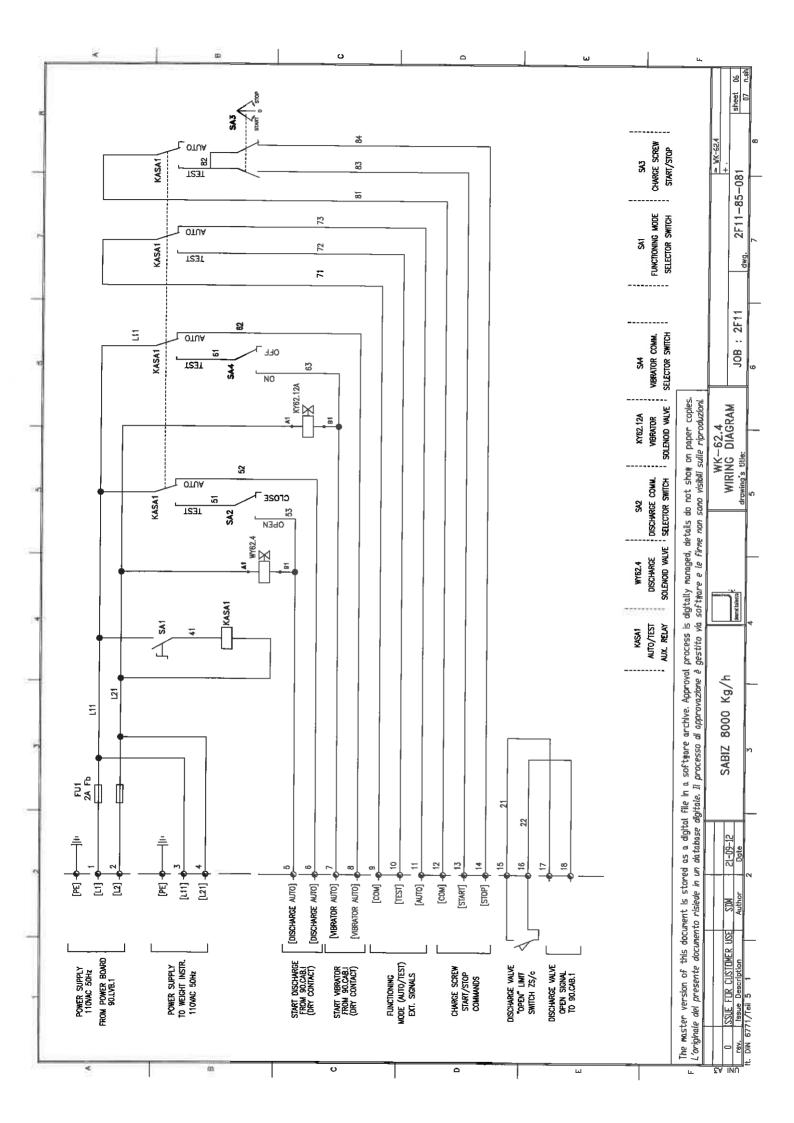


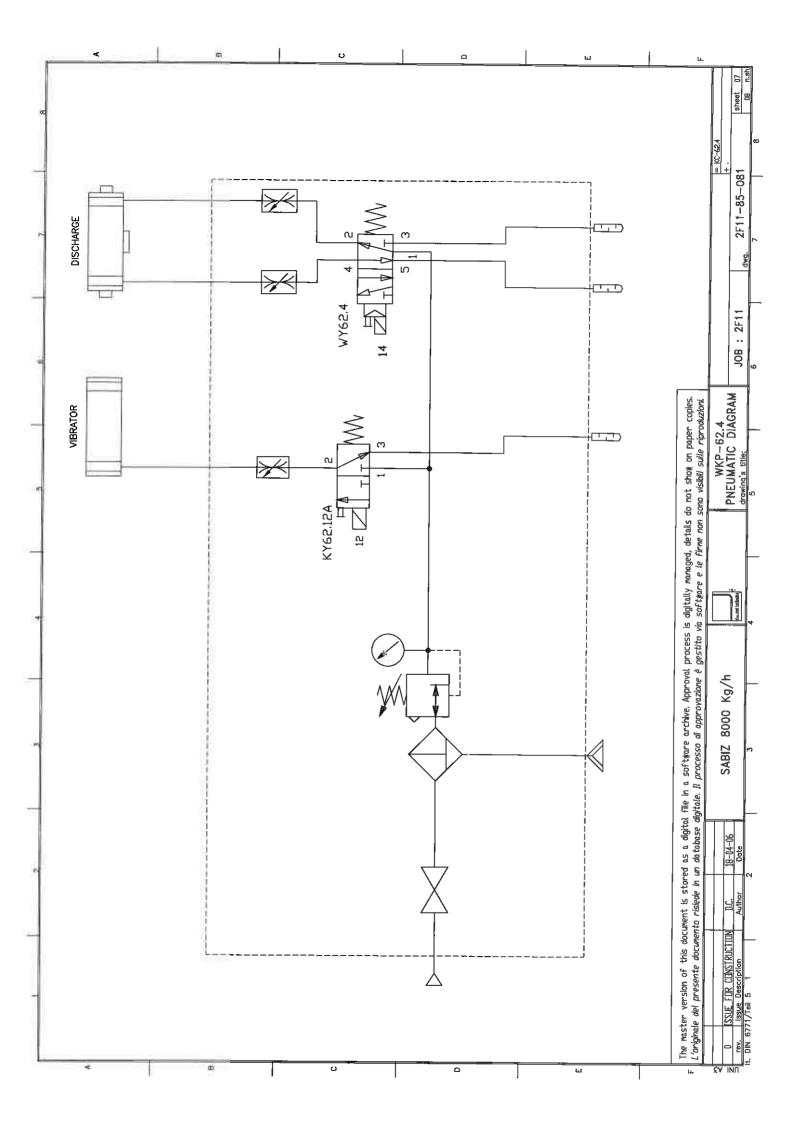

Totale / Total Su altro foglio / On other sheet In questo foglio / On this sheet = VKP-62.4 0 0 2F11-85-081 0 0 0 Q 0 0 0 0 0 2F11 0 0 JOB 0 O 0 do not show on paper copies, sono visibili sulle riproduzioni. WK-62.4
TERMINAL BLOCK
drawing's title: 0 0 0 0 0 0 0 0 ballestra s.p.a digitally managed, detalls softhare e le firme non 0 0 0 M. SPARE 20 0 SPARE 61 0 81 7.7. 0 TIMIL 2M. 10 90,CAB.1 진형 12 41 0 DISCHARGE VALVE process i 22 91 0 TIMIT SWITCH 12 91 0 DISCHARGE VALVE as a digital file in a soft#are archive. Approval database digitale. Il processo di approvazione è †8 t. Ö Kg/h ξ8 51 0 18 15 0 8000 CONTROL SIGNALS Σ۷ 11 O 77 10 0 SABIZ 14 6 0 8 0 **79** €9 L 0 1.8A0.06 MOST 29 9 0 CONTROL SIGNALS 0 ÇÇ Ç 0 21-09-12 Date 127 110VAC 50 Hz רוו ٤ 0 POM, SUPPLY TO WEIG, JASTR, ЭЬ ЬE 0 this document is stoned a documento risiede in un 27 7 FROM POWER BOARD 90,LVB,1 0 110AVC 20 Hz ١٦ 0 L POWER SUPPLY 0 ЪΕ ьЕ Morsettiera Fish plate c. ldentif. collegamento Designation group žξ Apparecchiatura Designation group 図 Terminale Terminal Morsetto Terminal Tipo morsetto Terminal type Tipo SSUE FIRE CUSTOMER Destination marck Destination marck del presente Ъ ORIGINE DESTINAZIONE master version źΖ Cavo Identificazione morsettiera / designation group strip 'originale Jev. ပ w

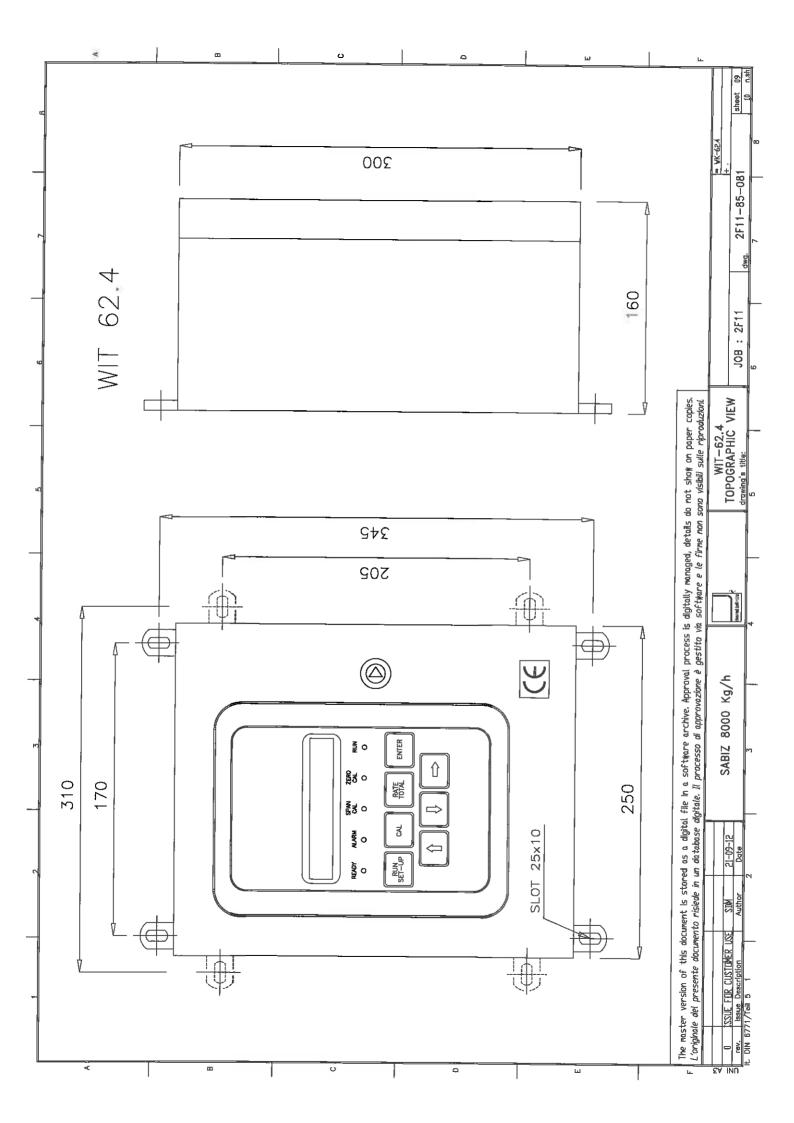

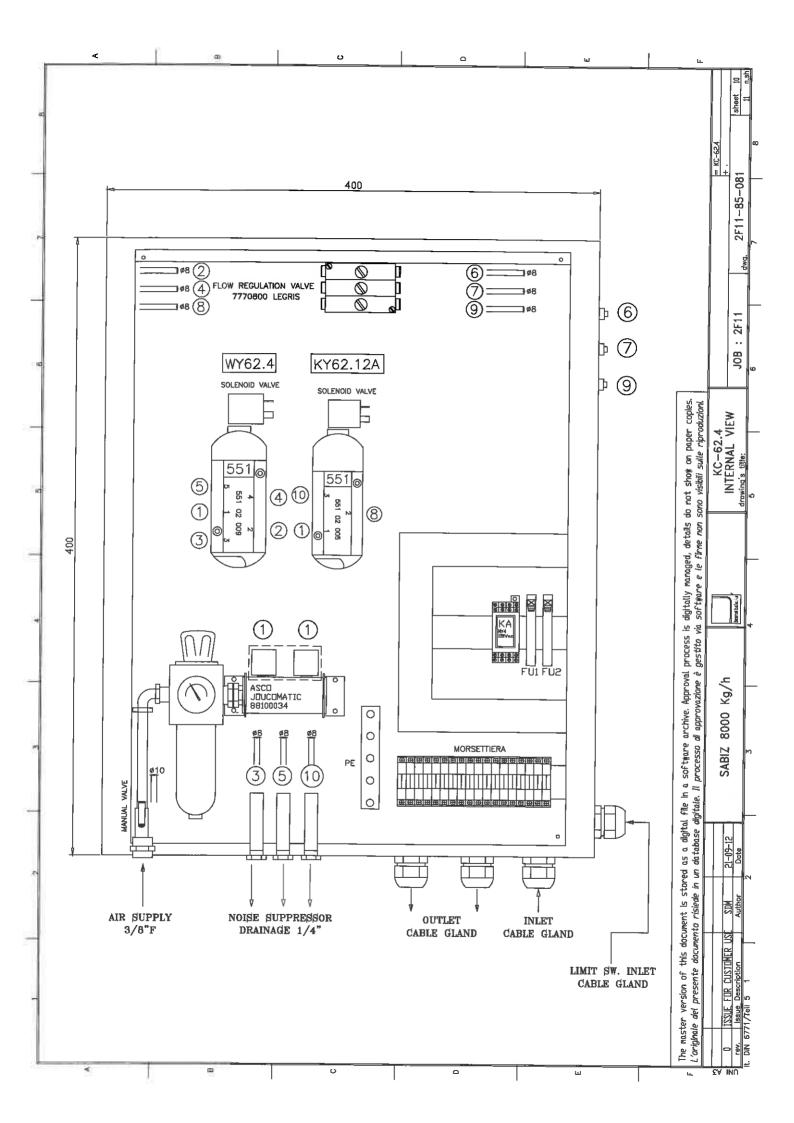

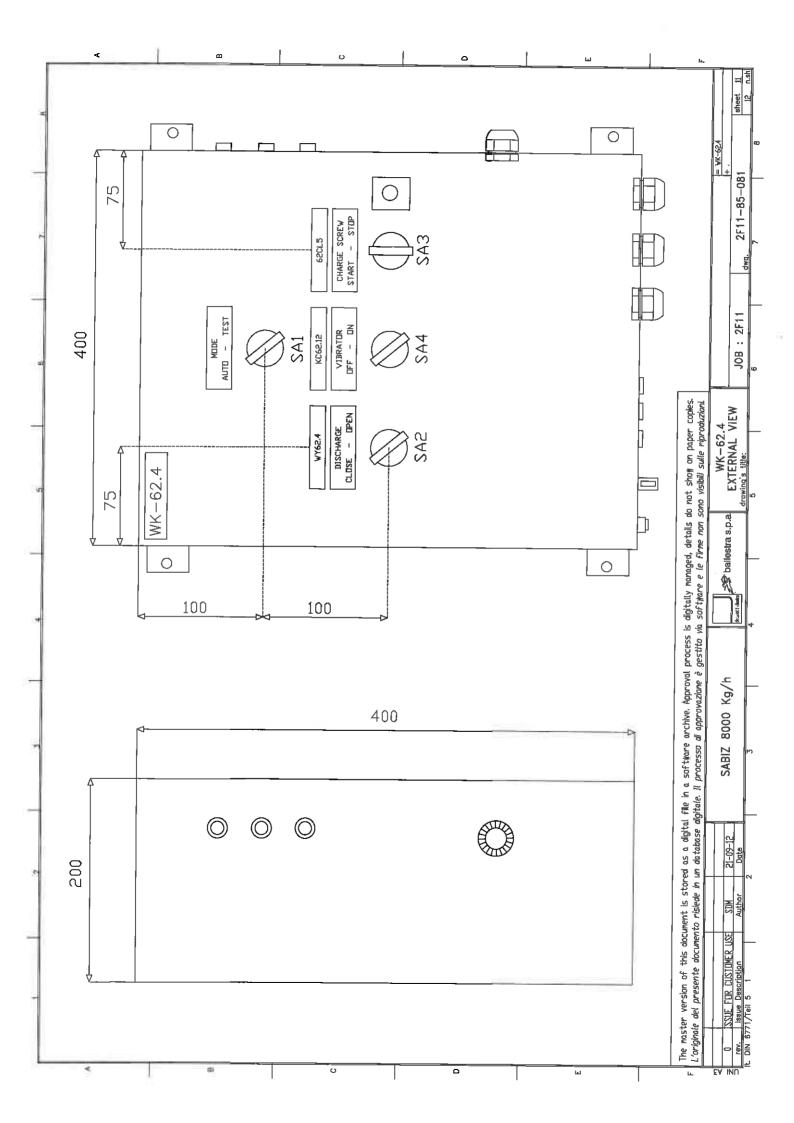

	ING DIAGRAM	LABEL DWG Nr.																		= KC-624
OMER	SCHEMATIC WIRING	UTILITIES CUBICLE LA								i										
TED BY CUSTOMER		MANUFACT. IDENTIFIC.	ASCO JOUCOMATIC	CIMATIC	ASCO JOUCOMATIC	ASCO JOUCOMATIC	LEGRIS	ASCO JOUCOMATIC	ASCO JOUCOMATIC	ASCO JOUCOMATIC	ASCO JOUCOMATIC	PHOENIX CONTACT		PHOENIX CONTACT	PHOENIX CONTACT	PHOENIX CONTACT	PHOENIX CONTACT		digitally managed, details do not show an paper copies.	KC-62.4
VIAL SHALL BE VERIFIED	1 1	IDENTIFICATION DATA	342 25 203		551 02 009	551 02 005 A	77700800	3199 08 13 A	3116 08 13	■	A	UK5 HESI		UK 2,5N	D-UK 2,5	E/NS 35N	UT 2,5 PE		iz iš	S carpollocal S
HIS MALERIAL EQUIPMENT		EQUIPMENTS DESCRIPTION AND APPLICATION	FILTER & REGULATOR GROUP 1/4"	MANUAL VALVE 3/8"F-3/8"M	SOLENOID VALVE 5V-1/4"-110V 50Hz	SOLENOID VALVE 3V-1/4"-110V 50Hz	FLOW REGULATION VALVE	FITTING 1/4" FOR PIPE @ 8	FITTING (THROUGH PANEL)	"T" FITTING FOR PIPE @ 8	NOISER SUPPRESSOR DRAINAGE	FUSE TERMINAL	FUSE 2A Fb	TERMINALS	END PLATE	END TERMINAL	GROUND TERMINAL		The master version of this document is stored as a digital file in a softmare anchive. Approval process L'originale del presente documento rislede in un database digitale. Il processo di approvazione è gestito	SABI7 8000
ı		YTITNAUQ DAT	1	-	X	1 W2	(1	13	ا ا	-	ю 	2 FU1	2 FU1	- 20	1	2	2 -		The master version of this document is stored L'originale del presente documento rislede in un	Test CTIMETER PLEATER

		ي ا	1		<u> </u>	Τ		T	Τ	T		<u> </u>		<u> </u>	Ţ	T	T-]	tanta C
		DWG Nr.																			= VK-62.4 + .
CUSTOMER		1																			
USI		SUBICLE S)											-		+	+	+	_	-	
BY	CITAMPLICO	UTILITIES TAG																			27.10
-IED		DENTIFIC.			-										-					copies.	ST
VERIFIE	I														_			+		n paper	-62.4 ENT LI
BE V		MANUFACT.	SIEMENS	SIEMENS	SIEMENS	SIEMENS	SIEMENS	SIEMENS	OMRON	OMRON		CEB								do not show o	WK-62,4 EQUIPMENT LIST
SHALL		DATA														-				naged, details	
) NC																		gitally man	
MATERIAL	. 1		AB01	_ m	0	EB01														ito via sc	
- 1	IT LIST	IDENTIFICATION	3SB1000-2AB01	3SB1400-0B	3SB1400-0C	3SB1000-2EB01	3SB1400-0B	3SB1400-0C	MY4	PYF04A		GS4420								The master version of this document is stored as a digital file in a soft⊭are archive. Approval process is digitally managed, details do not sho⊯ on paper copies. L'originale del presente documento risiede in un database digitale. Il processo di approvazione è gestito via soft⊭mre e le firme non sono visibili sulle ribroduzioni.	8000 Kg/h
S H L	EQUIPMENT	Z		WITCH	SWITCH	3 RET.	WITCH	SWITCH									-			rre archive so di appr	Z 8000
	MIP	DESCRIPTION LICATION	POSITIONS	SELECTOR SWITCH	SELECTOR S	SPRING RET.	SELECTOR SWITCH				LABEL (Dwg:15629-CC11-P013A)	200								a softwo	SABIZ
		EQUIPMENTS DESCRIP	2 POSI			3 POS.		R SELECTOR	CONTACT 110VAC		-cc11-	400×400×200								al file in digitale.	
		ENTS APF	SWITCH	NO FOR	NC FOR	SWITCH	NO FOR	NC FO	NTACT	FOR RELAY	15629-	PANEL 4(İ	!	į	as a digi- database	21-09-12
		ANC	SELECTOR S	CONTACT 1	CONTACT 1	SELECTOR S	CONTACT 1	CONTACT 1 NC FOR	4		L (Dwg	CONTROL PA								s stored de in un	
		EC							RELAY	SOCKET	LABE	CON								cument le	SDW
		TAG	SA2 SA2		SA2 SA4	SA3	SA3	SA3	KASA1	KASA1	ı	-								this do	TIMER US
		YTITNAUQ	М	M	7	-	-	-	-	-	4	-								slon of resente	UR CUST
						_					_							_		ster ver	0 SSUE FOR CUSTOMER USE
																				The ma: L'origin	