JOB: 2F11

SABIZ 8000 Kg/h

SOLID DOSEX SYSTEM ITEM: 62WG3

WEIGHT TRANSMITTER INDICATOR: WIT-62.3

PNEUMATIC BOX: KC-62.3

(CUSTOMER'S SUPPLY)

ELECTRICAL & PNEUMATICAL DOCUMENTATION

	The master version of this document is stored as a clinita	file in a software archive	The master version of this document is stored as a clinital file in a software such to a American increase to distributive measured and the second se		
	L'originale del presente documento i siede in un detabas	e digitale. Il processo di ap	Loriginale del presente documento i ilede in un defabase digitale. Il processo il approvazione è gastito via escribura il mangra via della mangra de		
	Drawing supplier	Rev.			
		0			
	Drawing	Sheets			
	2F11-85-080	1 of 13			
desmet ballestra	Plant SABIZ 8000 Kg/h		0 ISSUE FOR CUSTUMER USE	SDM	21.09.2012
		K.	Rev. Issue description	Author	Date

COVER PAGE Description D	5							
NDEX		Desc	0	-	2	က		Description
INDEX NUMBER NU	001	PAGE (×				046	
INSTRUMENT LIST X	002)	×				047	
BLOCK DIAGRAM X WIT-62.3 - WIRING DIAGRAM X WK-62.3 - WIRING DIAGRAM X WK-62.3 - WIRING DIAGRAM X WK-62.3 - PREWINAL BLOCK X WK-62.3 - PREWINAL BLOCK X WK-62.3 - PREWINAL VIEW X KC-62.3 - EQUIPMENT LIST X WC-62.3 -	003	NT LIST	×				048	
WIT-62.3 - WIRING DIAGRAM WK-62.3 - WIRING DIAGRAM WK-62.3 - PREWINAL BLOCK WK-62.3 - INERNIAL BLOCK WK-62.3 - INERNAL VIEW KC-62.3 - EXTERNAL VIEW KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPMENT LIST X X X X X X X X X X X X X	004	BLOCK DIAGRAM	×				049	
WK-62.3 - WIRUNG DIAGRAM WK-62.3 - TERMINAL BLOCK WKT-62.3 - TERMINAL VIEW KC-62.3 - EXTERNAL VIEW KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPMENT	005	WIT-62.3 - WIRING DIAGRAM	×				020	
WK-62.3 - PREMINAL BLOCK WK-62.3 - TOPOGRAPHIC VIEW KC-62.3 - TOPOGRAPHIC VIEW KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPMENT LIST X X X X X X X X X X X X X	900	WK-62.3 - WIRING DIAGRAM	×				051	
WK-62.3 - TERMINAL BLOCK WK-62.3 - INTERNAL VIEW KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPMENT LIST X C-62.3 - EQUIPMENT LIST	200	WK-62.3 - PNEUMATIC DIAGRAM	×				052	
MIT-62.3 - TOPOGRAPHIC VIEW KC-62.3 - EXTERNAL VIEW KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPM	800	WK-62.3 - TERMINAL BLOCK	×				053	
KC-62.3 - EXTERNAL VIEW KC-62.3 - EXTERNAL VIEW KC-62.3 - EQUIPMENT LIST KC-62.3 - EQUIPMENT LIST X X X X X X X X X X X X X	600	WIT-62.3 - TOPOGRAPHIC VIEW	×				054	
KC-62.3 - EXTERNAL VIEW KC-62.3 - EQUIPMENT LIST X KC-62.3 - EQUIPMENT LIST X	010	KC-62.3 - INTERNAL VIEW	×				055	
KC-62.3 - EQUIPMENT LIST X KC-62.3 - EQUIPMENT LIST X	011	KC-62.3 - EXTERNAL VIEW	×				056	
KG-62.3 - EQUIPMENT LIST X X X X X X X X X X X X X	012	KC-62.3 - EQUIPMENT LIST	×				057	
	013	KC-62.3 - EOUIPMENT LIST	>				200	
	014		,				020	
	015		T			T	800	
	010						090	
	016						061	
	017						062	
	018					İ	063	
	019						064	
	020						1800	
	021						390	
	000		Ť			T	000	
	770						/90	
	023						890	
	024		i				690	
	025						020	
	026						071	
	027						070	
	028					T	0720	
	020						0/3	
	620					Ī	074	
	030						075	
	031					_	076	
	032						077	
	033						078	
	034						070	
	035							
	036						082	
	037					T	000	
	038						7000	
	030		İ				200	
	040						000	
	243						080	
	140						086	
	042						087	
	043				-		8880	THE CONTRACT OF THE CONTRACT O
	044						080	
	270		1					

n

2

0


Revisions


	iples.	delorn.			0 ISSUE FOR CUSTOMER USE	Issue description	
	on paper co	Dome in			0	Revision	
	digitally managed, details do not show	Plant	SABIZ 8000 Kg/h	Drawing's title	INDEX		
-	pproval process is rovazione è gestift	Rev.	0		Sheet 2	Next 3	
2 1 101 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	ne master version or uns document is stored as a digital file in a software archive. Approval process is digitally managed, details do not show on paper copies. Originale del presente documento risiede in un database digitale. Il processo di approvazione è destito via software e la firma non sono visibili sulla abonduzioni	Drawing supplier		Drawing	2F11-85-080	_	


21.09.2012 Date


SDM

sheet 04 = VK-62,3 2F11-85-080 dwg. : 2F11 9 The master version of this document is stored as a digital file in a software archive. Approval process is digitally managed, detalls do not show on paper copies. L'originale del presente documento risiede in un database digitale. Il processo di approvazione è gestito via software e le firme non sono visibili sulle riproduzioni. INSTRUMENT LIST drawing's title: JUNCTION BOX FOR ELECTRIC AND PNEUMATIC SIGNAL KC-62.3 CHARGING CONTROL 90 CUSTOMER CONTACTS 90 50 02 占 WEIGHT TRANSMITTER INDICATOR WIT-62.3 WEIGHT TRANSMITTER BY CUSTOMER 4-20mA CONTACTS 05 05 5 5 SABIZ 8000 Kg/h Z / VISUAL QA_
Z / MIMIC LS_
DIS. Nr.
DIS. Nr.
DWG. Nr.
INGRESSO/USGITA
INPUT/OUTPUT BASE/BASE FUSIBILE/FUSE PORTATA/CAP. V0LT_ H2_ \\\ SIGLA / TAG - 무 - 기 - 의 보그 COMANDO / CONTROL VISUALIZZ / VISUAL. SINOTTICO / MIMIC F F DIS. N OVERALL DIM. DIMENSION FORATURA CUT OUT INSTRUMENTS TAG SIGLA STRUMENTO COSTRUTIORE STRUMENTO / MANUFACTURER MODEL RELE" AUSILIARI E/O TEMPORIZZATI AUX. RELAYS AND/OR TIMERS UNITA" DI ALLARME ALARMS POINTS ACCESSOR!
ACCESSOIRES
CAVI DI USCITA
OUTSIDE CONNECTION CABLE 21-09-2012 SCHEMA DI COLLEGAMENTO CONTROL DIAGRAM ALIMENTAZIONE STRUMENTO FUNZIONE STRUMENTO INSTRUMENTS SERVICE INSTRUMENT FEEDING SCHEMI PARTIC.
PARTIC. DIAGRAMS
SEGNALI
INSTRUM. SIGNALS FUSIBILI AUSILIARI AUXILIARY FUSES SEGNALAZIONI 픮 INSTRUMENT STRUMENTO SIGNALINGS COMANDO MODELLO 0 ISSUE FOR CUSTOMER'S USE t. DIN 6771/Teil 5 1 0 12 4 5 9 9 ∞ O CARATTERISTICHE GENERALI GENERAL CHARACTERISTICS BACK PANEL RETRO QUADRO ГРОИТЕ QUADRO ГРОИТ РАИЕL VARIE MISCELLAN,

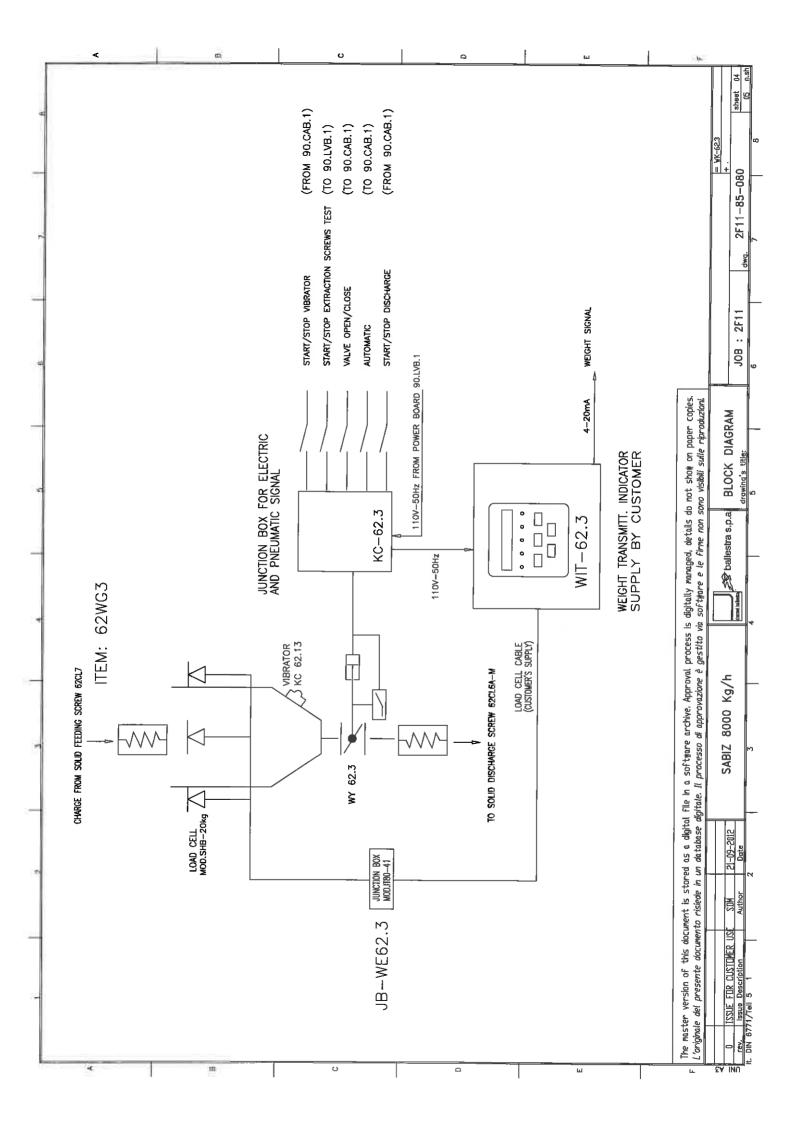


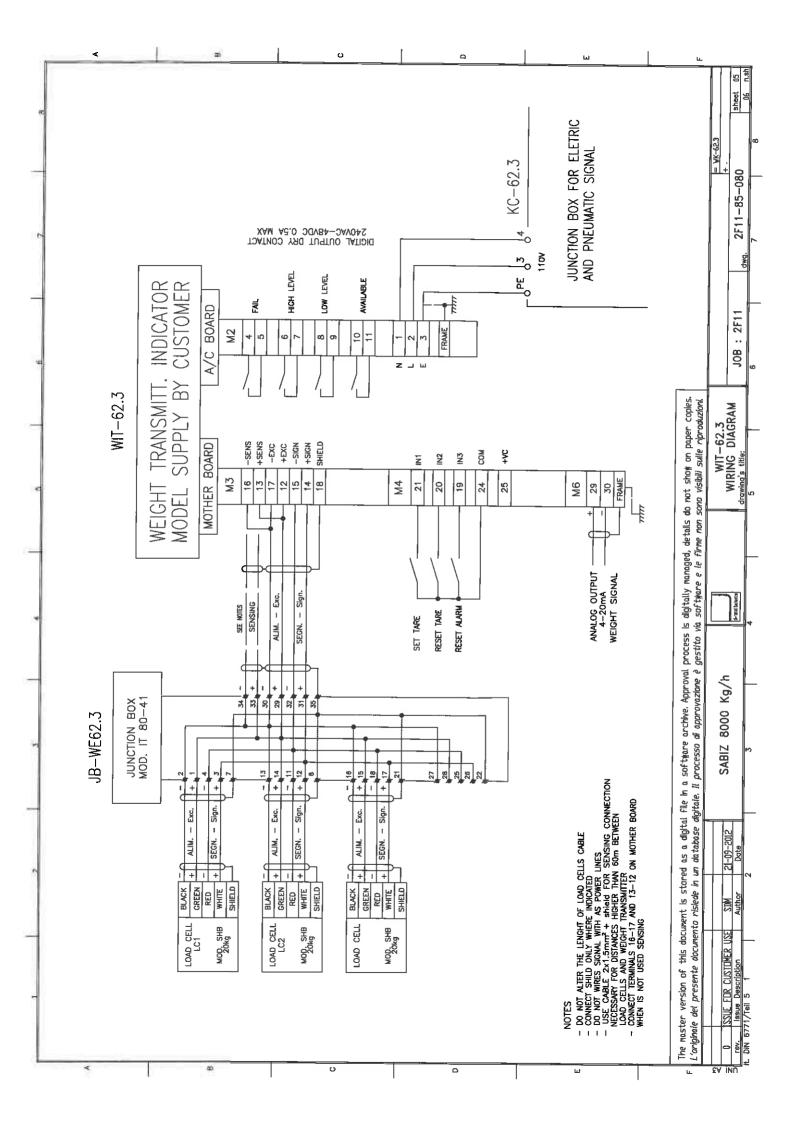


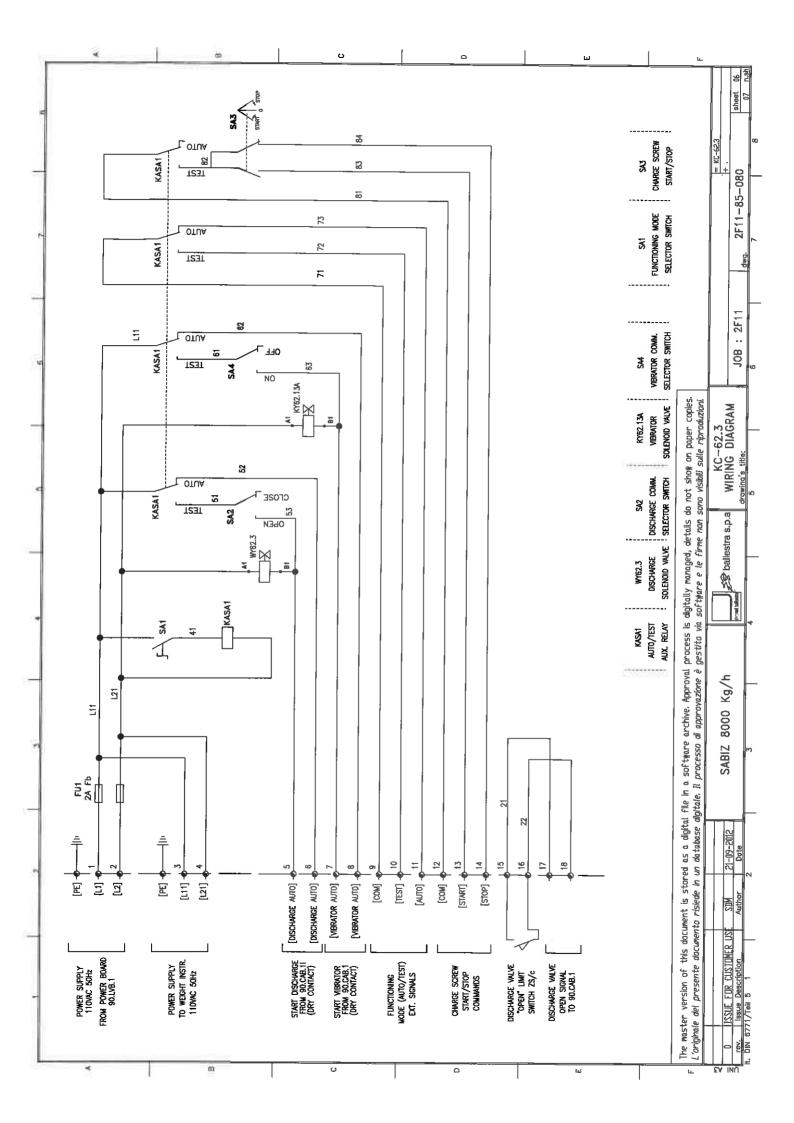


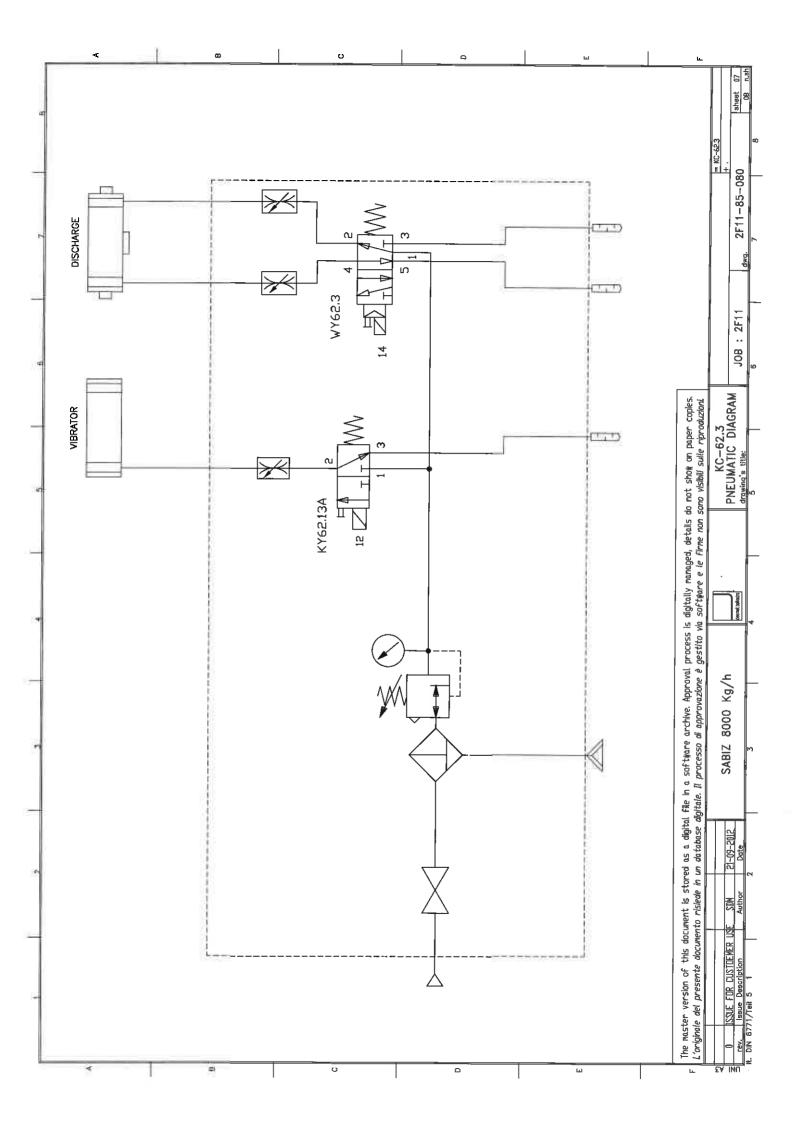

۵ Totale / Total Su altro foglio / On other sheet Jeene sind nO \ oilgot obseup ni 0 0 2F11-85-080 0 0 Ō 0 O 0 0 0 0 2F11 0 .. O JOB 0 0 0 KC-62.3 TERMINAL BLOCK drawing's title: it show on paper copies, visibili sulle riproduzioni. 0 0 0 0 0 ō not do not sono y 0 0 algitally managed, details soft⊯are e le firme non 0 0 0 20 SPARE 0 SPARE 6 L Ó ΖZ 81 0 LIMIT SW. TO 90,CAB.1 process is a gestito via s 12 41 0 DISCHARGE VALVE 22 9١ 0 LIMIT SWITCH 12 91 0 DISCHARGE VALVE as a digital file in a soft-yare archive. Approvat database digitale. Il processo di approvazione è ; 128 かし 0 Kg/h ₹8 13 0 18 15 0 8000 ٤٧ 11 0 CONTROL SIGNALS 72 10 0 SABIZ 14 6 0 79 8 0 0 ξ9 L FROM 90.CAB,1 29 0 CONTROL SIGNALS 9 29 G 0 21-09-2012 Dote 127 0 7 110AVC 20 Hz 111 ξ 0 POM, SUPPLY TO WEIG, NISTR, ьЕ 0 Эd this document is stored documento riskede in un 21 7 0 FROM POWER BOARD BOLLYBUT 110AVC 20 Hz SDM ĮП 0 POWER SUPPLY ьЕ ЬΕ 0 <u></u> dentif, collegamento Designation group Apparecchiatura Designation group žž 冒 settien plate Morsetto Terminal Tipo morsetto Terminal type this SSUE FOR CUSTOMER F F Destination marck Destination marck 활동 presente master version of źż Cave è Identificazione morsettiera / designation group strip 'originale O Ω ш

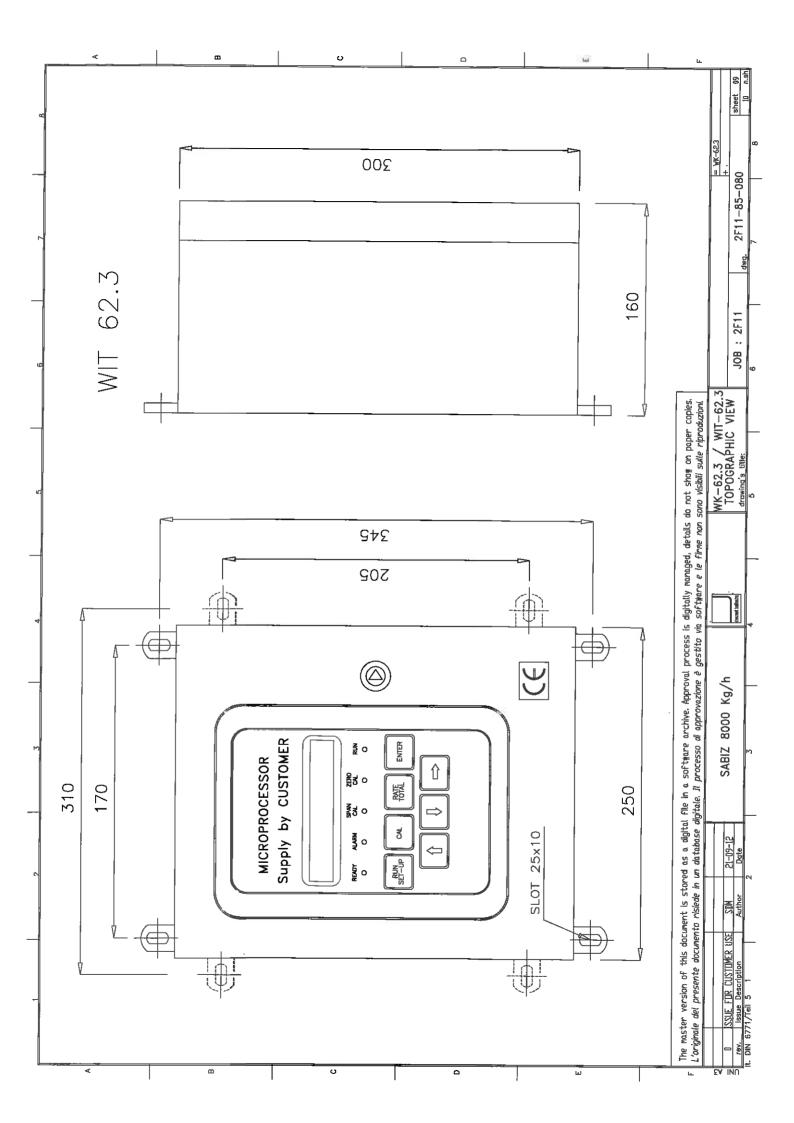

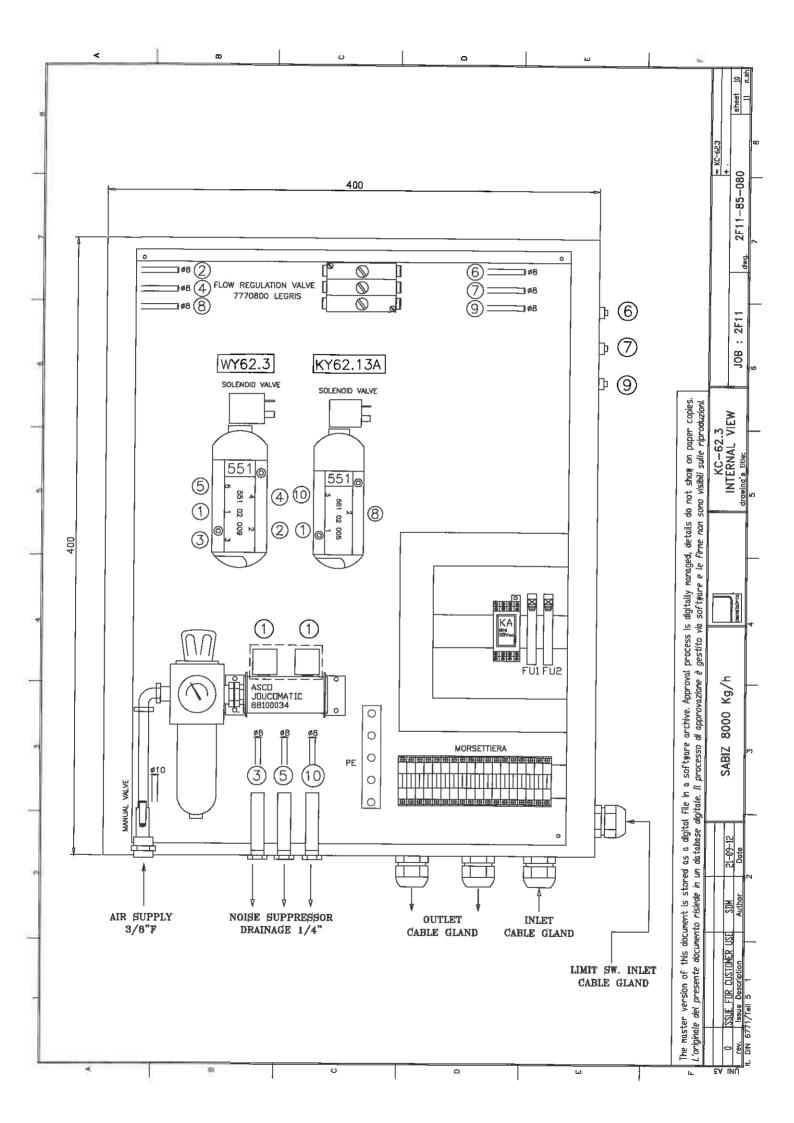

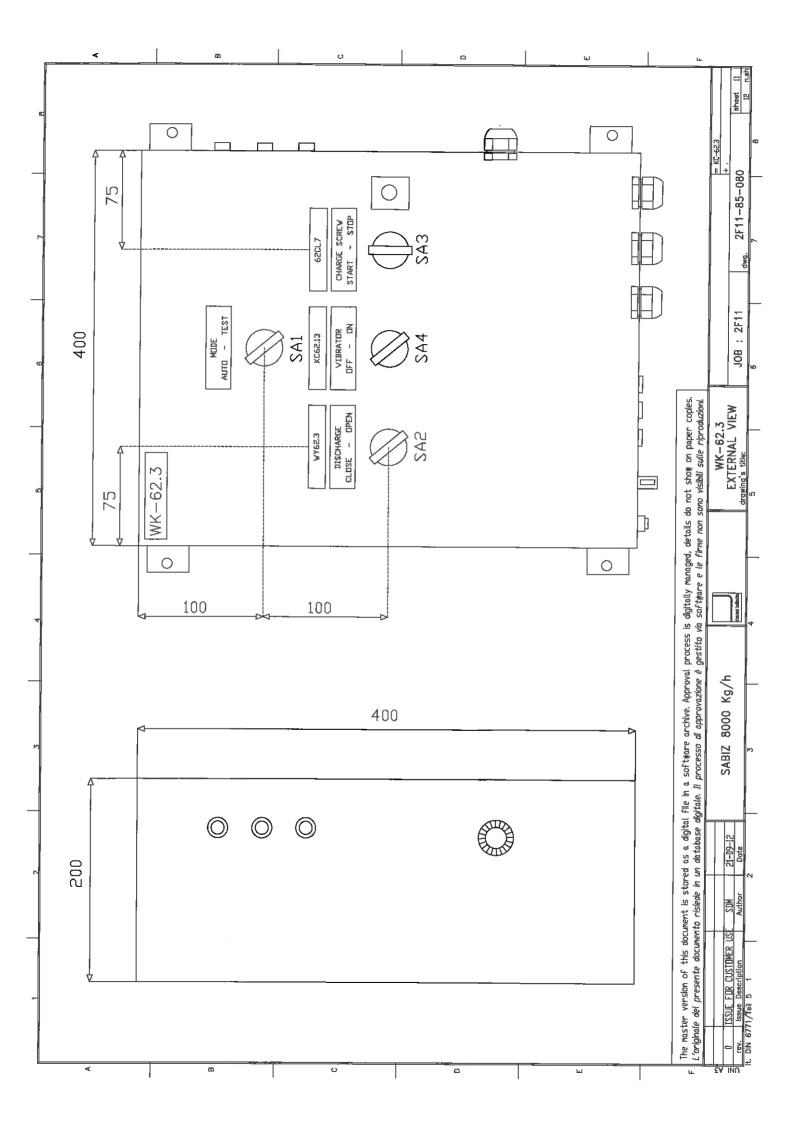

	<u> </u>			<u> </u>	— . 		-	`	,									w		L.	sheet 12
20	DIAGRAM	DWG Nr.																			KC-623
	WIRING	LABEL																			ZF11-85-080
	MATIC	CUBICLE										_						_			
CUSTOMER	SCHEMATIC	UTILITIES TAG																			JOB : 2F11
CUS		IDENTIFIC.																-		coples.	IST
B		MANUFACT.	ASCO JOUCOMATIC	CIMATIC	ASCO JOUCOMATIC	ASCO JOUCOMATIC	LEGRIS	ASCO JOUCOMATIC	ASCO JOUCOMATIC	ASCO JOUCOMATIC	ASCO JOUCOMATIC	PHOENIX CONTACT		PHOENIX CONTACT	PHOENIX CONTACT	PHOENIX CONTACT	PHOENIX CONTACT			do not show on paper sono visibili sulle ripro	KC-62.3 EQUIPMENT LIST
SIAL SHALL BE VERIFIED	NT_LIST	IDENTIFICATION DATA	342 25 203		551 02 009	551 02 005	77700800	3199 08 13	3116 08 13			UK5 HESI		UK 2,5N	D-UK 2,5	E/NS 35N	UT 2,5 PE			ve. Approval process is digitally managed, detalls rovazione è gestito via softmare e le firme non	8000 Kg/h
THIS MATERIAL	EQUIPMENT	EQUIPMENTS DESCRIPTION AND APPLICATION	FILTER & REGULATOR GROUP 1/4"	MANUAL VALVE 3/8"F-3/8"M	SOLENOID VALVE 5V-1/4"-110V 50Hz	SOLENOID VALVE 3V-1/4"-110V 50Hz	FLOW REGULATION VALVE	FITTING 1/4" FOR PIPE @ 8	FITTING (THROUGH PANEL)	"T" FITTING FOR PIPE @ 8	NOISER SUPPRESSOR DRAINAGE	FUSE TERMINAL	FUSE 2A Fb	TERMINALS	END PLATE	END TERMINAL	GROUND TERMINAL			The master version of this document is stored as a algital file in a software archive. Approval process is algitally managed, detalls do not show on paper capies. L'originale del presente documento risiede in un database digitale. Il processo di approvazione è gestito via software e le firme non sono visibili sulle riproduzioni.	\$200 S200 S1-09-12 Author Date
		DAT	_	_	Σ	742	ı	1	ı	ı	-	£1	5	1	1	ı	1			ocumento	ER US
		YTITNAUQ	-	-	-	-	14)	13	ניו	_	ю	74	7	20	-	7	2			on of th	R CUSTON scription
												.								naster versi	0 ISSUE FOR CUSTOMER US rev. Issue Description
	<			<u> </u>		1		<u> </u>					0							The m	EA INU

	ING DIAGRAM	LABEL DWG Nr.												_				= WKP-62.3
	SCHEMATIC WIRING	UTILITIES CUBICLE TAG																
		IDENTIFIC. TAG															on paper copies. ulle riproduzioni.	WK-62.3
	į	MANUFACT.	SIEMENS	SIEMENS	SIEMENS	SIEMENS	SIEMENS	SIEMENS	OMRON	OMRON	1	CEB					digitally managed, detalls do not shay on paper copies. softymere e le firme non sono visibili sulle riproduzioni.	M K
LSI	-	IDENTIFICATION DATA	3SB1000-2AB01	3SB1400-0B	3SB1400-0C	3SB1000-2EB01	3SB1400-0B	3SB1400-0C		14A		.20					.π -≲	
FOLIPMENT		NTS DESCRIPTION APPLICATION	POSITIONS 3SB	SELECTOR SWITCH 3SB	FOR SELECTOR SWITCH 3SB	POS. SPRING RET. 3SB		SELECTOR SWITCH 3SB	VAC MY4	PYF04A	10-P013A)	00x200 GS4420					The master version of this document is stored as a digital file in a softigare archive. Approval process L'originale del presente documento risiede in un database digitale. Il processo di approvazione è gestito v	SABIZ 8000 Kg/h
		EQUIPMENTS DE AND APPLIC	SELECTOR SWITCH 2 PA	CONTACT 1 NO FOR SE	CONTACT 1 NC FOR SE	SELECTOR SWITCH 3 PA	CONTACT 1 NO FOR SELECTOR SWITCH	CONTACT 1 NC FOR SE	RELAY 4 CONTACT 110VAC	SOCKET FOR RELAY	LABEL (Dwg:15629-CC10-P013A)	CONTROL PANEL 400x400x200					nt Is stored as a digital fil	21-00-12
	-		3 SAZ SAZ SAZ SAZ		2 SA2 CC	1 SA3 SE	1 SA3 C(1 SA3 CC	1 KASA1 RE	1 KASA1 SC	4 – A	- 5					The master version of this document is stared L'originale del presente documento rislede in un	O SISTEMENT OF THE CHIEF HER
											<u>-</u> -					_	The master v Coniginale del	0 ISSUE