



Speaker Voltage

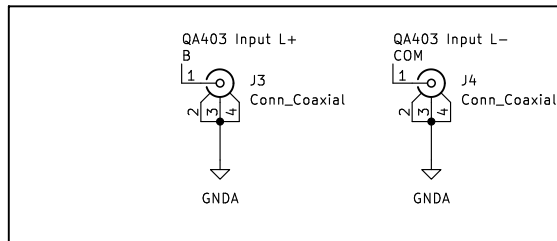


Speaker Current

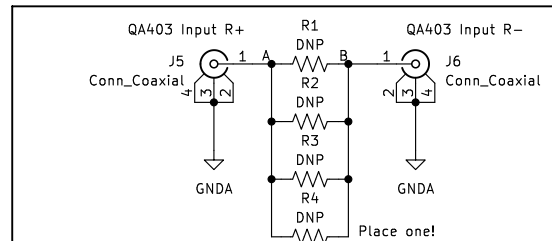


GNDA is ground of the test equipment which may or may not be same as COM (AMP-)

Input/Output

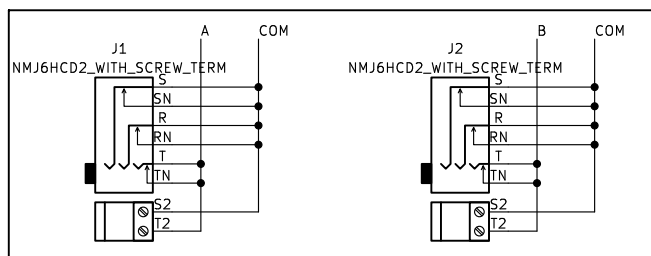

Connections to QA403 & Nets

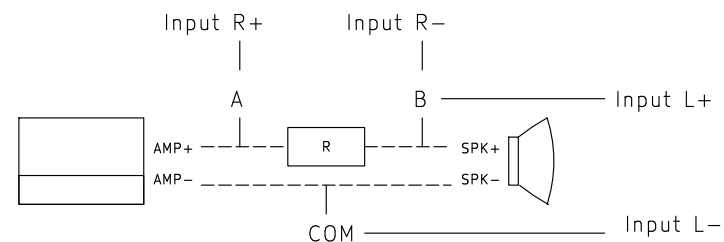

For use with Quantasylum QA403

Exciton Labs Ltd

Sheet: /

File: QA403 Impedance Fixture.kicad_sch

Title: Speaker Impedance Fixture

Size: A4 Date: 2023-08-03

KiCad E.D.A. kicad 7.0.1

Rev: 2

Id: 1/1