



## Speaker Voltage

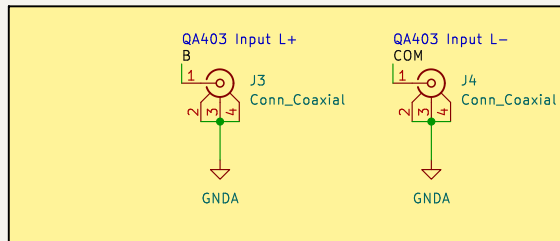


## Speaker Current

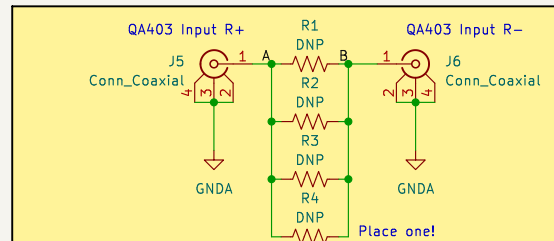


GNDA is ground of the test equipment which may or may not be same as COM (AMP-)

## Input/Output

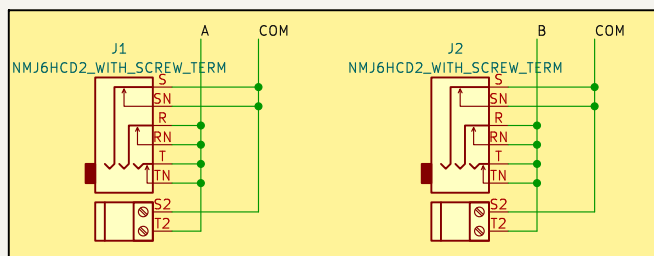

## Connections to QA403 & Nets

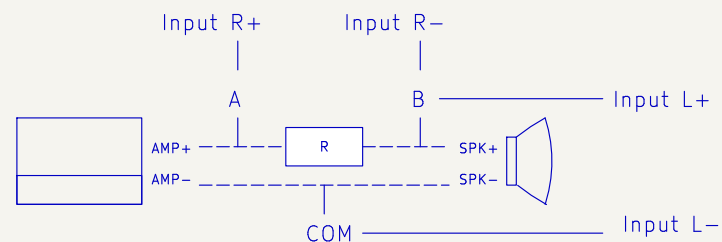

For use with Quantasylum QA403

**Exciton Labs Ltd**

Sheet: /

File: QA403 Impedance Fixture.kicad\_sch

**Title: Speaker Impedance Fixture**

Size: A4 Date: 2023-07-19

KiCad E.D.A. kicad 7.0.1

**Rev: 1**

Id: 1/1