



PRODUCT IDENTIFICATION

Collagen Peptides Kids Gummies

60 gummies · ≥99% HPLC


|                                                      |                                     |
|------------------------------------------------------|-------------------------------------|
| AMINO ACID SEQUENCE<br>Sequence available on request |                                     |
| PRODUCT NAME<br>Collagen Peptides Kids Gummies       | CATALOGUE NO.<br>AV-COL-046         |
| LOT / BATCH NO.<br>ALV-926547                        | CAS NO.<br>—                        |
| MOLECULAR FORMULA<br>—                               | MOLECULAR WEIGHT<br>—               |
| QUANTITY / VIAL<br>60 gummies                        | PHYSICAL FORM<br>Lyophilised powder |
| MANUFACTURE DATE<br>2026-02-15                       | RE-TEST DATE<br>2028-02-15          |
| STORAGE<br>-20 °C, desiccated, protected from light  | PURITY GRADE<br>≥ 99% (HPLC)        |

SPECIFICATIONS & RESULTS


| TEST                  | METHOD         | SPECIFICATION                         | RESULT       | PASS |
|-----------------------|----------------|---------------------------------------|--------------|------|
| Appearance            | Visual         | White to off-white lyophilised powder | White powder | ✓    |
| Identity (ESI-MS)     | LC-MS          | Consistent with structure             | Conforms     | ✓    |
| Purity (RP-HPLC)      | HPLC-UV 220 nm | ≥ 99.0 %                              | 99.4 %       | ✓    |
| Single Impurity (max) | RP-HPLC        | ≤ 1.0 %                               | 0.34 %       | ✓    |
| Net Peptide Content   | UV / nitrogen  | ≥ 80.0 %                              | 83.6 %       | ✓    |
| Water Content         | Karl Fischer   | ≤ 8.0 %                               | 5.6 %        | ✓    |
| Acetate Content       | Ion HPLC       | ≤ 15.0 %                              | 10.9 %       | ✓    |
| Bacterial Endotoxin   | LAL            | < 10 EU/mg                            | < 1 EU/mg    | ✓    |

RP-HPLC CHROMATOGRAM

Column C18 · 220 nm · 1.0 mL/min

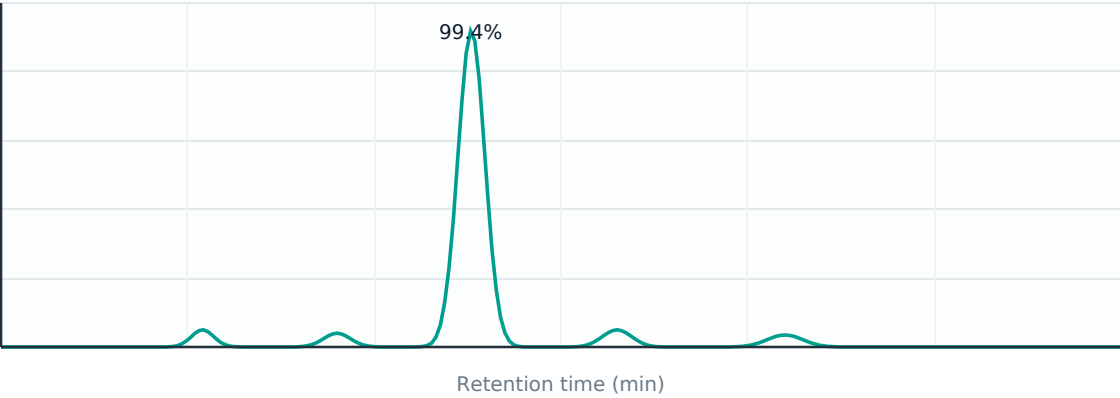

ESI-MS

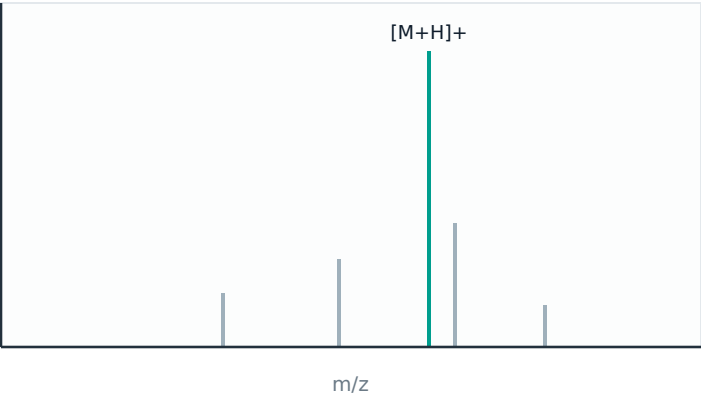

RESULT: CONFORMS — This batch meets all Alluvia Peptides release specifications.  
FOR LABORATORY RESEARCH USE ONLY. Not for human or veterinary use, diagnostic or therapeutic application.

RELEASED BY (QUALITY CONTROL)

A. Mercer

Dr. Aria Mercer — QC Manager, Analytical Services  
Date of issue: 2026-02-15

