
CASA ÁNGEL · CLIMATIZACIÓN · FICHA CI-PE-01 · ATELIER

02. Planta Entrepiso · 94,62 ml · 19,36 m² · 4,89 m/m² · CO-N S04 · completo

CI-PE-01 · planta 1:20

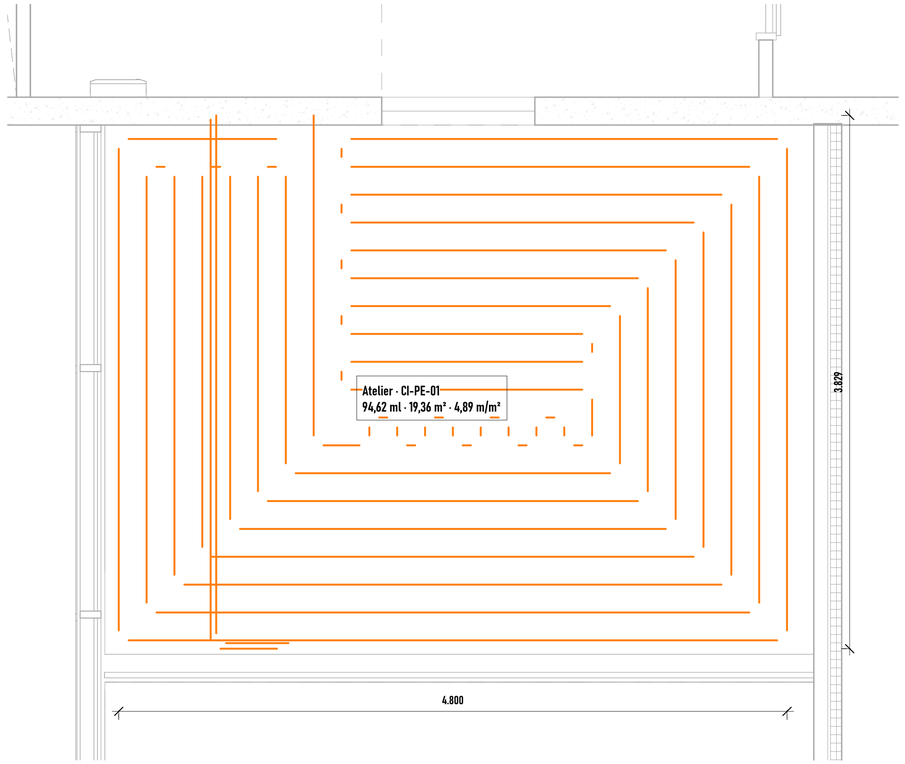

Datos del circuito 1:10

Ficha CI-PE-01

Local: Atelier · 02. Planta Entrepiso
Circuito: CI-PE-01
Tubo PEX Ø20: 94,62 ml (ida 65,79 · retorno 28,84)
Superficie servida: 19,36 m²
Densidad: 4,89 m/m² · paso equivalente 0,20 m
Colector: CO-N · salida S04
Termostato: (ninguno en el modelo)
Estado: completo (completo ≥ 4 m/m²)

Referencias

Trazo de color: serpentín de este circuito sobre el eje del tubo del modelo
Cuadrado: termostato · arquitectura vinculada en medio tono
Cotas: extensión del serpentín (m)

Climatización R32 (archivo de documentación con el modelo principal vinculado). Piso radiante: serpentines PEX Ø20 (mando + retorno) trazados sobre el eje de cada tubo del modelo; colector de cada circuito por conectividad de tubos y accesorios. Densidad completa ≥ 4 m/m². Bomba de calor: no modelada.

https://ezeader.myportfolio.com/ezequiel-ader

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

No.	Description	Date

Angel Luis Brusca

CASA ANGEL

CLI-F-CI-PE-01

Project number	0001
Date	18 de Agosto, 2025
Drawn by	Author
Checked by	Checker
Climatiz. · CI-PE-01	
Scale	As indicated

10/26/2026 10:06:47 AM