

CASA ÁNGEL · CLIMATIZACIÓN · CIRCUITO CI-PA-01 · BAÑO PA

CI-PA-01 · Baño PA · 33,35 ml · 5,74 m/m²

CI-PA-01 · planta 1:15

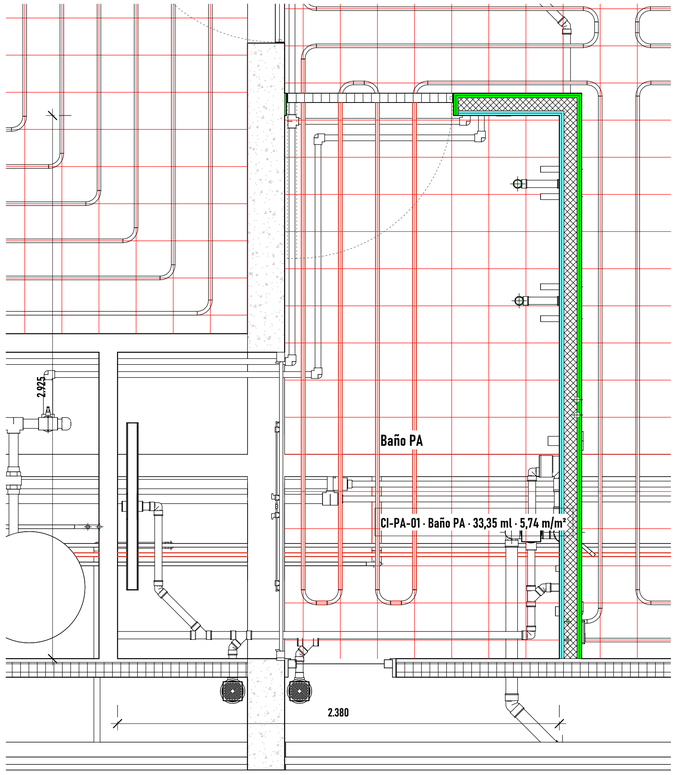

CI-PA-01 · axonométrica 1:15

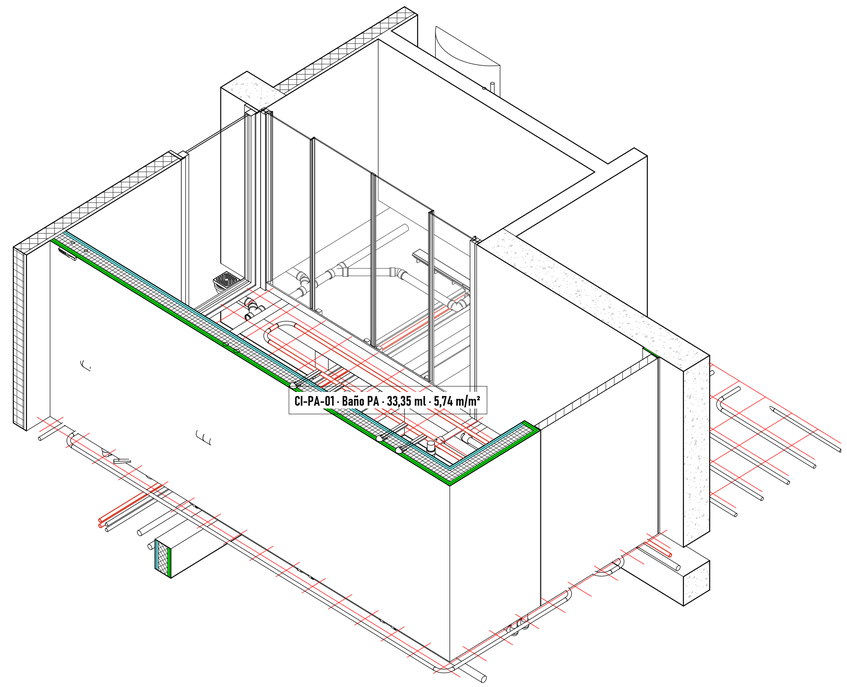

CI-PA-01 · Baño PA · 33,35 ml · 5,74 m/m²
Mando 22,22 ml · Retorno 11,13 ml · Local 5,81 m²
Densidad 5,74 m/m² (paso 15 cm ≈ 6,7 m/m²) · completo
Sistemas Revit: Hydronic Supply 13, Hydronic Supply 19

Climatización: piso radiante con serpentines PEX Ø20 (mando + retorno) según el modelo. Longitudes por local tomadas en el nivel de cada tramo. Bomba de calor, circuitos por salida de colector y sistemas de retorno: no modelado / a definir.

https://ezeader.myportfolio.com/ezequiel-ader

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

No.	Description	Date

Angel Luis Brusca

CASA ANGEL

CLI-F-CI-PA-01

Project number	0001
Date	18 de Agosto, 2025
Drawn by	Author
Checked by	Checker

Climatización · CI-PA-01

Scale 1 : 15

10/23/2025 4:33 PM