

CASA ÁNGEL · CLIMATIZACIÓN · CIRCUITO CI-PB-05 · CUARTO A INV.

CI-PB-05 · Cuarto A Inv. · 27,41 ml · 2,31 m/m²

CI-PB-05 · planta 1:15

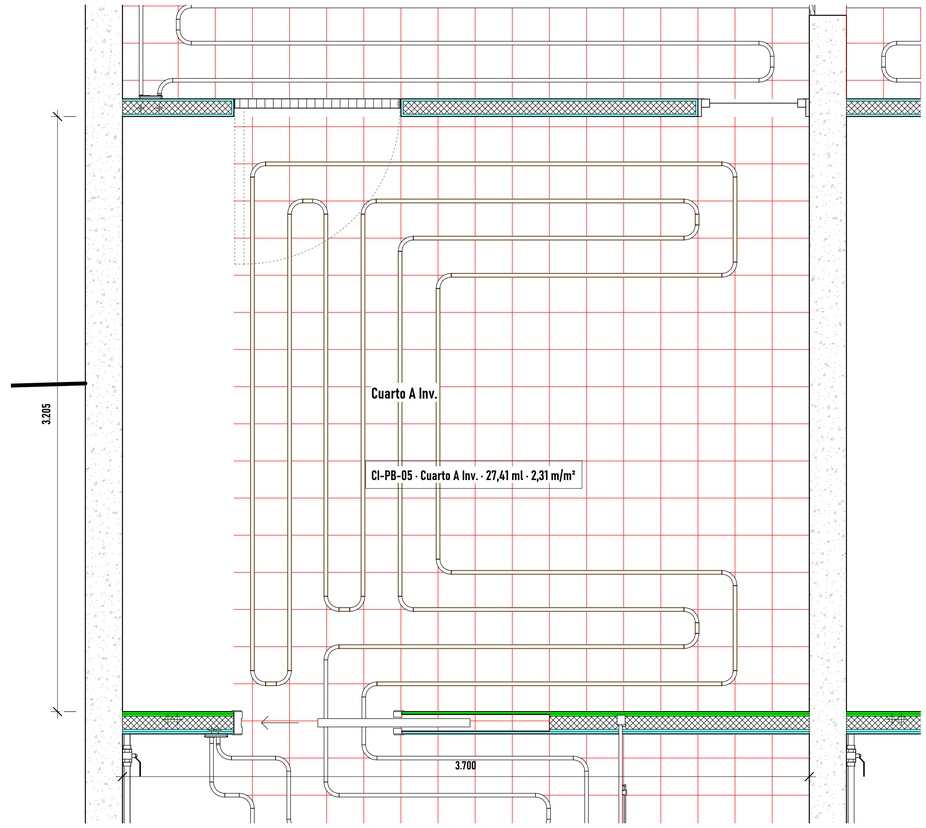

CI-PB-05 · axonométrica 1:25

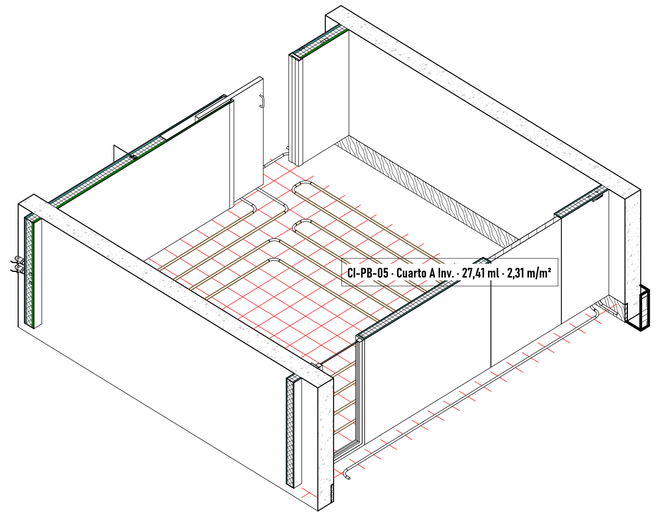

CI-PB-05 · Cuarto A Inv. · 27,41 ml · 2,31 m/m²
Mando 14,83 ml · Retorno 12,58 ml · Local 11,86 m²
Densidad 2,31 m/m² (paso 15 cm ≈ 6,7 m/m²) · incompleto o solo distribución (densidad < 4 m/m²)
Sistemas Revit: Hydronic Supply 13

Climatización: piso radiante con serpentines PEX Ø20 (mando + retorno) según el modelo. Longitudes por local tomadas en el nivel de cada tramo. Bomba de calor, circuitos por salida de colector y sistemas de retorno: no modelado / a definir.

https://ezeader.myportfolio.com/ezequiel-ader

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

No.	Description	Date

Angel Luis Brusca

CASA ANGEL

CLI-F-CI-PB-05

Project number	0001
Date	18 de Agosto, 2025
Drawn by	Author
Checked by	Checker

Climatización · CI-PB-05

Scale 1 : 15

10/23/2025 5:13 PM