

CASA ÁNGEL · CLIMATIZACIÓN · CIRCUITO CI-PB-10 · LAVADERO

CI-PB-10 · Lavadero · 23,26 ml · 3,50 m/m²

CI-PB-10 · planta 1:15

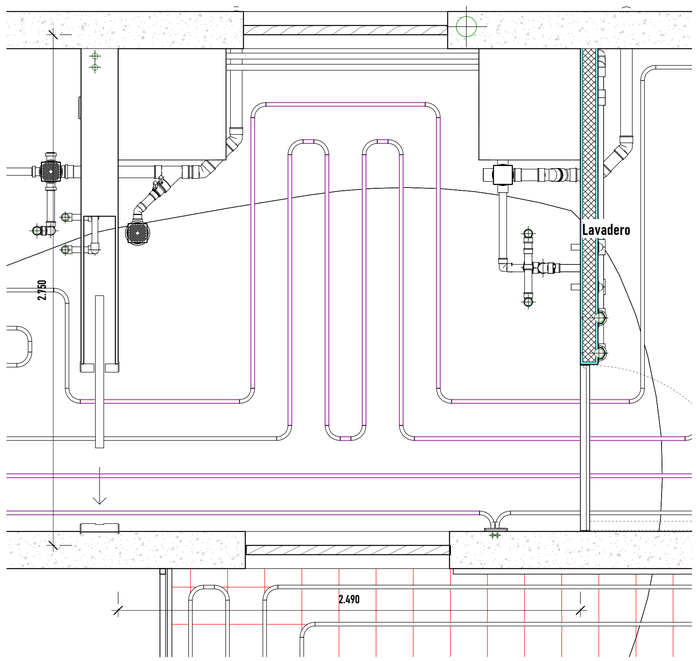

CI-PB-10 · axonométrica 1:15

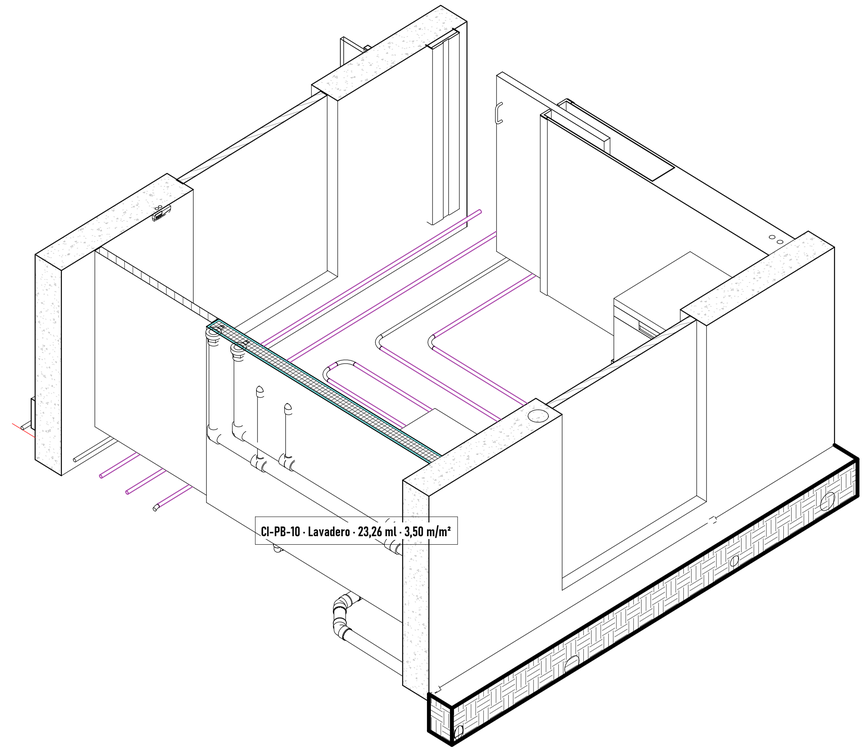

CI-PB-10 · Lavadero · 23,26 ml · 3,50 m/m²
Mando 9,34 ml · Retorno 13,92 ml · Local 6,64 m²
Densidad 3,50 m/m² (paso 15 cm ≈ 6,7 m/m²) · incompleto o solo distribución (densidad < 4 m/m²)
Sistemas Revit: Hydronic Supply 3

Climatización: piso radiante con serpentines PEX Ø20 (mando + retorno) según el modelo. Longitudes por local tomadas en el nivel de cada tramo. Bomba de calor, circuitos por salida de colector y sistemas de retorno: no modelado / a definir.

https://ezeader.myportfolio.com/ezequiel-ader

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

Consultant
Address
Address
Phone
Fax
e-mail

No.	Description	Date

Angel Luis Brusca

CASA ANGEL

CLI-F-CI-PB-10

Project number	0001
Date	18 de Agosto, 2025
Drawn by	Author
Checked by	Checker
Climatización · CI-PB-10	
Scale	1 : 15

10/23/2025 5:23 PM