

GENERAL NOTES:


- 1. FOR SYMBOLS, ABBREVIATIONS AND GENERAL NOTES, REFER TO LEGEND SHEETS G3ZR-COM-225-PID-001-0001-01 TO G3ZR-COM-225-PID-001-0008-01.
- 2. PIPING DEADLEGS AND POCKETS SHALL BE ELIMINATED.

NOTES:

- 1. TAGS PREFIXED WITH GW02-WP01A.
- 2. TAGS PREFIXED WITH GW02-WP01B.
- 3. TAGS PREFIXED WITH GW02-WP01.
- 4. AUTOMATIC CHANGEOVER BETWEEN DUTY / STANDBY PUMP ON DUTY PUMP FAILURE TO MAINTAIN ADEQUATE PRESSURE IN THE UTILITY WATER HEADER.
- 5. 2 X 100% PUMPS. DATA SHOWN IS FOR A SINGLE PUMP.

HOLDS:

- 1. DRIVER RATED POWER TO BE CONFIRMED DURING EPC.

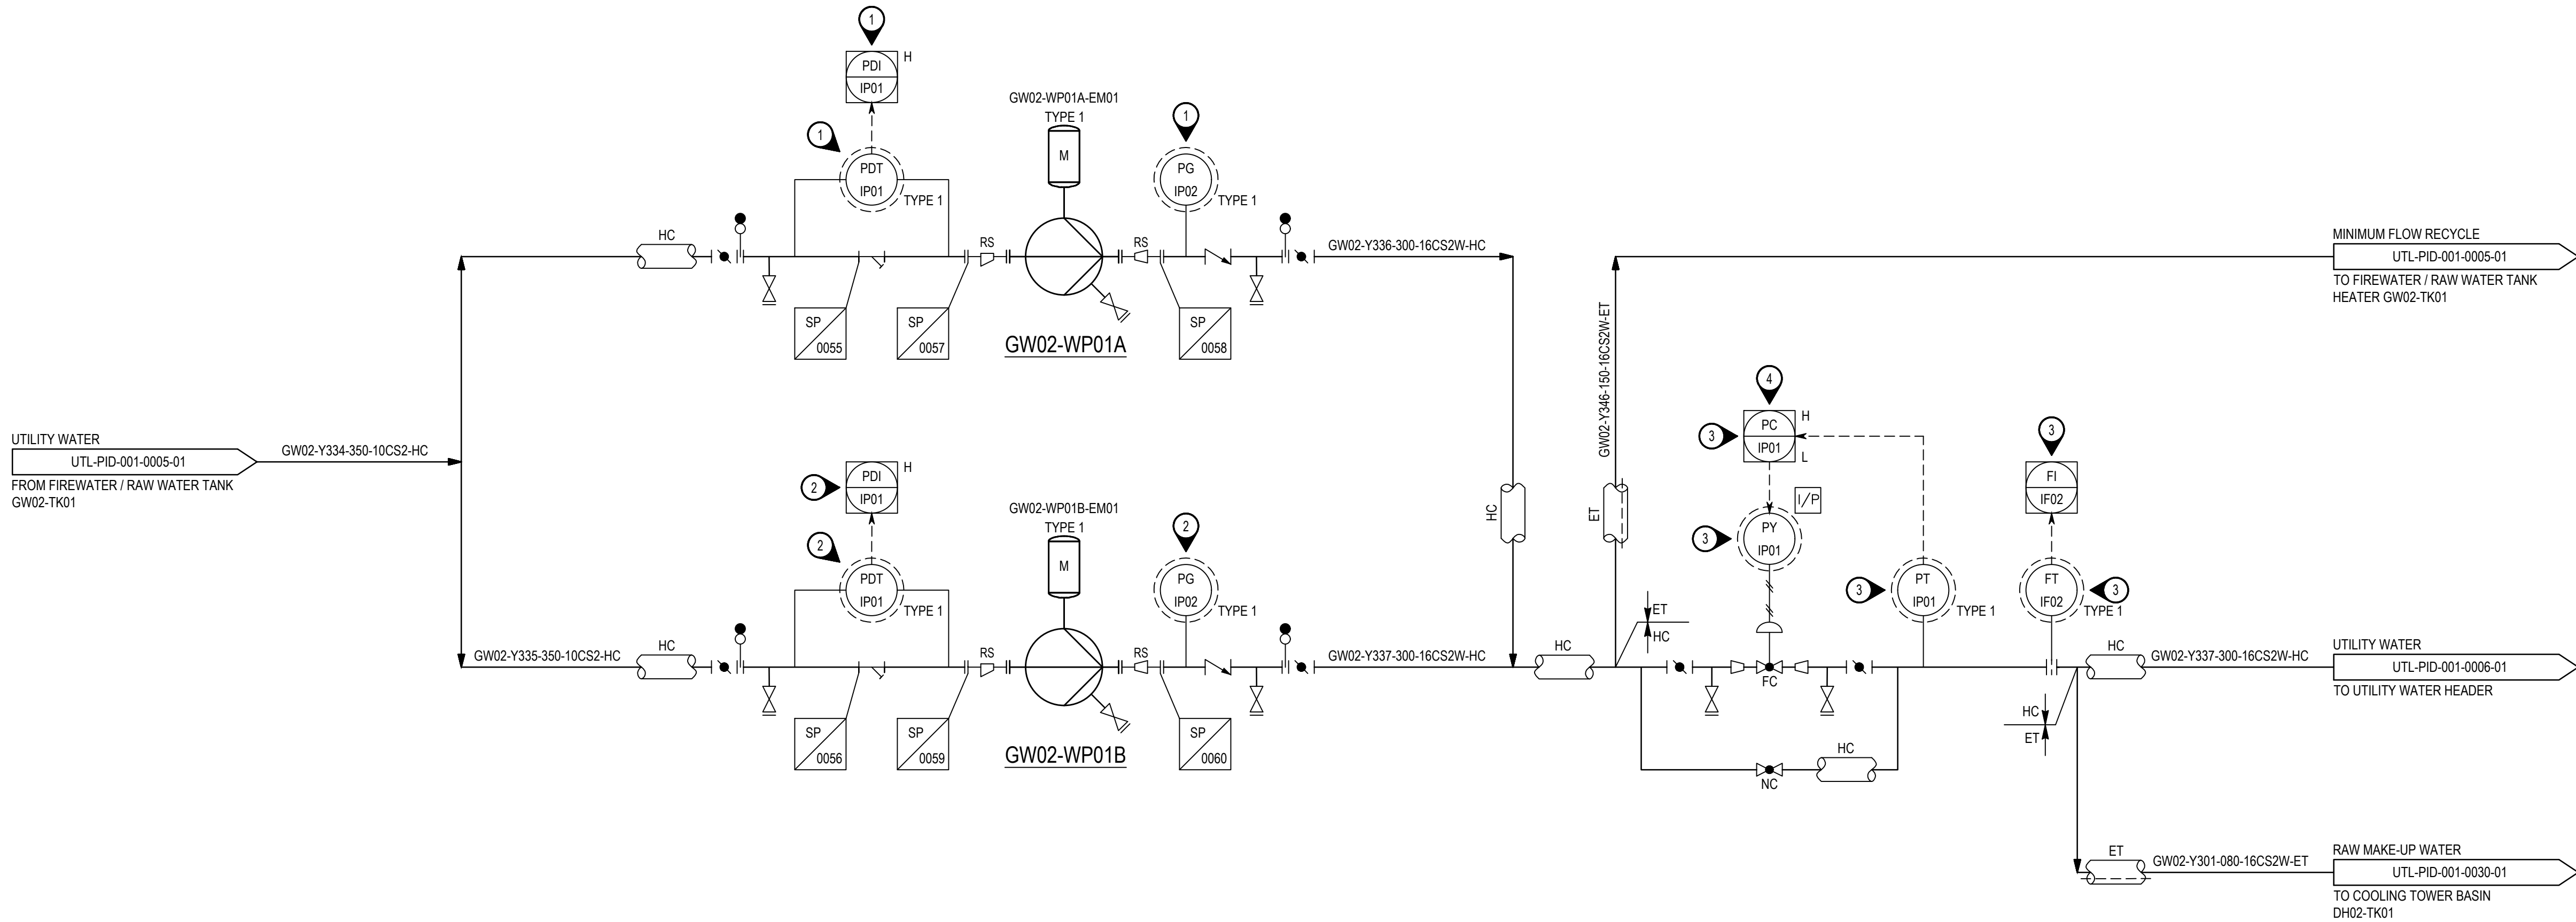

GW02-WP01A/B
RAW / UTILITY WATER PUMPS
DESIGN CAPACITY: 668.2 m³/hr
RATED DIFFERENTIAL HEAD: 62.55 m
DRIVER RATED POWER: 250 kW (HOLD 1)
IMPELLER MATERIALS: 12% Cr
CASING MATERIALS: CS
INSULATION: ET
TRIM: Y344-16CS2W-ET (GW02-WP01 A)
Y345-16CS2W-ET (GW02-WP01 B)

THIS P&ID HAS BEEN ISSUED DIRECTLY IFH, AS IT IS SPLIT FROM G3ZR-UTL-225-PID-001-0005-01.

NOTICE: THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF FLUOR AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT IS FURNISHED.

A	11MAR2025	IFH	ISSUED FOR HAZOP	AG	HCH	HCH/RS	KM
REV	DATE	STATUS	REVISION DESCRIPTION	BY	CHK	APP	CLIENT



GEZERO PROJECT



PIPING AND INSTRUMENTATION DIAGRAM
RAW / UTILITY WATER PUMPS

SCALE	DRAWING NUMBER	SIZE	REVISION
N/A	G3ZR-UTL-225-PID-001-0013-01	A1	A

FILE NAME: G3ZR-UTL-225-PID-001-0013-01_B.dwg