

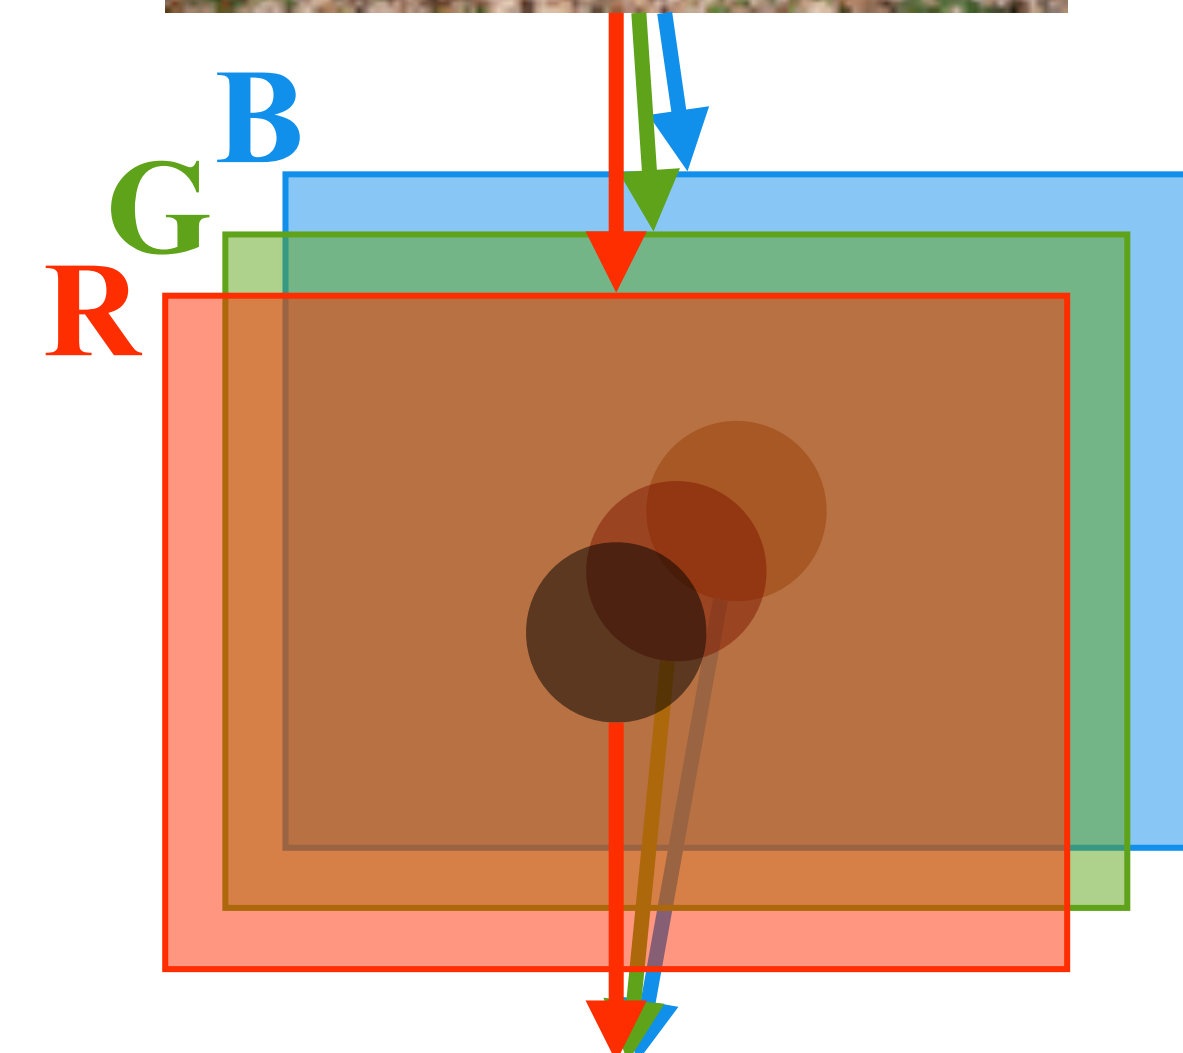


Hazy Image

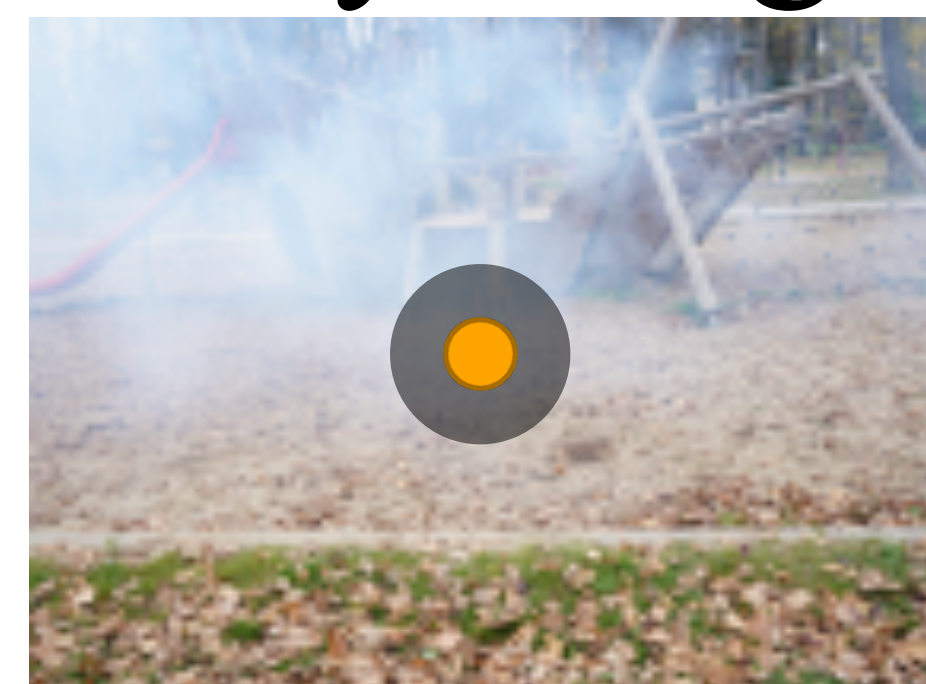


minimum value

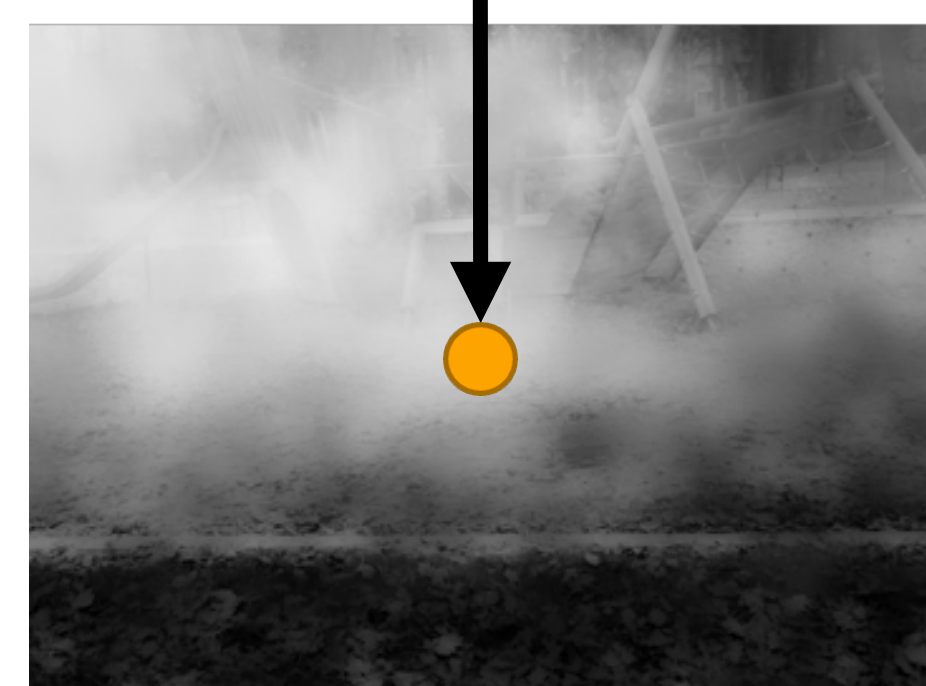


Continuous Density Mask

(a) Input Prior

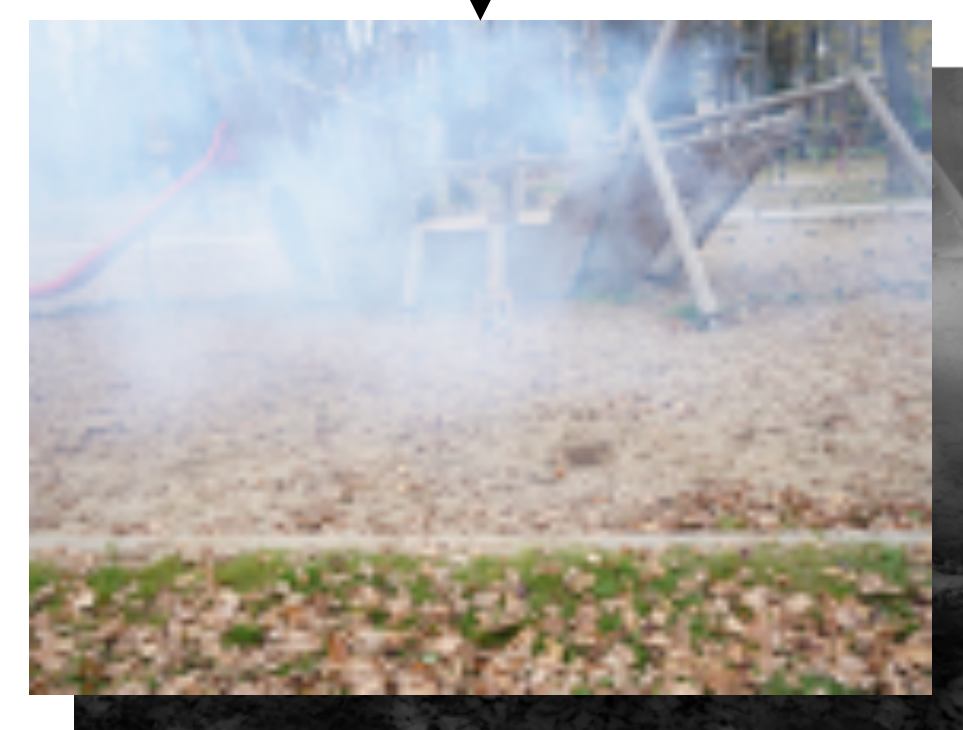


Model Input

Dehazed Image

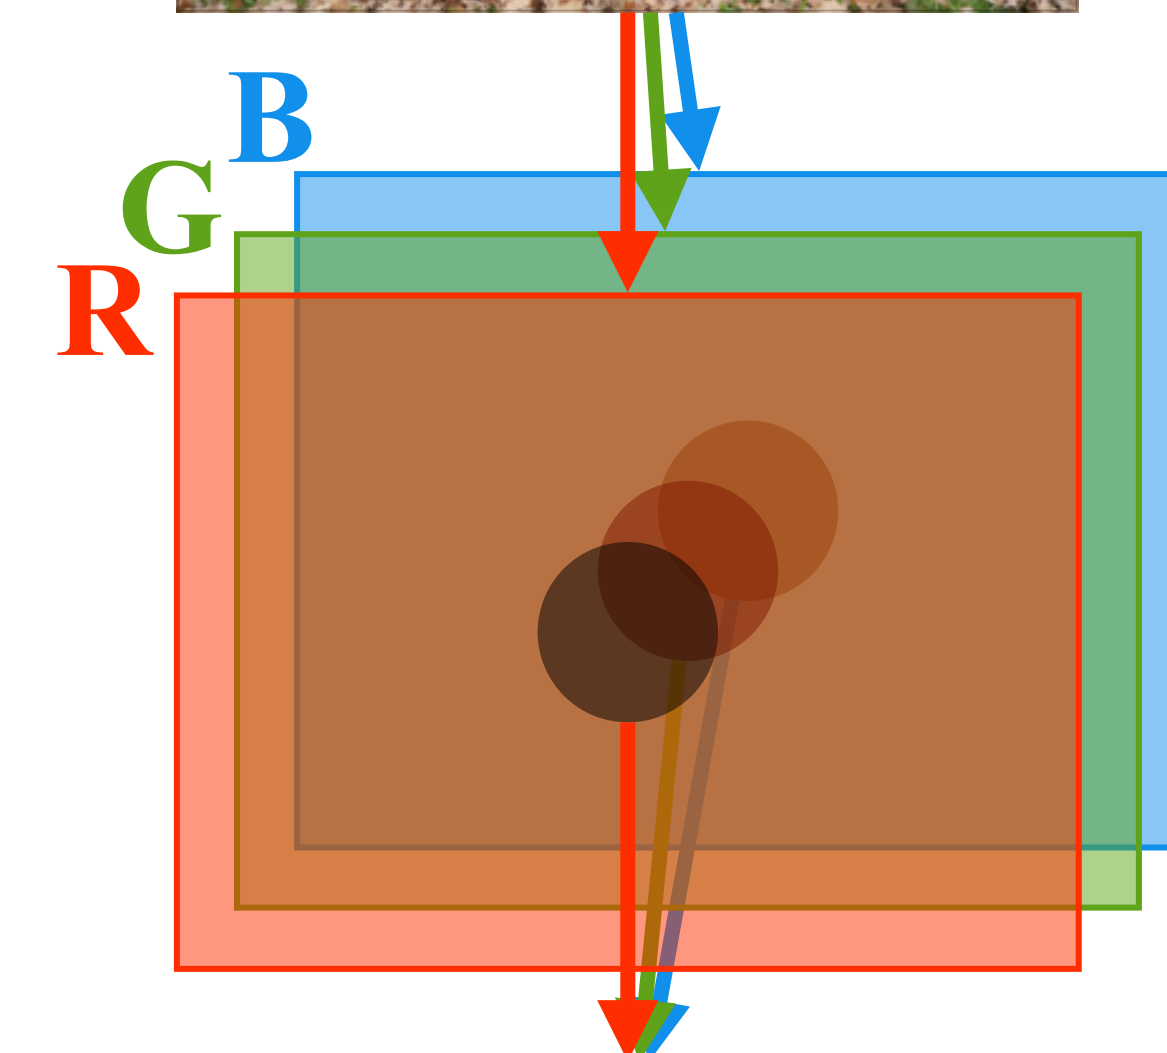


minimum value

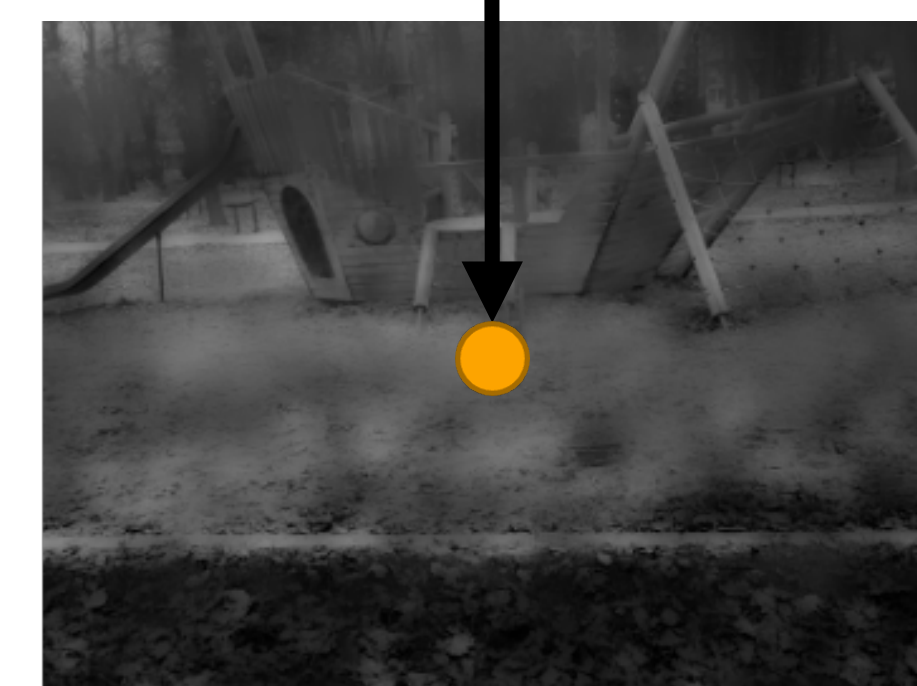


Continuous Density Mask

Ground Truth

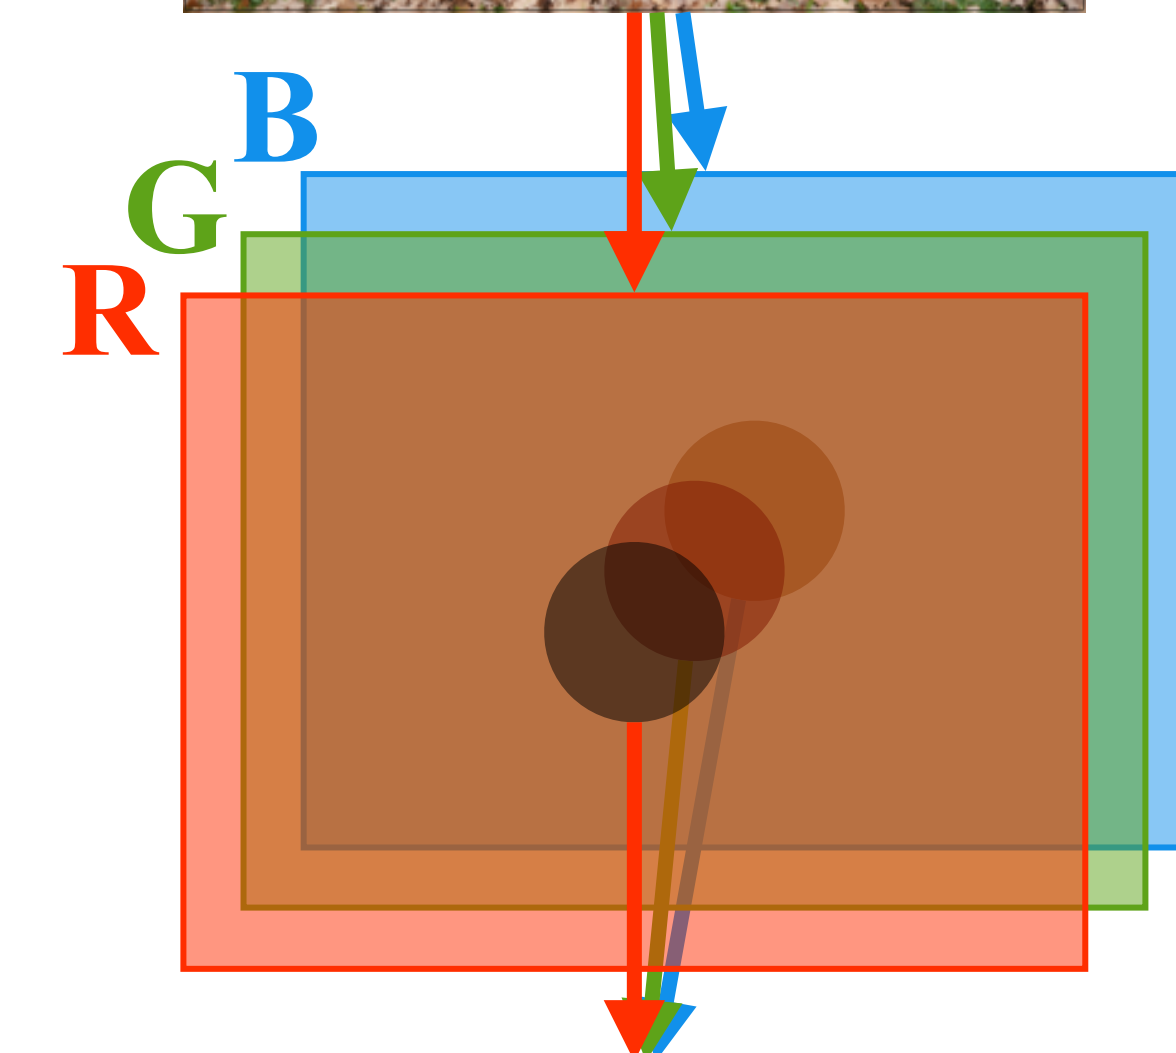

minimum value

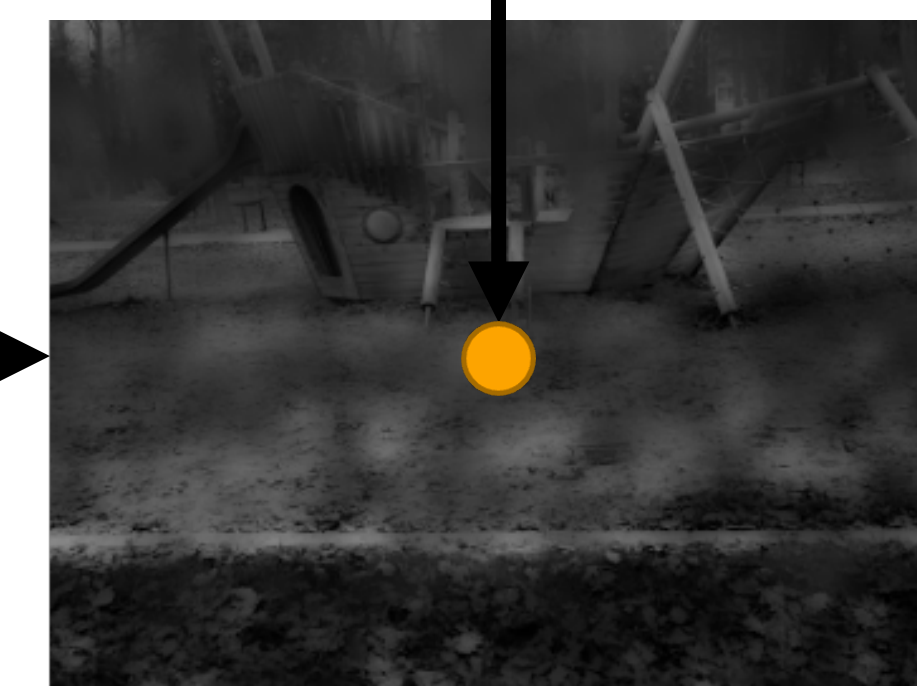

Continuous Density Mask

Loss

(b) Auxiliary Loss