


The binding constraint changes by parameter

Eight parameters against nine evidence dimensions

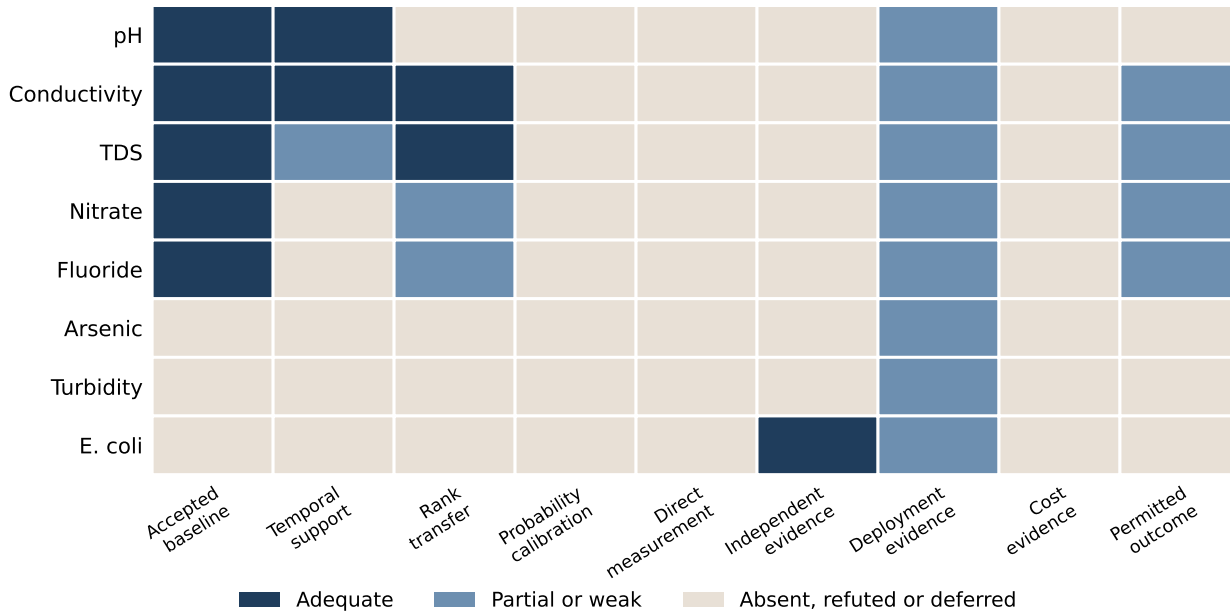

No cell is a score. Each is a recorded verdict from the canonical files: accepted population, temporal gate, transfer verdict, calibration verdict, independent evidence cells, implementation and cost documentation, and the permitted terminal outcome. Arsenic, turbidity and E. coli are constrained at the data layer; pH at transfer; the remaining four reach rank transfer and are then constrained by calibration and by product evidence.