


Phase41c Ablation & Comparison — Accuracy / Macro F1 / Kappa  
Dashed lines = Baseline (phase41c: Acc 73.33%, F1 0.7340,  $\kappa$  0.7005)

### Ablation Study



### Comparison Study

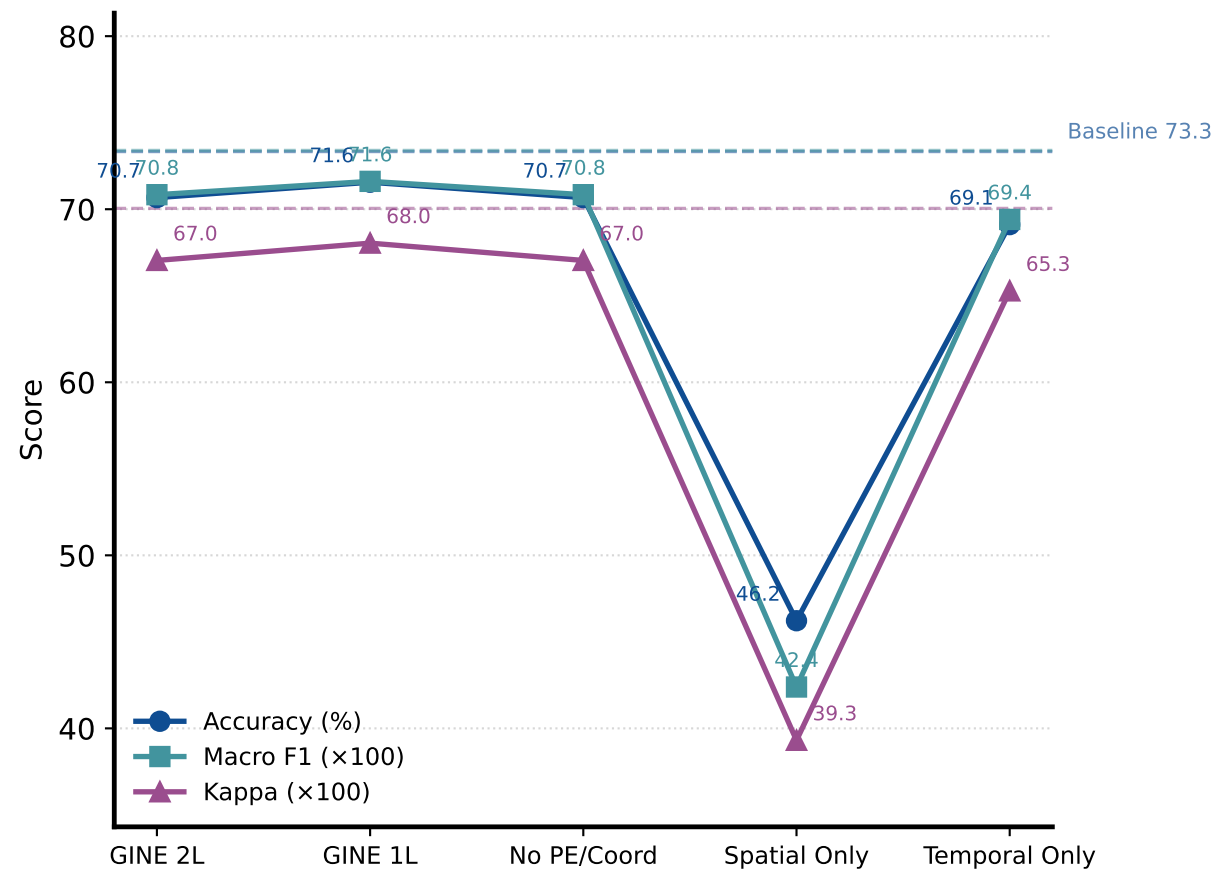