160008222171

中国认可
国际互认
检测
TESTING
CNAS L0095

INTERNATIONAL CERTIFICATION TEST REPORT

Application No: 2020G8536288131

Report Ref. No: GT0012019-0579-M1

Name of product: 1. Flush-type 13A Switched socket-outlet with Earthing-contact and shutter

2. Flush-type 13A Switched socket-outlet with Earthing-contact, shutter and indicator lamp

Model: 1. 282432, 282432-C, 282432-C1, 282432-C2, 282432-C3, 282433, 282433-C, 282433-C1, 282433-C2, 282433-C3 13A 250V~

2. 282480, 282480-C, 282480-C1, 282481, 282481-C, 282481-C1, *282480-C2, 282480-C3, 282481-C2, 282481-C3* 13A 250V~

Name of Laboratory: Vkan Certification & Testing Co., Ltd.

检验检测专用章

VKAN CERTIFICATION & TESTING CO., LTD.

TEST REPORT
BS1363-2
13A plugs, socket-outlets, adaptors and connection units Part 2. Specification for 13 A switched and unswitched socket-outlets

Report Number.....:	GT0012019-0579-M1
Date of issue .....:	September 24, 2020
Total number of pages	36
Applicant's name .....:	TCL-Legrand International Electrical (Huizhou) Co., Ltd.
Address .....:	Bldg. B1-B3, East No.39 Hechang 6th Rd., HZZK Hi-tech Industrial Development Zone, Huizhou, Guangdong, P.R.China
Test specification:	
Standard .....:	BS 1363-2: 2016+A1:2018
Test procedure .....:	GTR For Low Voltage Electrical Equipment and Appliances
Non-standard test method.....:	N/A
Test Report Form No. .....:	GCC-BS1363_2A2
Test Report Form(s) Originator ..:	CVC.
Master TRF .....:	Dated 2018-05
Test item description.....:	1. Flush-type 13A Switched socket-outlet with Earthing-contact and shutter 2. Flush-type 13A Switched socket-outlet with Earthing-contact, shutter and indicator lamp
Trade Mark.....:	legrand
Manufacturer .....:	LEGRAND FRANCE
Address of Manufacturer.....:	128, Avenue du Marechal de Lattre de Tassigny 87045 LIMOGES Cedex-France
Model/Type reference.....:	1. 282432, 282432-C, 282432-C1, 282432-C2, 282432-C3, 282433, 282433-C, 282433-C1, 282433-C2, 282433-C3 2. 282480, 282480-C, 282480-C1, 282481, 282481-C, 282481-C1, ***282480-C2, 282480-C3, 282481-C2, 282481-C3***
Ratings.....:	1. 13A 250V~ 2. 13A 250V~

Testing procedure and testing location:		
☒ **Testing Laboratory:**	Vkan Certification & Testing Co., Ltd.	
Testing location/ address.....:	No. 3, Tiantaiyi Road, Kaitai Avenue, Science City, Guangzhou, 510663, P.R. China	
Tested by (name,function,signature).....:	Li Zhongyao, Engineer	Li zhong yao
Approved by (name, function, signature).:	Liu Bo, Manager	Liu Bo

Copy of marking plate

Select 282481-C2 as the representative model:

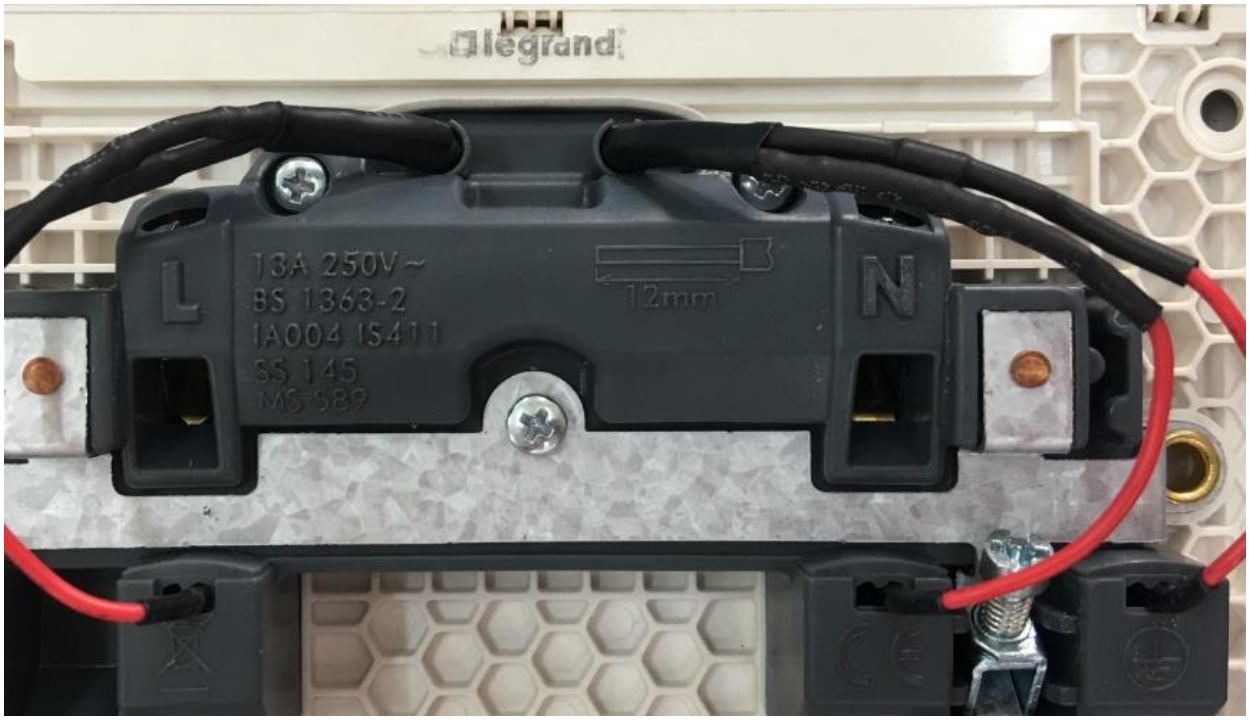

Other type's copy of marking plate sees Annex 3.

Test item particulars ..... :	
Standard Sheet .....:	13.9 of BS 1363-2: 2016+A1:2018
Rated current (A) / Rated voltage (V) ..... :	13A / 250V
Degree of protection against access to hazardous parts and against harmful ingress of solid foreign objects ..... :	IP2X
Degree of protection against harmful ingress of water ..... :	IPX0
Provision for earthing ..... :	With earthing contact
Method of connecting the cable ..... :	N/A
Type of cable ..... :	N/A
Nominal cross-sectional areas (mm^2) ..... :	N/A
Type of terminals ..... :	Pillar terminals
Type of connections ..... :	N/A
Socket-outlets:	
Degree of protection against electric shock ..... :	Normal protection
Existence of shutters ..... :	With shutters
Method of application / mounting of the socket-outlet ..... :	Flush-type
Method of installation .....:	Design A
Intended for circuits where ..... :	A single earthing circuit provides protective earthing
Switched socket-outlets without interlock:	
According to the method of actuating the switch..... :	Rocker
According to the switching of the neutral ..... :	Un-switched neutral
Possible test case verdicts:	
- test case does not apply to the test object .....:	N/A
- test object does meet the requirement.....:	P (Pass)
- test object does not meet the requirement .....:	F (Fail)
Testing .....:	
Date of receipt of test item .....:	2020-08-04
Date (s) of performance of tests .....:	From 2020-08-10 to 2020-09-24

General remarks:

The test results presented in this report relate only to the object tested.
This report shall not be reproduced, except in full, without the written approval of the Issuing testing laboratory.
"(See Enclosure #)" refers to additional information appended to the report.
"(See appended table)" refers to a table appended to the report.

Throughout this report a ☒ comma / ☐ point is used as the decimal separator.

Name and address of factory.....:	TCL-Legrand International Electrical (Huizhou) Co., Ltd Bldg. B1-B3, East No.39 Hechang 6th Rd., HZZK Hi-tech Industrial Development Zone, Huizhou, Guangdong, P.R.China

Summary of testing:

1. This report is applicable to: Flush-type 13A Switched socket-outlet with Earthing-contact, shutter and indicator lamp: 282480-C2, 282480-C3, 282481-C2, 282481-C3 13A 250V~.
2. The original Test Report Ref. No. GT0012019-0579 dated November 15, 2019 was modified on September 24, 2020 including the following modifications:

   Details of the Modification are as follows:

   Added New models: 282480-C2, 282480-C3, 282481-C2, 282481-C3 13A 250V~. New models 282480-C2, 282480-C3, 282481-C2, 282481-C3 13A 250V~ are the same as the original models except the shape and appearance.

   Modification to clause concerned:

   ——Tests of sub-clause/clause 5, 6, 7, 8, 9.1, 13.1, 13.2, 13.3 of BS 1363-2: 2016+A1:2018 are carried out on 282480-C2, 282481-C2 13A 250V~.

   ——And tests of sub-clause/clause 5, 7 of BS 1363-2: 2016+A1:2018 are carried out on 282480-C3, 282481-C3 13A 250V~.
3. This report must be used in conjunction with the test report GT0012019-0579.
4. Sample identification:

   Group A: 282481-C2 13A 250V~; Group B: 282480-C2 13A 250V~;

   Group C: 282480-C3, 282481-C3 13A 250V~ .
5. The country which the product will be export to: United Arab Emirates, Kingdom of Bahrain, Sultanate of Oman, Republic of Yemen, State of Kuwait, State of Qatar.

The difference of samples:

MODEL	Number of outlets	Plate Colour	Dimensions
282481-C2	2	Golden	146mm × 88mm
282481-C3	2	Grey	146mm × 88mm
282480-C2	1	Golden	86mm × 88mm
282480-C3	1	Grey	86mm × 88mm

Remarks:

Annex 1: Test results of 282480-C3, 282481-C3 13A 250V~;

Annex 2: National difference to IEC 60884-2-3:2006 with IEC 60884-1:2002, AMD1:2006, AMD2:2013;

Annex 3: PHOTOGRAPHS.

SCHEDULE OF TEST

Set A: Tests of 282480-C2, 282481-C2 13A 250V~.

Sequence no.	Samples number	Clause number	Results
Test Sequence 1	A1#, A2#, A3#; B1#, B2#, B3#	5, 6, 7, 9.1, 13.1, 13.2, 13.3, 8 (except Annex C)	Pass

Set B: Tests of 282480-C3, 282481-C3 13A 250V~ (See Annex 1)

Sequence no.	Samples number	Clause number	Results
Test Sequence 1	C1#~C6#	5, 7	Pass

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict

Sequence no.1			P
5	**General conditions for type testing**		P
5.1	All tests shall be type tests		P
	Unless otherwise specified, the socket-outlets were tested as delivered by the manufacturer or responsible vendor and under normal conditions of use, at an ambient temperature of 20 °C ± 5 °C and after being conditioned at normal laboratory temperature and humidity levels for at least 4 days.		P
	Socket-outlets shall be deemed to comply if no specimen fails to complete the series of tests given in table 1		P
5.2	All inspections and tests, of any one classification (see clause 6), shall be carried out as specified in the clauses listed in Table 1 on the number of specimens in the sample column and in the order given		P
5.3	Gauges in accordance with Figure 11, Figure 12, Figure 14 and Figure 16 shall be considered to comply with the dimensional requirements.		P

6	**Classification**		P
	- single or multiple .....:	multiple (282481-C2) single (282480-C2)	—
	- switched or unswitched .....:	switched	—
	- fused or unfused.....:	unfused	—
	- fixed or portable.....:	fixed	—
	- (if fixed) flush or surface or panel-mounting.....:	flush-mounting	—
	- (if portable) rewireble or non- rewireble .....:		N/A
	- with or without indicator lamp.....:	with	—
	- IP rating if declared	IP20	—
	- screw-type or screwless terminals	Screw-type (Pillar terminals)	—
	- suitability for electric vehicle charging	Not for electric vehicle charging	—
	- incorporation of electronic components	Without USB charger	—

7	**Marking and labeling**		P
7.1	Socket-outlets shall be legibly and durably marked with the following information, which shall not be placed on screws, removable washers or other easily removable parts, or upon parts intended for separate sale:		P
	a) either the name, trade mark or identification mark of the manufacturer or responsible vendor, which may be duplicated on a removable fuse carrier……:	legrand	P
	b) the number of this British Standard, i.e. BS 1363……..:	BS 1363	P
	c) for portable socket-outlets the number of this British Standard shall be followed by '/A'……..:		N/A

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict
	d) for socket-outlets for electric vehicle charging, the number of this British Standard shall be followed by "/EV", this shall only be marked on the rear of a fixed socket-outlet		N/A
	e) on rewirable socket-outlets the terminals intended for the connection of the various conductors shall be identified by the symbols given in 7.5 .:	L, N, ⏚	P
	f) for fused socket-outlets, the words 'FUSE' or 'FUSED' or the symbol (given in 7.5) on the engagement surface of a socket-outlet…….:		N/A
	g) fixed fused multiple socket-outlets shall be marked on the engagement surface with the maximum rated current of 13A (e.g. MAX. 13A)……...:		N/A
	h) all socket-outlets shall be marked with the following:		P
	1) rated current, "13 A"…….…….:	13 A	P
	2) rated volts……. …….:	250 V	P
	3) nature of supply…… ……..:	~	P
	i) for socket-outlets with screwless terminals:		N/A
	1) an appropriate marking indicating the length of insulation to be removed before insertion of the conductor into the screwless terminal;		N/A
	2) an indication of the suitability to accept rigid conductors only for those socket-outlets having this restriction;		N/A
	3) an indication of the suitability to accept flexible conductors only for those socket-outlets having this restriction.		N/A
	j) where the declared IP classification is higher than IP20 then the IP classification shall be marked. The marking shall be discernible when the socket-outlet is mounted and wired as in normal use.		N/A
	Portable socket-outlets shall be marked on the accessible external surface		N/A
	In the case of a non-rewirable portable socket-outlet, the rated current shall be the maximum current appropriate to the attached flexible cord as given in table 2		N/A
7.1.1	Compliance shall be checked by inspection and by rubbing the marking for approximately 15 s with a cloth soaked in water , and again for approximately 15 s with a cloth soaked in an aliphatic solvent hexane		P
	After test, the marking shall remain legible		P
	Markings produced by an engraving or moulding process shall be deemed to conform without test.		P
7.2	Portable socket-outlets fitted with a flexible cord shall be supplied with a label or instructions indicating the colour coding of the cores of the flexible cord as following code:		N/A
	-Green/yellow core: to the earthing contact		N/A
	- Brown core: to the line contact		N/A
	-Blue core: to the neutral contact		N/A
7.3	Rewirable portable socket-outlets shall be provided with adequate instructions for the safe connection of the appropriate 3-core flexible cord, including clear instructions for the removal of insulation from the conductors		N/A
7.4	Symbols shall be comply with the standard		P

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict
7.5	Instructions for installation and use of socket-outlets having an IP classification greater than IP20 shall be provided.		N/A
9.1	Live parts of socket-outlets shall not be accessible		P
9.1.1	Compliance shall be checked by the application of the test pin shown in figure 1 perpendicular to the accessible external surface of the socket-outlet with a force of 5 N. It shall not be possible to touch live parts. SELV parts are not considered to be live parts for the purpose of this test.		P
13	**Construction of socket-outlets**		P
13.1	The disposition of the socket contact shall be as shown in figure 3		P
	The engagement surface shall be substantially flat.		P
	Any steps or profile contours on the engagement surface shall not result in the surface deviating from the plane of engagement by more than 3 mm		P
	Holes not exceeding 8 mm diameter for the purpose of assembly fixing shall be deemed acceptable		P
	There shall be no projection on the engagament surface of the socket-outlet such as would prevent the full insertion of a plug.		P
	If raised marking is used it shall not project more than 0.5 mm from the engagement surface and shall allow compliance with 13.2	No projections from the engagement surface	N/A
	The spacing of the socket contacts shall correspond with that of plug pins as specified in BS 1363-1: 2016		P
	Compliance shall be checked by inspection, measurement and the use of the gauges shown in figure 11	Complying	P
13.2	The line and neutral socket contacts in socket-outlets shall be positioned so as to make satisfactory contact with the corresponding pins of a plug in all positions that the contacts may occupy when the plug is correctly and fully inserted		P
	Compliance shall be checked by inspection and the use of the gauge shown in figure 12 and the circuit shown in figure 13. Both indicator lamps shall light	Both indicator lamps lighted	P
13.3	The travel of the end of either current-carrying pin from the front face of the socket-outlet to the first point of contact not less than 9.6mm		P
	Compliance shall be checked by inspection and the use of the gauge shown in figure 14 and the circuit shown in figure 13. Neither indicator lamps shall light	Neither indicator lamps lighted	P
8	**Creepage distances, clearances and distances through insulation**		P
8	Clearances		P

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict
	Accessories shall be constructed so that the clearances, creepage distances and solid insulation are adequate to withstand the electrical stresses taking into account the environmental influences that may occur. Clearances, creepage distances and solid insulation shall comply with the relevant requirements of 8.1, 8.2 and 8.3.		P
	The distance between lead wires in the pinch of a neon lamp with external resistor shall be a minimum of 1 mm.		N/A
	As a minimum, socket-outlets shall conform to the requirements for basic insulation in 8.1.1 and 8.1.2.		P
	Socket-outlets complying with the requirements for basic insulation shall be deemed to meet the requirements of this clause. If the manufacturer declares an insulation level exceeding basic insulation then the socket-outlet shall be tested accordingly.		P
8.1.1	Clearances for basic insulation		P
	The clearances for basic insulation shall not be less than the values given in Table 3 except as described below.		P
	Minimum clearance in air (mm)(table 3); measured value (mm)……..:	3; >3,90	P
	except as described below (by the test of annex F)		N/A
	Rated impulse withstand voltage (V); smaller minimum clearance in air(mm)(table 3);measured value(mm) ……:		—
8.1.2	Clearances for functional insulation		P
	Clearances for functional insulation shall not less than the values specified for basic insulation in 8.1.1		P
	Minimum clearance in air (mm)(table 3); measured value (mm)……..:	3; >3,90	P
	except as described below (by the test of annex F)		N/A
	Rated impulse withstand voltage (V); smaller minimum clearance in air(mm)(table 3);measured value(mm) ……:		—
8.1.3	Clearances for supplementary insulation		N/A
	Clearances for supplementary insulation shall not less than the values specified for basic insulation in 8.1.1		N/A
	Minimum clearance in air (mm)(table 3); measured value (mm)……..:		N/A
	except as described below (by the test of annex F)		N/A
	Rated impulse withstand voltage (V); smaller minimum clearance in air(mm)(table 3);measured value(mm)……:		—
8.1.4	Clearances for reinforced insulation		N/A
	Clearances for reinforced insulation shall not less than the values specified for basic insulation in 8.1.1		N/A
	Minimum clearance in air (mm) (table 3); measured value (mm)……..:		N/A

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict
	except as described below (by the test of annex F)		N/A
	Rated impulse withstand voltage (V); smaller minimum clearance in air(mm)(table 3);measured value(mm)……:		N/A
8.1.5	Contact gap		P
	The minimum contact gap shall be 1.2 mm in the open position……..:	1,2, >1,50	P
8.2	Creepage distances		P
	The creepage distances shall be dimensioned for the voltage, which is expected to occur in normal usetaking into account the pollution degree, and the material group as declared by the manufacturer		P
8.2.1	Creepage distances for basic insulation		P
	The creepage distances for basic insulation shall not be less than the valve given in table 4		P
	Minimum creepage distances (mm)(table 4); measured value (mm)……...……..:	3; >3,90	P
8.2.2	Creepage distances for functional insulation		P
	Creepage distances for functional insulation shall not less than the values specified for basic insulation in 8.2.1		P
	Minimum creepage distances (mm)(table 4); measured value (mm)……...……..:	3; >3,90	P
8.2.3	Creepage distances for supplementary insulation		N/A
	Creepage distances for supplementary insulation shall not less than the values specified for basic insulation in 8.2.1		N/A
8.2.4	Creepage distances for reinforced insulation		N/A
	Creepage distances for reinforced insulation shall not less than those derived from twice the distance specified for basic insulation in table 4		N/A
	Minimum creepage distances (mm) (table 4); measured value (mm)……...…….……..:		N/A
8.3	Solid insulation		P
	Solid insulation for basic, functional, supplementary and reinforced insulation shall be capable of withstanding electrical stresses which can occur in normal use		P
8.3.1	Conformity shall be checked by tests in accordance with 15.1.3 using the values given in Table 5		P
15.1.3	A 50Hz voltage of substantially sinusoidal waveform is applied as described in 15.1.2		P
	Test voltage (a.c., for 1 min)		P
	a)……..:	1500 V	P
	b)		P
	1)……..:	1500 V	P
	2)……..:	1500 V	P

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict
	3)……..:		N/A
	c)……..:	1500 V	P
	During the test, no flashover or breakdown shall occur		P
8.4	Printed wiring boards and equivalent construction shall conform to BS EN 60664-5:2007.		N/A
	Where coating, potting or moulding is used articles shall conform to BS EN 60664-3:2003+A1:2010		N/A

ANNEX 1

Set C: Tests of 282480-C3, 282481-C3 13A 250V~.

Sequence no.	Samples number	Clause number	Results
Test Sequence 1	C1#~C6#	5, 7	Pass

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict

Sequence no.1			P
5	**General conditions for type testing**		P
5.1	All tests shall be type tests		P
	Unless otherwise specified, the socket-outlets were tested as delivered by the manufacturer or responsible vendor and under normal conditions of use, at an ambient temperature of 20 °C ± 5 °C and after being conditioned at normal laboratory temperature and humidity levels for at least 4 days.		P
	Socket-outlets shall be deemed to comply if no specimen fails to complete the series of tests given in table 1		P
5.2	All inspections and tests, of any one classification (see clause 6), shall be carried out as specified in the clauses listed in Table 1 on the number of specimens in the sample column and in the order given		P
5.3	Gauges in accordance with Figure 11, Figure 12, Figure 14 and Figure 16 shall be considered to comply with the dimensional requirements.		P

7	**Marking and labeling**		P
7.1	Socket-outlets shall be legibly and durably marked with the following information, which shall not be placed on screws, removable washers or other easily removable parts, or upon parts intended for separate sale:		P
	a) either the name, trade mark or identification mark of the manufacturer or responsible vendor, which may be duplicated on a removable fuse carrier .....……:	legrand	P
	b) the number of this British Standard, i.e. BS 1363……..:	BS 1363	P
	c) for portable socket-outlets the number of this British Standard shall be followed by '/A' ..... ……:		N/A
	d) for socket-outlets for electric vehicle charging, the number of this British Standard shall be followed by "/EV", this shall only be marked on the rear of a fixed socket-outlet		N/A
	e) on rewirable socket-outlets the terminals intended for the connection of the various conductors shall be identified by the symbols given in 7.5 .....:	L, N, ⏚	P
	f) for fused socket-outlets, the words 'FUSE' or 'FUSED' or the symbol (given in 7.5) on the engagement surface of a socket-outlet……..:		N/A
	g) fixed fused multiple socket-outlets shall be marked on the engagement surface with the maximum rated current of 13A (e.g. MAX. 13A)……...:		N/A
	h) all socket-outlets shall be marked with the following:		P
	1) rated current, "13 A"……. ……:	13 A	P
	2) rated volts……. ……:	250 V	P

BS 1363 Part 2			
Cl.	Requirement – Test	Result	Verdict
	3) nature of supply……. ……..:	~	P
	i) for socket-outlets with screwless terminals:		N/A
	1) an appropriate marking indicating the length of insulation to be removed before insertion of the conductor into the screwless terminal;		N/A
	2) an indication of the suitability to accept rigid conductors only for those socket-outlets having this restriction;		N/A
	3) an indication of the suitability to accept flexible conductors only for those socket-outlets having this restriction.		N/A
	j) where the declared IP classification is higher than IP20 then the IP classification shall be marked. The marking shall be discernible when the socket-outlet is mounted and wired as in normal use.		N/A
	Portable socket-outlets shall be marked on the accessible external surface		N/A
	In the case of a non-rewirable portable socket-outlet, the rated current shall be the maximum current appropriate to the attached flexible cord as given in table 2		N/A
7.1.1	Compliance shall be checked by inspection and by rubbing the marking for approximately 15 s with a cloth soaked in water , and again for approximately 15 s with a cloth soaked in an aliphatic solvent hexane		P
	After test, the marking shall remain legible		P
	Markings produced by an engraving or moulding process shall be deemed to conform without test.		P
7.2	Portable socket-outlets fitted with a flexible cord shall be supplied with a label or instructions indicating the colour coding of the cores of the flexible cord as following code:		N/A
	-Green/yellow core: to the earthing contact		N/A
	- Brown core: to the line contact		N/A
	-Blue core: to the neutral contact		N/A
7.3	Rewirable portable socket-outlets shall be provided with adequate instructions for the safe connection of the appropriate 3-core flexible cord, including clear instructions for the removal of insulation from the conductors		N/A
7.4	Symbols shall be comply with the standard		P
7.5	Instructions for installation and use of socket-outlets having an IP classification greater than IP20 shall be provided.		N/A

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

Annex 2: National difference (IEC 60884-2-3:2006 with IEC 60884-1:2002, AMD1:2006, AMD2:2013)

8	**MARKING**		
8.1	Accessories marked as follows:		P
	- rated current (A) ..... :	13	P
	- rated voltage (V) ..... :	250	P
	- symbol for nature of supply ..... :	~	P
	- manufacturer's or responsible vendor's name ... :	legrand	P
	- type reference ..... :	282480-C2, 282480-C3, 282481-C2, 282481-C3	P
	- symbol for degree of protection (first digit) if higher than 2..... :		N/A
	- symbol for degree of protection (second digit) if higher than 0..... :		N/A
	Socket-outlets with screwless terminals marked with the following:		N/A
	- the length of insulation to be removed ..... :		N/A
	- an indication of the suitability to accept rigid conductors only (if any) ..... :		N/A
	Switched socket-outlets without interlock:		N/A
	Symbol of mini-gap construction		N/A
	Symbol OFF position		N/A
	Symbol ON position		N/A
8.2	Symbols used: as required in the standard		P
	Marking for the nature of supply placed next to the marking for rated current and rated voltage		P
	Mini-gap construction (m)……..:		N/A
	open position (off) ……..:		N/A
	Closed position (on) ……..:		N/A
8.3	Marking of fixed socket-outlets placed on the main part:		P
	- rated current, rated voltage and nature of supply		P
	- identification mark of the manufacturer or of the responsible vendor		P
	- length of insulation to be removed, if any		N/A
	- type reference		P
	Cover plates necessary for safety purposes and intended to be sold separately: marked with the manufacturer's or responsible vendor's name and type reference		N/A

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	IP code, if applicable: marked so as to be easily discernible		N/A
	Fixed socket-outlets classified according to item b) of 7.2.5: identified by a triangle visible after installation unless they have an interface configuration different from that used in normal circuits ..... :		N/A
8.5	Neutral terminals: N ..... :		P
	Earthing terminals: [earth symbol] ..... :		P
	Markings not placed on screws or other easily removable parts		P
	Terminals for conductors not forming part of the main function of the socket-outlet:		N/A
	- clearly identified unless their purpose is self-evident, or		N/A
	- indicated in a wiring diagram fixed to the accessory		N/A
	Identification of such terminals may be achieved by:		N/A
	- their being marked with graphical symbols according to IEC 60417-2 or colours and/or alphanumeric system, or		N/A
	- their being marked with their physical dimensions or relative location		N/A
8.6	Surface-type mounting boxes forming an integral part of socket-outlets having IP>20: IP code marked on the outside of its associated enclosure so as to be easily discernible		N/A
8.7	Indication of which position or with which special provision the declared IP of flush-type and semi-flush-type fixed socket-outlets having IP>X0 is ensured		N/A
8.8	Marking durable and easily legible. Test: 15 s with water and 15 s with petroleum spirit		P
8.101	Terminals for phase conductors (supply conductors): identified unless method of connection is of no importance, self-evident or indicated on a wiring diagram		P
	Such identification may take the form of a letter L or for more than one pole L1, L2, L3, etc., which may be accompanied by arrow or arrows pointing to the relevant terminal or terminals.		N/A
	Indications not placed on screws or other easily removable parts		P

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
8.102	Two, three, and four pole switches and switches having a rated voltage exceeding 250 V or a rated current exceeding 16 A shall be so marked that the direction of movement of the actuating member to is different positions or the actual switch position, is clearly indicated.		N/A
	Marking clearly visible on the front of the switch		N/A
	Not possible to fix cover, cover plate, or removable actuating members in an incorrect position		N/A
	For the indication of the direction of movement of the operating means, symbols may be used		N/A
	Closed position (on) shall be clearly indicated		N/A
13	**CONSTRUCTION OF FIXED SOCKET-OUTLETS (282481-C2, 282480-C2)**		P
13.1	Socket-contact assembly have sufficient resilience to ensure adequate contact pressure on plug pins		P
	Part of socket-contact assembly ensure metallic opposing contacts at least on two sides of each pins		P
13.2	Socket-contact and pin(s) of socket-outlet which are made of copper or copper alloy, as specified in 26.5, are considered as complying with this requirement		P
	The pin(s) of socket-outlets so constructed in such a way that the mechanical strength of the pin(s) does not depend on the plastic material		P
	Compliance is checked by inspection and in case of doubt by the tests of 14.2 and Clause 21 on a new set of specimens without plastic		P
13.3	Insulating linings, barriers and the like: adequate mechanical strength		P
13.4	Socket-outlets constructed as to permit		P
	- easy introduction into the terminal and reliable connection of the conductors in the terminals, except for lead wires of pilot lights		P
	- easy fixing of the main part to a wall or in a mounting box		P
	- correct positioning of the conductors		P
	- adequate space between the underside of the main part and the surface on which the main part is mounted;		P
	- adequate space between the sides of the main part and the enclosure (cover or box);		P
	Socket-outlets having screwless terminals, constructed that the connecting and/or disconnecting means of the screwless terminals cannot be activated by the conductors during and after installation		N/A

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	Compliance is checked by inspection and in case of doubt by the following test		N/A
	The test is carried out with a solid copper conductor having the smallest cross-sectional area, as specified in 12.3.2. (mm^2)……:		N/A
	If it is not possible to exert a force onto the connecting/disconnecting device, the product is deemed to comply with the requirements without further tests.		N/A
	During the application of the pull, the conductor do not come out of the screwless terminal		N/A
	In addition socket-outlets classified as design A: permit easy positioning and removal of the cover or cover plate, without displacing the conductors or activating the connecting and/or disconnecting means of screwless terminals.		P
	Compliance is checked by inspection and by an installation test with conductors of the largest nominal cross-sectional area specified in Table 3 (mm^2)…..:	2,5	P
13.5	Socket-outlets designed that full engagement of associated plugs is not prevented by any projection from their engagement face		P
	Gap between the engagement face of the socket-outlet and the plug: not exceed 1 mm		P
13.6	Covers provided with bushings for the entry holes for the pins: not possible to remove them from the outside or for them to become detached inadvertently from the inside when the cover is removed		N/A
13.7	Covers, cover-plates or parts of them intended to ensure protection against electric shock:		P
	- held in place at two or more points by effective fixings		P
	- fixed by means of a single fixing, for example, by a screw, provided that they are located by another means (for example, by a shoulder)		N/A
	Fixings of covers or cover-plates of socket-outlets of design A serve to fix the main parts: there are means to maintain the base in position, even after removal of the covers or cover-plates		N/A
13.7.1	Covers or cover-plates whose fixings are of the screw-type:		N/A
	Compliance checked by inspection only		N/A
13.7.2	Covers or cover-plates whose fixing is not dependent on screws and whose removal is obtained by applying a force in a direction approximately perpendicular to the mounting/supporting surface:		P
	Compliance checked, when their removal may give access, with the standard test finger:		P

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
	to live parts: by the test of 24.14 (verification of the non-removal and the removal)		N/A
	to non-earthed metal parts separated from live parts in such a way that creepage distances and clearances have the values shown in table 23: by the test of 24.15 (verification of the non-removal and the removal)		N/A
	only to parts of insulating material, or earthed metal parts, or metal parts separated from live parts in such a way that creepage distances and clearances have twice the values shown in table 23, or live parts of SEL V circuits not greater than 25 V a.c.: by the test of 24.16 (verification of the non-removal and the removal)		P
13.7.3	Covers or cover-plates the fixing of which is not dependent on screws and whose removal is obtained by using a tool, in accordance with the manufacturer's instructions given in an instruction sheet or in other documentation:		N/A
	Compliance checked, when their removal may give access, with the standard test finger:		N/A
	to live parts: by the test of 24.14 (verification of the non-removal only)		N/A
	to non-earthed metal parts separated from live parts in such a way that creepage distances and clearances have the values shown in table 23: by the test of 24.15 (verification of the non-removal only)		N/A
	only to parts of insulating material, or earthed metal parts, or metal parts separated from live parts in such a way that creepage distances and clearances have twice the values shown in table 23, or live parts of SEL V circuits not greater than 25 V a.c.: by the test of 24.16 (verification of the non-removal only)		N/A
13.8	Cover-plate intended for a socket-outlet with earthing contact: not interchangeable with a cover-plate intended for a socket-outlet without earthing contact		N/A
13.9	Surface-type socket-outlets: no free openings in their enclosures		N/A
	Drain holes, small gaps between enclosures or boxes and conduits, cables, or earthing contacts, if any, or between enclosures or boxes and grommets or membranes and knockouts are neglected provided they do not compromise the declared IP rating.		N/A
13.10	Screws or other means for mounting the socket-outlet on a surface in a box or enclosure: easily accessible from the front		P
	Fixing means not serve any other fixing purpose		P

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
13.11	Multiple socket-outlets with a common base: provided with fixed links for the interconnection of the contacts in parallel		P
	Fixing of the links independent from the connection of the supply wires		P
13.12	Multiple socket-outlets, comprising separate bases: correct position of each base ensured		N/A
	Fixing of each base independent of the fixing of the combination to the mounting surface		N/A
13.13	Mounting plate of surface-type socket-outlets: adequate mechanical strength		N/A
13.14	Socket-outlets withstand the lateral strain imposed by equipment likely to be introduced into them		P
	Socket-outlets 16A 250V: test made 4 times with the socket-outlet turned through 90°, 5 N for 1 min (device shown in fig. 13)		P
	During the test: device not become disengaged from the socket-outlet		P
	After the test:		P
	- no damage		P
	- socket-outlets comply with clause 22		P
13.15	Socket-outlets are not an integral part of lampholders		P
13.16	Surface-type socket-outlets having IP>20 are according to their IP classification when fitted with conduits or with sheathed cables and without a plug in engagement		N/A
	Surface-type socket-outlets having a degree of protection from IPX4 to IPX6 shall have provision for opening a drain hole.		N/A
	Socket-outlets with a drain hole: drain hole is not less than 5 mm in diameter, or 20 mm^2 in area with a width and a length of not less than 3 mm ..... :		N/A
	Drain hole: effective		N/A
	Lid springs (if any): of corrosion-resistant material (bronze or stainless steel) ..... :		N/A
13.17	Earthing pins: adequate mechanical strength		N/A
	Not solid pins: compliance checked by inspection and by the test of 14.2 made after the tests of clause 21		N/A
13.18	Earthing contacts, phase contacts and neutral contacts :		P
	- locked against rotation;		P
	- when the product is ready for the wiring do not possible to be removed without the use of a tool		P

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
13.19	Metal strips of the earthing circuit: no burrs which might damage the insulation of the supply conductors		P
13.20	Socket-outlets to be installed in a box: designed that the conductor ends can be prepared after the box is mounted in position, but before the socket-outlet is fitted in the box		P
13.21	Inlet openings: allow the introduction of the conduit or the sheath of the cable		N/A
	Surface-type socket-outlets:		N/A
	the conduit or sheath of the cable can enter at least I mm into the enclosure		N/A
	inlet opening for conduit entries, or at least two of them if there are more than one, capable of accepting conduit sizes of 16, 20, 25 or 32 according to IEC 60423 or a combination of at least two of any of these sizes		N/A
	inlet opening for cable entries capable of accepting cables having the dimensions specified in table 14 or be as specified by the manufacturer: rated current (A); Limits of external dimensions of cable min/max (mm) ..... :		N/A
13.22	Membranes (grommets) in inlet openings: reliably fixed and not displaced by the mechanical and thermal stresses occurring in normal use		N/A
	Test on membranes subjected to the ageing treatment specified in 16.1 and assembled in the accessories		N/A
	Accessories placed at (40 ± 2) °C for 2 h. Force of 30 N applied for 5 s by test probe 11 of IEC 61032. During the test: no deformation		N/A
	Membranes likely to be subjected to an axial pull: axial pull of 30 N applied for 5 s. During the test: membranes not become detached		N/A
	After the test: no harmful deformation, cracks or similar damage		N/A
	Test repeated with membranes not subjected to any treatment		N/A
13.23	Membranes in inlet openings: introduction of the cables into the accessory permitted when the ambient temperature is low		N/A
	Test on membranes not subjected to the ageing treatment specified in 16.1 and assembled in the accessories		N/A
	Accessories kept at (-15 ± 2) °C for 2 h: possibility to introduce cables of the largest diameter through membranes		N/A
	After the test: no harmful deformation, cracks or similar damage		N/A

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict
13.101	Switches shall be constructed to match the number of poles of the socket-outlet, except that the neutral pole is not switched in unswitched neutral socket-outlets.	Un-switched neutral socket-outlets	P
	The earthing contact is not considered as a pole and the earth circuit shall not be switched		P
	The position of the switch operating member shall be such that it does not prevent, nor shall its correct operation be prevented by, the proper insertion of the corresponding plug or plugs.		P
13.102	Knobs of rotary switches shall be securely coupled to the shaft or the part operating the mechanism.		N/A
	The knob is subjected for 1 min to an axial pull of 100 N.		N/A
	After, knob having only one direction of operation are turned 100 times in the reverse direction.		N/A
	Knob shall not become detached		N/A
13.103	The actuating member of a switch, when released, shall automatically take up the position corresponding		P
	Single push-button the actuating member may take up a single rest position.		N/A
13.104	Switches shall be so constructed that the moving contacts can come to rest only in the “ON” or “OFF” position		P
	Intermediate position permissible if:		N/A
	- it corresponds to the intermediate position of the actuating member, and		N/A
	- the insulation between fixed and moving contacts is adequate. Electric strength test as specified in 17.2: test voltage a.c. for 1 min (V) .....:	500 V / 750 V / 1250 V / 2000 V	N/A
13.105	Switches shall be constructed so that undue arcing cannot occur when the switch is operated slowly.		P
	Compliance is checked by:		P
	After the test of clause 21, to break the circuit a further ten times		P
	During the test, no sustained arcing shall occur.		P
13.106	Switched socket-outlets with switches operating more than one pole shall make and break all poles simultaneously.		N/A
	Switched neutral, the neutral shall not make after or break before other poles.		N/A
13.107	The action of the mechanism, if the cover or cover plates are removable for installation purposes, shall be independent of the presence of the covers or cover plates.		P

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

27	**CREEPAGE DISTANCES, CLEARANCES AND DISTANCES THROUGH SEALING COMPOUND (282481-C2, 282480-C2)**		P
27.1	Creepage distances, clearances and distances through sealing compound are not less than the values shown in table 23	See appended table 27.1	P
27.2	Insulating sealing compound does not protrude above the edge of the cavity in which it is contained		N/A
27.3	Surface-type socket-outlets do not have bare current-carrying strips at the back		N/A
27.101	For switches incorporated in switched socket-outlets, creepage distances, clearances and distances through sealing compound shall be not less than the values shown in table 102		P

IEC 60884-2-3			
Clause	Requirement + Test	Result - Remark	Verdict

27.1	**TABLE: creepage distances, clearances and distances through sealing compound**						**P**
	rated voltage (V) ..... :	**250**					**—**
item per table 23	**creepage distance dcr, clearance cl and distance through sealing compound dtsc at/of:**	**required cl (mm)**	**cl (mm)**	**required dcr (mm)**	**dcr (mm)**	**required dtsc (mm)**	**dtsc (mm)**
	between live parts of different polarity	≥ 3	> 3,90	≥ 3	> 3,90	—	—
	between live parts and accessible surface of parts of insulating material	≥ 3	> 3,90	≥ 3	> 3,90	—	—
	between live parts and metal frames supporting the base of flush-type socket-outlets	≥ 3	—	≥ 3	—	—	—
	between live parts and earthed metal parts including parts of earthing circuit	≥ 3	> 3,90	≥ 3	> 3,90	—	—
	between live parts and screws or devices for fixing bases, covers or cover-plates of fixed socket-outlets	≥ 3	> 3,90	≥ 3	> 3,90	—	—
	between the accessible unearthed metal parts [b] of a socket-outlet and a fully engaged plug of the same system having pins and metal parts connected to them made according to the most unfavourable construction [c]	≥ 6	—	≥ 4,5	—	—	—
	between live parts of a socket-outlet (without a plug) or of a plug and their accessible unearthed or functional earthed metal parts [b]	—	—	—	—	—	—
	between live parts and accessible unearthed or functional earthed metal parts [b] of socket-outlets and plugs	—	—	—	—	—	—
item per table 102	creepage distance dcr, clearance cl and distance through sealing compound dtsc at/of:	required cl (mm)	cl (mm)	required dcr (mm)	dcr (mm)	required dtsc (mm)	dtsc (mm)
	Between live parts which are separated when the contacts are open	≥ 3	Min.3,50	≥ 3	> 3,90	—	—
supplementary information:							

ANNEX 3

PHOTOGRAPHS

282481-C2 13A 250V~

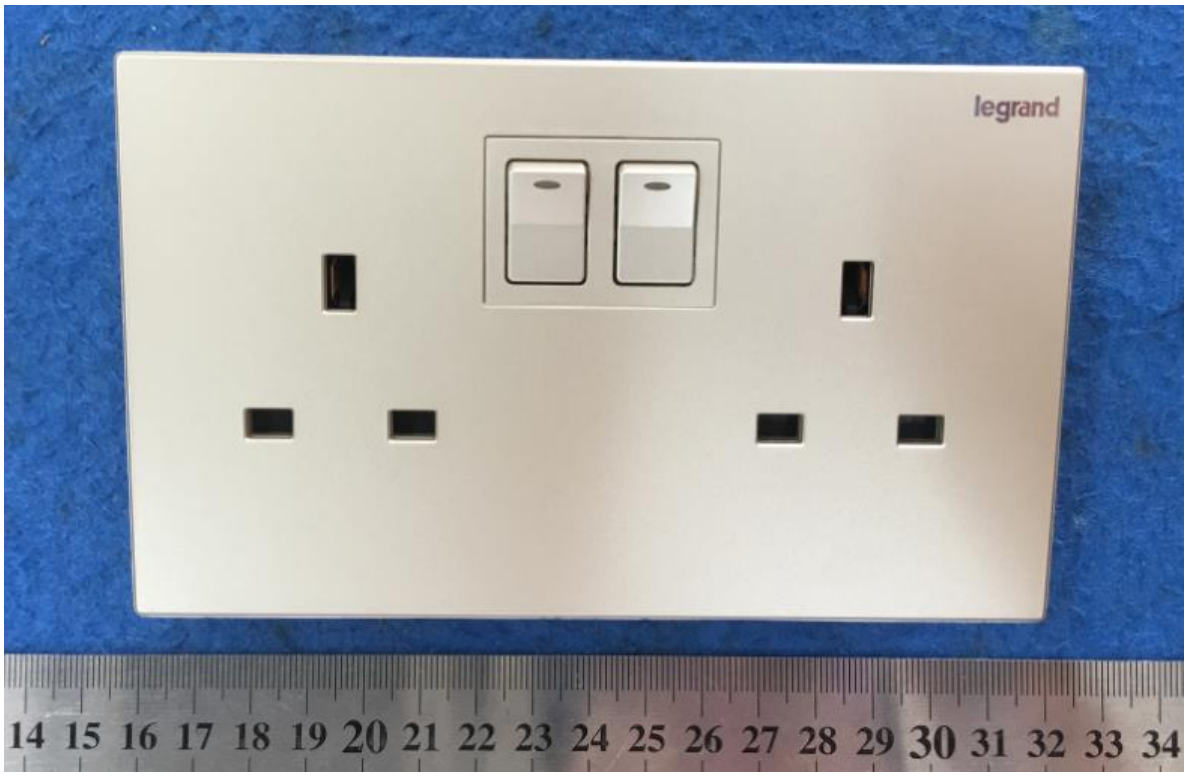

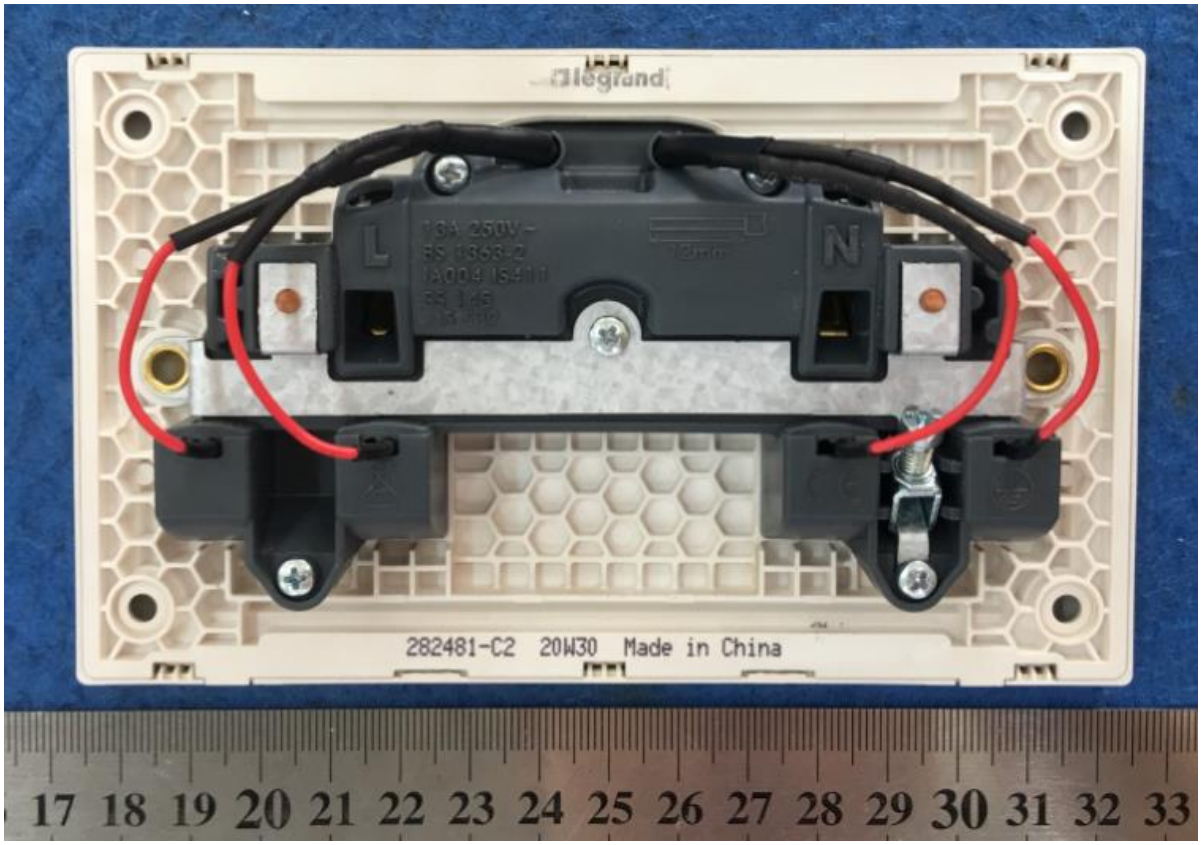

ANNEX 3
PHOTOGRAPHS

Inner Configuration of 282481-C2 13A 250V~

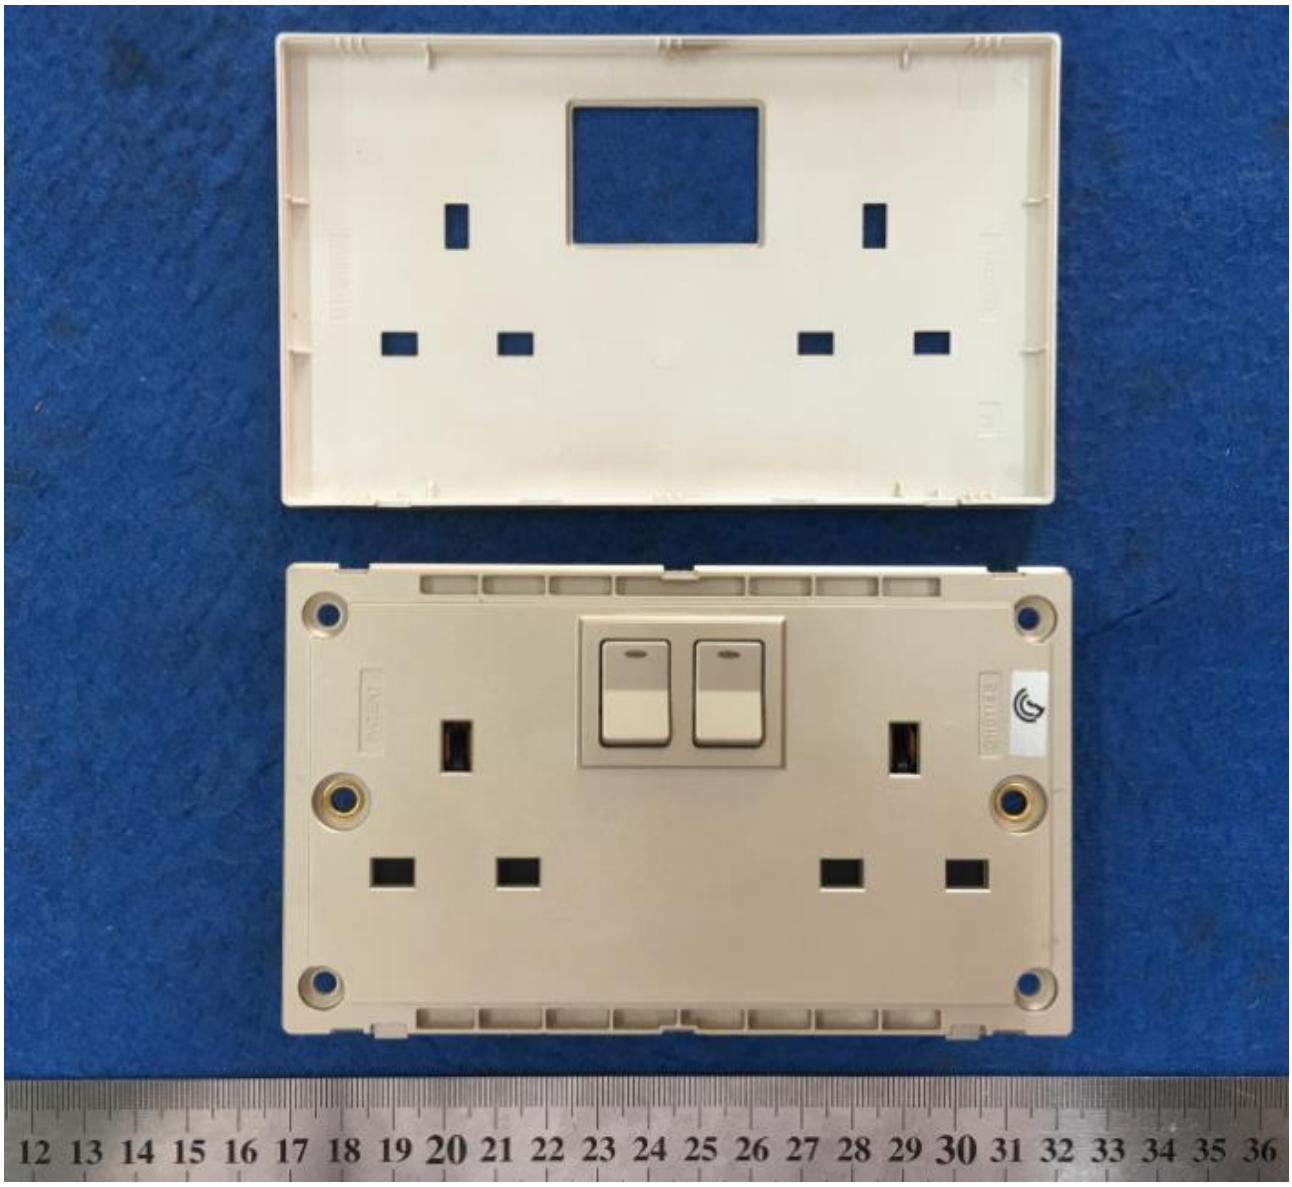

ANNEX 3

PHOTOGRAPHS

Inner Configuration of 282481-C2 13A 250V~

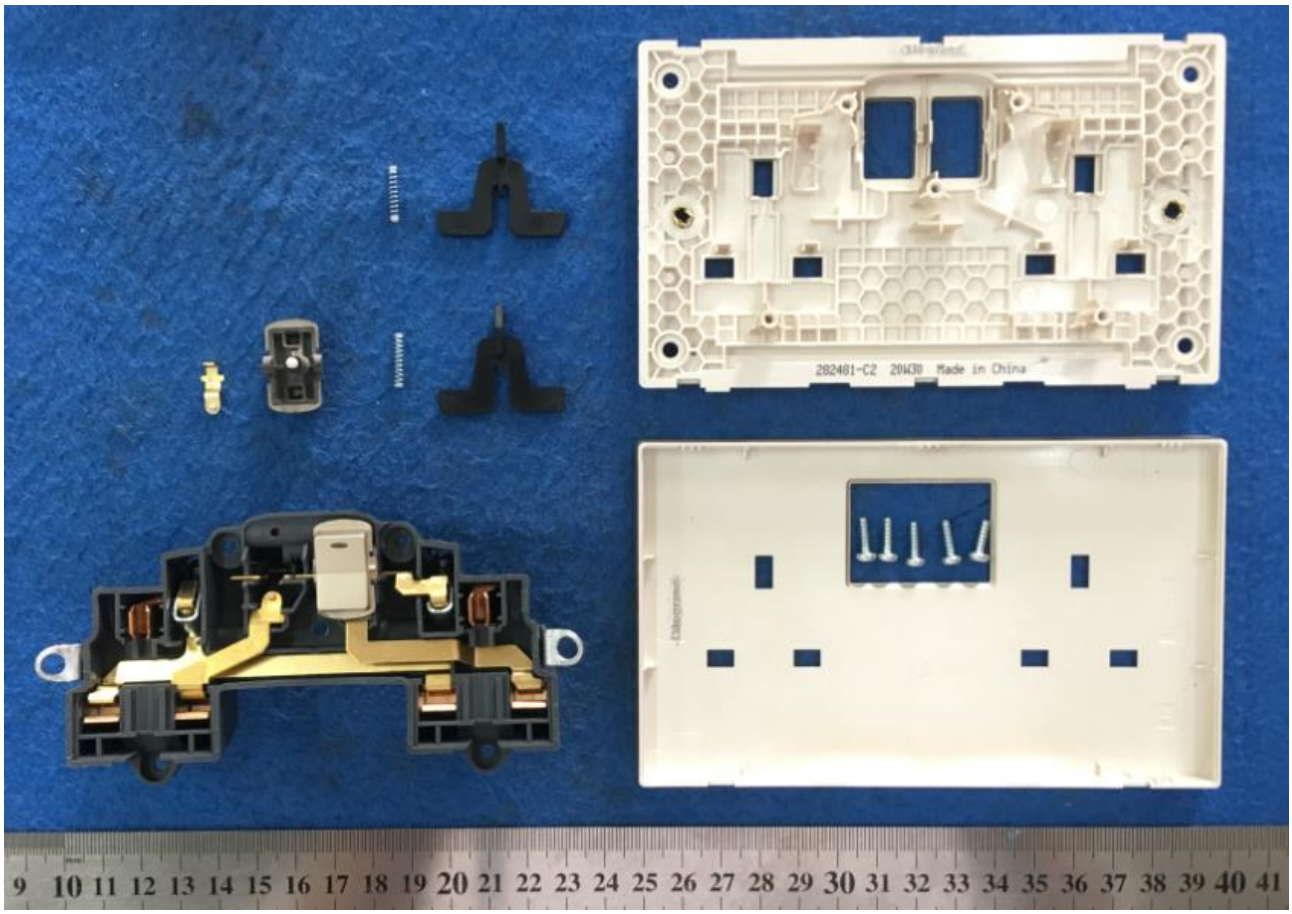

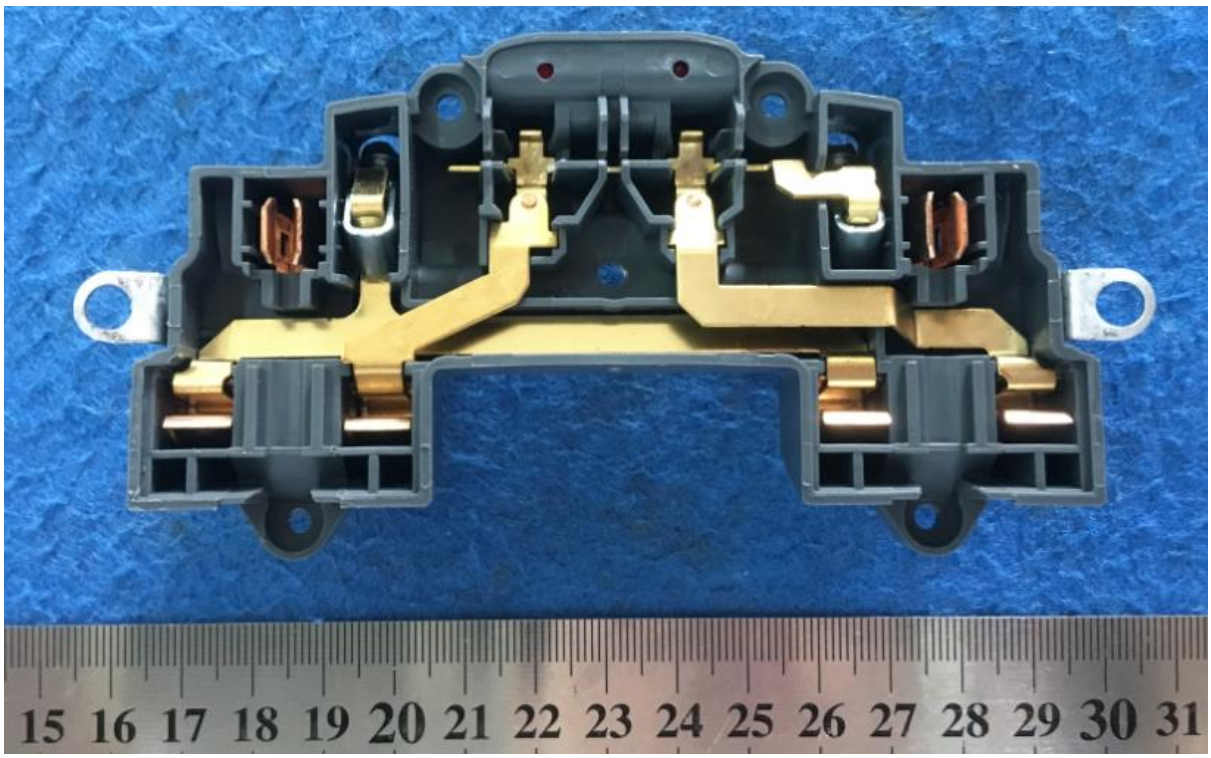

ANNEX 3

PHOTOGRAPHS

Inner Configuration of 282481-C2 13A 250V~

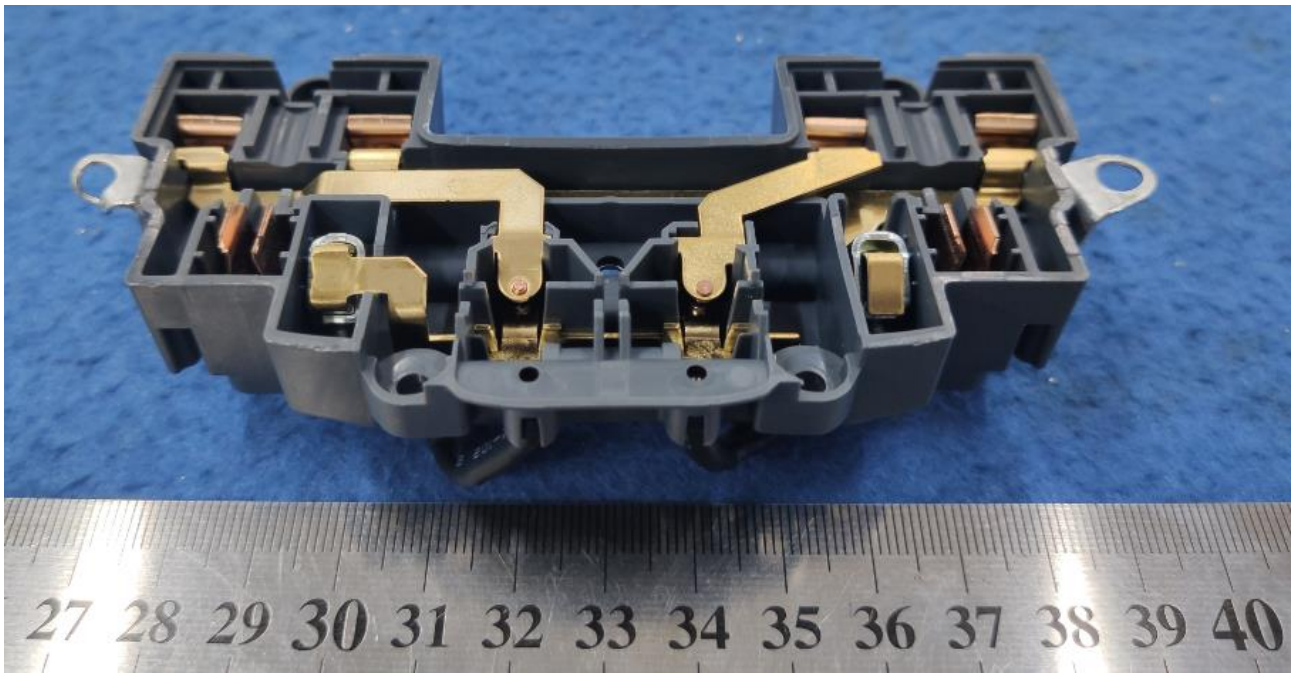

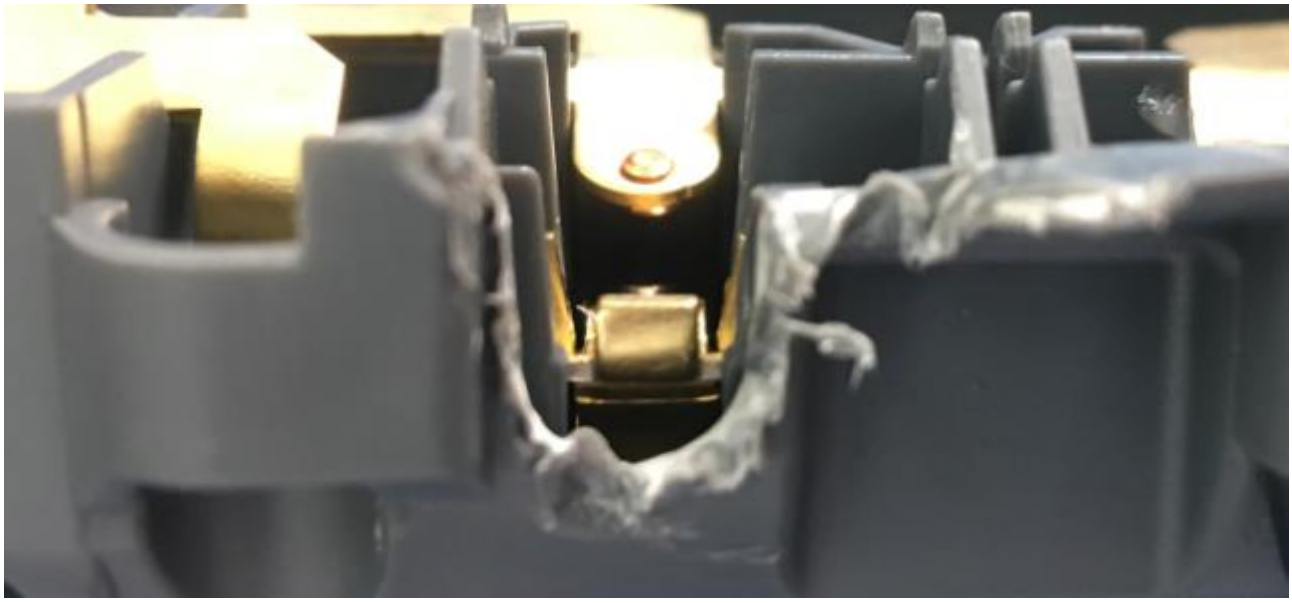

ANNEX 3
PHOTOGRAPHS
shutter

282481-C3 13A 250V~

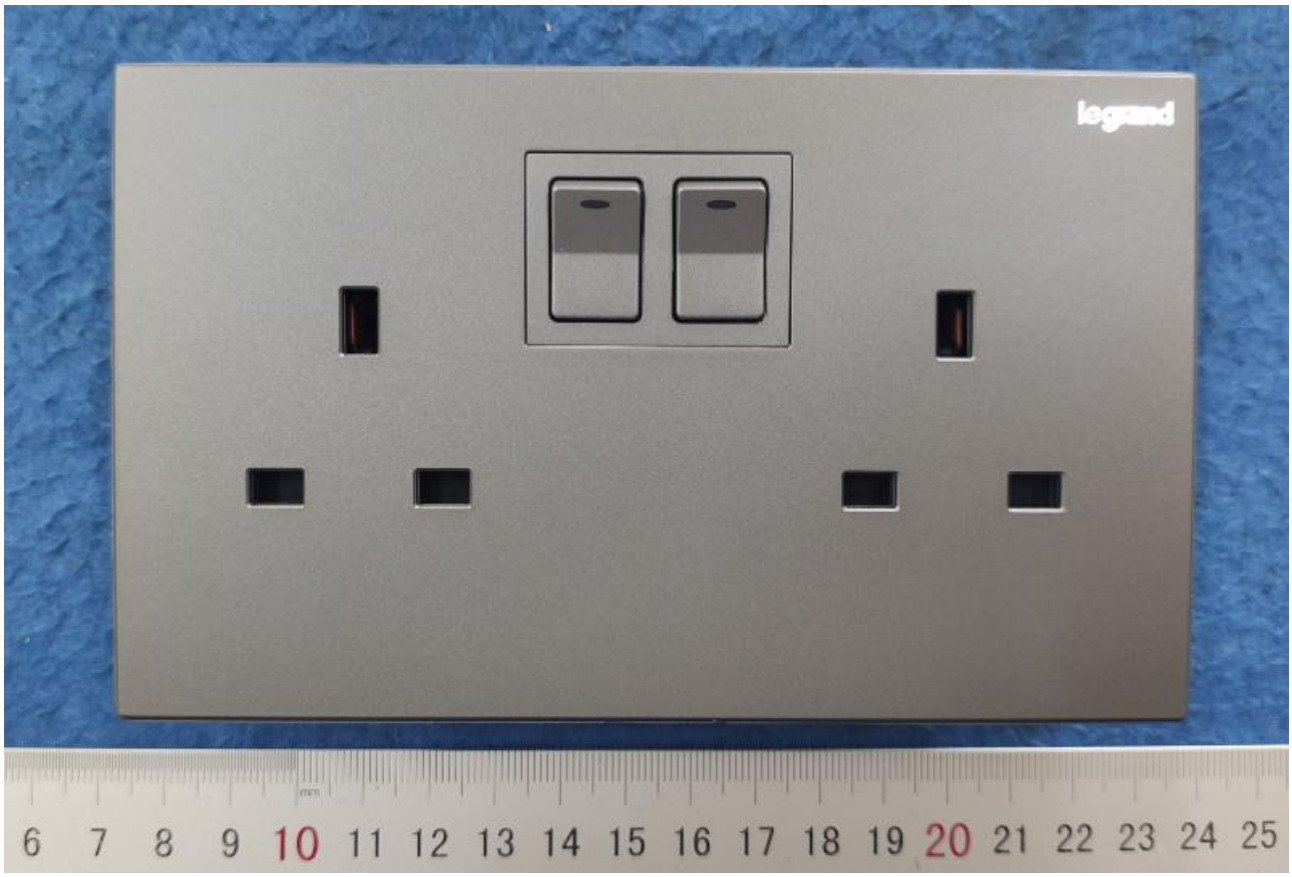

ANNEX 3
PHOTOGRAPHS

282481-C3 13A 250V~

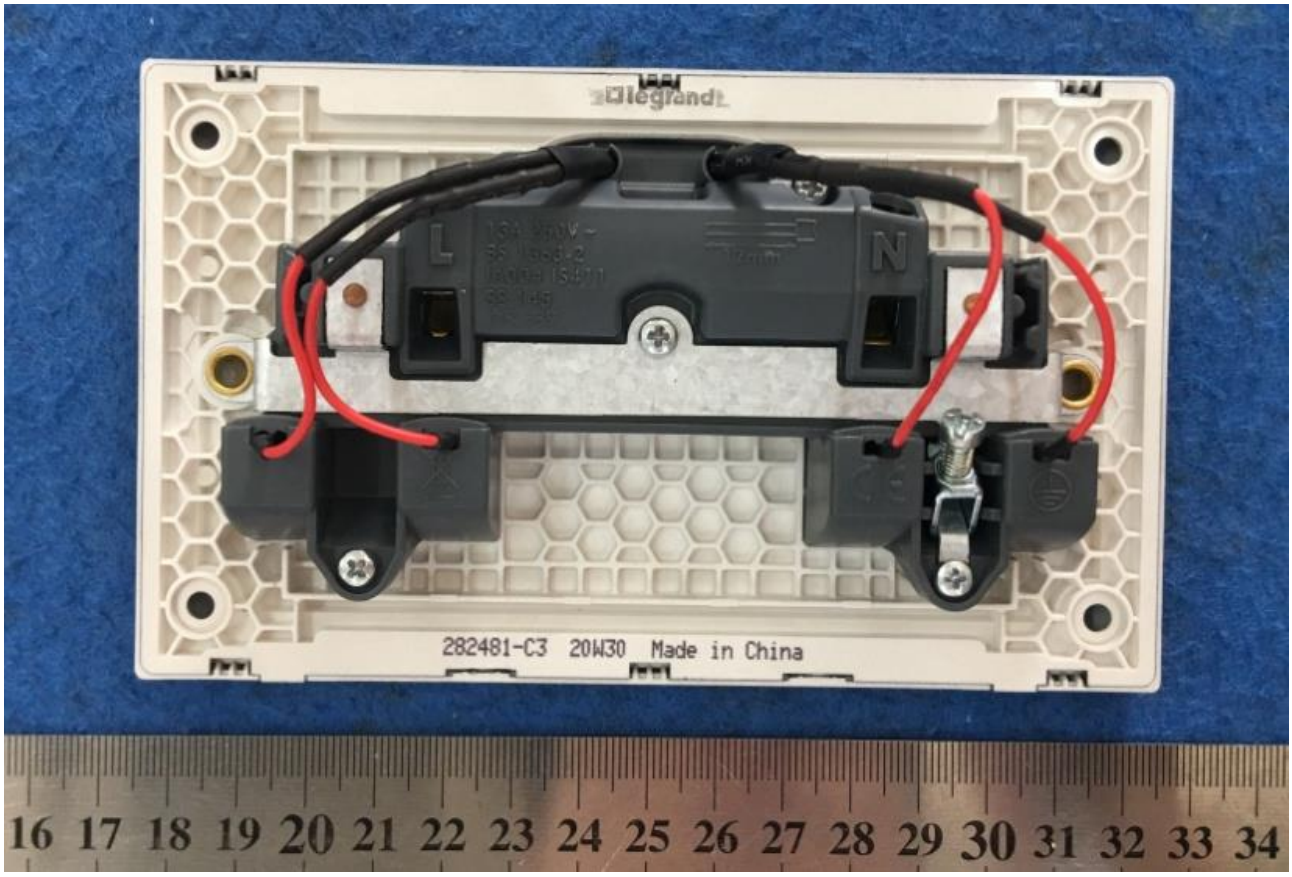

282480-C2 13A 250V~

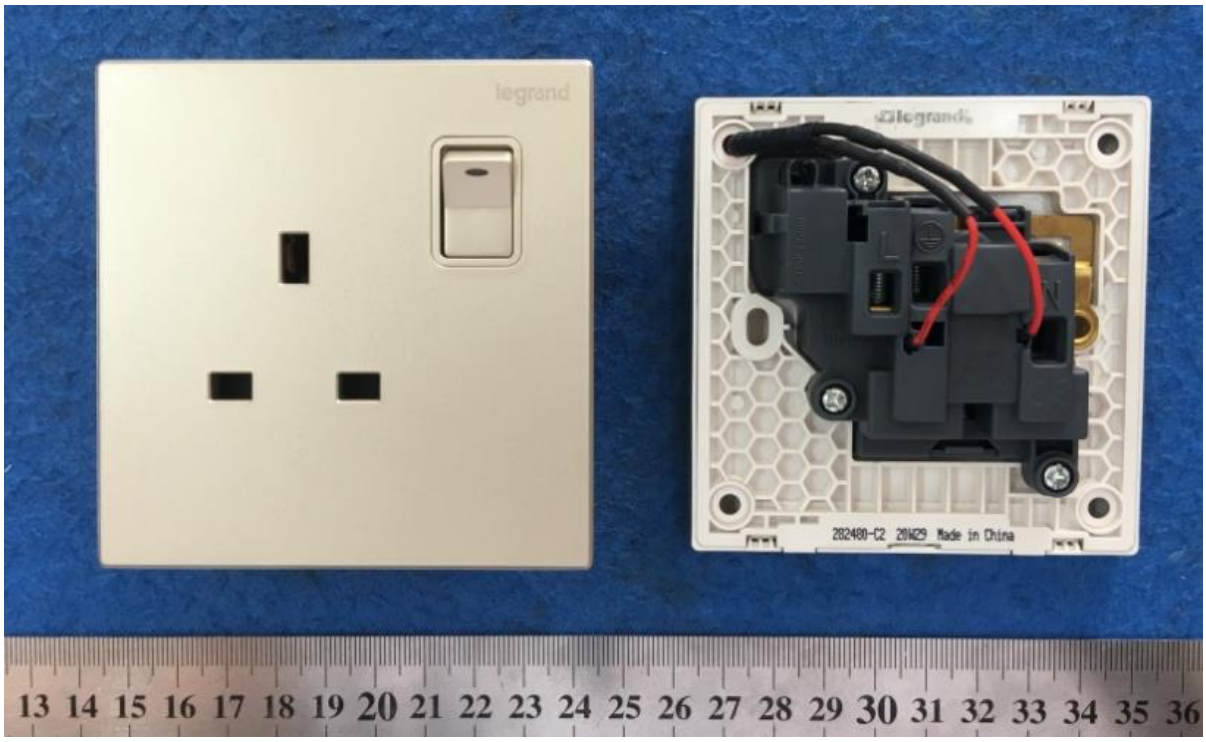

ANNEX 3
PHOTOGRAPHS

Marks of 282480-C2 13A 250V~

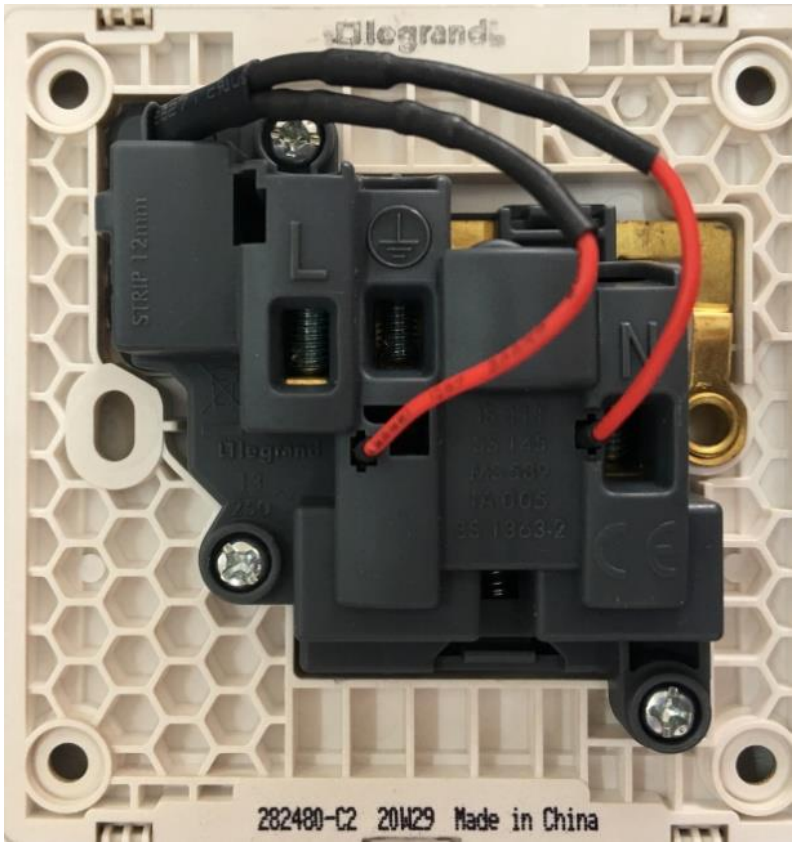

Inner Configuration of 282480-C2 13A 250V~

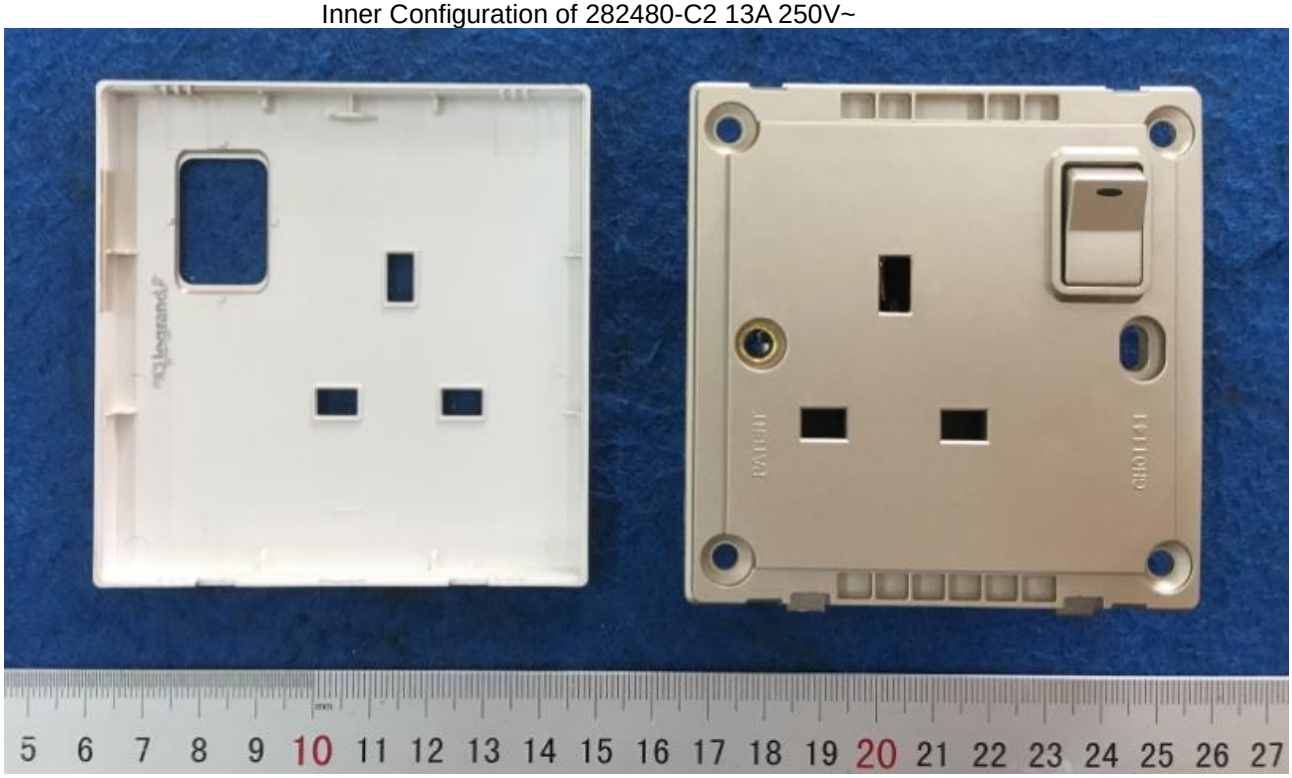

ANNEX 3

PHOTOGRAPHS

Inner Configuration of 282480-C2 13A 250V~

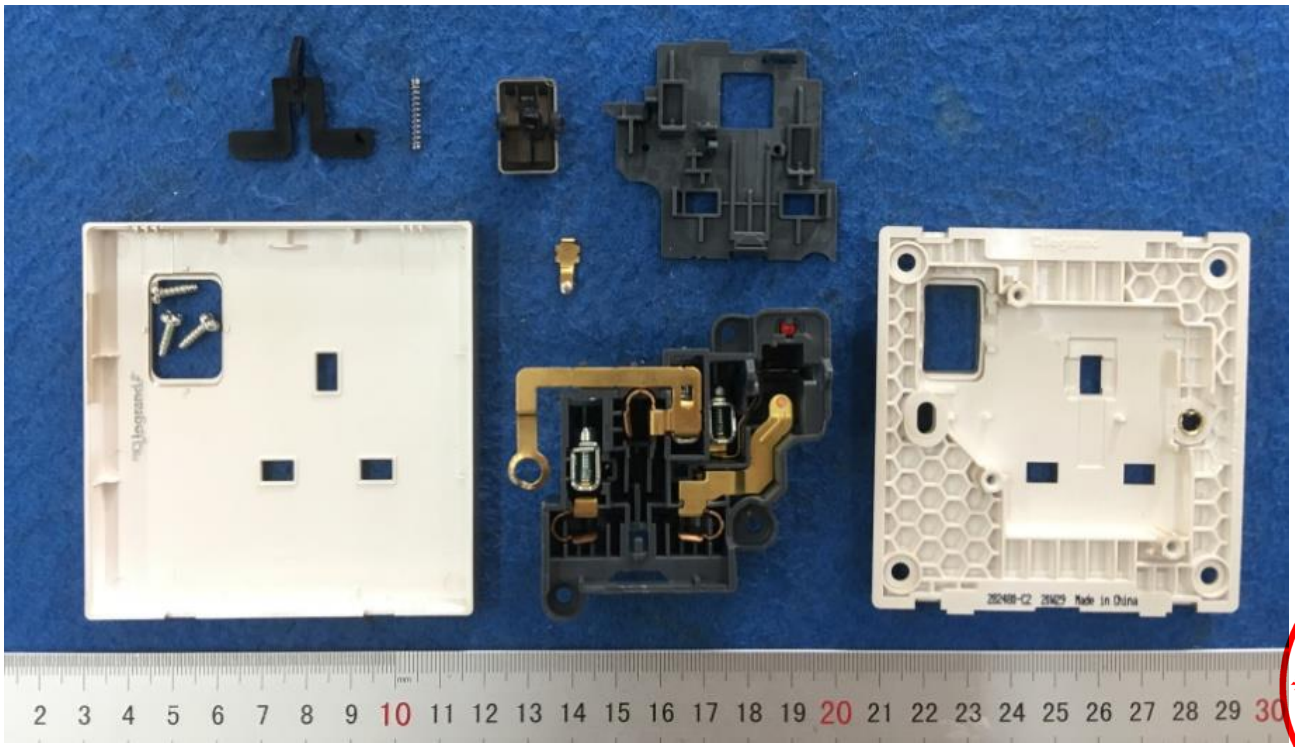

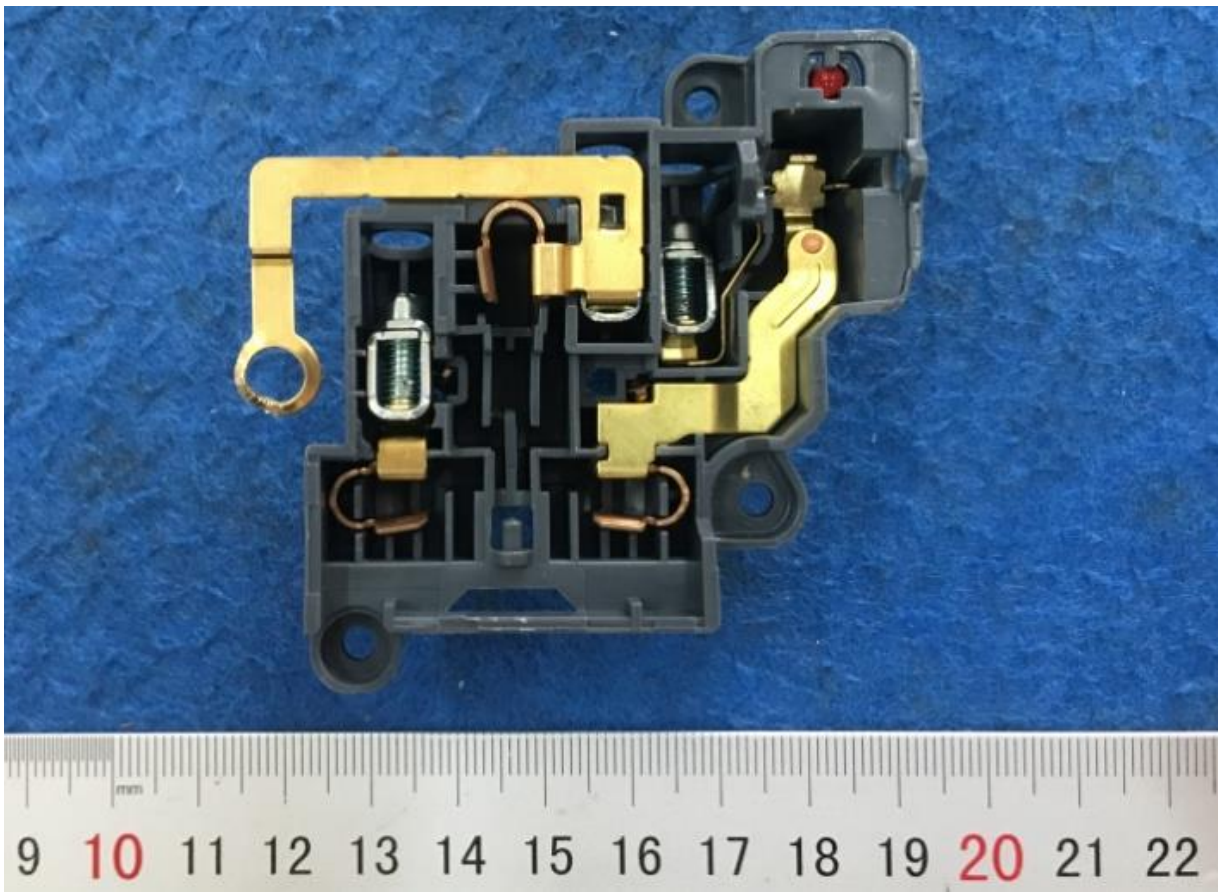

ANNEX 3

PHOTOGRAPHS

Inner Configuration of 282480-C2 13A 250V~

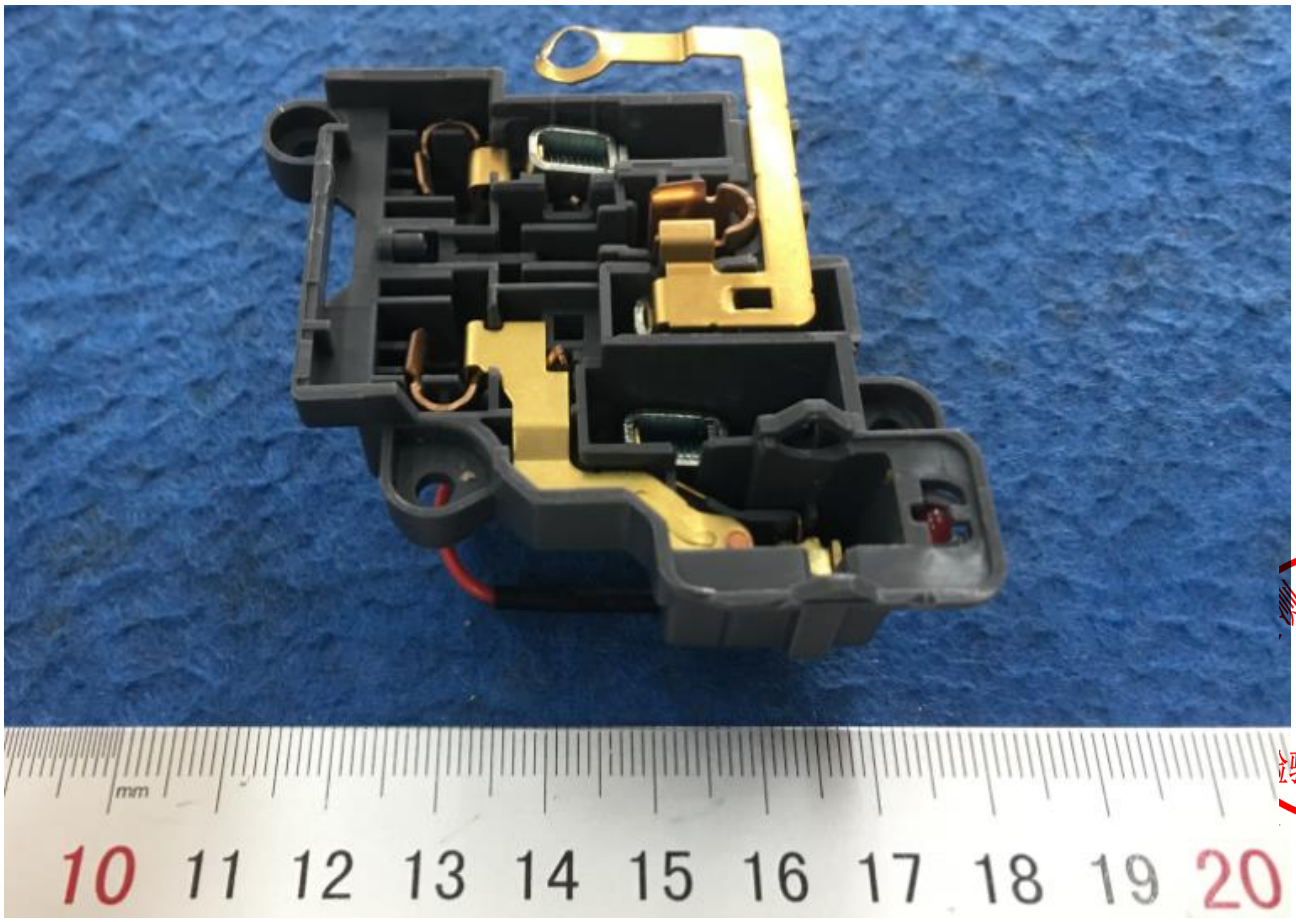

ANNEX 3

PHOTOGRAPHS

Shutter

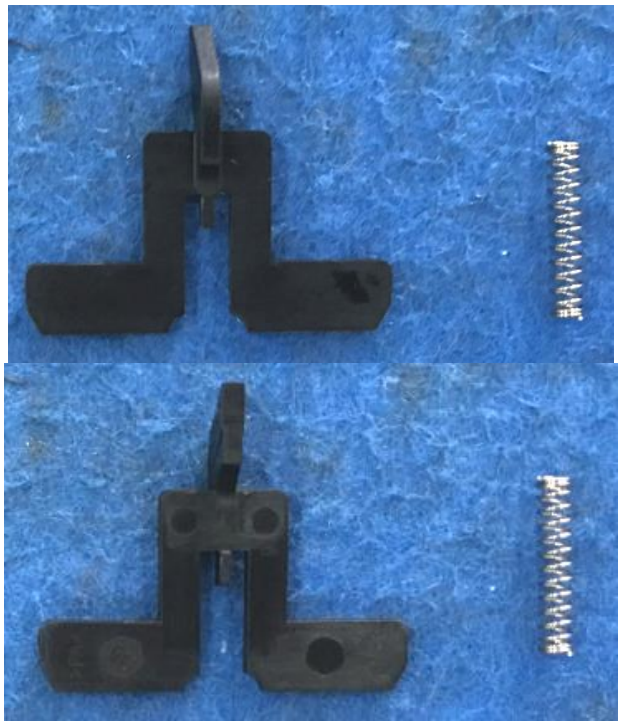

282480-C3 13A 250V~

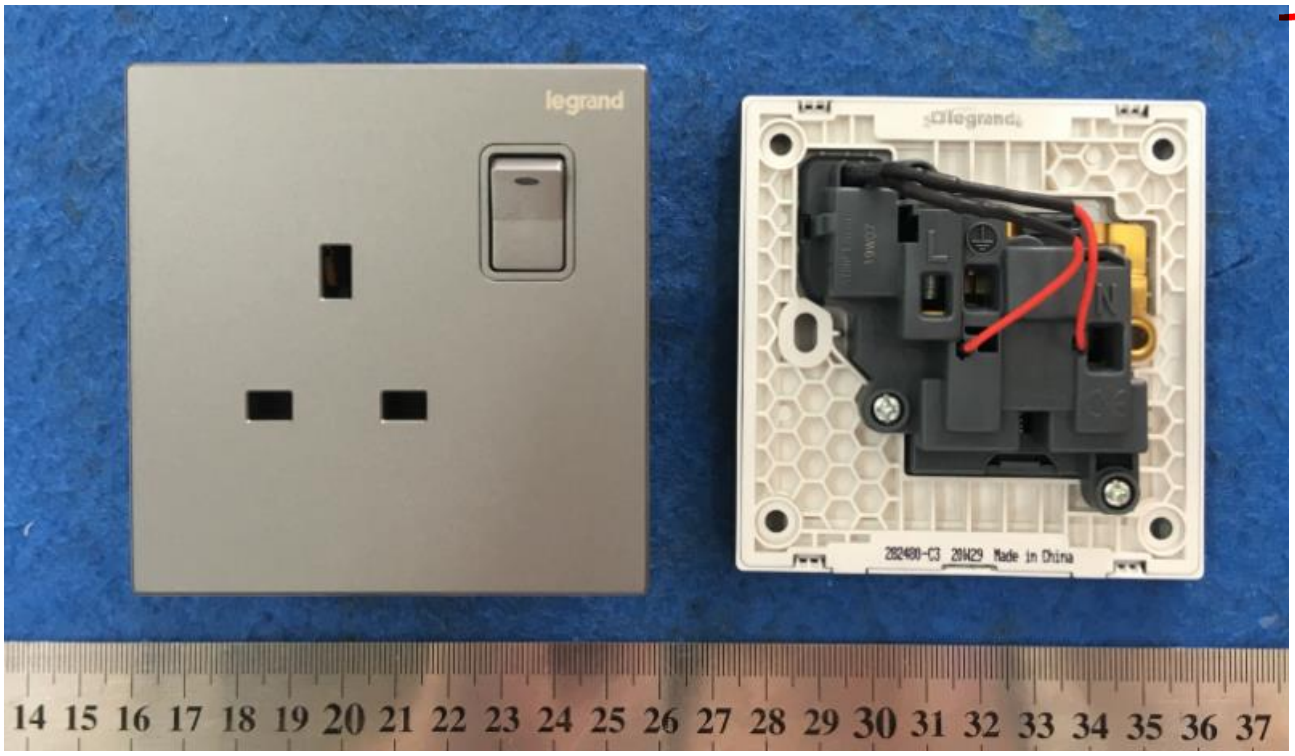

ANNEX 3

PHOTOGRAPHS

Marks of 282480-C3 13A 250V~

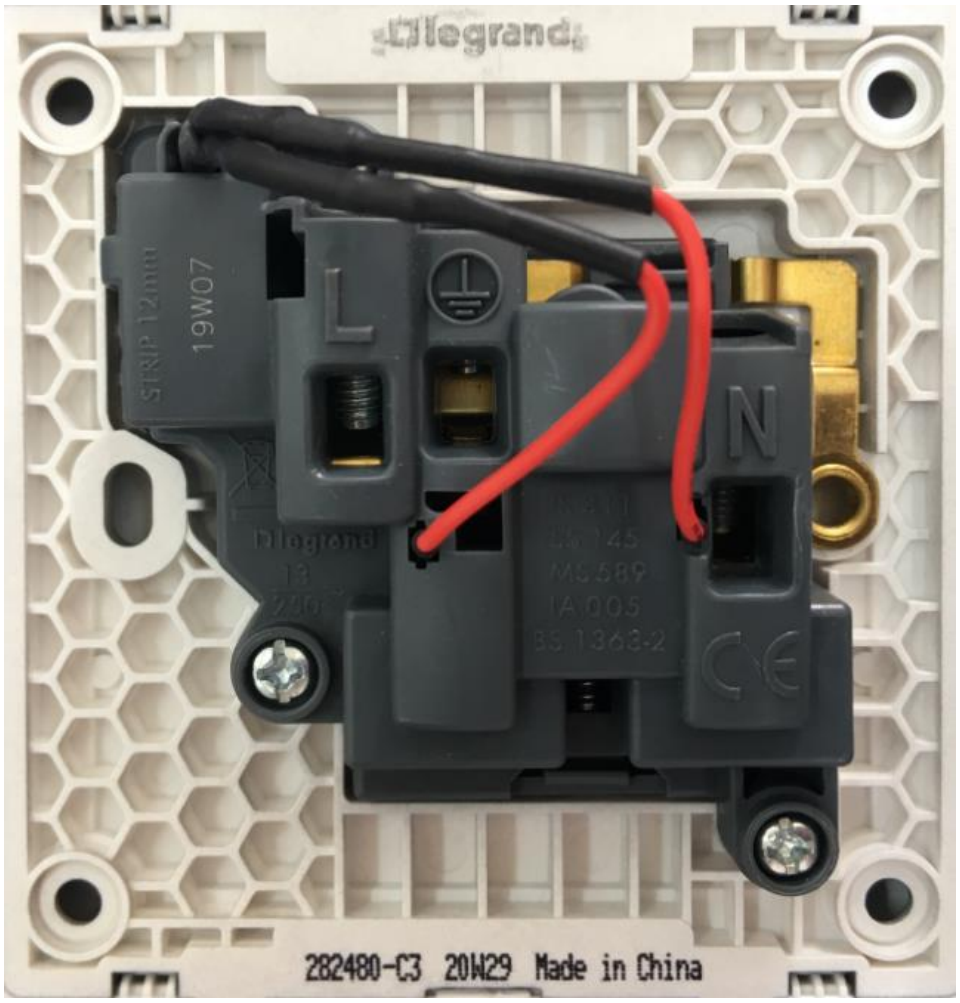

-----End of report-----