
REV	DESCRIPTION	DFTR	CHKR	ENGR APPV	DATE
C1	REVISED PER ENG CHANGES	WSG	JO	J.CRAFT	3/07
C2	REVISED TITLE	WSG	JO	J.CRAFT	8/07
C3	REVISED FOR SIEMENS PPS INTERFACE	WSG	JO	B. MORRIS	4/2011

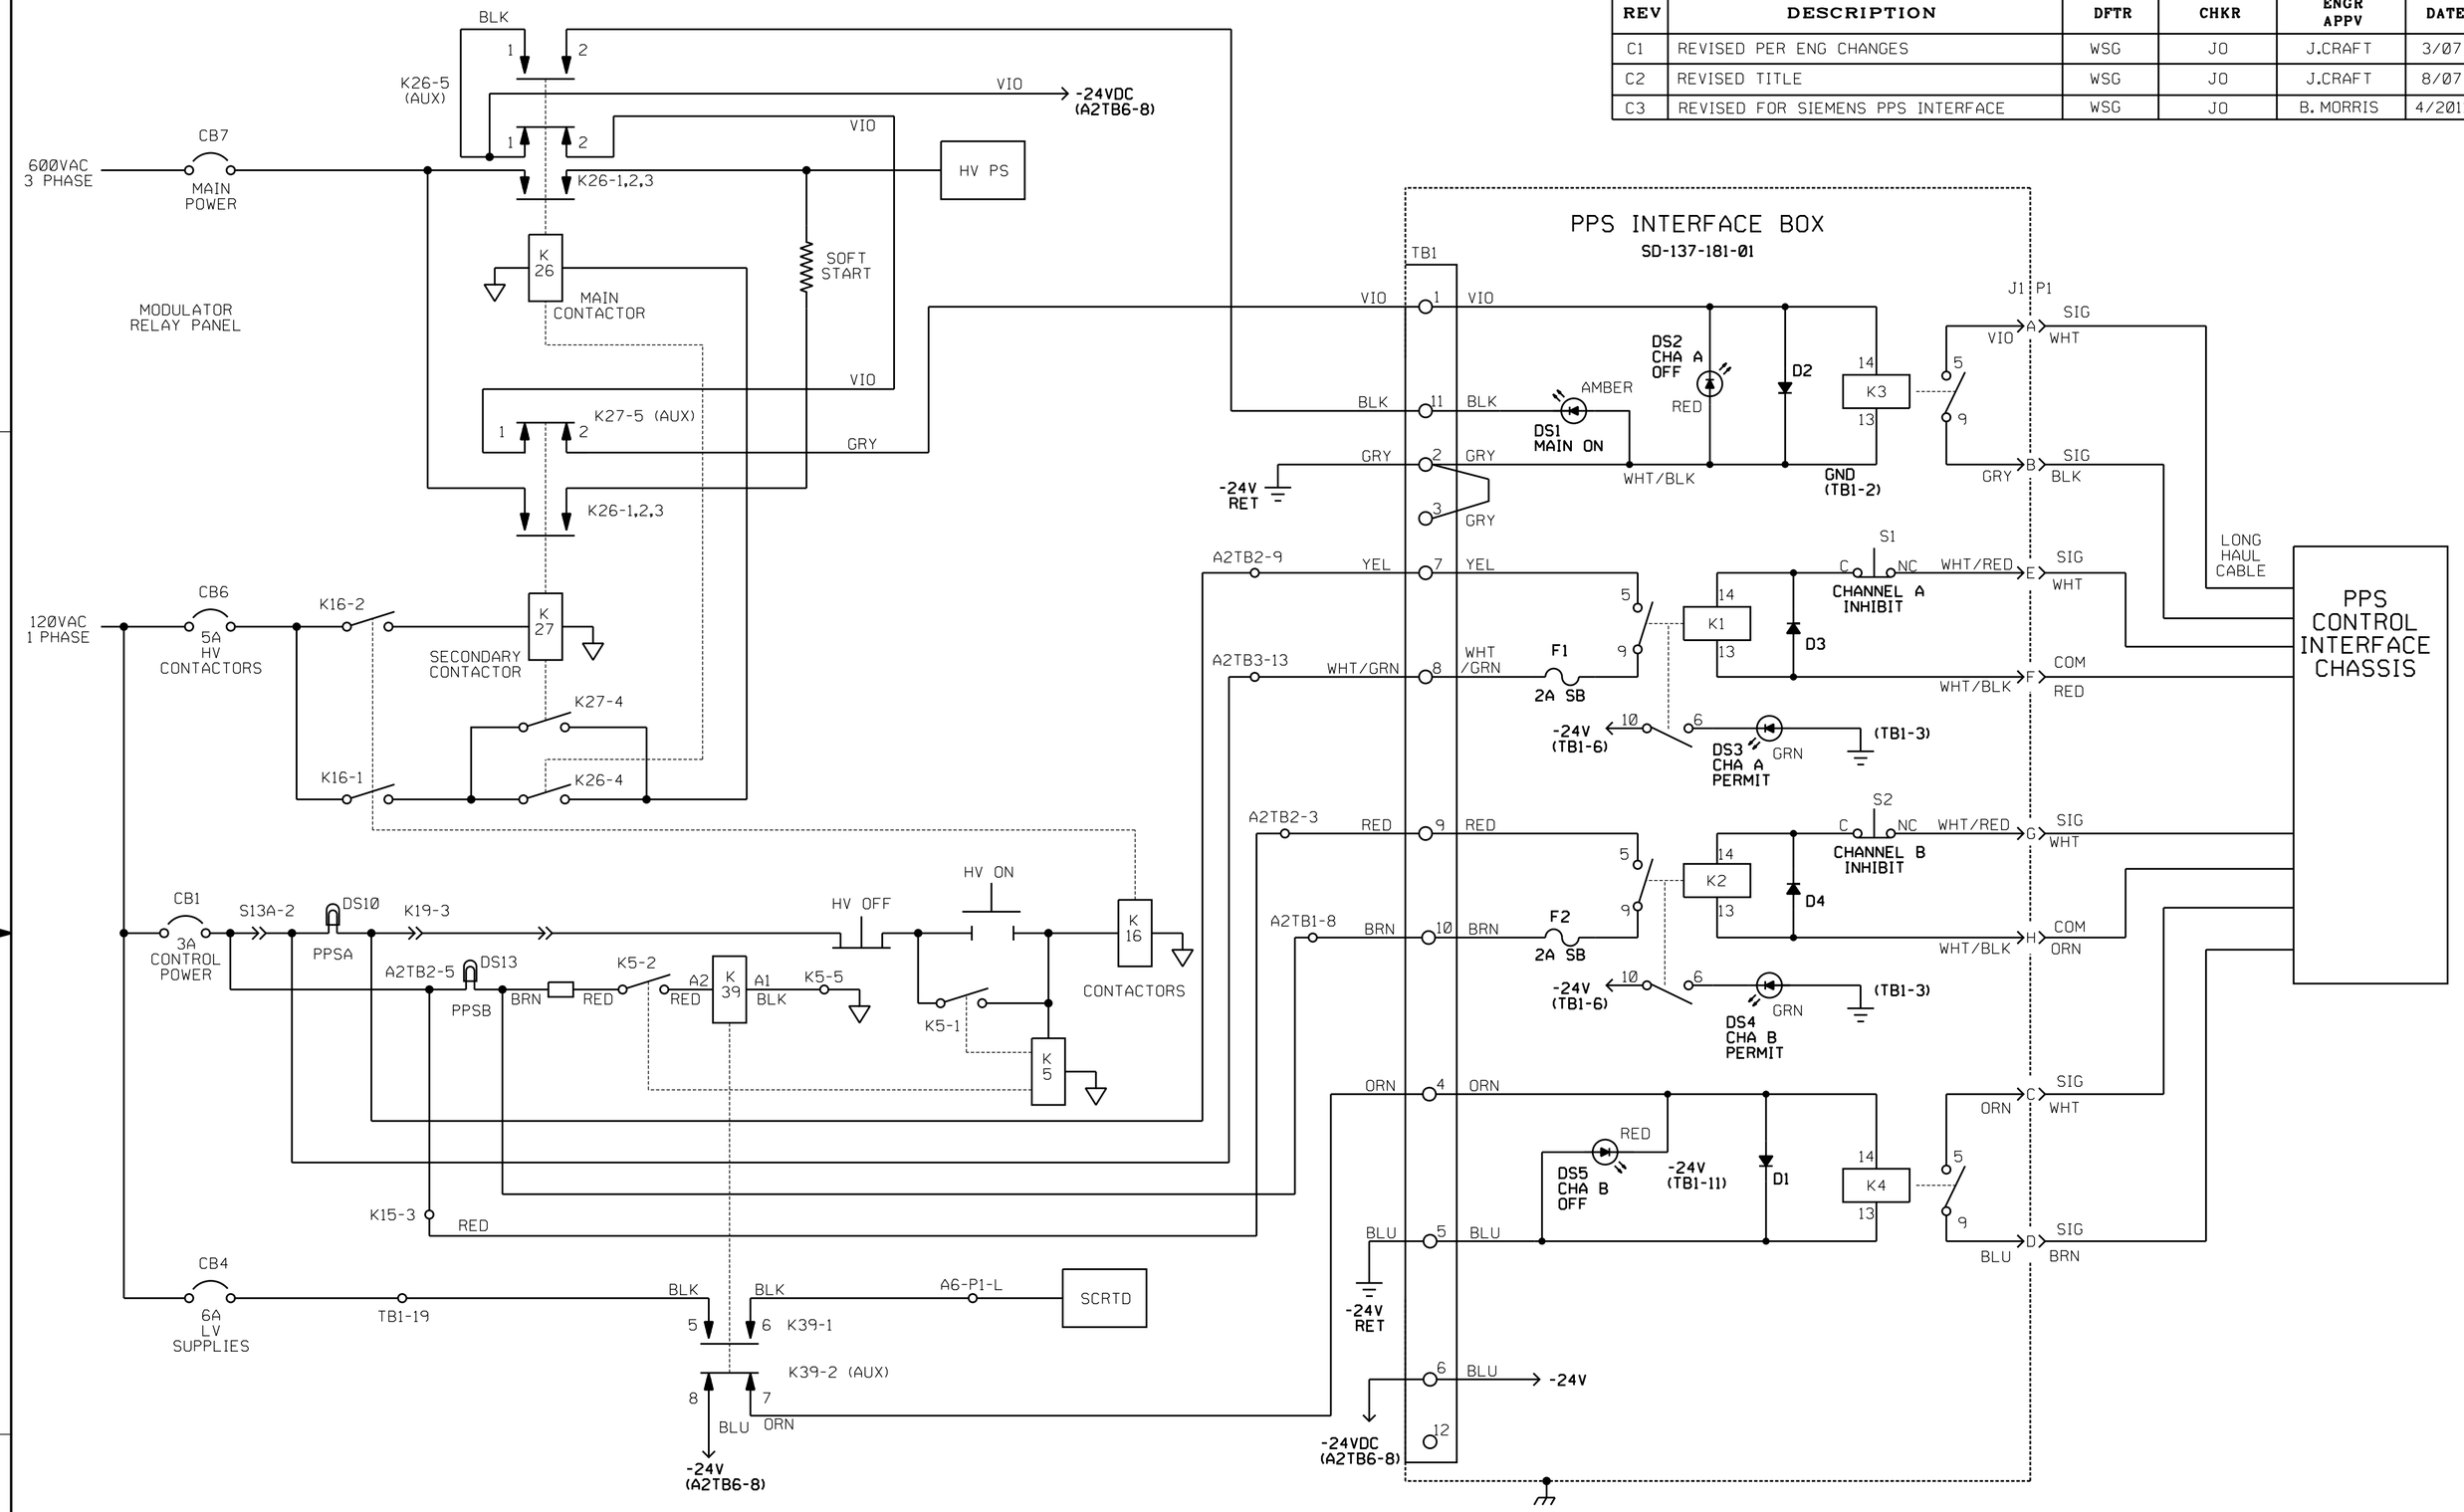

NOTE: (UNLESS OTHERWISE SPECIFIED).

1. 120VAC WIRING IS 20 AWG.
2. 24VAC WIRING IS 22 AWG.
3. ALL WIRES AND LUGS ARE RATED TO 600VAC.

REFERENCE DWG'S:

WD-730-629-01
EI-730-600-01
WD-730-620-02
FS-730-600-02
SD-730-600-00
SD-137-181-01

STANFORD LINEAR ACCELERATOR CENTER
U. S. DEPARTMENT OF ENERGY
STANFORD UNIVERSITY STANFORD, CALIFORNIA

PROPRIETARY DATA OF STANFORD UNIVERSITY AND/OR U.S. DEPARTMENT OF ENERGY. RECIPIENT SHALL NOT PUBLISH THE INFORMATION WITHIN UNLESS GRANTED SPECIFIC PERMISSION OF STANFORD UNIVERSITY.

	DATE	APPROVAL
ENGR J. CRAFT		J. CRAFT
DFTR W. GORECKI	05/01/06	
CHKR OLSZEWSKI		

CAD FILE NAME: WD137181010301.DGN

SHEET 1 OF 1

PPS INTERFACE II WIRING DIAGRAM

WD-137-181-Ø1-C3

C

PPS INTFC II WIRING DIA

ESD