



L1101-4

CAUTION

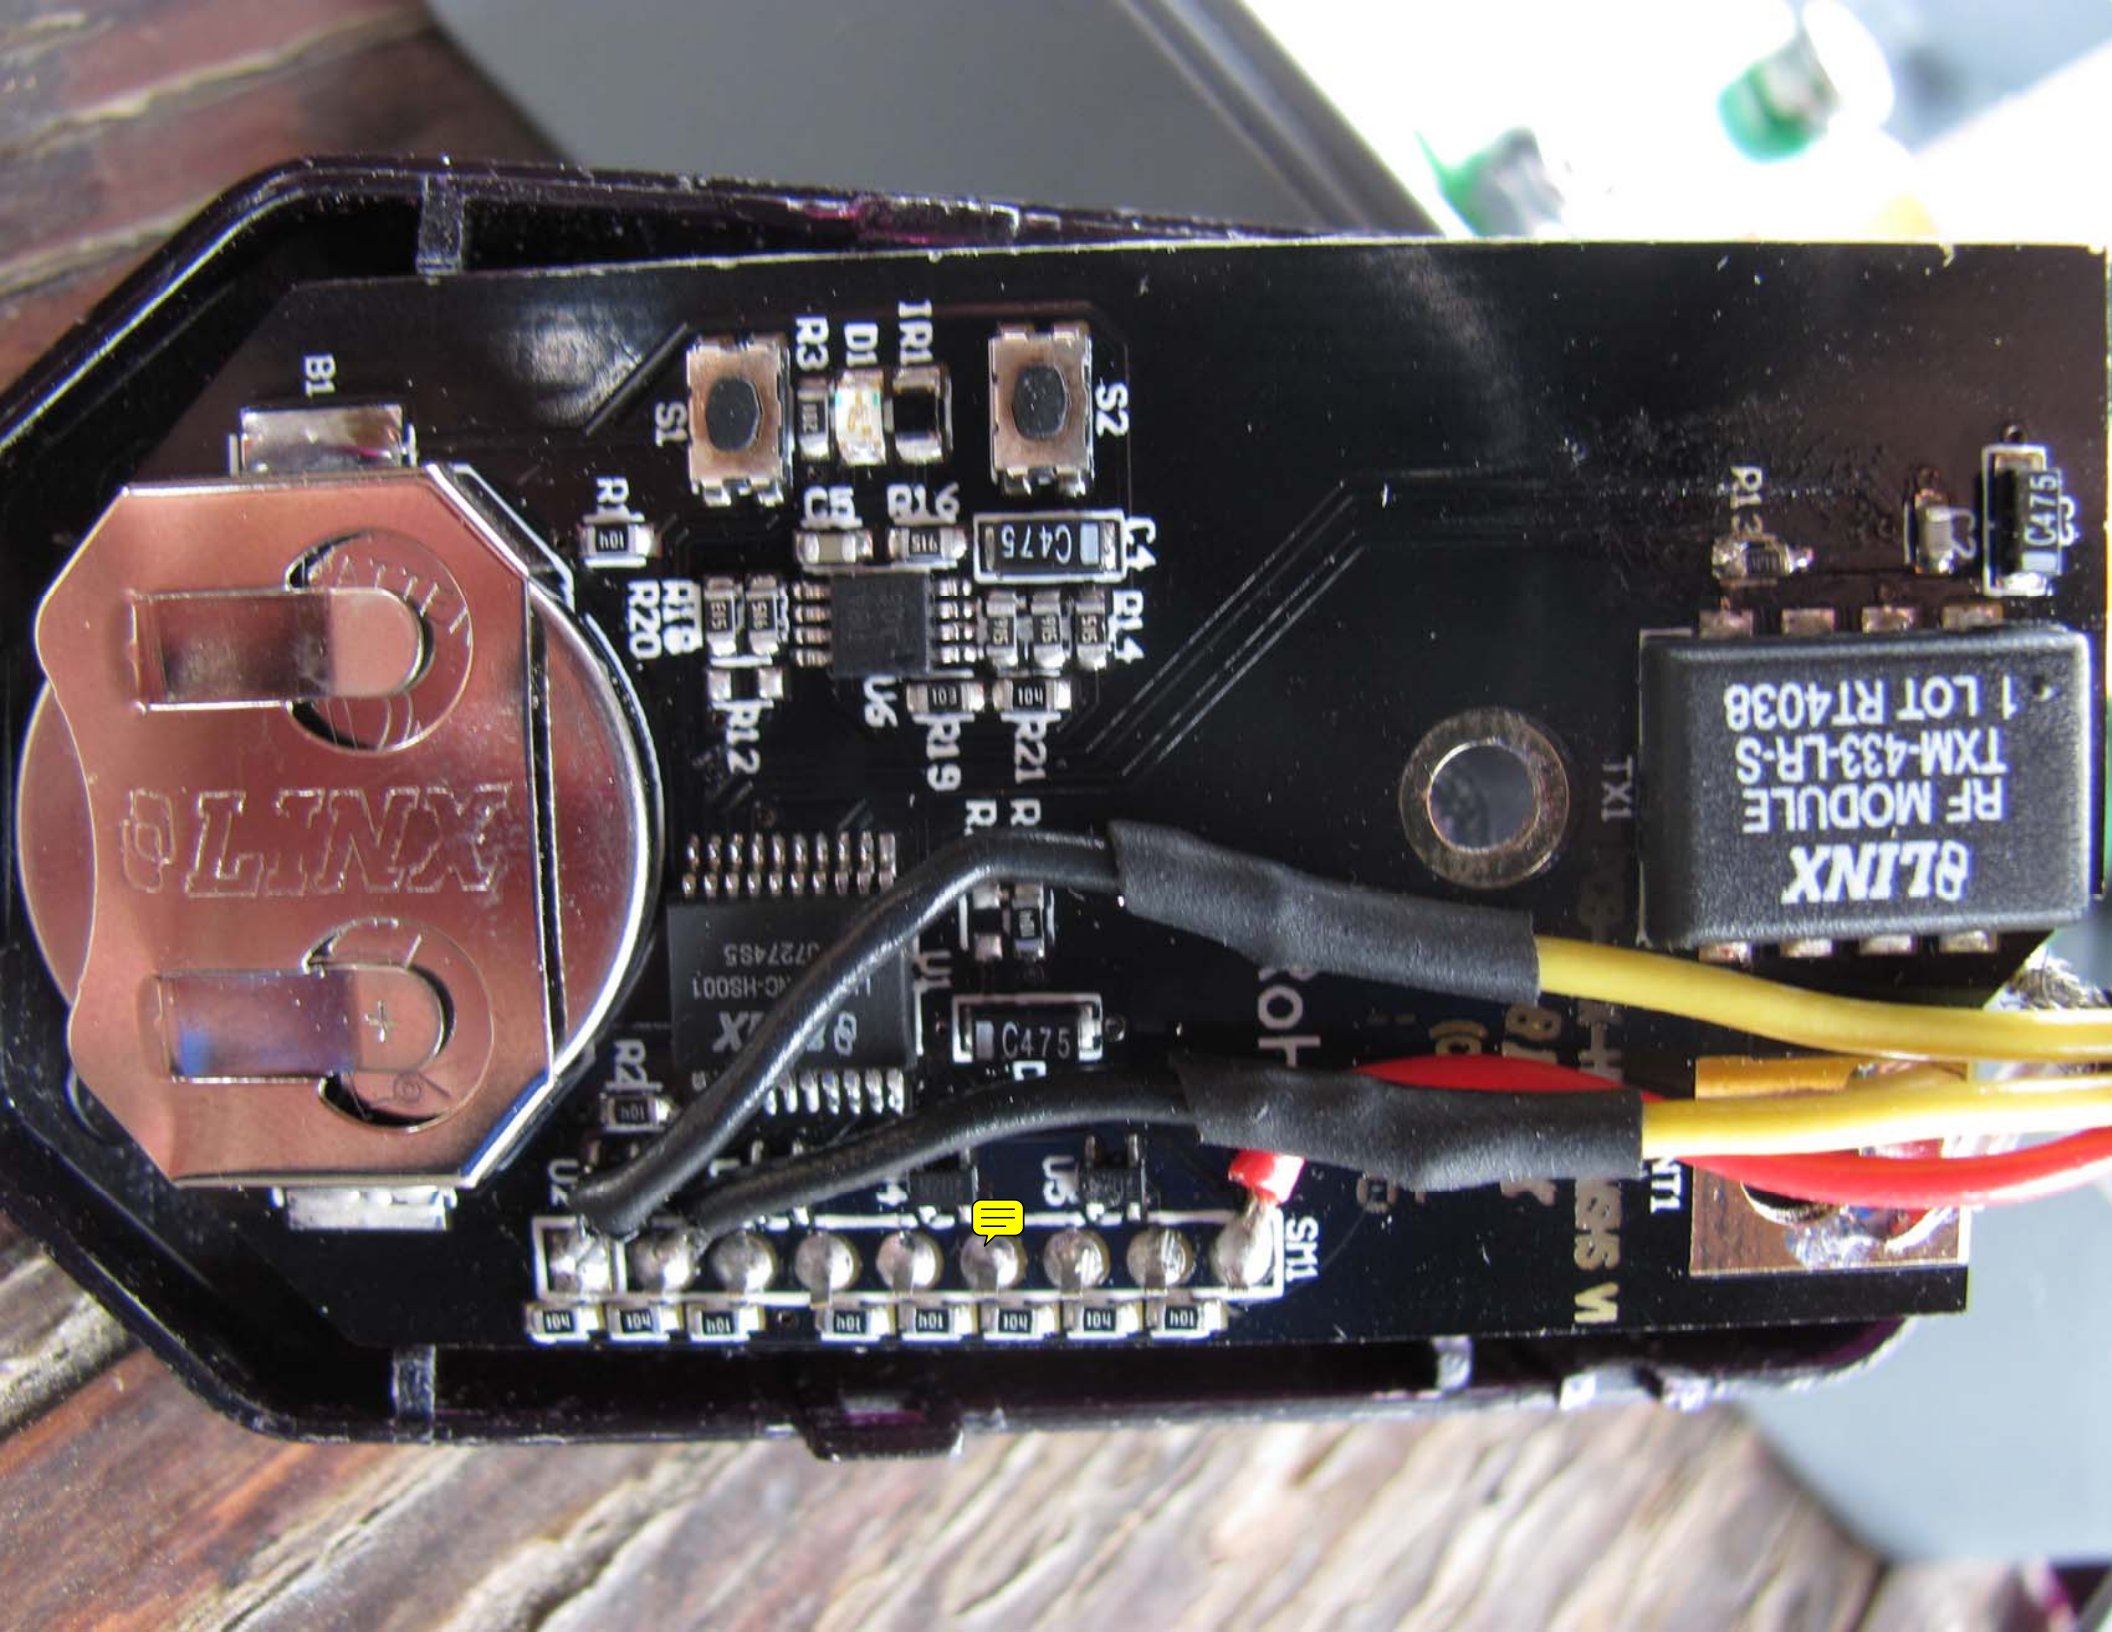


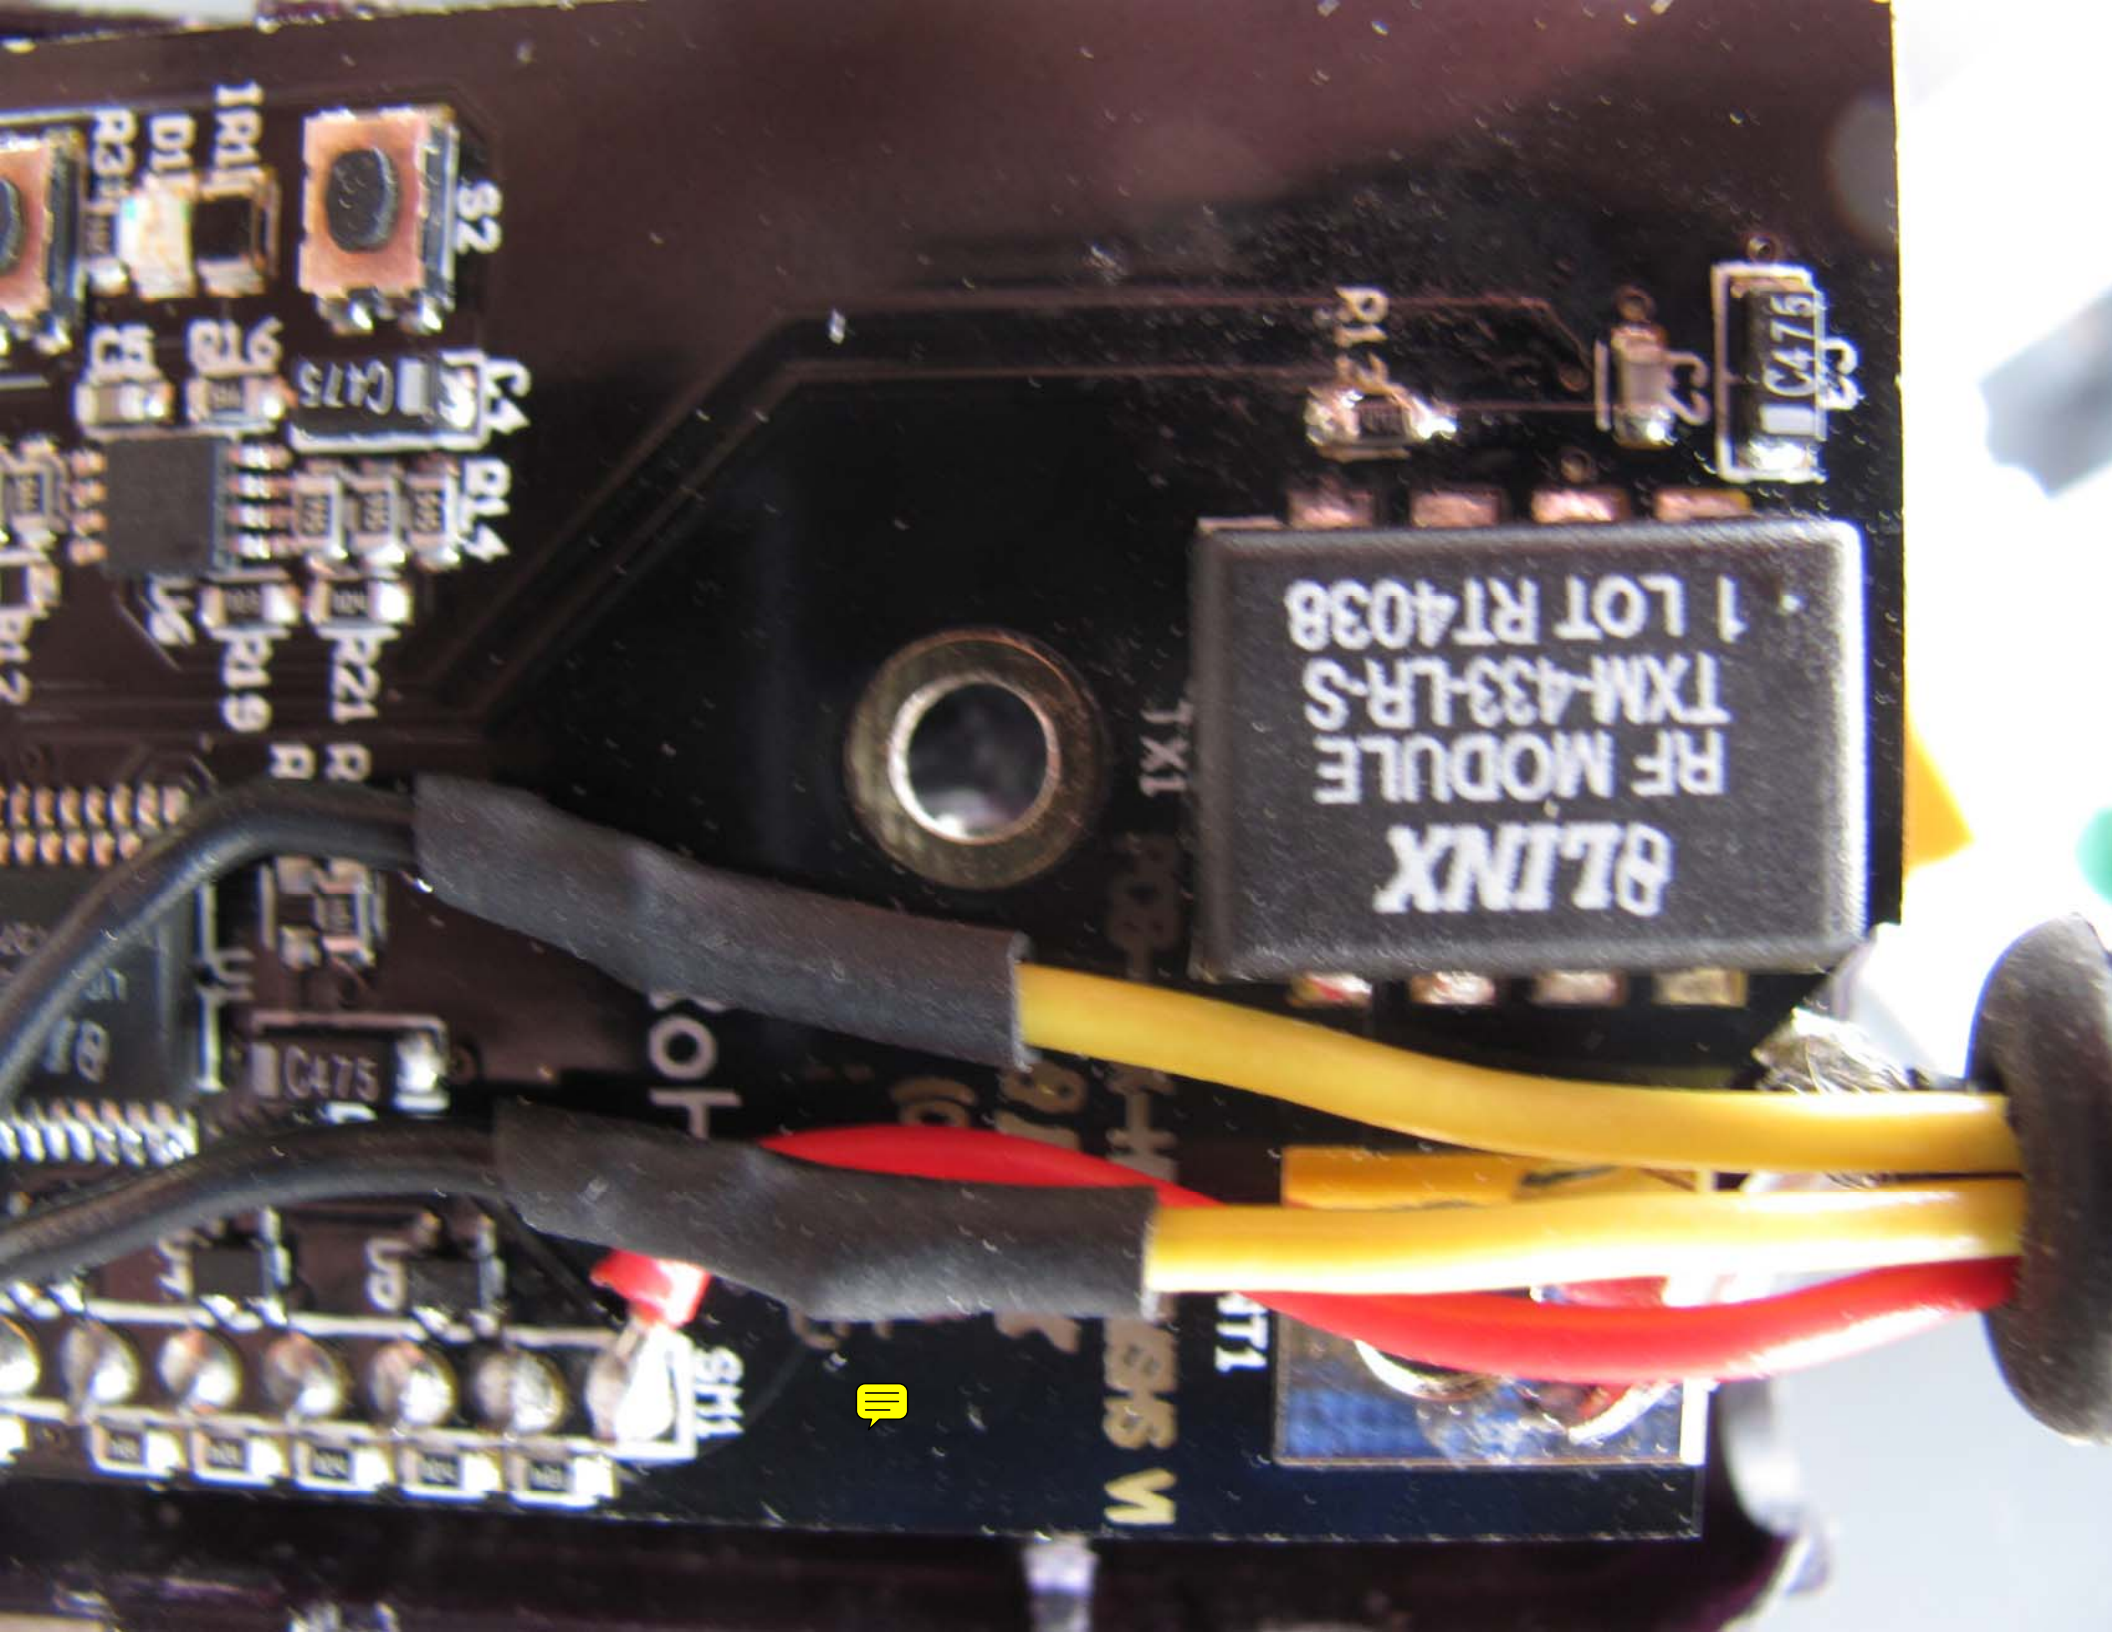



8LINX
RF MODULE
TXM-433-LR-S
1 LOT RT4038

1X1



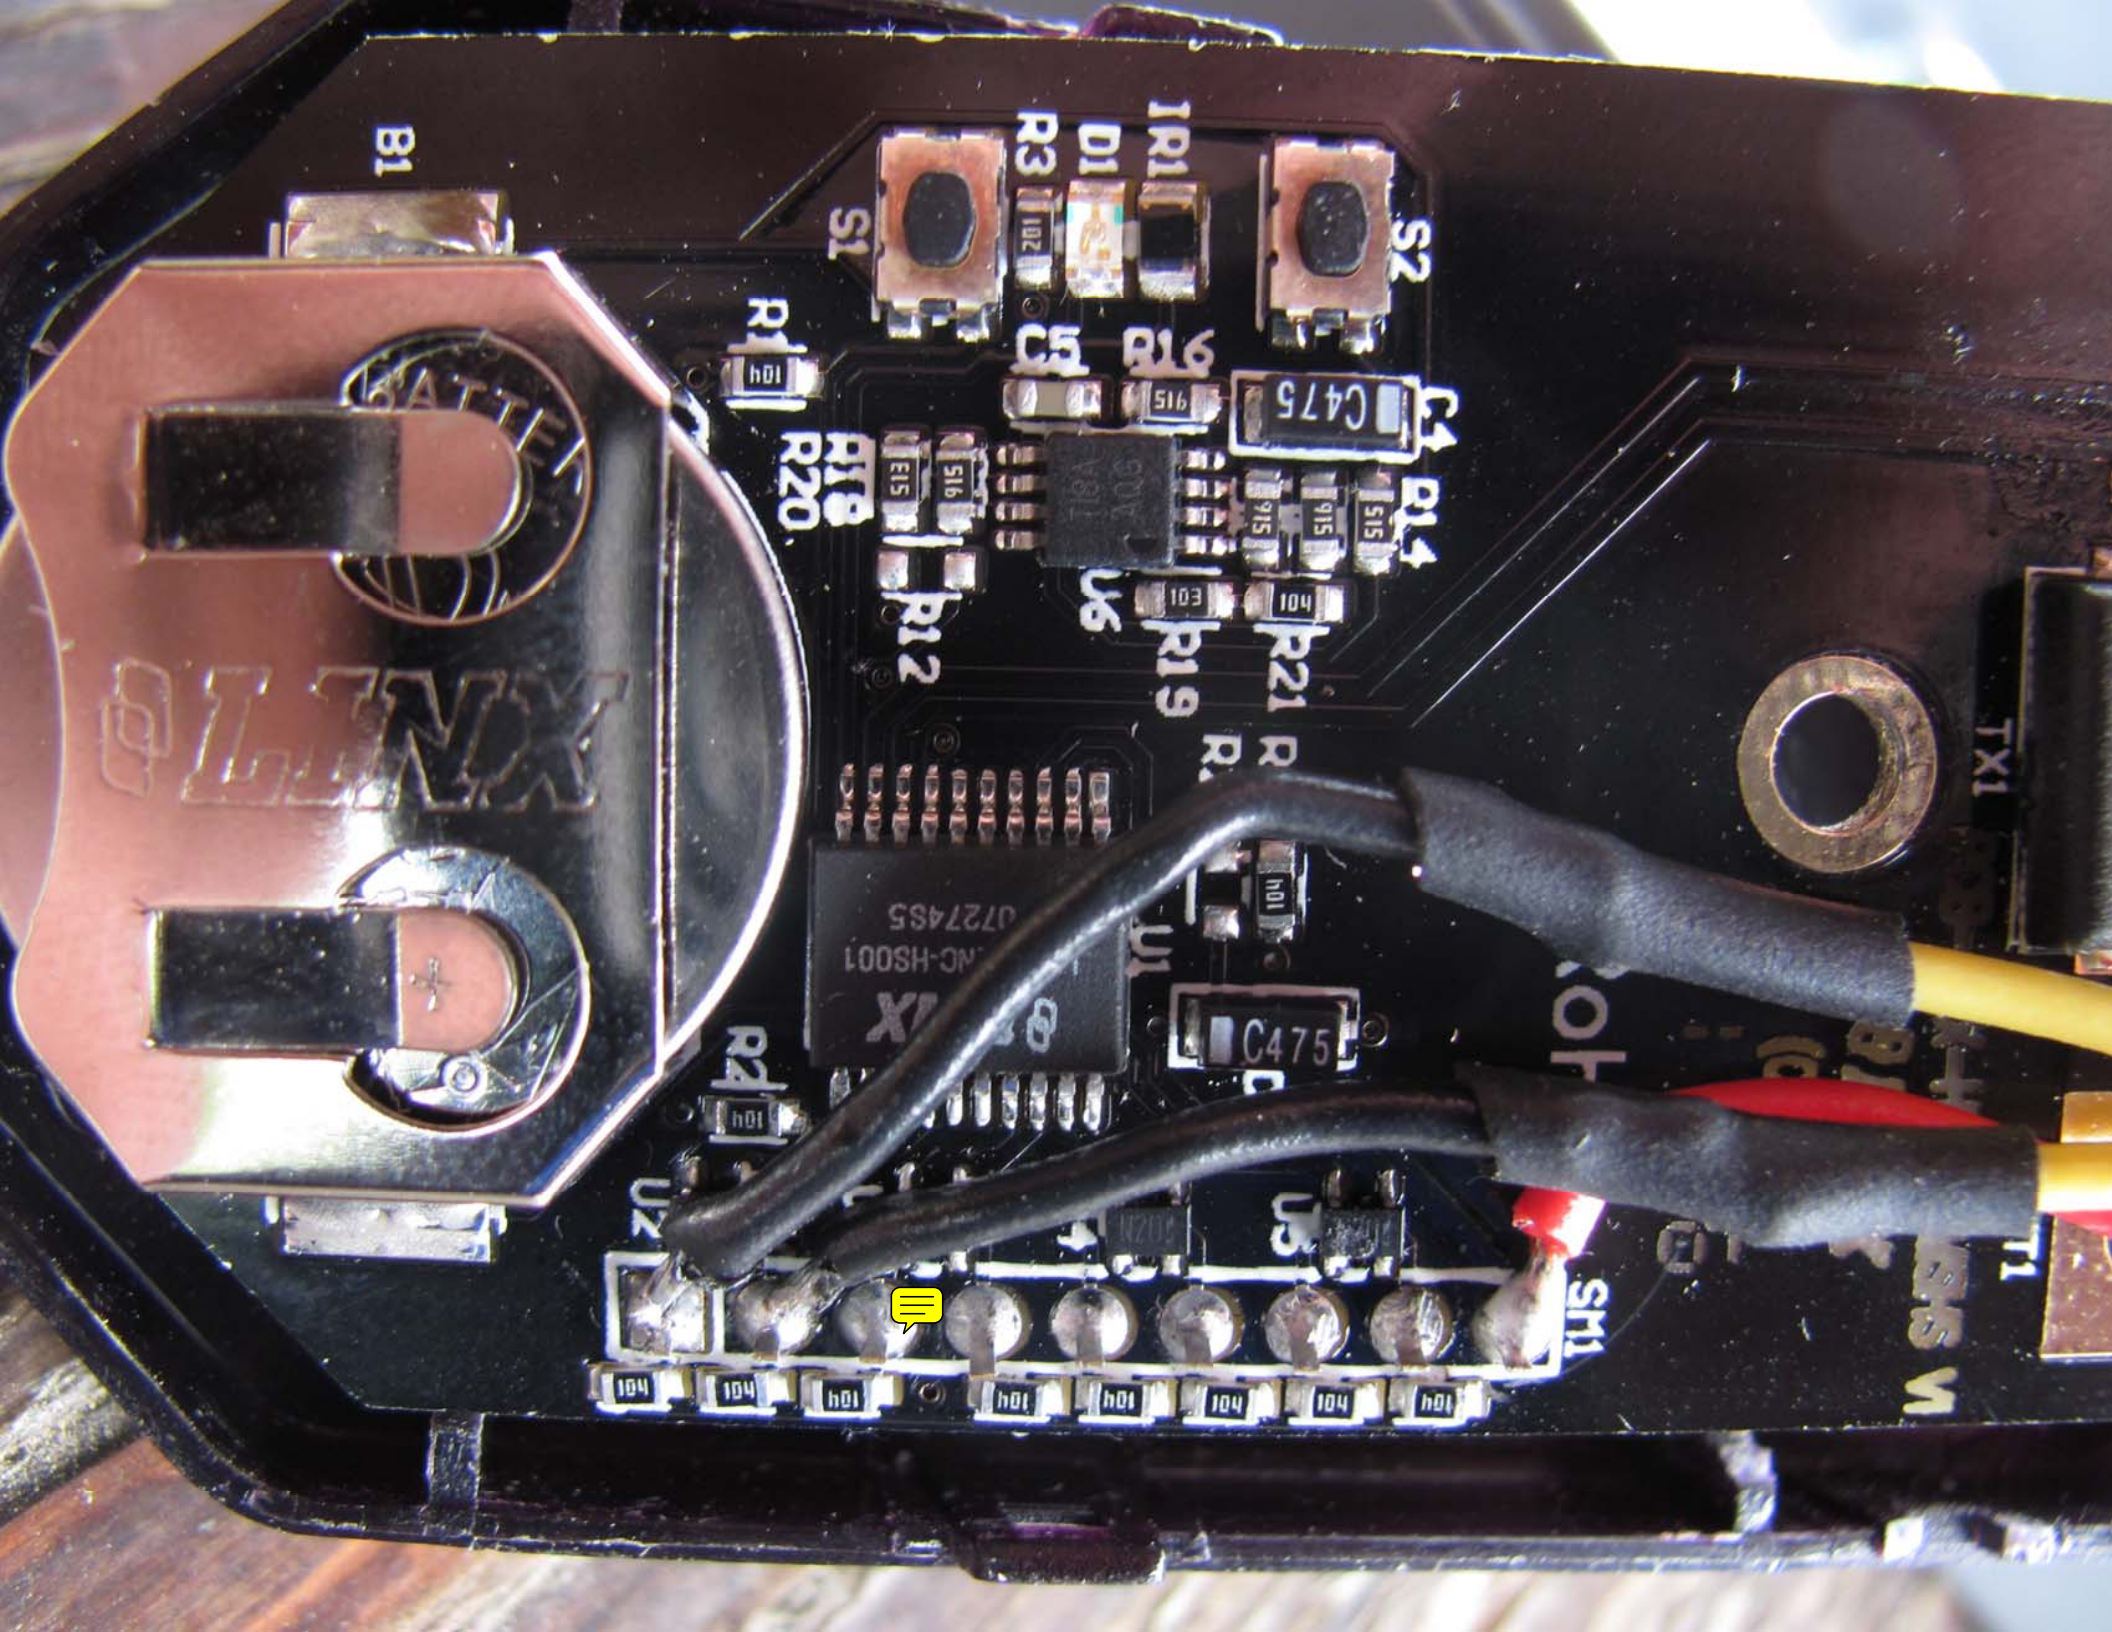

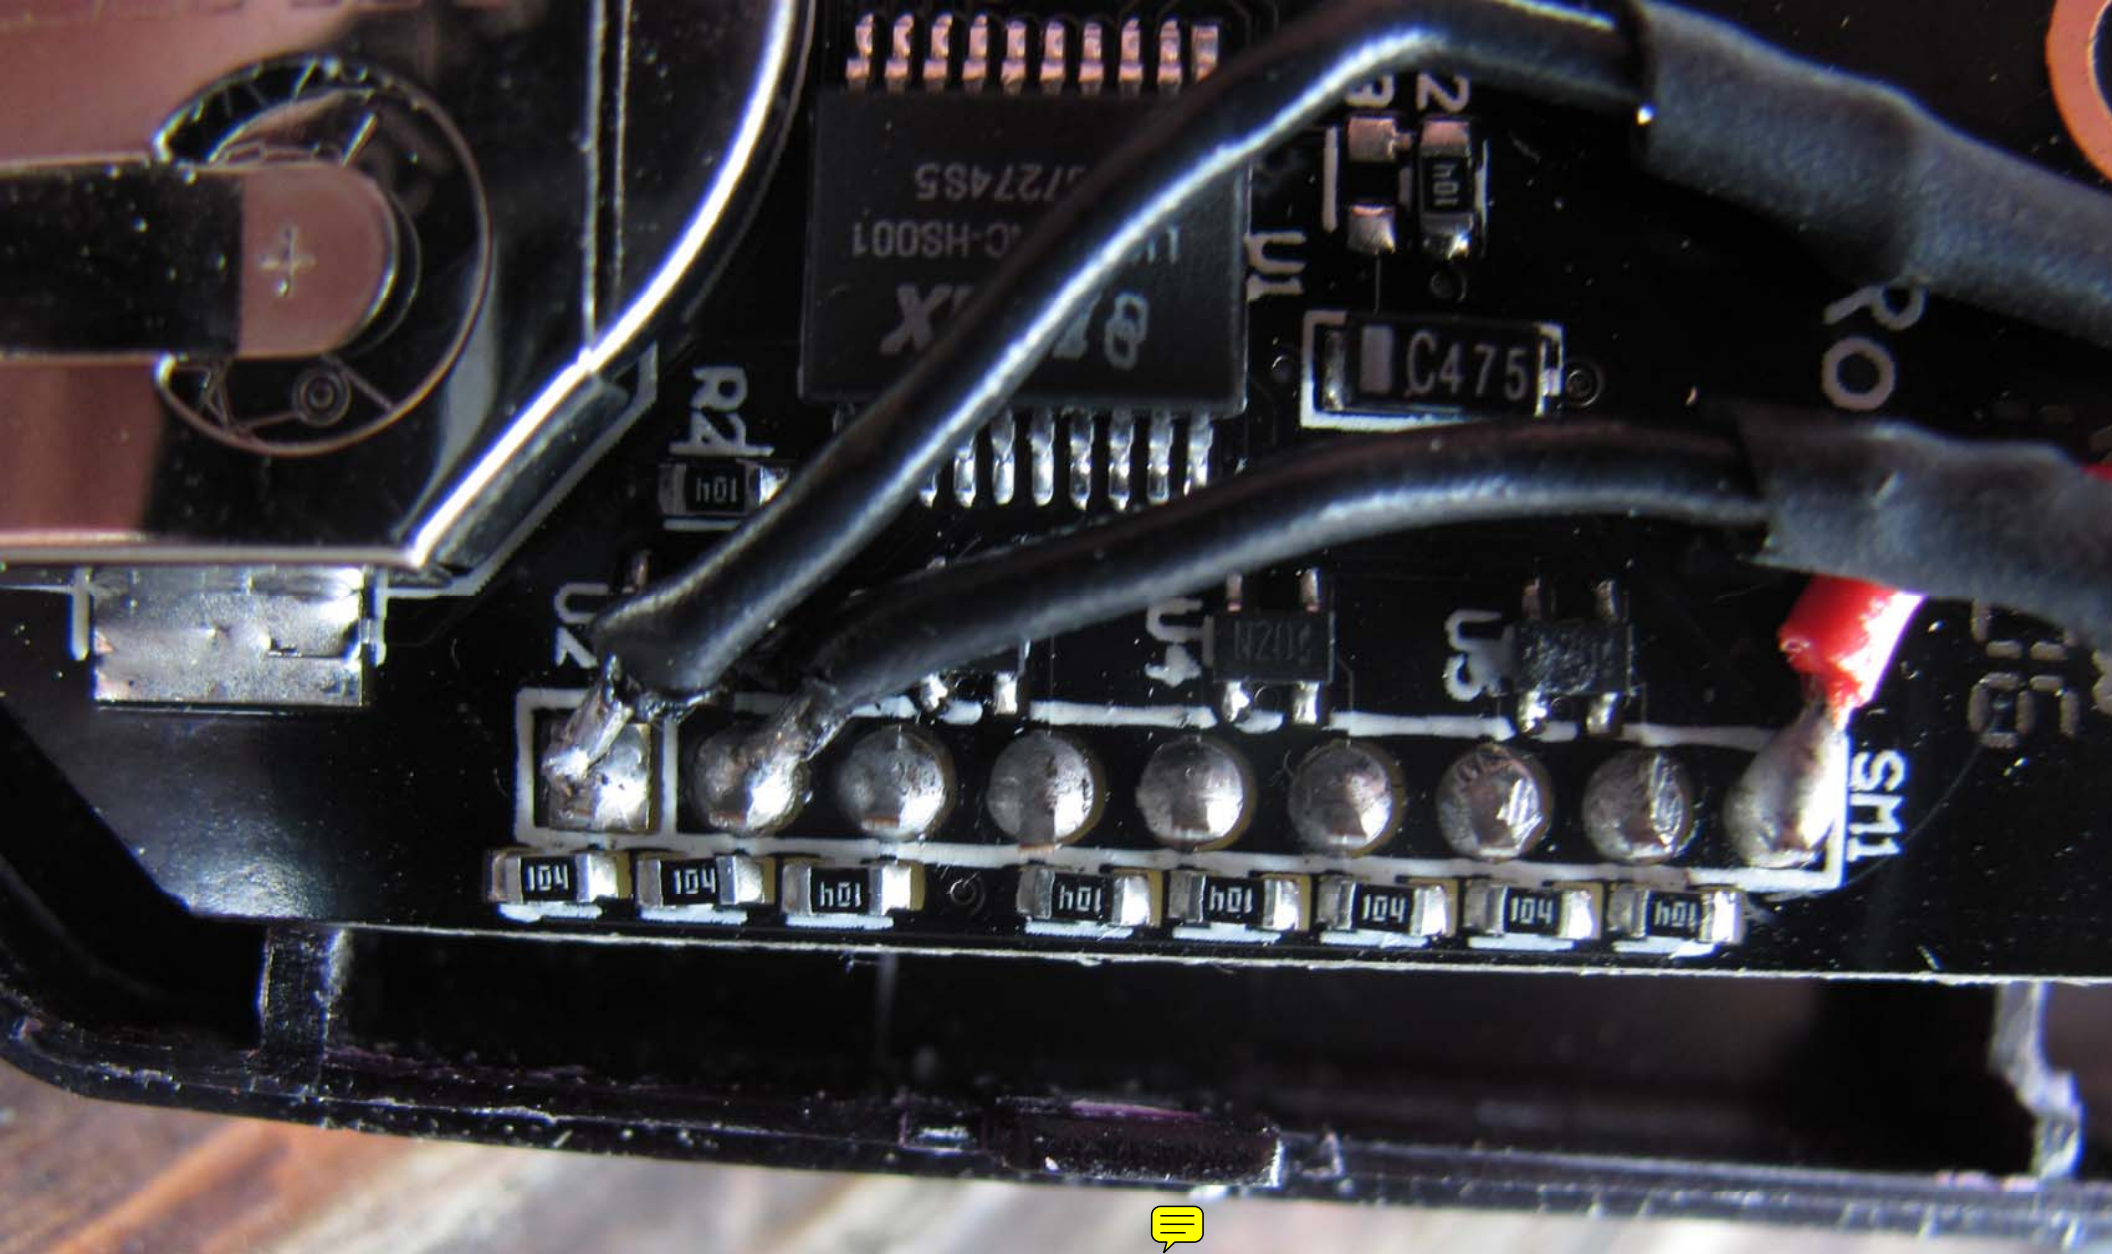

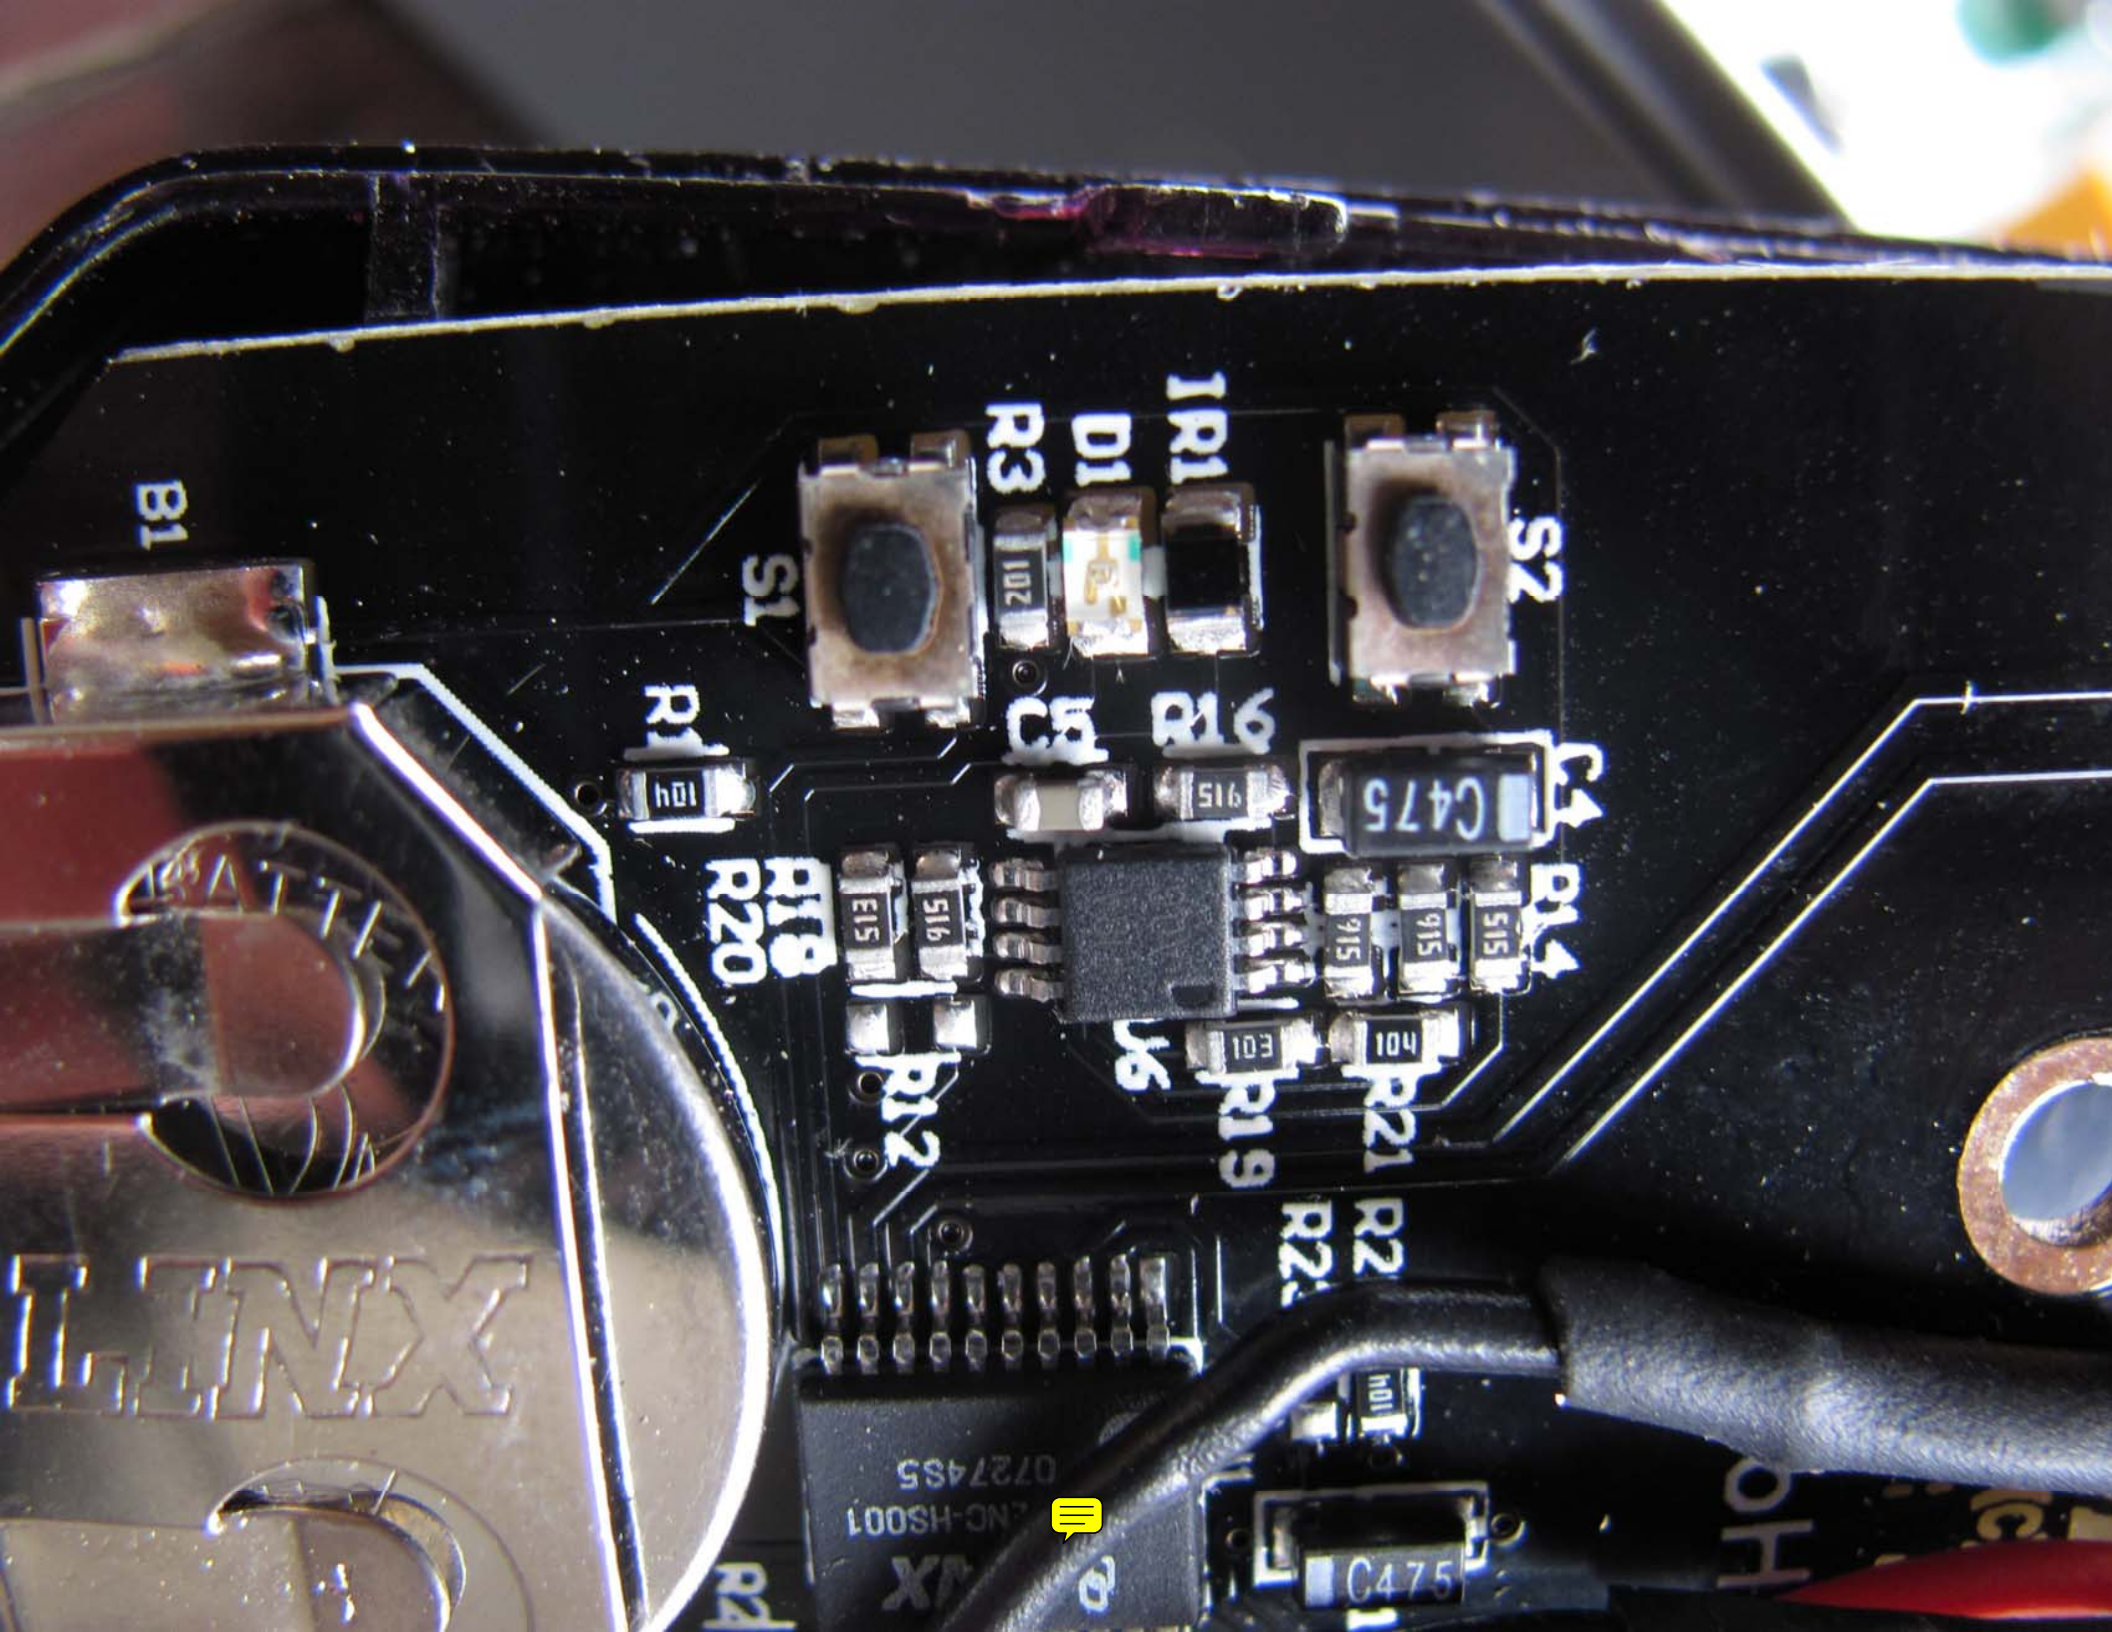


DS2E RELAY1

11128L
DS2E-S-DC24V
AG232444 CHINA
0.6A125VAC
0.6A110VDC
2A 30VDC

DS2E RELAY2


11128L
DS2E-S-DC24V
AG232444 CHINA
0.6A125VAC
0.6A110VDC
2A 30VDC



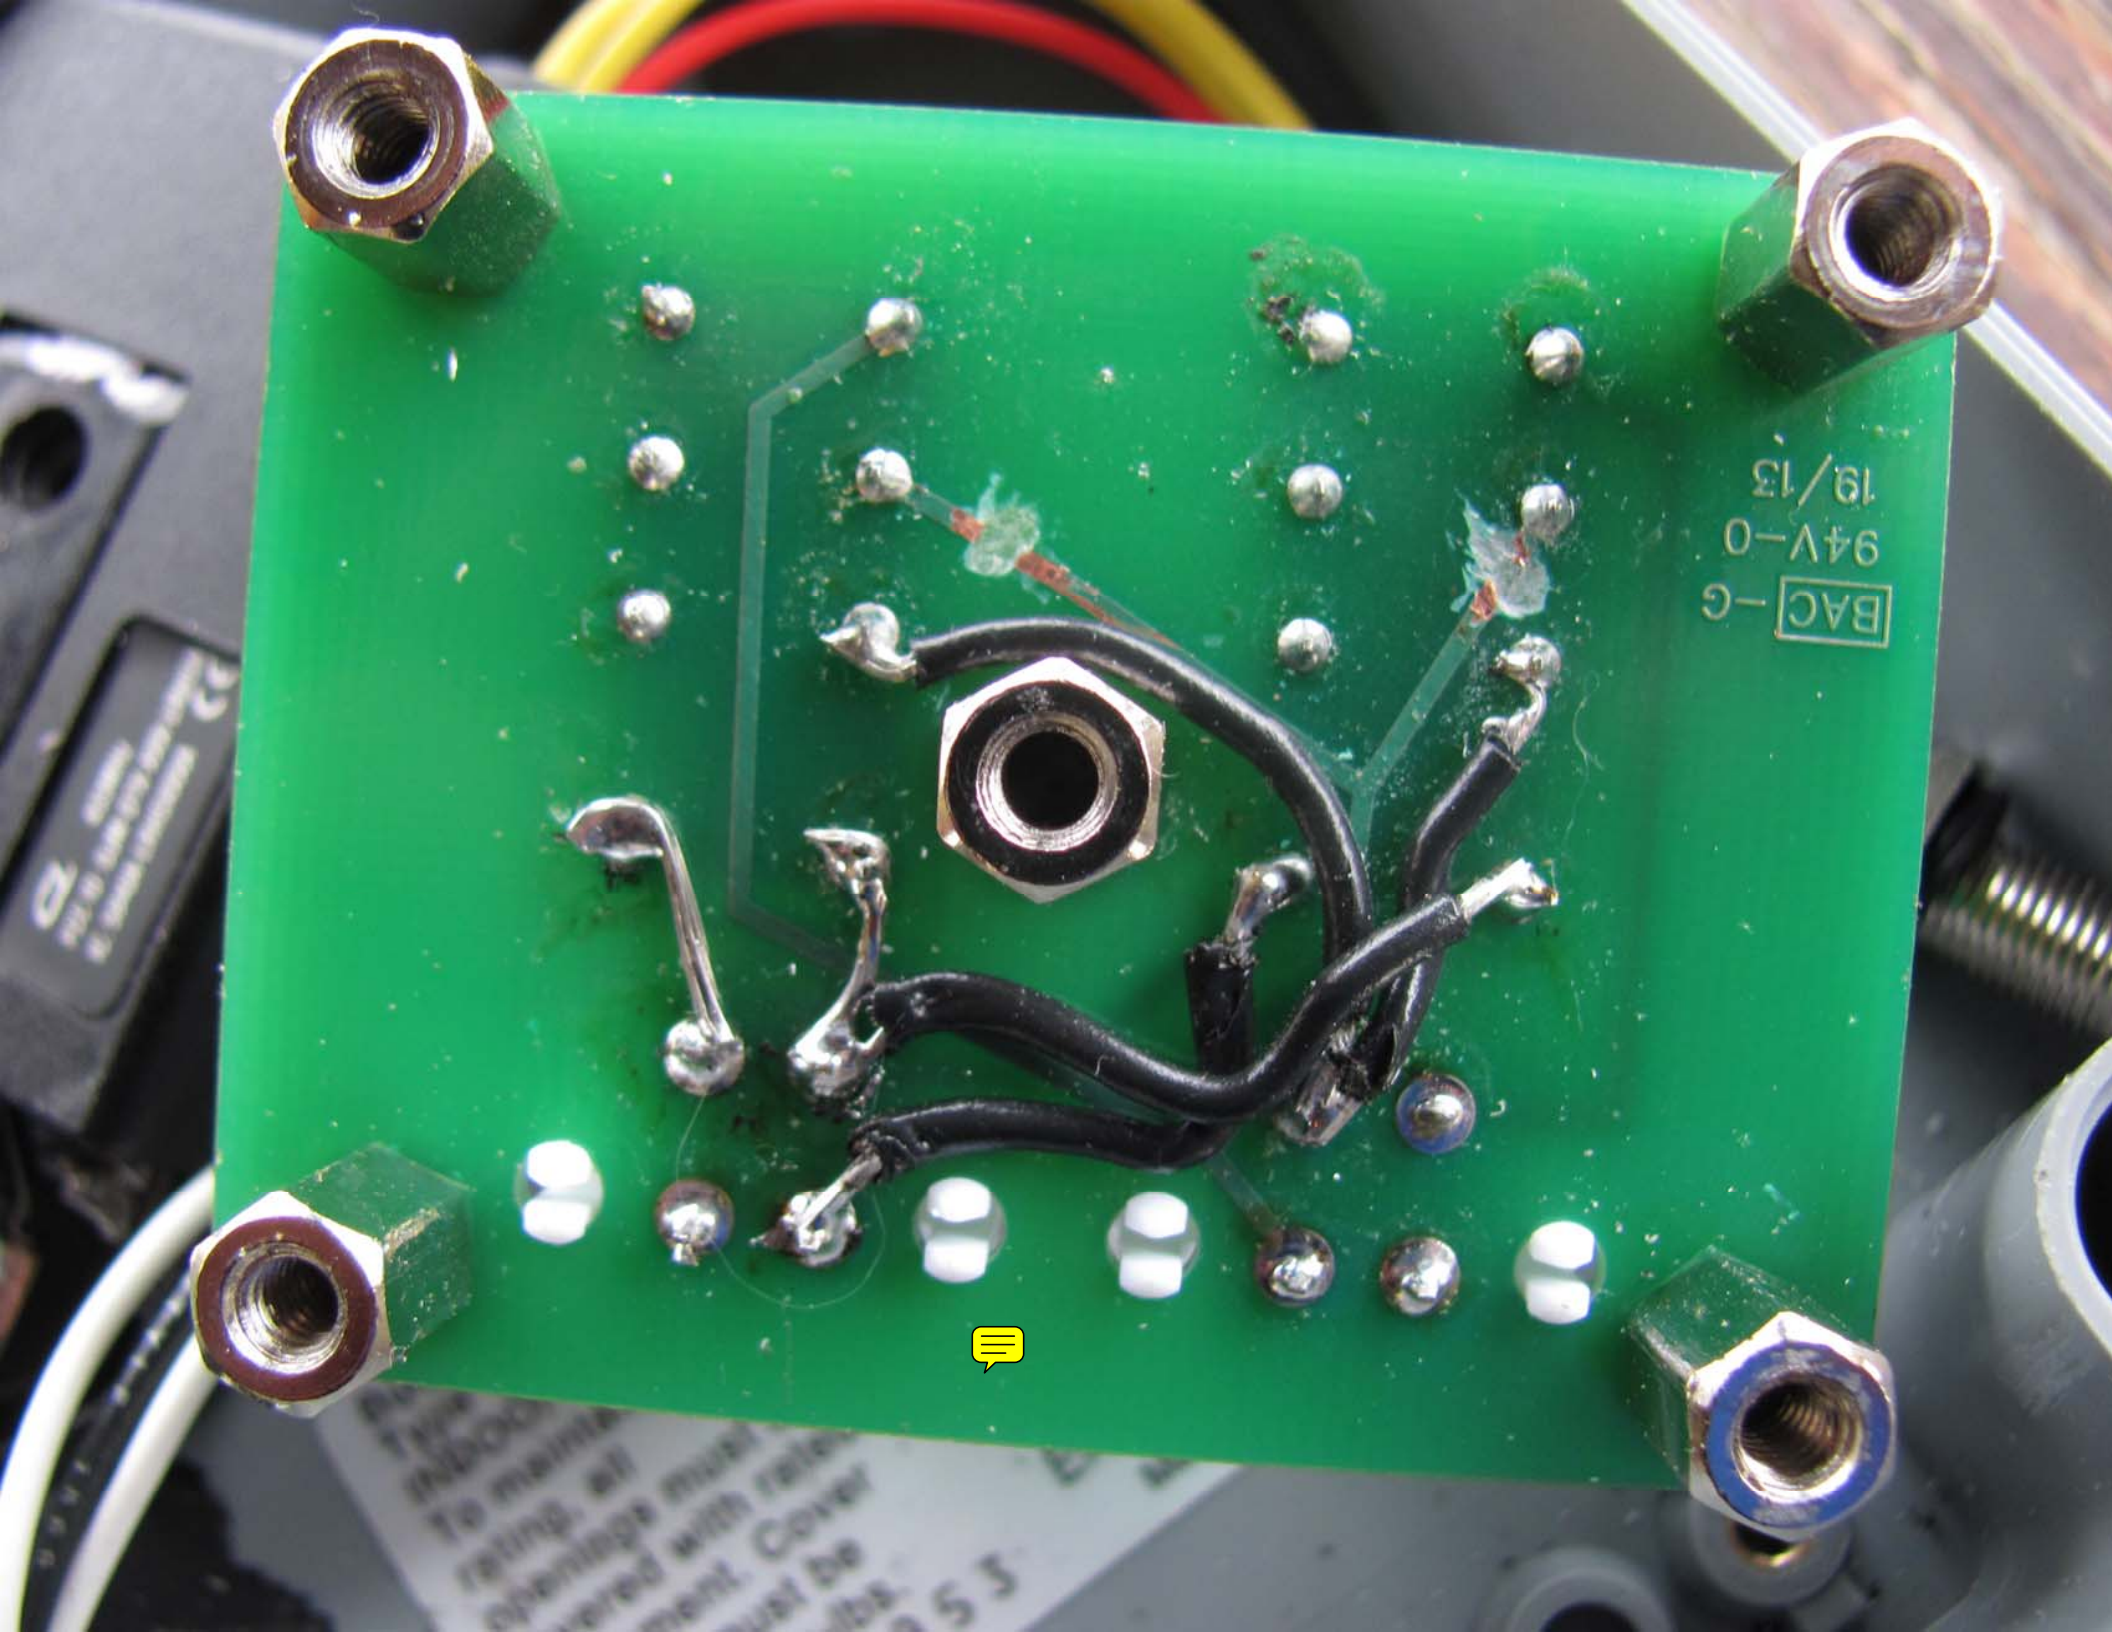


BAC -G
94V-0
19/13



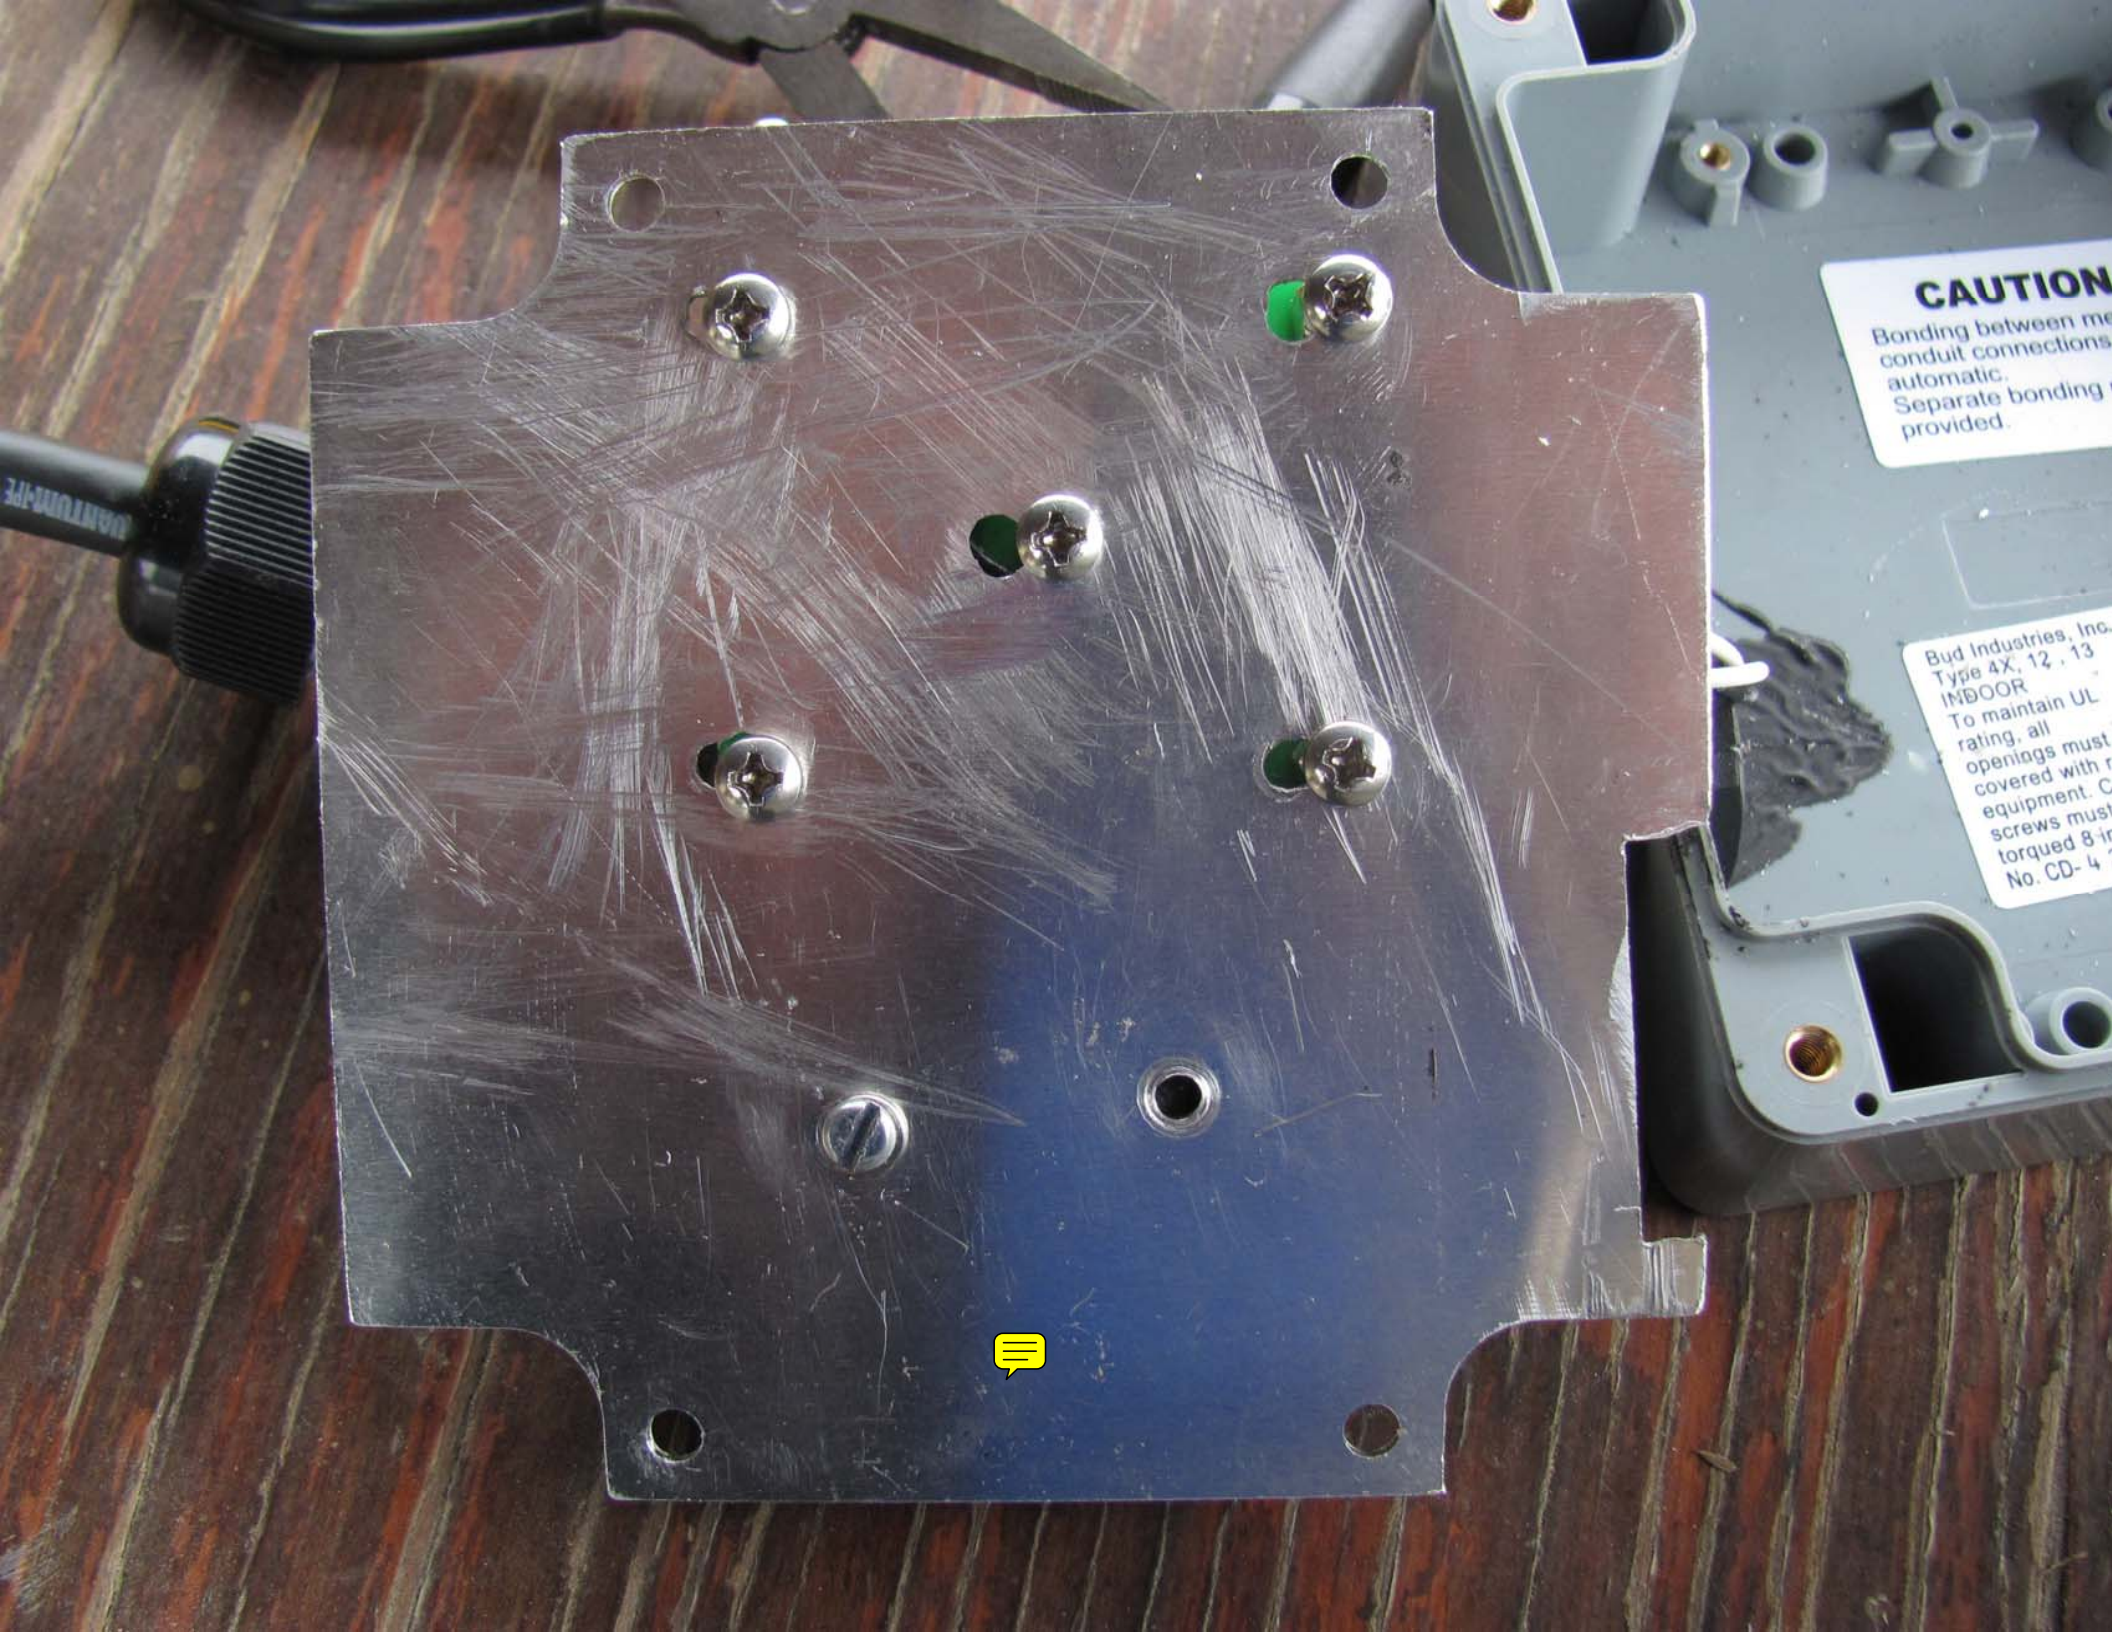

CAUTION
Bonding between metal
conduit connections is
automatic.
Separate bonding is
provided.

Bud Industries, Inc.
Type 4X, 12, 13
INDOOR
To maintain UL
rating, all
openings must
be covered with
equipment. C
screws must
be torqued 8 in
No. CD-4

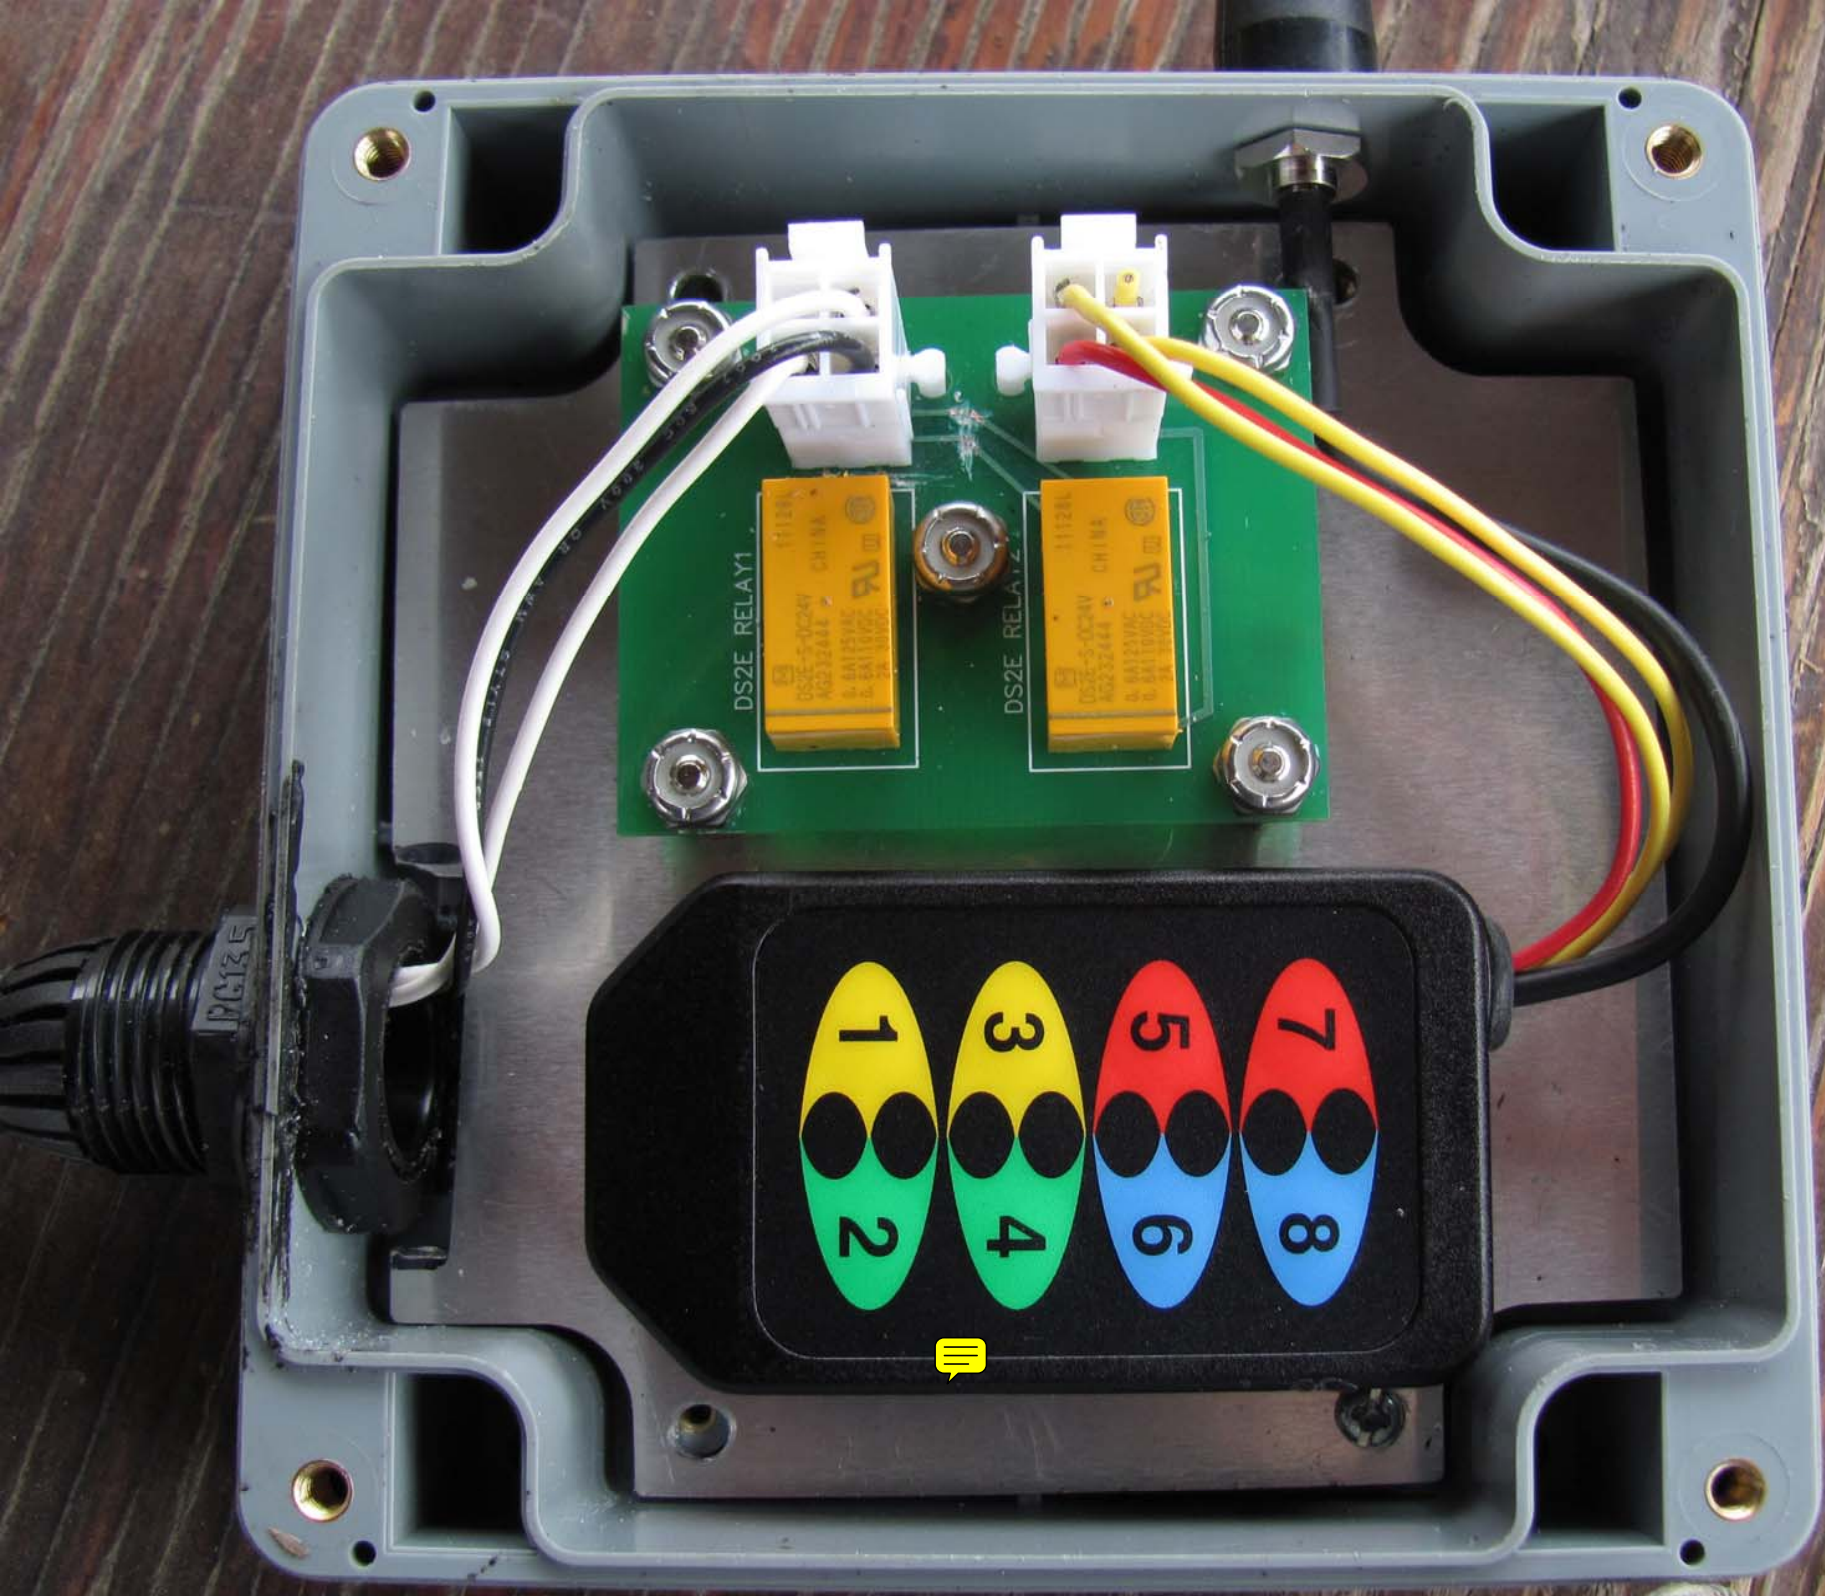

CAUTION

Bonding between metallic
conduit connections is not
automatic.
Separate bonding must be
provided.

Bud Industries, Inc.
Type 4X, 12, 13
INDOOR
To maintain UL
rating, all
openings must be
covered with rated
equipment. Cover
screws must be
torqued 8 in-lbs.
No. CD- 4 2 9 9 5 3

UL **US**
LISTED
INDUSTRIAL
CONTROL
PANEL
ENCLOSURE
Made In Taiwan