
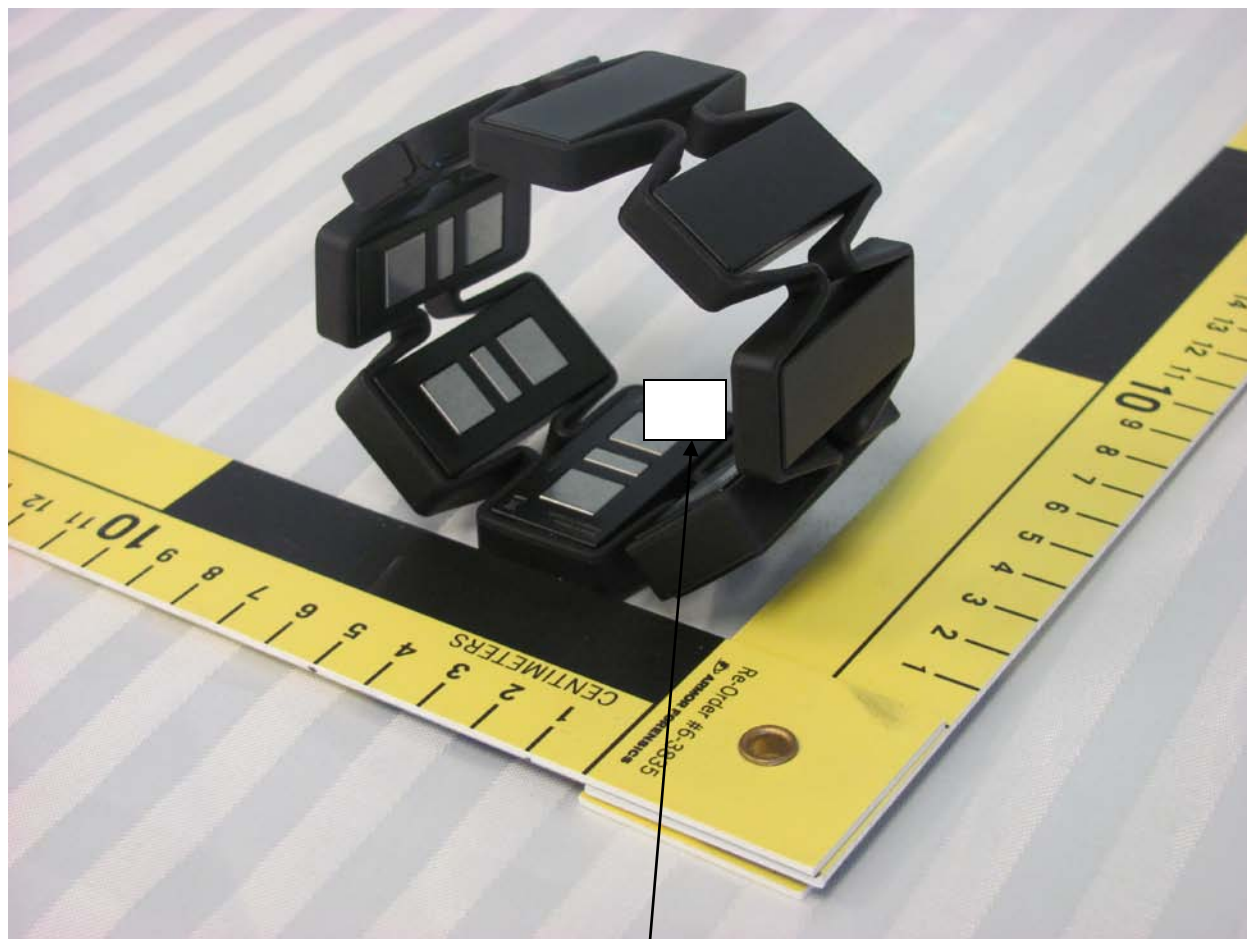


|             |  |   |
|-------------|--|---|
| Client      | Thalmic Labs Inc                                     |  |
| Product     | Myo Armband  |   |
| Standard(s) | RSS 210 Issue 8:2010 / FCC Part 15 Subpart C 15:2014 |   |



Label Location