
XT-iP630

Labels description

1. Packing:



2. Outside product:

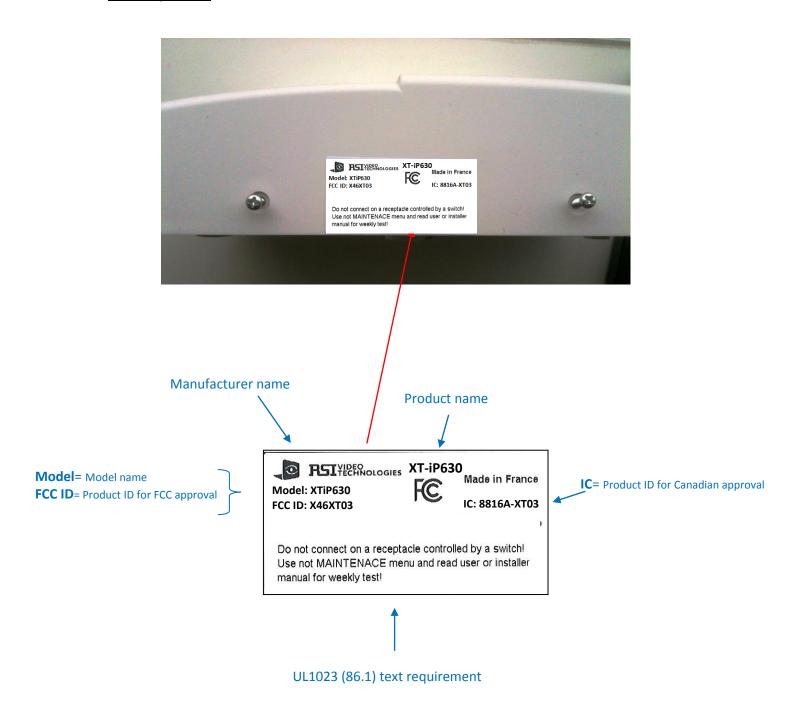

3. Inside product:

Power supply information with UL1023 (86.1) requirements


POWER SUPPLY / ALIMENTATION

Option 1 : == 14.4VDC (4 x Lithium 3.6V LSH20 SAFT) (estimated life = 4 years) / (autonomie = 4 ans)

Option 2: (Mandatory when LAN selected)
==-/~9-12VAC/DC - 1.2A
+ 6VDC (4 x Alkaline 1.5V LR20 D)
(estimated life = 1 year) / (autonomic

See user or installer manual for batteries maintenance and periodic replacement instructions / Pour la maintenance ou le changement de pile, voir le manuel d'installateur ou d'utilisateu

Retirer les piles avant toute intervention de maintenance! (EN) Remove batteries before any maintenance! (D) batterien vor jeglichen Wartungsareiten entfermen!

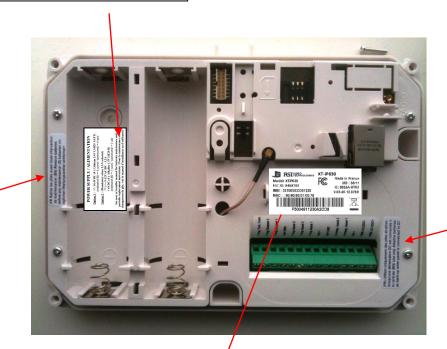

lorsqu'une alimentation DC est connectée à la centrale (EN) Use only Alkaline batteries as back-up when panel is connected to DC (FR) Utilisez uniquement des piles alcalines

Manufacturer name

Product name

Model = Model name **FCC ID**= Product ID for FCC approval **IMEI**= IMEI number of the GPRS modem MAC = MAC address of the LAN interface RSI YIDEO

Model: XTiP630 FCC ID: X46XT03

IMEI: 357005033351220 MAC::90:90:60:01:00:78 XT-iP630

Made in France MD: 36/11 IC: 8816A-XT03

V.03.40.12.078D



Product serial number

MD= Manufacturing date: WEEK/YEAR **IC**= Product ID for Canadian approval

V= Firmware version