




ZONESCAN 820 Alpha V2, test setup fully anechoic chamber

 Examiner:
 Thomas KÜHN
 Report Number:
 F190760E2

 Date of issue:
 30.08.2019
 Order Number:
 19-110760
 page 1 of 4



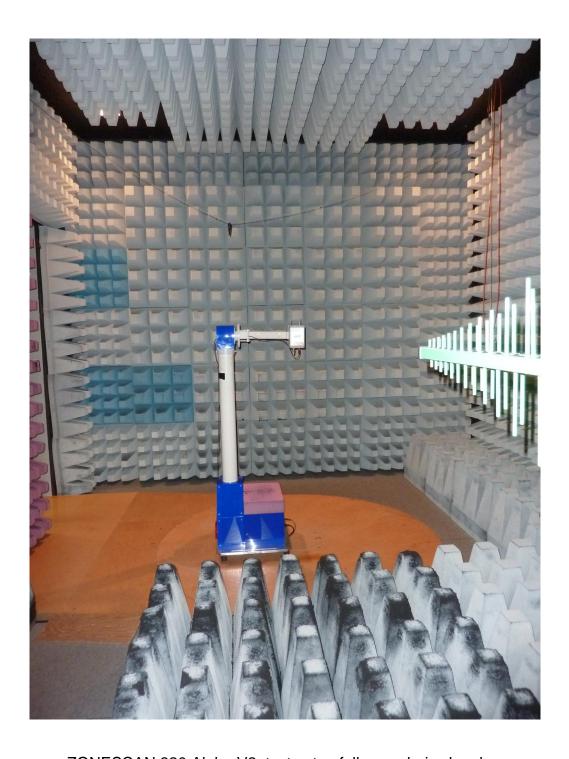


ZONESCAN 820 Alpha V2, test setup fully anechoic chamber

 Examiner:
 Thomas KÜHN
 Report Number:
 F190760E2

 Date of issue:
 30.08.2019
 Order Number:
 19-110760
 page 2 of 4



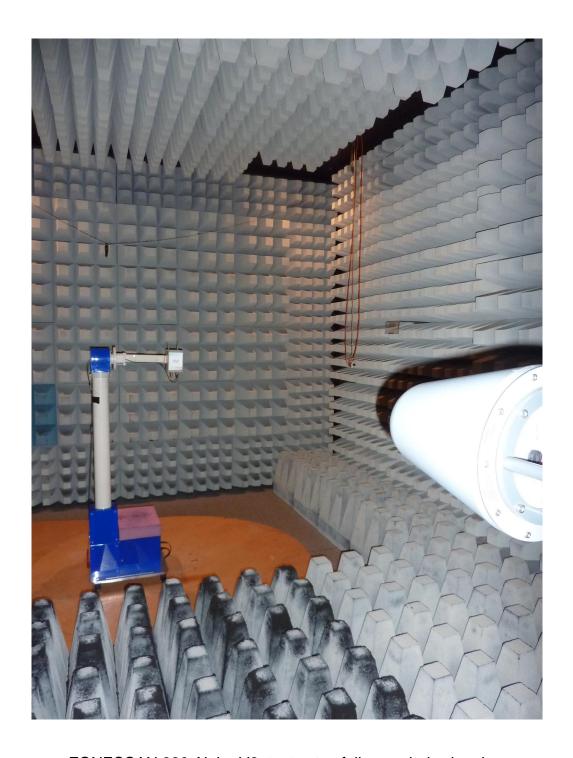


ZONESCAN 820 Alpha V2, test setup fully anechoic chamber

 Examiner:
 Thomas KÜHN
 Report Number:
 F190760E2

 Date of issue:
 30.08.2019
 Order Number:
 19-110760
 page 3 of 4



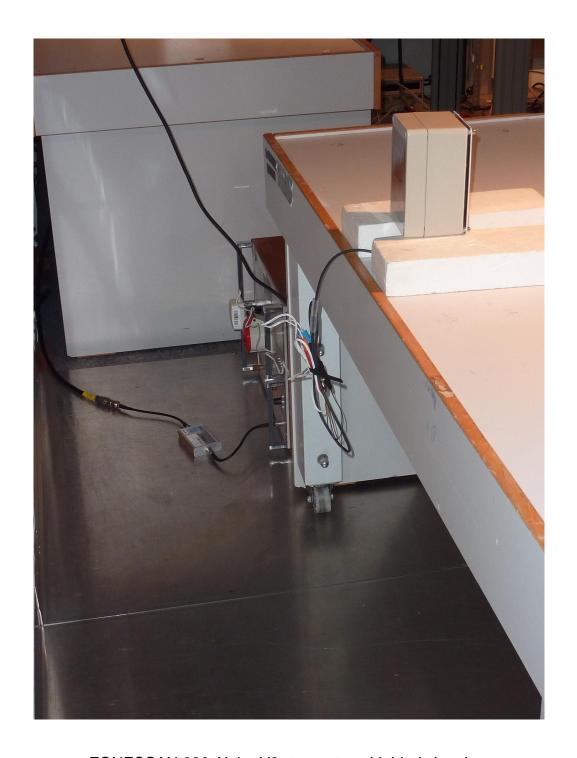

ZONESCAN 820 Alpha V2, test setup shielded chamber

 Examiner:
 Thomas KÜHN
 Report Number:
 F190760E2

 Date of issue:
 30.08.2019
 Order Number:
 19-110760
 page 4 of 4