

Brief paper

Multivariable PID control with set-point weighting via BMI optimisation[☆]Fernando D. Bianchi^{*,1}, Ricardo J. Mantz², Carlos F. Christiansen³*Laboratorio de Electrónica Industrial, Control e Instrumentación (LEICI), Facultad de Ingeniería, Universidad Nacional de La Plata, CC 91, 1900 La Plata, Argentina*

Received 6 June 2006; received in revised form 28 December 2006; accepted 31 May 2007

Available online 14 September 2007

Abstract

The paper focuses on the design of multivariable PID controllers with set-point weighting. The advantage of this PID structure is that the responses of the system to disturbances and to changes in the set-point can be adjusted separately. The proposed design methods rely on the transformation of the tuning of the controller gains into a static output feedback (SOF) problem. Hence, multivariable PID controllers can be designed by solving an optimisation problem with bilinear matrix inequalities (BMIs). The paper addresses the design of both time-invariant and gain-scheduled robust controllers. All of the tuning methods discussed through the paper are based on a PID structure with filtered derivative term, thus guaranteeing the well-posedness of the closed loop system.

© 2007 Elsevier Ltd. All rights reserved.

Keywords: PID control; Robust control; Gain scheduling; Bilinear matrix inequality (BMI); Linear parameter varying systems**1. Introduction**

Although new and more powerful tools have been developed, PID control is still the most used control strategy in industrial applications. An attractive feature of PID controllers is their relatively simple and intuitive design. Moreover, the fixed structure of PID controllers has made possible the development of ready-made hardware modules and software packages for a quick and easy implementation (Li, Ang, & Chong, 2006). For these reasons, PID controllers are commonly preferred even though more aggressive controllers can be obtained with other more sophisticated techniques.

The popularity of PID controllers has encouraged the formulation of a large number of methods for tuning the controller parameters (see e.g., Astrom & Hagglund, 2005; O'Dwyer,

2006). In MIMO plants with low interactions, it is possible to employ PID controllers in multiple SISO loops selected according to physical considerations or to a relative gain array (RGA) analysis. In this case, decentralised multivariable control, classical or indeed heuristic tuning methods can be used. However, in plants having strong interactions between the input and output pairs, it is necessary the use of centralised controllers designed with more sophisticated tuning methods usually based on optimisation notions (see e.g., Ruiz-Lopez, Rodriguez-Jimenes, & Garcia-Alvarado, 2006 and references therein). An approach, introduced in Ge, Chiu, and Wang (2002) and Zheng, Wang, and Lee (2002), consists in transforming the tuning of the controller parameters into a static output feedback (SOF) problem. Then, the controller parameters are determined by solving an optimisation problem with bilinear matrix inequalities (BMIs) for which several numerical algorithms are currently available (see e.g., Apkarian, Noll, & Tuan, 2003; El Ghaoui, Oustry, & AitRami, 1997; Goh, Safonov, & Papavassilopoulos, 1994; Orsi, Helmke, & Moore, 2006). A similar approach has also been used to formulate effective tuning methods for robust and gain-scheduled multivariable PID controllers (Mattei, 2001). It is interesting to note that these methods are actually particular cases of the procedures for designing optimal fixed-structure

[☆] This paper was not presented at any IFAC meeting. This paper was recommended for publication in revised form by Associate Editor Mario Sznaier under the direction of Editor Roberto Tempo.

* Corresponding author. Tel./fax: +54 221 4259306.

E-mail address: fbianchi@ing.unlp.edu.ar (F.D. Bianchi).

¹ UNLP-CONICET.

² UNLP-CICpBA.

³ UNLP.

controllers. This is another motivation to examine these tuning methods.

Over the years, several modifications to the standard algorithm have been proposed with the aim of improving the performance and operativity of PID controllers. One of these alternative structures is the so-called PID with set-point weighting or two degree of freedom PID (2DOF-PID). The advantage of the 2DOF-PID structure is that the responses of the system to disturbances and to changes in the set-point can be adjusted separately. This characteristic results especially useful when the controller must accomplish several simultaneous specifications (Astrom & Hagglund, 2005). The 2DOF-PID structure is widely accepted for single-loop controllers. However, tuning methods for multivariable centralised 2DOF-PID controller are not commonly treated in the literature.

This paper introduces a tuning method for multivariable 2DOF-PID controllers based on BMI optimisation. Firstly, in Section 2, the design of 2DOF-PID controllers for linear time-invariant (LTI) plants is examined. Subsequently, Section 3 discusses the design of robust and gain-scheduled controller in the context of linear parameter varying (LPV) systems.

2. 2DOF-PID control for LTI plants

Consider the following LTI plant:

$$\begin{aligned}\dot{x}(t) &= Ax(t) + B_w w(t) + B_u u(t), \\ z(t) &= C_z x(t) + D_{zw} w(t) + D_{zu} u(t), \\ y(t) &= C_y x(t) + D_{yw} w(t),\end{aligned}\quad (1)$$

where $x \in \mathbb{R}^{n_s}$ is the state, $w \in \mathbb{R}^{n_w}$ is the disturbance, $u \in \mathbb{R}^{n_u}$ is the control input, $y \in \mathbb{R}^{n_y}$ is the measured output and $z \in \mathbb{R}^{n_z}$ is a fictitious signal used to assess the closed loop performance. It is assumed that the pairs (A, B_u) and (A, C_y) are stabilisable and detectable, respectively.

The purpose of this section is to provide a tuning method for a multivariable 2DOF-PID controller of the form

$$u(t) = K_p e_p(t) + K_i \int_0^t e(\eta) d\eta + K_d \frac{de_d(t)}{dt}, \quad (2)$$

where $e_p(t) = K_b r(t) - y(t)$, $e(t) = r(t) - y(t)$,

$$\tau \dot{e}_d(t) = -e_d(t) + K_c r(t) - y(t), \quad (3)$$

$r(t) \in \mathbb{R}^{n_y}$ is the set-point or reference and K_p , K_i , K_d , K_b and K_c are constant matrices of dimension $n_u \times n_y$ to be found. The time constant τ , in the filtered derivative term (3), is fixed according to the required controller bandwidth.

The control action (2) can be expressed as

$$u(s) = G_{ff}(s)r(s) + G_c(s)y(s), \quad (4)$$

where

$$G_{ff}(s) = K_{pr} + K_i \frac{1}{s} + K_{dr} \frac{s}{1 + s\tau},$$

$$G_c(s) = K_p + K_i \frac{1}{s} + K_d \frac{s}{1 + s\tau},$$

$K_{pr} = K_p K_b$ and $K_{dr} = K_d K_c$. Fig. 1 shows the closed loop system with the controller described by (4). It can be observed

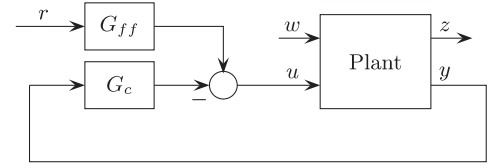


Fig. 1. Closed loop system with a 2DOF-PID controller.

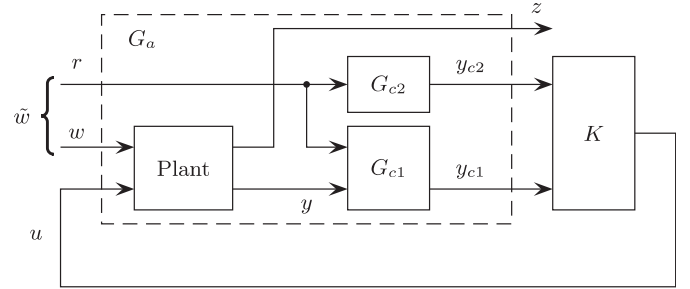


Fig. 2. Equivalent representation for the closed loop system in Fig. 1.

that the 2DOF-PID structure has different signal paths for the reference and for the controlled variable y . This feature permits to tune G_{ff} independently of G_c and then to improve the performance of the closed loop system. For example, the gains K_p , K_i and K_d can be tuned to accomplish stability and a good disturbance rejection whereas K_b and K_c to fulfil the specifications on the reference tracking.

To transform the tuning of controller parameters into a SOF problem, we define the following transfer matrices:

$$G_{c1} = \begin{bmatrix} 0 & -I_{n_y} \\ \frac{1}{s} I_{n_y} & -\frac{1}{s} I_{n_y} \\ 0 & -\frac{s}{1+s\tau} I_{n_y} \end{bmatrix}, \quad G_{c2} = \begin{bmatrix} I_{n_y} \\ \frac{s}{1+s\tau} I_{n_y} \end{bmatrix}$$

and reorganise the closed loop system as Fig. 2 depicts. Hence, the tuning of a 2DOF-PID controller reduces to find a SOF gain

$$K = [K_{pr} \ K_{dr} \ K_p \ K_i \ K_d]. \quad (5)$$

In order to formulate a procedure to determine the constant gain K , let

$$\begin{aligned}\dot{x}_{c1}(t) &= A_{c1}x_{c1}(t) + B_{c11}r(t) + B_{c12}y(t), \\ y_{c1}(t) &= C_{c1}x_{c1}(t) + D_{c11}r(t) + D_{c12}y(t)\end{aligned}\quad (6)$$

and

$$\begin{aligned}\dot{x}_{c2}(t) &= A_{c2}x_{c2}(t) + B_{c2}r(t), \\ y_{c2}(t) &= C_{c2}x_{c2}(t) + D_{c2}r(t)\end{aligned}\quad (7)$$

be state-space realisations of the transfer matrices G_{c1} and G_{c2} , respectively. Therefore, the plant G_a comprised of G_{c1} , G_{c2} and the plant to be controlled (1) (see Fig. 2) is described by

$$\begin{aligned}\dot{\tilde{x}}_a(t) &= \tilde{A}x_a(t) + \tilde{B}_w \tilde{w}(t) + \tilde{B}_u u(t), \\ \tilde{z}(t) &= \tilde{C}_z x_a(t) + \tilde{D}_{zw} \tilde{w}(t) + \tilde{D}_{zu} u(t), \\ \tilde{y}(t) &= \tilde{C}_y x_a(t) + \tilde{D}_{yw} \tilde{w}(t),\end{aligned}\quad (8)$$

where $\tilde{y}^T = [y_{c2}^T \ y_{c1}^T]$, $\tilde{w}^T = [r^T \ w^T]$ and $\tilde{z}^T = [z^T \ z_l^T]$. The variable z_l includes some of the signals in Fig. 2 used as performance measurement. With these previous definitions the matrices of system (8) are

$$\begin{aligned} \tilde{A} &= \begin{bmatrix} A & 0 & 0 \\ B_{c12}C_y & A_{c1} & 0 \\ 0 & 0 & A_{c2} \end{bmatrix}, \quad \tilde{B}_w = \begin{bmatrix} 0 & B_w \\ B_{c11} & B_{c12}D_{yw} \\ B_{c2} & 0 \end{bmatrix}, \\ \tilde{B}_u^T &= [B_u^T \ 0 \ 0], \quad \tilde{C}_z = \begin{bmatrix} C_z & 0 & 0 \\ & C_{z_l} & \end{bmatrix}, \\ \tilde{D}_{zw} &= \begin{bmatrix} 0 & D_{zw} \\ & D_{z_lw} \end{bmatrix}, \quad \tilde{D}_{zu} = \begin{bmatrix} D_{zu} \\ & D_{z_lu} \end{bmatrix}, \\ \tilde{C}_y &= \begin{bmatrix} 0 & 0 & C_{c2} \\ D_{c12} & C_{c1} & 0 \end{bmatrix}, \quad \tilde{D}_{yw} = \begin{bmatrix} D_{c2} & 0 \\ D_{c11} & D_{c12}D_{yw} \end{bmatrix}. \end{aligned} \quad (9)$$

Given the state-space realisation of the open loop system (8), we have to find the constant matrix K such that the closed loop system

$$\begin{aligned} \dot{x}_{cl}(t) &= (\tilde{A} + \tilde{B}_u K \tilde{C}_u) x_{cl}(t) + (\tilde{B}_z + \tilde{B}_u K \tilde{D}_{yw}) \tilde{w}(t), \\ \tilde{z}(t) &= (\tilde{C}_z + \tilde{D}_{zu} K \tilde{C}_y) x_{cl}(t) + (\tilde{D}_{zw} + \tilde{D}_{zu} K \tilde{D}_{yw}) \tilde{w}(t) \end{aligned}$$

is internally stable and fulfils the performance specifications. In the present discussion, the performance specifications are stated as a bound on the infinite norm of the transfer \tilde{w} to \tilde{z} , i.e., $\|T_{\tilde{z}\tilde{w}}(s)\|_\infty < \gamma$. Using the well-known Bounded Real Lemma, we can transform this specification in the frequency domain into a matrix inequality in the closed loop system matrices and in a symmetric positive definite matrix (Apkarian & Gahinet, 1995). Therefore, the application of this lemma to the closed loop system leads to the following theorem.

Theorem 1. *Given the plant (1), the 2DOF-PID controller (2) guarantees that the closed loop system is internally stable and $\|T_{\tilde{z}\tilde{w}}(s)\|_\infty < \gamma$ if there exist matrices K and $X = X^T > 0$ such that*

$$\begin{bmatrix} (\tilde{A} + \tilde{B}_u K \tilde{C}_y)^T X + (\star) & \star & \star \\ (\tilde{B}_w + \tilde{B}_u K \tilde{D}_{yw})^T X & -\gamma I & \star \\ \tilde{C}_z + \tilde{D}_{zu} K \tilde{C}_y & \tilde{D}_{zw} + \tilde{D}_{zu} K \tilde{D}_{yw} & -\gamma I \end{bmatrix} < 0, \quad (10)$$

where $\tilde{A}, \dots, \tilde{D}_{yw}$ are given by (9). The symbol \star denotes an element so that the previous matrix is symmetric.

The previous statement states that a set of 2DOF-PID controller gains can be found by solving an optimisation problem with a BMI constraint in K and X . This kind of optimisation problems is not convex and in general they prove to be more difficult to solve than the ones with LMI constraints. It must be noted that, except for very particular plants, any tuning procedure that aims to optimise the PID gains results nonconvex. This is an inevitable consequence of designing an optimal fixed-structure controller (Bhattacharyya, Chapellat, & Keel, 1995). Nevertheless, in the literature can be found several number of algorithms for solving optimisation problems with BMIs in a reasonable time. Some of them search for local solutions such

as (El Ghaoui et al., 1997; Orsi et al., 2006). Others permit to find the global solution at the expense of a larger computational effort (see e.g., Apkarian et al., 2003; Goh et al., 1994). More recently, algorithms to obtain approximated solutions based on relaxations have been also proposed (see e.g., Henrion & Lasserre, 2004).

Observe that Theorem 1 also includes the design of particular cases such as 2DOF-PI and standard PID controllers. To this end, only the state-space realisations of G_{c1} and G_{c2} and the dimensions of the matrix K need to be modified. For tuning 2DOF-PI controllers, the last rows of the transfer matrices G_{c1} and G_{c2} must be eliminated and the constant gain matrix to be found is $K = [K_{pr} \ K_p \ K_i]$. For designing standard PID controllers, G_{c2} and the first column of G_{c1} are removed and K becomes $[K_p \ K_i \ K_d]$. This last version corresponds to a similar situation treated in Zheng et al. (2002), with the difference that Theorem 1 considers a realisable version of the derivative term. The use of a realisable version for the derivative term in (2) guarantees that the closed loop system is well-posed and thus subsequent verifications or additional constraints are not necessary.

Remark 2. Note that, in a similar way to \mathcal{H}_∞ optimal control techniques, the performance signals can be passed through weighting functions to refine the performance specifications. So the different nature of the reference and disturbances can be considered in the tuning of the PID gains (Sanchez Peña & Sznajder, 1998). Moreover, the synthesis procedure can be further refined by including other performance criteria such as \mathcal{H}_2 norm, peak-to-peak norm, etc.

Remark 3. It must be noted that even though the Theorem 1 requires a model of the plant, it is not necessary an exact one. In fact, the modelling errors can be handled as usual in robust control. That is, the modelling errors can be covered with dynamic uncertainty and they can be taken into account in the design stage by selecting an input–output pair and a suitable weighting function (Sanchez Peña & Sznajder, 1998).

Remark 4. The computational effort increases with the complexity of the plant and the weighting functions since the number of unknowns increases with the dimension of the function X , a similar situation happens in full order \mathcal{H}_∞ optimal control techniques. However, in spite of full order \mathcal{H}_∞ controllers, in the case of the proposed tuning method the number of unknowns associated to the controller depends only on the dimensions of u and y . Therefore, in the case of PID controller the effort to compute online the control action is independent on the performance specifications. With respect to classical PID tuning procedures for multivariable plants, once the weighting functions are fixed, the proposed method permits to find the PID gains in only one step, without need of subsequent readjustments of the controller gains.

3. 2DOF-PID control for LPV plants

In this section, Theorem 1 is extended to LPV plants. Commonly, the LPV plants arise after reformulating a nonlinear

or time-varying system and they are closely related to gain-scheduling techniques (Bianchi, De Battista, & Mantz, 2006; Lu, Wu, & Kim, 2005).

We will consider an LPV plant governed by

$$\begin{aligned}\dot{x}(t) &= A(\theta(t))x(t) + B_w(\theta(t))w(t) + B_u(\theta(t))u(t), \\ z(t) &= C_z(\theta(t))x(t) + D_{zw}(\theta(t))w(t) + D_{zu}(\theta(t))u(t), \\ y(t) &= C_y(\theta(t))x(t) + D_{yw}(\theta(t))w(t).\end{aligned}\quad (11)$$

The matrices $A(\cdot)$, $B_w(\cdot)$, $B_u(\cdot)$, $C_z(\cdot)$, $C_y(\cdot)$, $D_{zw}(\cdot)$, $D_{zu}(\cdot)$ and $D_{yw}(\cdot)$ are continuous functions of a vector of time-varying parameters $\theta(t)$ taking values in a bounded set Θ . It is assumed that the pairs (A, B_u) and (A, C_y) are stabilisable and detectable, respectively, for all $\theta \in \Theta$. The transformation of the tuning of the 2DOF-PID controller parameters into a SOF problem, discussed in Section 2, is also valid in the case of LPV plants. Nevertheless, the method for computing the gain K must be modified.

In the case of an LPV plant, the stability and performance conditions must be satisfied for any possible trajectory $\theta(t)$. There are three possible cases to be analysed: robust, gain-scheduled and robust gain-scheduled controllers. The first is an LTI controller like the ones tuned in Section 2 but the matrix gain K must be determined to guarantee stability and to accomplish the performance specifications for any trajectory $\theta(t)$. The gain-scheduled controllers are actually an LPV system, i.e., the gain K is a function of $\theta(t)$ which must be measured in real-time. Thus, a gain-scheduled controller can adjust itself according to the changes in the dynamics of the plant. Because of this feature, usually a gain-scheduled controller is less conservative than a robust one. Finally, in the most general situation, the robust gain-scheduled controllers, the parameter is assumed divided in $\theta^T = [\theta_m^T \ \theta_u^T]$ where θ_m is measured in real-time and the θ_u is uncertain. In this case, the matrix K varies only with the measured parameters θ_m . As a consequence, the controller can adapt itself to the changes in the plant dynamics due to θ_m and is robust in spite of the changes due to θ_u .

Now, the matrices corresponding to the state-space realisation of G_a (8) are matrix functions of the parameter θ . Therefore, the closed loop system is an LPV system and stability and performance must be assured for any possible trajectory $\theta(t)$. The stability of the closed loop system can be established using the concept of quadratic stability. The performance is assessed by means of the induced \mathcal{L}_2 -norm of the operator $\tilde{w} \rightarrow \tilde{z}$,

$$\|T_{\tilde{z}\tilde{w}}\|_{i,2} = \sup_{\theta \in \mathcal{F}_\Theta} \sup_{\|\tilde{w}\|_2 \neq 0} \frac{\|\tilde{z}\|_2}{\|\tilde{w}\|_2},$$

where \mathcal{F}_Θ is the set of possible trajectories $\theta(t)$ that take values in Θ . An extension of the Bounded Real Lemma is available to express the condition $\|T_{\tilde{z}\tilde{w}}\|_{i,2} < \gamma$ as a matrix inequality (Apkarian, Gahinet, & Becker, 1995). The following theorem for tuning robust gain-scheduled 2DOF-PID controllers can be derived from applying this lemma to the closed loop LPV system.

Theorem 5. *Given the LPV plant (11), the 2DOF-PID controller (2), with K_p , K_i , K_d , K_b and K_c functions of θ_m ,*

assures that the closed loop system is quadratically stable and $\|T_{\tilde{z}\tilde{w}}\|_{i,2} < \gamma$ if there exist a matrix function $K(\theta_m)$ and a matrix $X = X^T > 0$ such that, for any $\theta \in \Theta$,

$$\begin{bmatrix} (\tilde{A} + \tilde{B}_u K \tilde{C}_y)^T X + (\star) & \star & \star \\ (\tilde{B}_w + \tilde{B}_u K \tilde{D}_{yw})^T X & -\gamma I & \star \\ \tilde{C}_z + \tilde{D}_{zu} K \tilde{C}_y & \tilde{D}_{zw} + \tilde{D}_{zu} K \tilde{D}_{yw} & -\gamma I \end{bmatrix} < 0, \quad (12)$$

where the functions $\tilde{A}(\cdot)$, $\tilde{B}_w(\cdot)$, $\tilde{B}_u(\cdot)$, $\tilde{C}_z(\cdot)$, $\tilde{C}_y(\cdot)$, $\tilde{D}_{zw}(\cdot)$, $\tilde{D}_{zu}(\cdot)$ and $\tilde{D}_{yw}(\cdot)$ are given by (9) and their dependence on θ have been dropped for brevity.

The optimisation problem is also nonconvex but in this case inequality (12) imposes an infinity number of constraints (one for each $\theta \in \Theta$). Nevertheless, when the matrices \tilde{A} , \tilde{B}_w , \tilde{C}_z and \tilde{D}_{zw} are affine functions of the parameter θ , \tilde{B}_u , \tilde{C}_y , \tilde{D}_{zu} and \tilde{D}_{yw} are constant matrices⁴ and Θ is a convex polytope, to check the constraint (12) at the vertices of the polytope amounts to check it at all $\theta \in \Theta$ (Apkarian et al., 1995). This property reduces the previous procedure to an optimisation problem with a finite number of constraints. In this situation, Theorem 5 reduces to the following one.

Theorem 6. *Consider the LPV plant (11) with*

- $\tilde{A}(\cdot)$, $\tilde{B}_w(\cdot)$, $\tilde{C}_z(\cdot)$ and $\tilde{D}_{zw}(\cdot)$ affine functions of the measured parameter θ ,
- \tilde{B}_u , \tilde{C}_y , \tilde{D}_{zu} and \tilde{D}_{yw} constant matrices, and
- Θ a convex polytope of k vertices, i.e., $\Theta = \text{Co}\{\theta^{v1}, \dots, \theta^{vk}\}$ where θ^{vj} is the vertex j .

Then the 2DOF-PID controller (2), with K_p , K_i , K_d , K_b and K_c functions of the measured parameter θ_m , assures that the closed loop system is quadratically stable and $\|T_{\tilde{z}\tilde{w}}\|_{i,2} < \gamma$ if there exist a set of matrices K^j and a matrix $X = X^T > 0$ such that

$$\begin{bmatrix} (\tilde{A}_j + \tilde{B}_u K_j \tilde{C}_y)^T X + (\star) & \star & \star \\ (\tilde{B}_{w,j} + \tilde{B}_u K_j \tilde{D}_{yw})^T X & -\gamma I & \star \\ \tilde{C}_{z,j} + \tilde{D}_{zu} K_j \tilde{C}_y & \tilde{D}_{zw,j} + \tilde{D}_{zu} K_j \tilde{D}_{yw} & -\gamma I \end{bmatrix} < 0$$

for all $j = 1, \dots, k$, where $\tilde{A}_j = \tilde{A}(\theta^{vj})$, $\tilde{B}_{w,j} = \tilde{B}_w(\theta^{vj})$, $\tilde{C}_{z,j} = \tilde{C}_z(\theta^{vj})$ and $\tilde{D}_{zw,j} = \tilde{D}_{zw}(\theta^{vj})$.

The gains of the LPV controller are computed online from the K_j 's and the measured θ_m according to the expression

$$K(\theta_m) = \sum_{j=1}^k \alpha_j K_j,$$

where the α_j 's must satisfy $\alpha_1 + \dots + \alpha_k = 1$, $\alpha_j \geq 0$ and $\theta_m = \alpha_1 \theta_m^{v1} + \dots + \alpha_j \theta_m^{vk}$.

LPV plants with more complex dependence on the parameter can be expressed as an affine system at expense of a more conservative design. Alternatively the number of constraints can be

⁴ Note that the assumption that \tilde{B}_u , \tilde{C}_y , \tilde{D}_{zu} and \tilde{D}_{yw} are constant matrices is not restrictive since it can be always fulfilled by filtering the input $u(t)$ and/or the output $y(t)$ (Apkarian et al., 1995).

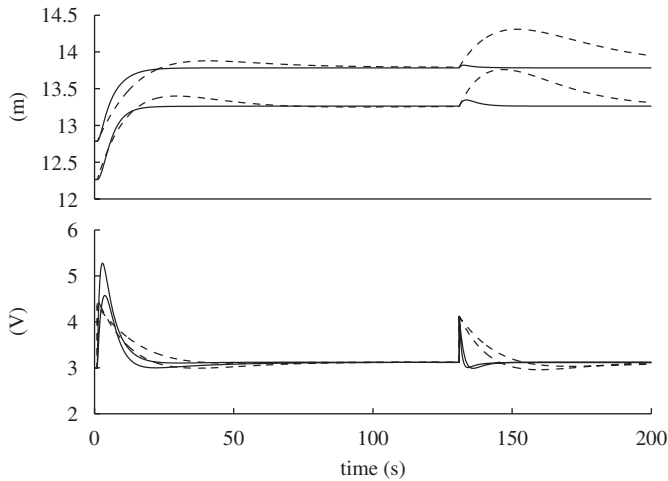


Fig. 4. Response of the closed loop system with an LTI 2DOF-PI controller (solid) and with a classical PI (dashed).

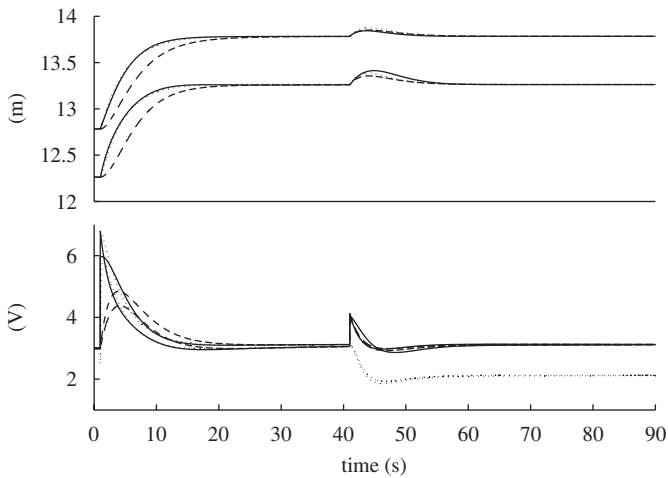


Fig. 5. Response of the closed loop system with three gain-scheduled controllers. 2DOF-PI (solid), 1DOF-PI (dashed) and full order controller (dotted).

flexible structure of the 2DOF-PI and the best performance to the optimisation procedure.

The methods discussed in Section 3 can be used to obtain robust or gain-scheduled controllers valid in certain operating range. The stationary values of the tank heights h_j^0 are functions of the voltages v_1^0 and v_2^0 (Johansson, 2000). Therefore, the time constants T_j and then the system matrices can be parameterised by the voltages v_1^0 and v_2^0 . For brevity only the situation $v_1^0 = v_2^0 = v^0$ will be examined. So the time constants and the matrices of the model (13) are affine functions of a single parameter $\theta = 1/v^0$. The voltage v^0 was considered in the range of 1.6–3.6 V and hence the parameter θ takes values in the polytope $\Theta = \text{Co}\{0.278, 0.625\}$.

Fig. 5 presents the responses of the nonlinear closed loop system with three controllers. The solid line corresponds to a 2DOF-PI controller and the dashed line to a 1DOF-PI, both designed with the proposed method. On the other hand, the dotted line corresponds to a full order controller synthesised according to (Apkarian et al., 1995). The synthesis setup used

was the same of the LTI case (see Fig. 3). The SOF problem was solved with the previous algorithm but with (14)–(16) checked at the vertices of Θ . The performance level γ was 1.66 and the cputime was 11.1 s. In Fig. 5 it can be observed again that, with similar disturbance rejection, the 2DOF controllers achieve a faster response to changes in the set-point. Also, it can be seen that the full order controller does not provide an appreciable improvement with respect to the 2DOF-PI controller. This is a case where a 2DOF-PI tuned with the proposed method permits a simpler implementation without sacrifices performance.

5. Conclusions

In this paper, tuning methods for centralised multivariable 2DOF-PID controllers have been proposed. Firstly, the design of LTI controllers was discussed and then the tuning of 2DOF-PID controller for LPV plants. In both cases, the proposed methods include the design of other PID structures such as the 2DOF-PI and the standard PI(D) control. In the case of LPV plants, the proposed methods allow to tune both time-invariant and robust gain-scheduled controllers according to the possibility to measure the time-varying parameters of the plant. In all the methods presented in the paper, it is possible to consider high frequency uncertainty so that the tuning of the controllers can be based on approximated models of the plant. Furthermore, the formulation in the context of BMI optimisation enables to extend to other criteria even multi-objective.


Acknowledgements

This work was supported by ANPCyT (PICT 2003 11-14111), CICpBA (Grant Res. 044/06), CONICET (PIP 5532/05) and UNLP (Grant I097).

References

- Apkarian, P., & Gahinet, P. (1995). A convex characterization of gain scheduled \mathcal{H}_∞ controllers. *IEEE Transactions on Automatic Control*, 40(5), 853–864.
- Apkarian, P., Gahinet, P., & Becker, G. (1995). Self-scheduled \mathcal{H}_∞ control of linear parameter-varying systems: A design example. *Automatica*, 31, 1251–1261.
- Apkarian, P., Noll, D., & Tuan, H. (2003). Fixed-order \mathcal{H}_∞ control design via a partially augmented lagrangian method. *International Journal of Nonlinear and Robust Control*, 13(12), 1137–1148.
- Astrom, K., & Hagglund, T. (2005). *Advanced PID control*. Research Triangle Park, USA: ISA.
- Bhattacharyya, S., Chapellat, H., & Keel, L. (1995). *Robust control—The parametric approach*. Upper Saddle River, USA: Prentice-Hall.
- Bianchi, F., De Battista, H., & Mantz, R. (2006). *Wind turbine control systems: Principles, modelling and gain scheduling design*. London, UK: Springer, London Ltd.
- El Ghaoui, L., Oustry, F., & AitRami, M. (1997). A cone complementary linearization algorithm for static output-feedback and related problem. *IEEE Transactions on Automatic Control*, 42, 1171–1176.
- Ge, M., Chiu, M., & Wang, Q. (2002). Robust PID controller design via LMI approach. *Journal of Process Control*, 12, 3–13.
- Goh, K., Safonov, M., & Papavasilopoulos, G. (1994). A global optimization approach for the BMI problem. *Proceedings of the 33rd CDC*.
- Henrion, D., & Lasserre, J. (2004). Solving nonconvex optimization problems. *IEEE Control Systems Magazine*, 24(3), 72–83.

- Johansson, K. (2000). The quadruple-tank process: A multivariable laboratory process with an adjustable zero. *IEEE Transactions on Control Systems Technology*, 8, 456–465.
- Li, Y., Ang, K., & Chong, G. (2006). Patents, software, and hardware for PID control. *IEEE Control Systems Magazine*, 26(1), 42–54.
- Löfberg, J. (2004). YALMIP: A toolbox for modeling and optimization in MATLAB. In *Proceedings of the CACSD conference*. Taipei, Taiwan. (<http://control.ee.ethz.ch/~joloef/yalmip.php>).
- Lu, B., Wu, F., & Kim, S. (2005). Linear parameter-varying antiwindup compensation for enhanced flight control performance. *Journal of Guidance, Control, and Dynamics*, 28(3), 494–505.
- Mattei, M. (2001). Robust multivariable PID control for linear parameter varying systems. *Automatica*, 37, 1997–2003.
- O'Dwyer, A. (2006). *Handbook of PI and PID controller tuning rules*. (2nd ed.), London, UK: Imperial College Press.
- Orsi, R., Helmke, U., & Moore, J. B. (2006). A Newton-like method for solving rank constrained linear matrix inequalities. *Automatica*, 42(11), 1875–1882.
- Ruiz-Lopez, I., Rodriguez-Jimenes, G., & Garcia-Alvarado, M. (2006). Robust MIMO PID controllers tuning based on complex/real ratio of the characteristic matrix eigenvalues. *Chemical Engineering Science*, 61(13), 4332–4340.
- Sanchez Peña, R., & Sznaiar, M. (1998). *Robust systems, Theory and applications*. New York, USA: Wiley.
- Wu, F., Yang, X., Packard, A., & Becker, G. (1996). Induced \mathcal{L}_2 -norm control for LPV systems with bounded parameter variations rates. *International Journal of Nonlinear and Robust Control*, 6(9–10), 983–998.
- Zheng, F., Wang, Q., & Lee, T. (2002). On the design of multivariable PID controllers via LMI approach. *Automatica*, 38, 517–526.



is the (co)author of the book: “Wind Turbine Control” (with F. Bianchi and H. De Battista), Springer, 2006.



Ricardo J. Mantz is Full Professor of Automatic Control at the EE Department of National University of La Plata (UNLP) and Official Member of the Commission of Scientific Researches of the Buenos Aires Province (CICPBA), Argentina. He is with the Laboratory of Industrial Electronics, Control and Instrumentation, Faculty of Engineering (UNLP). His main research interests are in the fields of switched control systems, sliding mode control, and control of renewable energy conversion systems. He is the (co)author of the book: “Wind Turbine Control” (with F. Bianchi and H. De Battista), Springer, 2006.

Carlos F. Christiansen (born in 1935) is Professor Emeritus at Universidad Nacional de La Plata (UNLP), Argentina. Since 1974 he has been Full Professor at the EE Department of UNLP. During 1978–1979 and 1987–1988 he was Scientific Associate at CERN, Switzerland. During 1992–1993 he was Visiting Scientist at the SSC Laboratory, Dallas, USA. Presently he is the Director of the Industrial Electronics, Control and Instrumentation Laboratory, UNLP. His primary area of interest is electronic power systems.



Fernando D. Bianchi received the B.S. and the Ph.D. degrees in Electronic Engineering from the National University of La Plata (UNLP), Argentina, in 1999 and in 2005, respectively. Currently, he is with the Laboratory of Industrial Electronics, Control and Instrumentation (LEICI) at the EE Department of Faculty of Engineering, UNLP. His research interests include robust control and LPV systems, and their applications to the control of renewable energy conversion systems. He is co-author (with H. De Battista and R. Mantz) of “Wind Turbine Control”, Springer, 2006.