


ELECTRICAL LEGEND					
	USB RECEPTACLE		INCANDESCENT LIGHTING SURFACE MOUNTED FIXTURE		GARAGE DOOR OPENER
	SINGLE RECEPTACLE		INCANDESCENT LIGHTING HANGING MOUNTED FIXTURE		FAN OUTLET ONLY W/BACKING
	DUPLEX RECEPTACLE		INCANDESCENT LIGHTING WALL MOUNTED FIXTURE		JUNCTION BOX
	PLUG MOLD		RECESSED LIGHTING FIXTURE - LED 6' -3000K		CEILING PADDLE FAN W/BACKING (48" MIN)
	GROUND FAULT INTERRUPTOR		RECESSED LIGHTING 2' LED ROUND HI HAT		CEILING PADDLE FAN W/BACKING (7' BOX)
	GROUND FAULT INTERRUPTOR WATER PROOF		RECESSED LIGHTING HI HAT		FLOOD LIGHTS
	1/2 SWITCH - DUPLEX RECEPTACLE		RECESSED LIGHTING LED WALL WASHING FIXTURE		EXHAUST FAN
	FLOOR OUTLET		RECESSED LIGHTING LED VAPOR-PROOF FIXTURE		SMOKE DETECTOR C/W MOUNT
	QUAD RECEPTACLE		RECESSED LIGHTING WATER-PROOF FIXTURE		DOORBELL CHIMES
	220 VOLTS		RECESSED LIGHTING FAN COMBO FIXTURE		SPEAKER
	POP UP OUTLET - GFI		RECESSED LIGHTING 2' PIN HOLE FIXTURE		INTERCOM SPEAKER PANEL
	240 VOLTS SPECIAL PURPOSE OUTLET		2 1/4 LED PANEL LIGHTING		ELECT PANEL
	SWITCH		2 1/2 LED PANEL LIGHTING		ELECT METER
	3 WAY SWITCH		ROUND LED		DISCONNECT
	DIMMER/STAT SWITCH		LED LIGHT STRIPS		RECESSED EXTERIOR STEP LIGHT - LED
	4 WAY SWITCH		TRACK LIGHTS		MOTION DETECTOR
	WATERPROOF SWITCH		MAKE-UP LIGHTING		HEAT SENSOR
	THERMOSTAT		RECESSED WALL FIXTURE		RECESSED CLOCK OUTLET
	SECURITY ALARM CONTROL PAD		ART LIGHT		
	SECURITY SYSTEM SIREN				
	CABLE TELEVISION OUTLET				
	SPEAKER VOLUME CONTROL				
	DOOR BELL				
	GARAGE DOOR OPENER BUTTON				
	FIREPLACE - FIRE-IGNITOR				
	PUSH BUTTON				
	AIR SWITCH				
	CENTRAL VACUUM INLET				

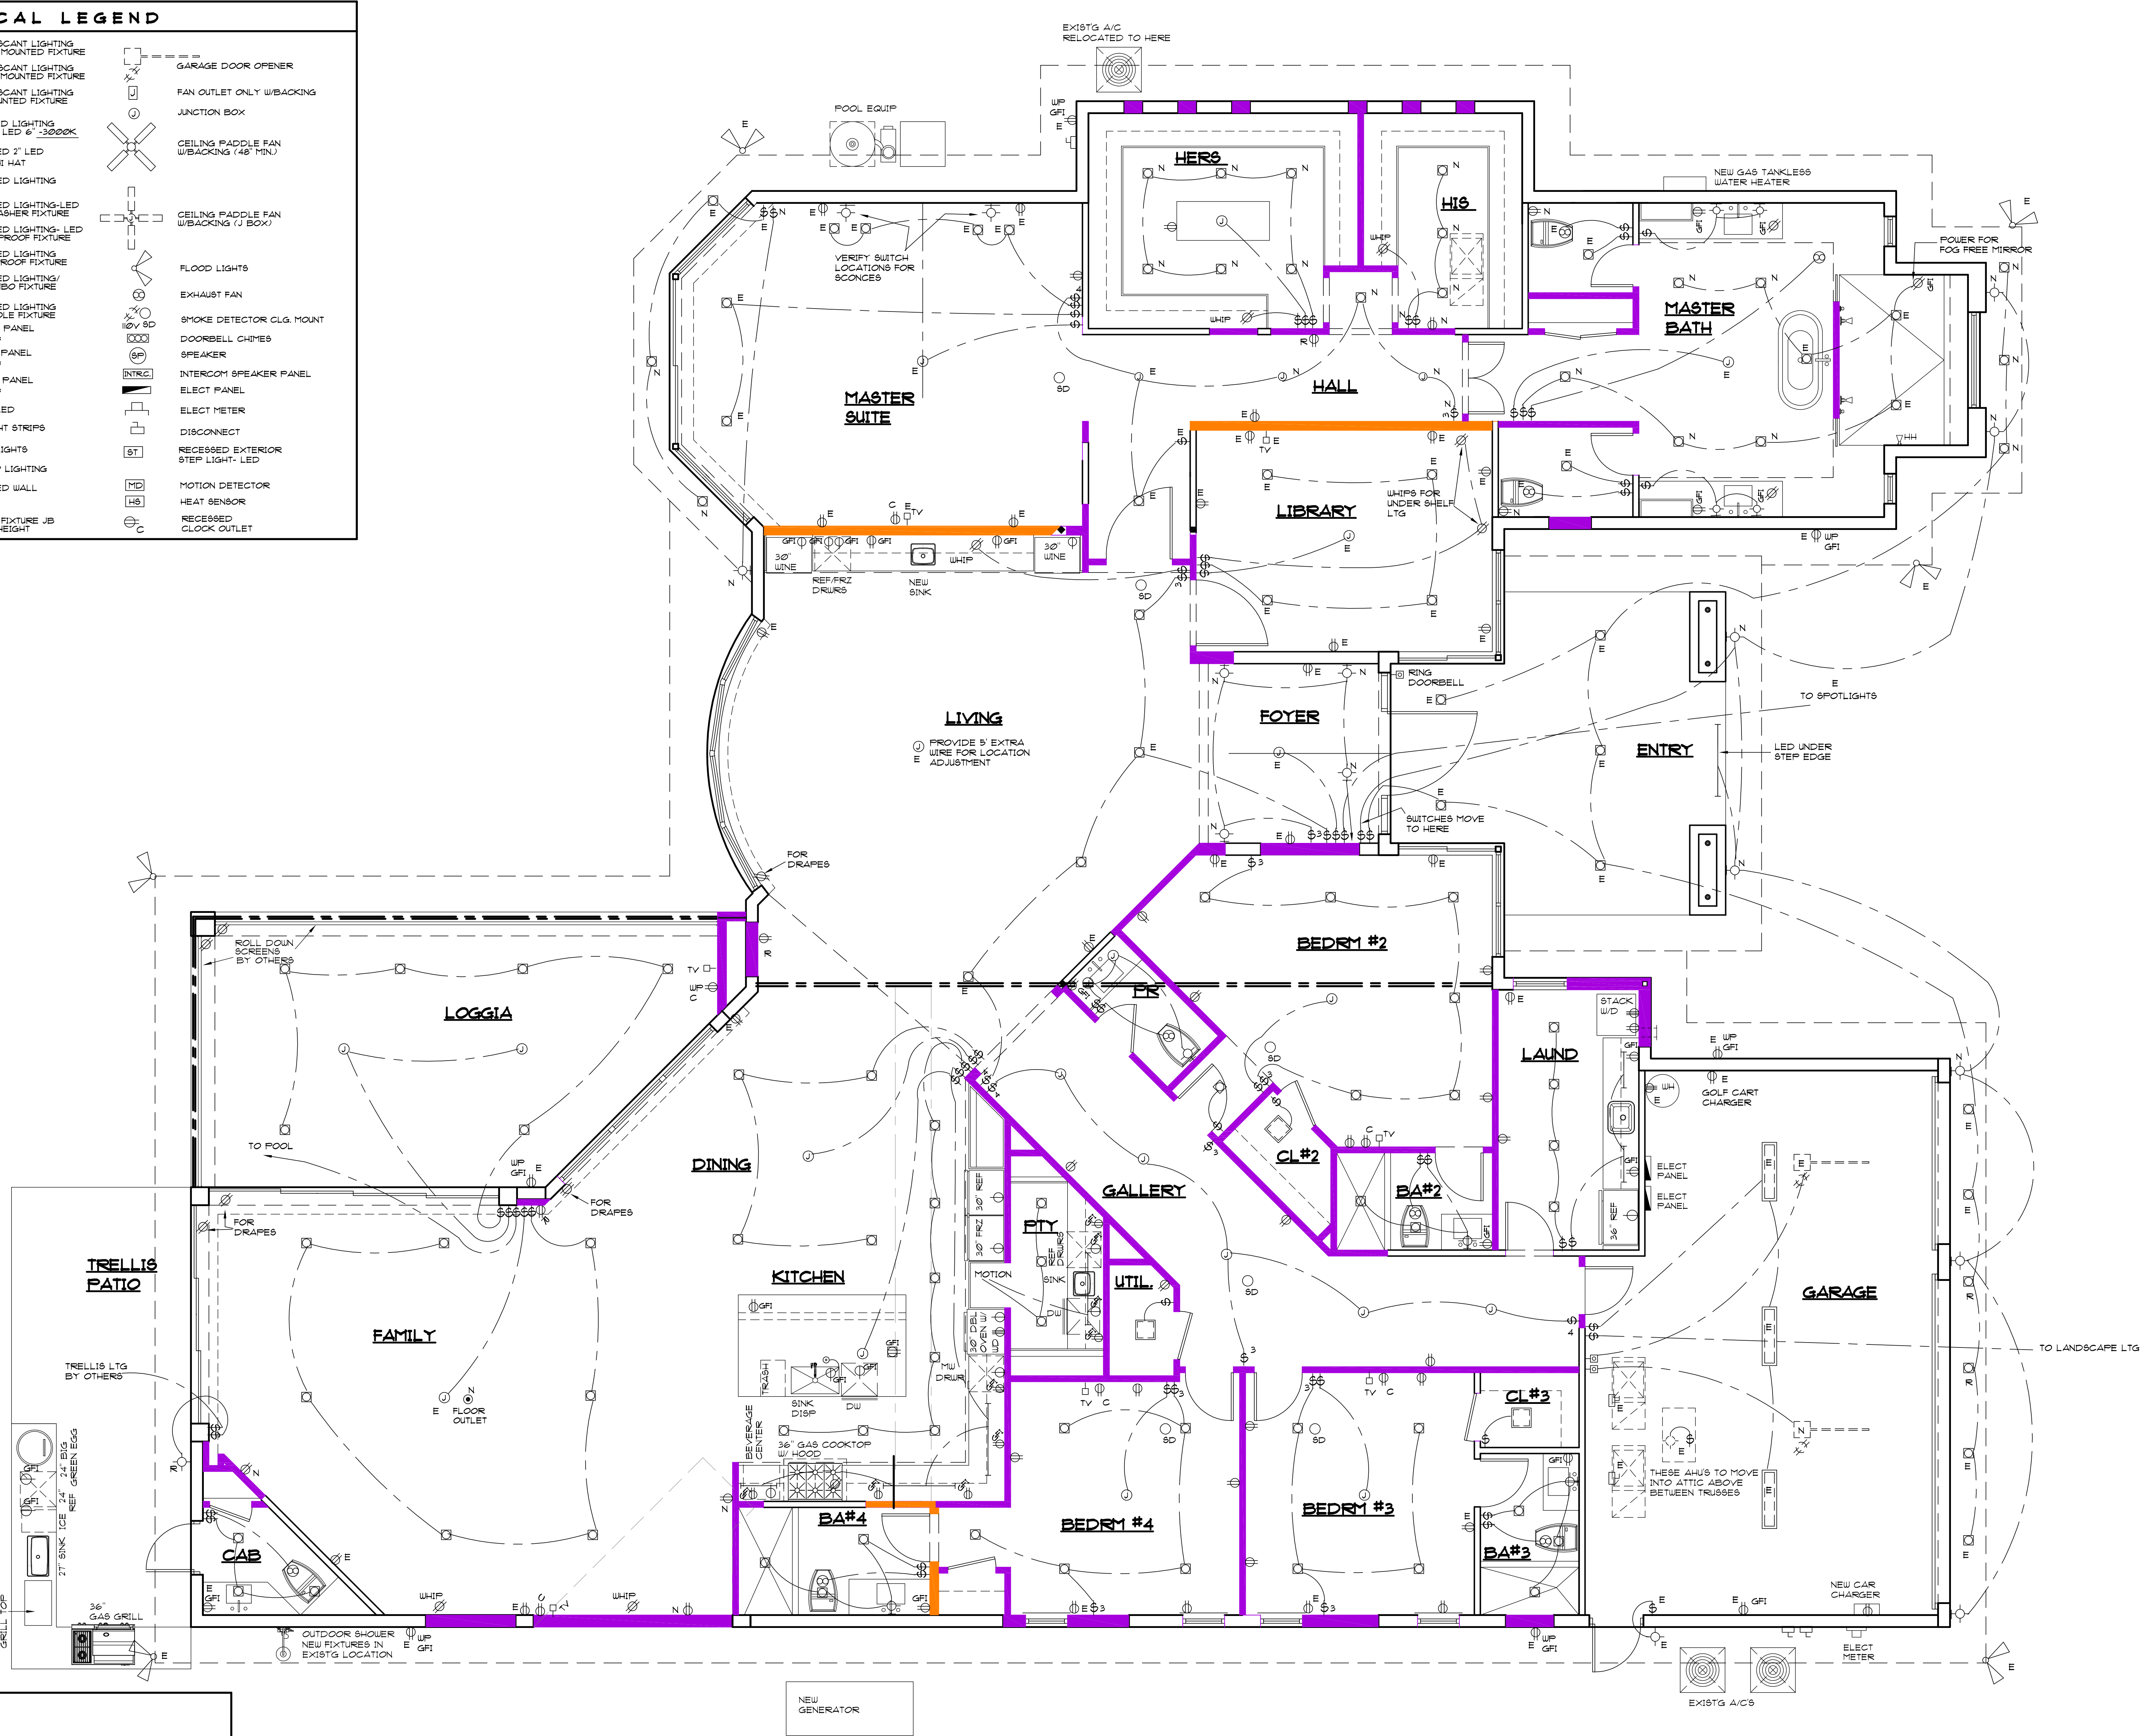

ELECTRICAL NOTES

-ALL OUTLET BOXES FOR RECEPTABLES, TV ANTENNAS, OR TELEPHONE JACKS, ETC. IN RATED WALLS MUST BE METAL OR UL RATED FOR USE IN ONE HOUR FIRE RATED CONSTRUCTION.

-ALL ELECTRICAL WORK TO CONFORM TO THE NATIONAL ELECTRICAL CODE (NFPA 70).

-COORDINATE ALL CONDUIT RUNS AND EQUIPMENT INSTALLATION WITH OTHER TRADES TO AVOID CONFLICTS PRIOR TO FABRICATION, INSTALLATION AND ERECTION.

-MINIMUM WIRE SIZE SHALL BE #14 AWG. INSULATION FOR WIRE SIZE #6 AND SMALLER SHALL BE THIN #4 AND LARGER SHALL BE THIN. ALL CONDUCTORS #10 AND SMALLER MAY BE SOLID #3 AND LARGER SHALL BE STRANDED (ROMEX MAY BE USED WHERE APPROVED).

-CIRCUIT LOCATION AND LOAD DATA ARE BASED UPON INFORMATION GIVEN TO THE ARCHITECT AT TIME OF DESIGN. CONTRACTOR SHALL VERIFY ALL EQUIPMENT AND PANEL SIZES AND SHALL PROVIDE CIRCUITS & ROUTING OF CONDUITS TO SUIT JOB CONDITIONS.

-NEC 200.4 PROVIDE FOR ALL NEW MULTI WIRE BRANCH CIRCUITS IDENTIFIED HANDLE TIES OR COMMON TRIP BREAKERS AND FOR EXIST'G MULTIWIRE CIRCUITS AS PART OF A PANEL CHANGE OR UPGRADE.

-NEC 710.2 ARC FAULT PROTECTION IS REQUIRED FOR ALL NEW CIRCUITS AND THOSE THAT ARE MODIFIED, EXTENDED, OR REPLACED INCLUDING CIRCUIT BREAKERS IN EXIST'G PANEL CHANGES OR UPGRADES.

SMOKE DETECTORS SHOWN THRUOUT TO COMPLY W/ FBGR 2023 8TH ED. SECTION R314 AND TO BE LOCATED WITHIN 10' OF ALL SLEEPING AREAS. PROVIDE CO2-SM DETECTORS W/ 120V BATTERY BACK UP TO COMPLY W/ FBGR 2023 8TH ED SECT. R315

ALL OUTLETS INSIDE NEW CABINETS TO BE EASILY ACCESSIBLE

N = NEW FIXTURE OR SWITCH
R = RELOCATED FIXTURE OR SWITCH
E = EXISTING FIXTURE OR SWITCH

SEE PAGE E-2 FOR NEW PANEL SCHEDULE

EXIST'G 350 AMP SERVICE

NOTE: ALL ELECT FIXTURES IN MAIN ROOMS TO BE REPLACED W/ NEW AND TIED TO EXIST'G CIRCUITS

EXIST'G STEEL COLUMNS
EXIST'G BEARING WALLS
NEW CONSTRUCTION

REMODELED ELECTRICAL PLAN
SCALE 1/4" = 1'-0"

3719 COVENTRY LANE
BOCA RATON, FL 33486
LOT 59, COVENTRY
WOODFIELD
COUNTRY CLUB

DESIGN DRAWN BY:
LYNN MCCOLL, LLC
56123953289 lynnmcclp18@gmail.com

OWNER

A CUSTOM HOME FOR:
THE YANOFKY FAMILY
BOCA RATON, FLORIDA

REVISIONS

COMMISSION

24-018

DATE

01/20/25

SHEET TITLE

REMODELED ELECTRICAL

BRENNAN ENGINEERING INC.

1000 S. DIXIE HWY. STE. 400
BOCA RATON, FLORIDA 33432
(561) 352-3748
E.O. # 10266 P.E. # 51311
Victor Hernandez

E.B. # 7686 P.E. 72387

E-1