


ELECTRICAL SYMBOLS					
	DUPLEX RECEPTACLE AT 12" A.F.F.		SECURITY KEY PAD		INCANDESCENT LIGHT CLG, MOUNTED
	DUPLEX RECEPTACLE AT BASE		JUNCTION BOX		INCANDESCENT LIGHT WALL MOUNTED
	DUPLEX RECEPTACLE AT 8" ABV. COUNTER		TELEVISION JACK PRE-WIRED		HI-HAT CLG, MOUNTED
	DUPLEX RECEPTACLE FLUSH IN FLOOR		220 V. RECEPTACLE AT 12" A.F.F.		HI-HAT VAPOR PROOF
	DUPLEX RECEPTACLE GROUND FAULT		HVAC THERMOSTAT		F.P.&L. METER & DISC.
	DUPLEX RECEPTACLE TOP REG. SWITCHED		INTERCOM AT 60" A.F.F.		BREAKER PANEL
	DUPLEX RECEPTACLE WATERPROOF		TELEPHONE OUTLET AT 12" A.F.F.		EXHAUST FAN
	DUPLEX RECEPTACLE UNDER COUNTER		TELEPHONE OUTLET FLUSH IN FLOOR		EXHAUST FAN W/ LIGHT
	SWITCH SINGLE POLE		SPEAKER IN CLG.		FLUORESCENT LIGHT FIXTURE
	SWITCH THREE WAY		SECURITY LIGHTS		UNDER CAB FLUORESCENT
	SWITCH FOUR WAY		SMOKE DETECTOR		INCANDESCENT LIGHT CLG, MOUNTED W/ PULL CHAIN
	SWITCH RHEOSTAT		SWITCH DISCONNECT		VACUUM PORT
	SWITCH DIMMER		PADDLE FAN W/ OR W/O LIGHT		VOLUME CONTROL
	SWITCH KEYED		ALARM SIREN		AIR RETURN GRILLE
	MOTION DETECTOR		AIR SUPPLY GRILLE		AIR RETURN GRILLE
	WALL MOUNTED FLUORESCENT				

GENERAL ELECTRICAL NOTES:

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH BOTH LOCAL AND 2017 NATIONAL ELECTRICAL CODES.
2. ELECTRICAL CONTRACTOR SHALL VERIFY ELECTRICAL PLAN, RISER DIAGRAM, AND LOADS, AND NOTIFY THE GENERAL CONTRACTOR OF ANY ERRORS OR DISCREPANCIES PRIOR TO INSTALLATION.
3. ALL EQUIPMENT INSTALLED OUTSIDE OR EXPOSED TO WEATHER SHALL BE NEMA TYPE 3R.
4. MINIMUM WIRE SIZE SHALL BE # 14 COPPER.
5. ALL CONDUCTORS ARE TO BE COPPER, TYPE THHN, UNLESS OTHERWISE NOTED.
6. CONNECT GROUNDING ELECTRODE CONDUCTOR TO GROUND ROD AND NEAREST COPPER WATER LINE (COLD).
7. ALL 120V, 1 PHASE 15A. AND 20A. BATHROOM, AND EXTERIOR RECEPTACLES, SHALL HAVE GROUND FAULT INTERRUPTER (G.F.I.) PROTECTION WITH EXTERIOR RECEPTACLES OF THE WATERPROOF TYPE. ELECTRICAL CONTRACTOR MAY INSTALL INDIVIDUAL (G.F.I.) IN LIEU OF (G.F.I.) BREAKER WITH SEPARATE CIRCUIT.
8. SWITCHES SHALL BE OF STANDARD GRADE OF SILENT TYPE.
9. RECEPTACLES SHALL BE 15A. AND 120V. OF THE GROUND TYPE.
10. THE ELECTRICAL CONTRACTOR IS TO SIZE MOST BRANCH CIRCUITS; A MAXIMUM VOLTAGE DROP OF 3% IS PERMITTED.
11. THE ELECTRICAL CONTRACTOR IS TO ARRANGE FOR TELEPHONE SERVICE AND TELEPHONE WIRING. COORDINATE WITH THE TELEPHONE COMPANY UNLESS OTHERWISE SPECIFIED.
12. BRANCH CIRCUITS SHALL BE IN THIN WALL CONDUIT OR APPROVED ROMEX.
13. LIGHTING FIXTURES SHALL BE SELECTED BY THE OWNER. 75% OF THE LAMPS SHALL BE HIGH EFFICACY TYPE.
14. SMOKE ALARMS SHALL BE DIRECT WIRED 120V. U.L. 217 APPROVED TYPE WITH AUDIBLE ALARM INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND LISTING.
15. CARBON MONOXIDE DETECTOR(S) TO COMPLY W/ UL#2034-96.
16. ALL DEVICES SHALL BE SMOOTH TYPE, IVORY COLOR, UNLESS OTHERWISE SPECIFIED.
17. ALL MECHANICAL EQUIPMENT SHALL BE PROTECTED BY OVERCURRENT DEVICES OF TYPE AND RATING PER MANUFACTURER NAMEPLATE SPECIFICATIONS.
18. THE ELECTRICAL CONTRACTOR IS TO COORDINATE WITH OTHER TRADES TO MAKE CERTAIN THAT ALL AIR-CONDITIONING POWER AND CONTROL WIRING AND CONDUITS ARE IN THE BID.
19. EXHAUST FANS IN BATHROOMS (IF USED) SHALL BE RATED AT 1 CFM/SF OF VENTILATED FLOOR AREA.
20. ALL FAN VENTING AND ROOF PENETRATIONS SHALL BE BY MECHANICAL CONTRACTOR.
21. ELECTRICAL CONTRACTOR IS TO COORDINATE ALL SERVICE REQUIREMENTS WITH THE POWER COMPANY BEFORE BIDDING TO BE CERTAIN THAT ALL WORK NECESSARY TO MEET POWER COMPANY SPECIFICATIONS IS IN THE BID.
22. ALL RECEPTACLES SHALL BE TAMPER RESISTANT AND IN ACCORD. W/ NEC 210.52 AND ARC FAULT PROTECTED IN ACCORD. W/ NEC210.12(A)
23. CEILING FANS TO BE MOUNTED PER NEC 422.19, 422.20, 422.21
24. INSTALLATION HEIGHTS ABOVE FINISH FLOOR UNLESS OTHERWISE NOTED:
25. 45" TO CENTER WALL HUNG TELEPHONE
26. 12" TO CENTER TELEPHONE JACKS
27. 46" TO CENTER LIGHT SWITCHES
28. 16" TO CENTER RECEPTACLES
29. 46" TO CENTER KITCHEN RECEPTACLES OVER VANITIES
30. 42" TO CENTER BATH RECEPTACLES
31. 32" TO BATH RECEPTACLE (HORIZONTAL)
32. 12" TO CENTER TELEVISION JACKS
33. 91" TO BATH WALL SCONCES WIP
34. ALL LIGHTS IN CLOSET SHALL BE ENCLOSED AS PER NEC 410.16 & FBC RE E4003.12
35. ALL EXTERIOR FIXTURES SHALL BE U.L. RATED FOR EXTERIOR.
36. PROVIDE BUBBLE COVER OVER EXT. RECEPTACLES PER 406.9(B)(I)
37. ALL LAUNDRY, BATH & KITCHEN COUNTERTOP RECEPTACLES SHALL BE GFI PROTECTED & AFCI PROTECTED PER 210.12(A)
38. AFCI PROTECTION SHALL COMPLY WITH NEC 210.12 210.8 AND FBC RE E3902
39. ALL LIGHTING IN TUB OR SHOWERS SHALL BE PER NEC410.10(D) FBC RE E4003.11 AND SUITABLE FOR DAMP LOCATIONS.
40. ALL BATH WALL SCONCES TO HAVE WHIP @ +91"
41. ALL BATH RECEPTACLES TO BE AT 32" HORIZ.


SECOND FLOOR ELECTRIC PLAN

SCALE : 1/4" = 1'-0"

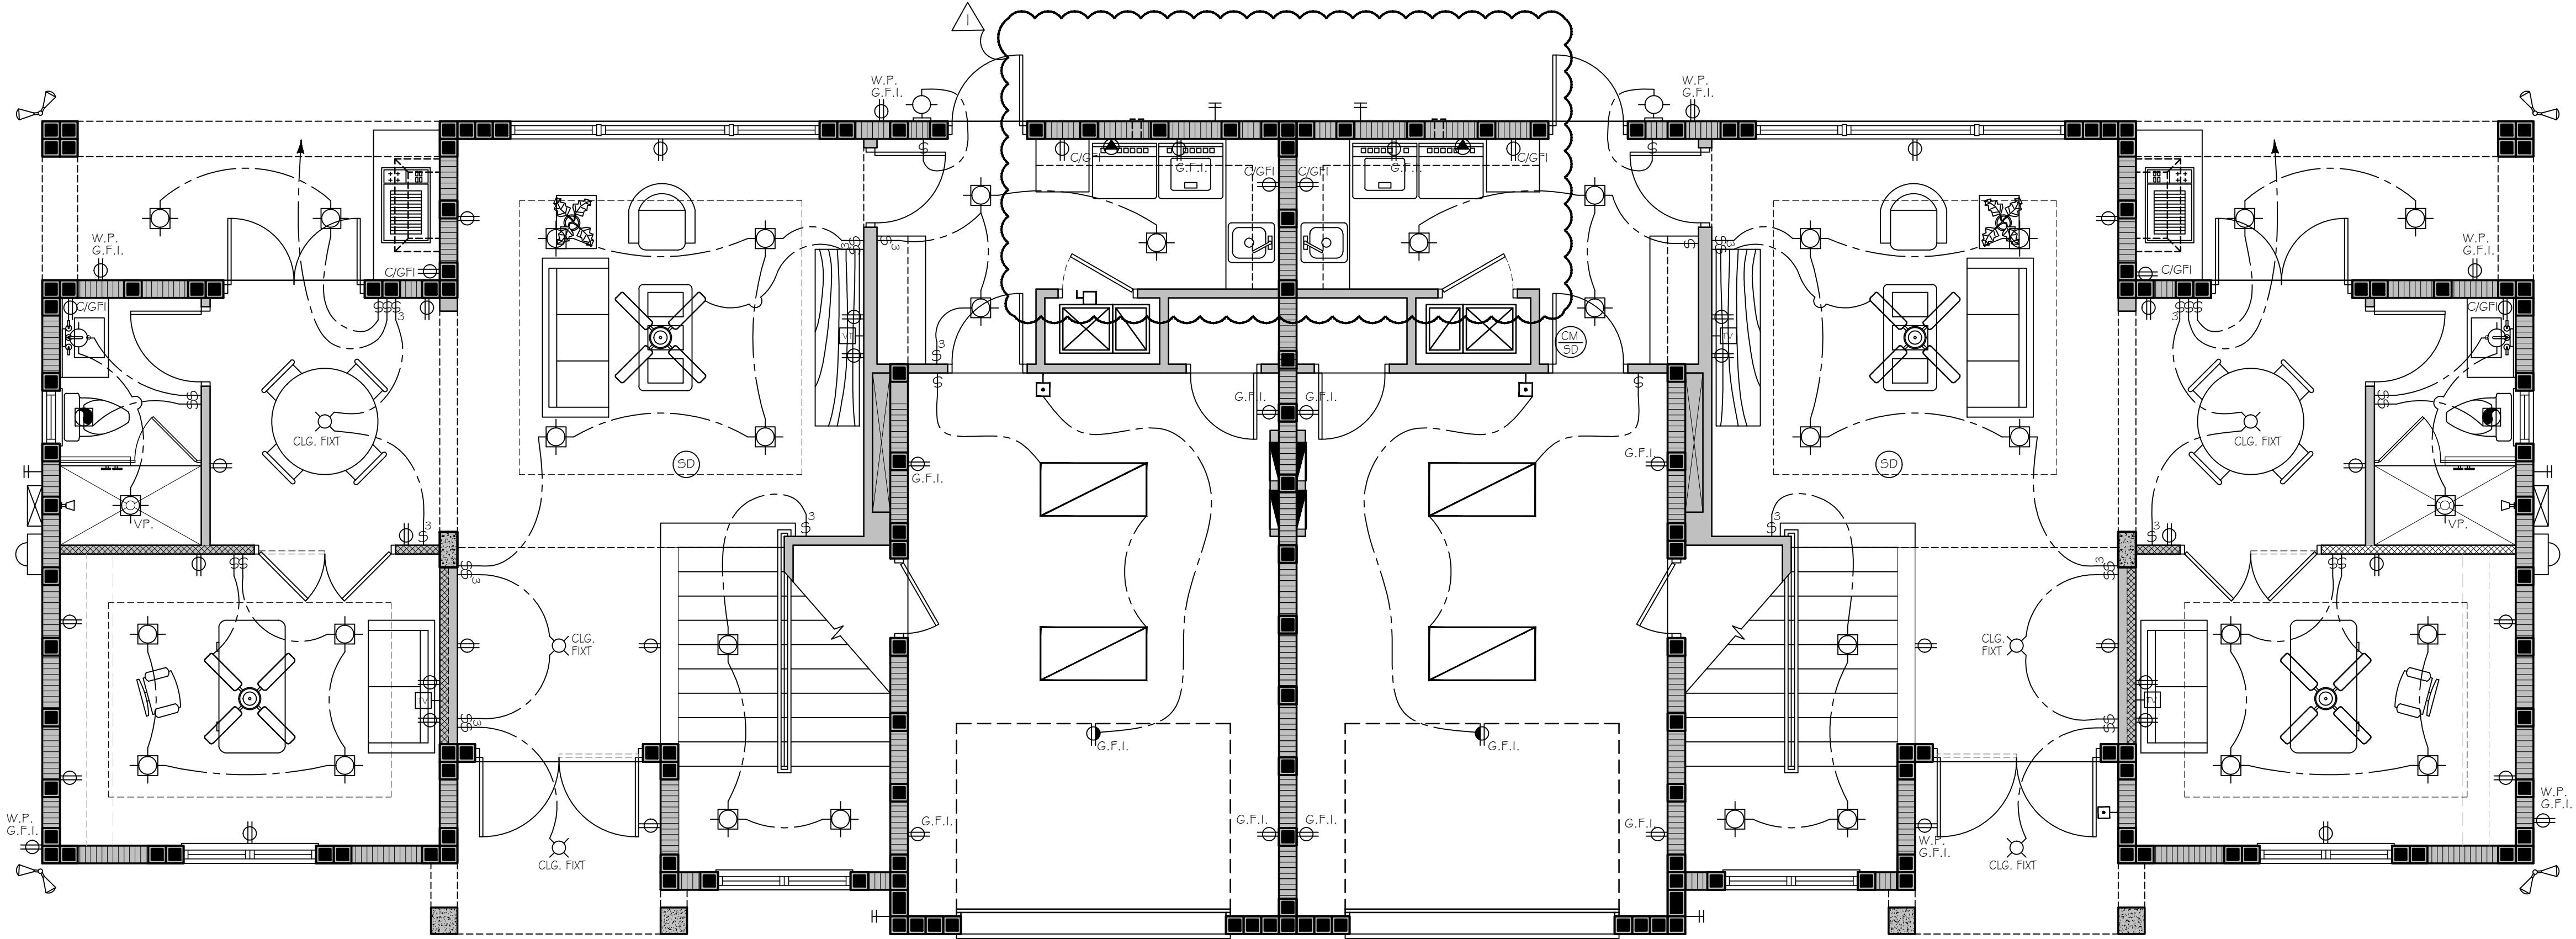

GROUND FLOOR ELECTRIC PLAN

SCALE : 1/4" = 1'-0"

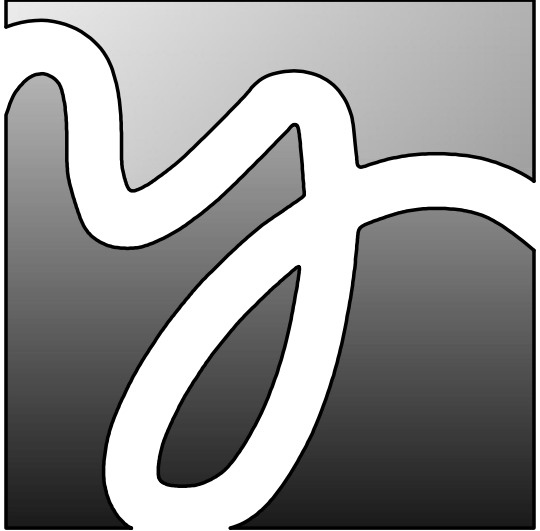


YATES ASSOCIATES
ARCHITECTURE INC.

AA-26001673
330 CLEMATIS ST, SUITE 210
WEST PALM BEACH, FL 33401
TEL: 561-653-8280 FAX: 561-653-8279
WWW.YATESARCHITECTURE.COM

DATE: June 1, 2022
JOB NO: 22-0000
DESIGN BY: K.D.Y.
DRAWN BY: D.C.M.
APPROVED: K.D.Y.
REVISIONS:
1. REVISIONS PER BLDG DEPARTMENT REVIEW
2. REVISIONS PER BLDG DEPARTMENT REVIEW

A PROPOSED TOWNHOUSE PROJECT FOR:
BUILTMORE CONTRACTING
2418 LAKE DRIVE
SINGER ISLAND, FL
PALM BEACH COUNTY

PERMIT
REVIEW
03-09-23

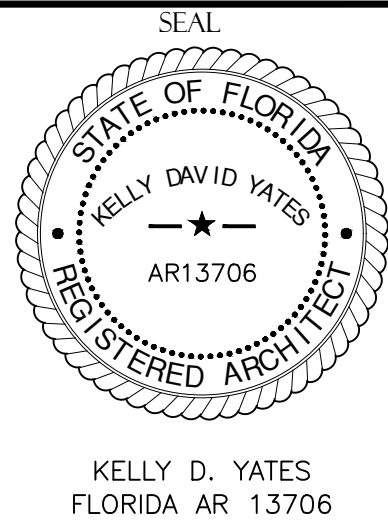

DIGITAL SIGNATURE

SHEET NO.

E-101

OF 1 SHTS
Copyright © 2020 Yates Architecture Inc.