ELECTRICAL SYMBOLS

	DUPLEX RECEPTACLE AT 12" A.F.F.		SECURITY KEY PAD		INCANDESCENT LIGHT CL'G. MOUNTED
B	DUPLEX RECEPTACLE AT BASE	J	JUNCTION BOX		INCANDESCENT LIGHT WALL MOUNTED
C	DUPLEX RECEPTACLE AT 8" ABV. COUNTER	TV	TELEVISION JACK PRE-WIRED		HI-HAT CL'G. MOUNTED
	DUPLEX RECEPTACLE FLUSH IN FLOOR		220 V. RECEPTACLE AT 12" A.F.F.	VP	HI-HAT VAPOR PROOF
GFI	DUPLEX RECEPTACLE GROUND FAULT	T	HVAC THERMOSTAT		F.P.&L. METER & DISC.
	DUPLEX RECEPTACLE TOP REC. SWITCHED		INTERCOM AT 60" A.F.F.		BREAKER PANEL
WP	DUPLEX RECEPTACLE WATERPROOF	PH	TELEPHONE OUTLET AT 12" A.F.F.		EXHAUST FAN
UC	DUPLEX RECEPTACLE UNDER COUNTER	PH	TELEPHONE OUTLET FLUSH IN FLOOR		EXHAUST FAN W/ LIGHT
S	SWITCH SINGLE POLE	SP	SPEAKER IN CL'G.		FLUORESCENT LIGHT FIXTURE
3	SWITCH THREE WAY		SECURITY LIGHTS		UNDER CAB FLUORESCENT
4	SWITCH FOUR WAY	SD	SMOKE DETECTOR	P.C.	INCANDESCENT LIGHT CL'G. MOUNTED W/ PULL CHAIN
R	SWITCH RHEOSTAT		SWITCH DISCONNECT	V	VACUUM PORT
D	SWITCH DIMMER		PADDLE FAN W/ OR W/O LIGHT	VC	VOLUME CONTROL
K	SWITCH KEYED			AS	ALARM SIREN
MD	MOTION DETECTOR		AIR SUPPLY GRILLE		AIR RETURN GRILLE
	WALL MOUNTED FLUORESCENT				

GENERAL ELECTRICAL NOTES:

1. ALL WORK SHALL BE DONE IN ACCORDANCE WITH BOTH LOCAL AND 2017 NATIONAL ELECTRICAL CODES.
2. ELECTRICAL CONTRACTOR SHALL VERIFY ELECTRICAL PLAN , RISER DIAGRAM, AND LOADS, AND NOTIFY THE GENERAL CONTRACTOR OF ANY ERRORS OR DISCREPANCIES PRIOR TO INSTALLATION.
3. ALL EQUIPMENT INSTALLED OUTSIDE OR EXPOSED TO WEATHER SHALL BE NEMA TYPE 3R.
4. MINIMUM WIRE SIZE SHALL BE # 14 COPPER.
5. ALL CONDUCTORS ARE TO BE COPPER, TYPE THHN, UNLESS OTHERWISE NOTED.
6. CONNECT GROUNDING ELECTRODE CONDUCTOR TO GROUND ROD AND NEAREST COPPER WATER LINE (COLD).
7. ALL 120V. 1 PHASE 15A. AND 20A. BATHROOM, AND EXTERIOR RECEPTACLES, SHALL HAVE GROUND FAULT INTERRUPTER (G.F.I.) PROTECTION WITH EXTERIOR RECEPTACLES OF THE WATERPROOF TYPE. ELECTRICAL CONTRACTOR MAY INSTALL INDIVIDUAL (G.F.I.) IN LIEU OF (G.F.I.) BREAKER WITH SEPARATE CIRCUIT.
8. SWITCHES SHALL BE OF STANDARD GRADE OF SILENT TYPE
9. RECEPTACLES SHALL BE 15A. AND 120V. OF THE GROUND TYPE.
10. THE ELECTRICAL CONTRACTOR IS TO SIZE MOST BRANCH CIRCUITS; A MAXIMUM VOLTAGE DROP OF 3% IS PERMITTED.
11. THE ELECTRICAL CONTRACTOR IS TO ARRANGE FOR TELEPHONE SERVICE AND TELEPHONE WIRING. COORDINATE WITH THE TELEPHONE COMPANY UNLESS OTHERWISE SPECIFIED.
12. BRANCH CIRCUITS SHALL BE IN THIN WALL CONDUIT OR APPROVED ROMEX.
13. LIGHTING FIXTURES SHALL BE SELECTED BY THE OWNER. 75% OF THE LAMPS SHALL BE HIGH EFFICACY TYPE
14. SMOKE ALARMS SHALL BE DIRECT WIRED 120V. U.L. 217 APPROVED TYPE WITH AUDIBLE ALARM INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND LISTING.
CARBON MONOXIDE DETECTOR(S) TO COMPLY W/ UL#2034-96.
15. ALL DEVICES SHALL BE SMOOTH TYPE, IVORY COLOR, UNLESS OTHERWISE SPECIFIED.
16. ALL MECHANICAL EQUIPMENT SHALL BE PROTECTED BY OVERCURRENT DEVICES OF TYPE AND RATING PER MANUFACTURER NAMEPLATE SPECIFICATIONS.
17. THE ELECTRICAL CONTRACTOR IS TO COORDINATE WITH OTHER TRADES TO MAKE CERTAIN THAT ALL AIR-CONDITIONING POWER AND CONTROL WIRING AND CONDUITS ARE IN THE BID.
18. EXHAUST FANS IN BATHROOMS (IF USED) SHALL BE RATED AT 1 CFM/SF OF VENTILATED FLOOR AREA.
19. ALL FAN VENTING AND ROOF PENETRATIONS SHALL BE BY MECHANICAL CONTRACTOR.
20. ELECTRICAL CONTRACTOR IS TO COORDINATE ALL SERVICE REQUIR-MENTS WITH THE POWER COMPANY BEFORE BIDDING TO BE CERTAIN THAT ALL WORK NECESSARY TO MEET POWER COMPANY SPECIFICATIONS IS IN THE BID.
21. ALL RECEPTACLES SHALL BE TAMPER RESISTANT AND IN ACCORD. W/ NEC 210.52 AND ARC FAULT PROTECTED IN ACCORD. W/ NEC210.12(A)
22. CEILING FANS TO BE MOUNTED PER NEC 422.19, 422.20, 422.21
23. INSTALLATION HEIGHTS ABOVE FINISH FLOOR UNLESS OTHERWISE NOTED:
45" TO CENTER WALL HUNG TELEPHONE
12" TO CENTER TELEPHONE JACKS
46" TO CENTER LIGHT SWITCHES
16" TO CENTER RECEPTACLES
46" TO CENTER KITCHEN RECEPTACLES OVER VANITIES
42" TO CENTER BATH RECEPTACLES
32" TO BATH RECEPTACLE (HORIZONTAL)
12" TO CENTER TELEVISION JACKS
91" TO BATH WALL SCONCES WIP
24. ALL LIGHTS IN CLOSET SHALL BE ENCLOSED AS PER NEC 410.16 & FBC RE E4003.12
25. ALL EXTERIOR FIXTURES SHALL BE U.L. RATED FOR EXTERIOR.
26. PROVIDE BUBBLE COVER OVER EXT. RECEPTACLES PER 406.9(B)(I)
27. ALL LAUNDRY, BATH & KITCHEN COUNTERTOP RECEPTACLES SHALL BE GFI PROTECTED & AFCI PROTECTED PER 210.12(A)
28. AFCI PROTECTION SHALL COMPLY WITH NEC 210.12 210.8 AND FBC RE E3902
29. ALL LIGHTING IN TUB OR SHOWERS SHALL BE PER NEC410.10(D) FBC RE E4003.11 AND SUITABLE FOR DAMP LOCATIONS.
30. ALL BATH WALL SCONCES TO HAVE WHIP @ +91"
31. ALL BATH RECEPTACLES TO BE AT 32" HORIZ.

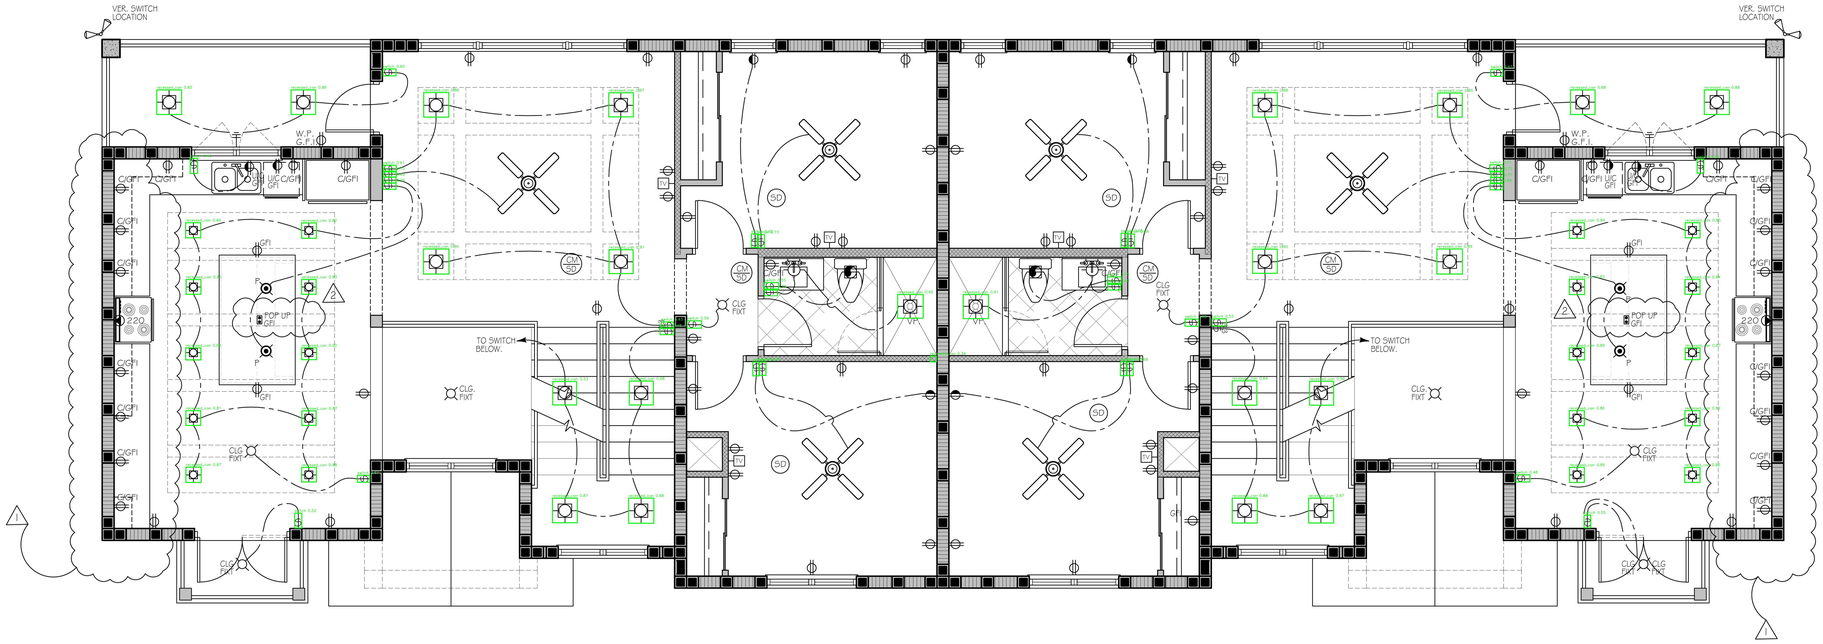

SECOND FLOOR ELECTRIC PLAN

SCALE : 1/4" = 1'-0"

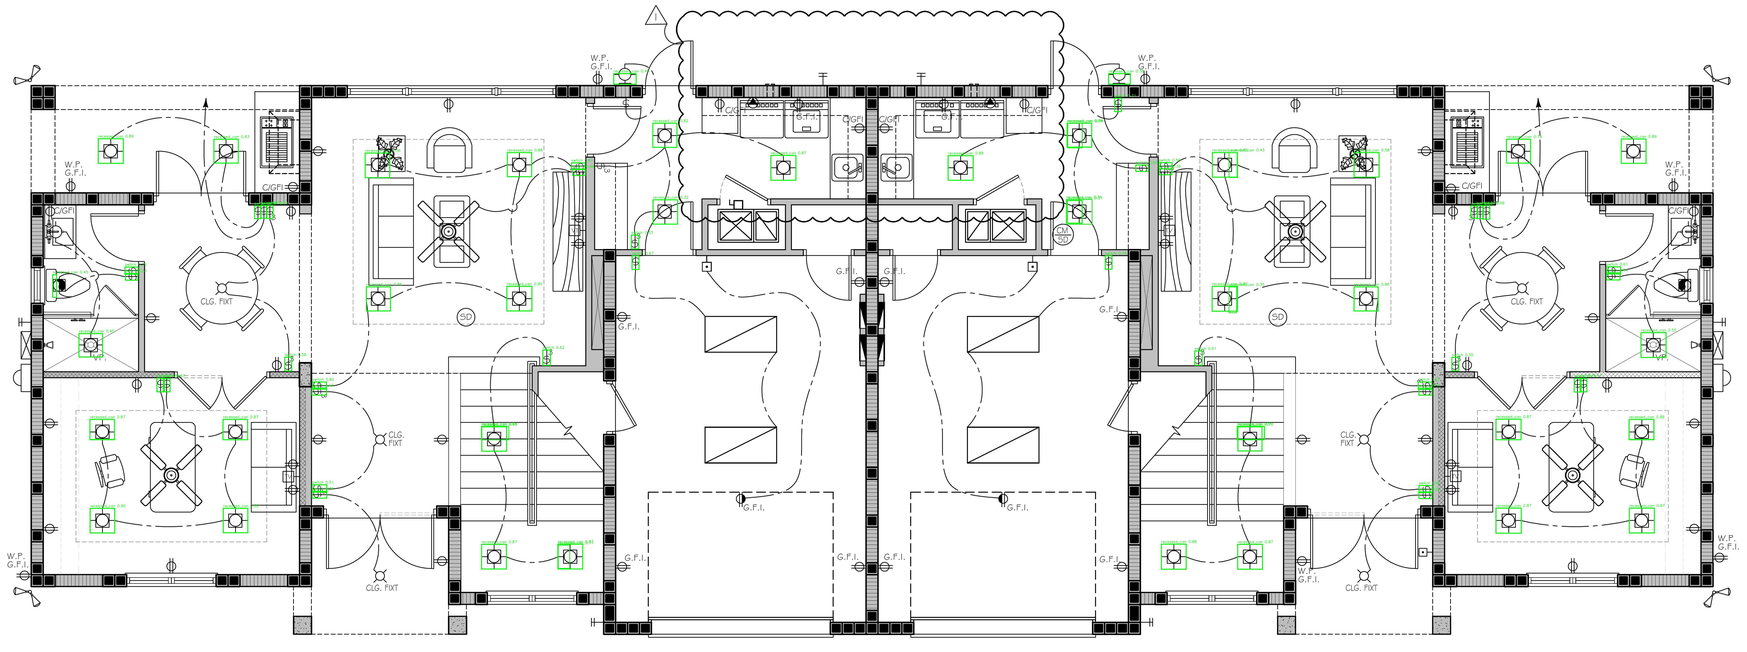

GROUND FLOOR ELECTRIC PLAN

SCALE : 1/4" = 1'-0"

YATES ASSOCIATES
ARCHITECTURE INC.
AA-26001673
330 CLEMATIS ST, SUITE 210
WEST PALM BEACH, FL 33401
TEL: 561-653-8280 FAX: 561-653-8279
WWW.YATESARCHITECTURE.COM

DATE: June 1, 2022
JOB NO: 22-0000
DESIGN BY: K.D.Y.
DRAWN BY: D.C.M.
APPROVED: K.D.Y.
REVISIONS:
1 REVISIONS PER BLDG DEPARTMENT REVIEW
2 REVISIONS PER BLDG DEPARTMENT REVIEW

A PROPOSED TOWNHOUSE PROJECT FOR:
BUILTMORE CONTRACTING
2148 LAKE DRIVE
SINGER ISLAND, FL
PALM BEACH COUNTY

PERMIT REVIEW 03-09-23

SEAL
STATE OF FLORIDA
KELLY DAVID YATES
AR13706
REGISTERED ARCHITECT
KELLY D. YATES
FLORIDA AR 13706

DIGITAL SIGNATURE
Kelly Yates
Digitally signed by Kelly Yates
Date: 2023.12.19 15:15:41 -05'00'

SHEET NO.
E-101
OF | SHTS

Copyright © 2020 Yates Architecture Inc.
This package is copyrighted. All rights reserved. No part of this package may be reproduced or distributed in any form or by any means, including the making of copies by any photo process or by any electronic or mechanical devices, printed, written, drawn, or oral, or the storing, in a data base or retrieval system, without the prior written permission, from the designer