


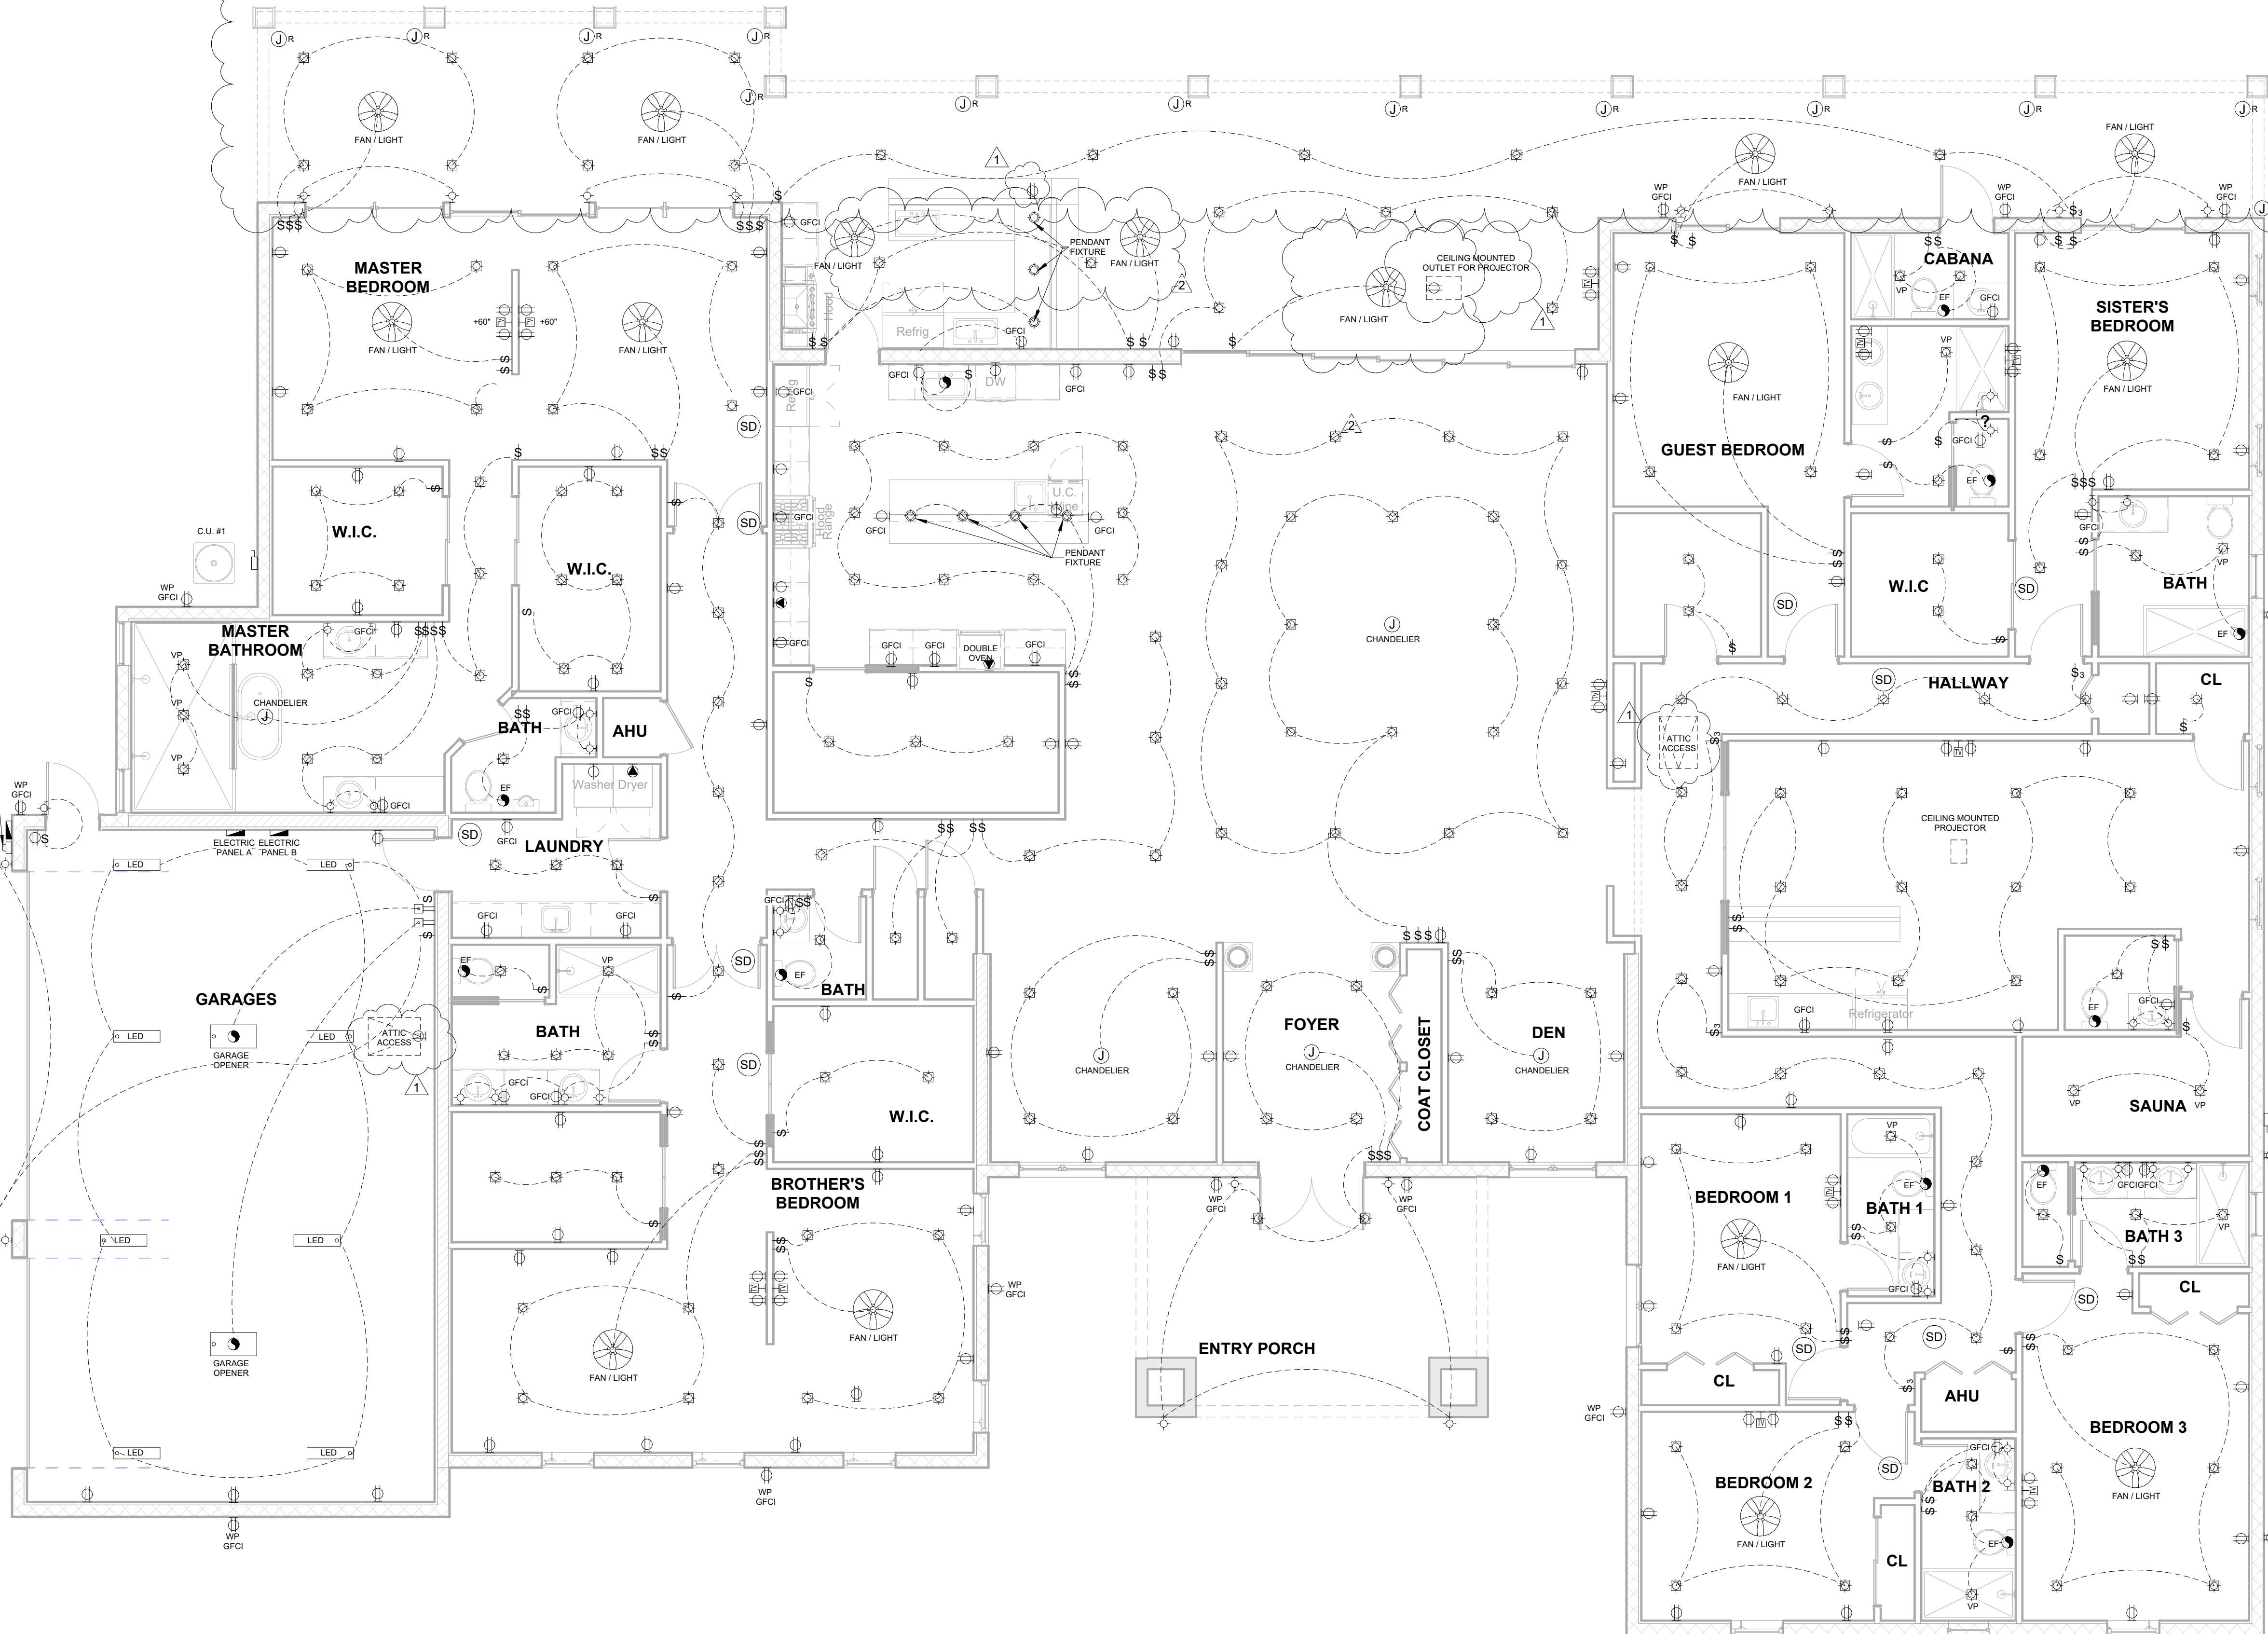

1 ELECTRICAL FLOOR PLAN
3/16" = 1'-0"

ELECTRICAL LEGEND			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
SSSS	GANG SWITCH PANEL		EXHAUST FAN
\$	SPST WALL SWITCH		GARAGE DOOR OPENER
\$3	3-WAY SWITCH		DISCONNECT SWITCH
\$4	4-WAY SWITCH		PANELBOARD
\$D	DIMMER SWITCH		POWER METER
\$R	RHEOSTAT SWITCH		TRACK LIGHT
	PUSH BUTTON SW.		2x4' FLUORESCENT LIGHT FIXTURE
	DUPLEX RECEPTACLE		1x4' FLUORESCENT LIGHT FIXTURE
	DUPLEX RECEPTACLE SPLIT WIRE		SECURITY SPOT LIGHT
	DEDICATED RECEPTACLE		RECESSED HI-HAT LIGHT FIXTURE
	220V RECEPTACLE		WALL MOUNT LIGHT FIXTURE
	FLOOR RECEPTACLE		HANGING LIGHT FIXTURE
	JUNCTION BOX		SURFACE MOUNT LIGHT FIXTURE
	INTERCOM STATION 60" A.F.F.		WALL SCONCE LIGHT FIXTURE
	TELEPHONE OUTLET		EYE BALL LIGHT FIXTURE
	TELEVISION OUTLET		HEAT LAMP
	THERMOSTAT		GROUND FAULT INTERRUPTER
	COMBO SMOKE / CO2 DETECTOR		VAPOR PROOF
	SPEAKERS (SEE SHOP DRAWINGS)		WATER PROOF
	VOLUME CONTROL (SPEAKERS)		UNDER COUNTER
	CEILING FAN		OVER COUNTER
	CEILING JUNCTION BOX FOR REMOTE CONTROLLED - ROLLDOWN SCREEN		

- ELECTRICAL NOTES:**
- THE DRAWINGS ARE DIAGRAMMATIC AND INDICATE THE GENERAL ARRANGEMENT OF THE ELECTRICAL WORK.
 - CONTRACTOR SHALL VERIFY EXACT LOCATION OF FIXTURES AND OUTLETS AT JOB SITE BEFORE ROUGHING-IN. CONTRACTOR SHALL VERIFY W/ FPL&L LOCATION OF SERVICE AND SHALL LOCATE METER, DISCONNECT & PANEL AS REQ'D.
 - THE ELECTRICAL CONTRACTOR SHALL COMPLY WITH THE N.E.C. AND ALL APPLICABLE CODES OR AUTHORITIES HAVING JURISDICTION OVER THIS PROJECT.
 - THE ELECTRICAL CONTRACTOR SHALL COORDINATE THE EXACT LOCATION OF ALL H.V.A.C. EQUIPMENT AND ITS GIVEN LOAD WITH THE MECHANICAL CONTRACTOR BEFORE ROUGHING-IN FOR PROPER POWER AND WIRING CONTROL LAYOUT AND INSTALLATION. ANY DISCREPANCIES BETWEEN THE GIVEN AND ACTUAL H.V.A.C. LOADS SHALL BE CORRECTED BEFORE ROUGHING-IN.
 - LIGHT FIXTURES OF THE BUILDING, SELECTED BY THE OWNER OR ARCHITECT, SHALL BE INSTALLED BY THE ELECTRICAL CONTRACTOR.
 - ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITIONS OF THE NATIONAL ELECTRICAL CODE AND SHALL COMPLY WITH ALL LOCAL RULES AND ORDINANCES.
 - UNLESS OTHERWISE NOTED, MINIMUM SIZE WIRE SHALL BE #12 "AWG", EXCLUDING CONTROL WIRING.
 - UNLESS OTHERWISE NOTED, ALL CONDUCTORS SHALL BE COPPER WITH "THW" INSULATION FOR SIZE #10 AND SMALLER. CONDUCTORS LARGER THAN #10 SHALL HAVE "THW" INSULATION. ALL CONDUCTORS #10 AND SMALLER MAY BE SOLID. ALL CONDUCTORS #8 AND LARGER SHALL BE STANDARD.
 - ALL 110 V., 10, 15, AND 20A RECEPTACLES INSTALLED OUTDOORS AND IN BATHROOMS SHALL HAVE GROUND FAULT CIRCUIT INTERRUPTER.
 - ALL CONVENIENCE OUTLETS TO BE OF GROUNDING TYPE.
 - ALL WORK SHALL BE COORDINATED WITH OTHER TRADES TO AVOID INTERFERENCE WITH THE PROGRESS OF CONSTRUCTION.
 - SMOKE DETECTORS SHALL BE LOCATED ON OR NEAR THE CEILING IN THE IMMEDIATE VICINITY OUTSIDE OF EACH SLEEPING AREA AND ON EACH ADDITIONAL FLOOR LEVEL (STORY), INCLUDING BASEMENTS.
 - SMOKE DETECTORS TO BE POWERED BY HOUSE ELECTRICAL SERVICE WITH BATTERY BACK-UP. VISIBLE "POWER-ON" INDICATOR AND A TEST BUTTON. SMOKE DETECTORS SHALL TIE INTO A KITCHEN OR BATH LIGHTING CIRCUIT AHEAD OF SWITCH. ALL SMOKE DETECTORS TO BE INTERCONNECTED (ON SAME CIRCUIT) AND MUST SIGNAL SIMULTANEOUSLY WITH TEMPORAL SOUND.
 - CONTRACTOR SHALL VERIFY WITH FPL&L THE LOCATIONS OF SERVICE AND SHALL LOCATE METER AND PANEL AS REQUIRED.
 - VERIFY ALL CONDUCTORS AND BREAKERS WITH EQUIPMENT MANUFACTURER'S SPECIFICATIONS.
 - PROVIDE G.F.I. FOR ALL BATHROOM RECEPTACLES, W.P. AND GARAGE RECEPTACLES, AND LIGHTING FIXTURES WITHIN 5'-0" OF SWIMMING POOL EDGE.
 - COORDINATE RACEWAY INSTALLATIONS WITH OTHER TRADES PRIOR TO CONSTRUCTION.
 - ALL BRANCH CIRCUITS SHALL BE IN RACEWAY OR NON-METALLIC SHEATHED CABLE.
 - ALL CONDUCTORS SHALL BE COPPER, U.N.O. CONDUCTORS #8 AND SMALLER SHALL HAVE T.W. INSULATION; CONDUCTORS LARGER THAN #8 SHALL HAVE T.H.W. INSULATION.
 - ALL ELECTRICAL SWITCHES SHALL BE 48" A.F.F. UNLESS OTHERWISE NOTED.
 - ALL RECEPTACLES SHALL BE 12" A.F.F. UNLESS OTHERWISE NOTED.
 - CLOSET LIGHTING SHALL BE MIN. 18" CLEAR FROM EDGE OF SHELVES PER NEC 410.16 MINIMUM CLEARANCE FROM DEFINED STORAGE AREA.
 - ALL HANGING FANS AND CHANDELIERS TO BE REINFORCED AS PER MANUFACTURER'S SPECIFICATIONS.
 - HYDROMASSAGE BATHTUBS MUST MEET ACCESS AND BONDING REQUIREMENTS AS PER LATEST N.E.C., ART. 680-72 & 680-73. PROVIDE G.F.C.I. PROTECTED CIRCUIT FOR ELECTRICAL COMPONENTS.
 - ALL RECESSED AND/OR DOWN LIGHT FIXTURES TO BE 5000K AND CRI-95 OR HIGHER LED UNITS WITH NOT LESS THAN 900 LUMENS OR EQUAL.
 - AS PER NEC 2017 ART. 210.12: ALL 120-VOLT, SINGLE PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED COMBINATION-TYPE ARC-FAULT CIRCUIT INTERRUPTER (AFCI). A LISTED OUTLET BRANCH-CIRCUIT TYPE AFCI INSTALLED AT THE FIRST OUTLET ON THE BRANCH CIRCUIT IN COMBINATION WITH A LISTED BRANCH-CIRCUIT OVERCURRENT PROTECTIVE DEVICE WHERE ALL OF THE FOLLOWING CONDITIONS ARE MET: THE BRANCH-CIRCUIT WIRING SHALL BE CONTINUOUS FROM THE BRANCH-CIRCUIT OVERCURRENT DEVICE TO THE OUTLET BRANCH-CIRCUIT AFCI; AND THE MAXIMUM LENGTH OF CONDUCTOR FROM THE BRANCH-CIRCUIT OVERCURRENT DEVICE TO THE FIRST OUTLET SHALL NOT EXCEED 15.2 M (50 FT); AND ARC-FAULT CIRCUIT INTERRUPTER PROTECTION SHALL BE PROVIDED FOR THE REMAINING PORTION OF THE BRANCH CIRCUIT.

NEW RESIDENCE
GYLES WILSON
17539 FOX TRAIL LN
LOXAHATCHEE FLORIDA

team architecture
i n c o r p o r a t e d

AR 8840

FERNANDO R. PRIETO

Check By: F.P.
Design By: A.C.
Drawn By: J.M.
Date: 06/15/2023
Sheet Number:

E101

Revisions
Description Date
BLDG REV 04/18/23
BY: OWNERS REV 06/20/23
BY: OWNERS REV 11/22/23

2328 10th. Avenue North, Suite 200
Lakewood, Florida 33461
(561) 855-2688

THIS DRAWING IS THE PROPERTY OF TEAM ARCHITECTURE INCORPORATED AND IS COPYRIGHTED. THERE SHALL BE NO USE OR COPYING OF THIS DOCUMENT WITHOUT AUTHORIZATION FROM TEAM ARCHITECTURE INCORPORATED.