

PART F2

SANITARY AND OTHER FACILITIES

OBJECTIVE

FO2

The *Objective* of this Part is to—

- (a) safeguard occupants from illness caused by infection; and
- (b) safeguard occupants from loss of amenity arising from the absence of adequate personal hygiene facilities; and
- (c) enable occupants to carry out laundering; and
- (d) provide for facilities to enable food preparation; and
- (e) enable unconscious occupants of *sanitary compartments* to be removed from the compartment.

FUNCTIONAL STATEMENTS

FF2.1

A building is to be provided with—

- (a) suitable sanitary facilities and space and facilities for personal hygiene; and
- NSW FF2.1(b)*
- (b) adequate means for the prevention of contaminants to hot water, warm water and cooling water systems.

FF2.2

A building is to be provided with—

- (a) space or facilities for laundering; and
- (b) suitable means for the sanitary disposal of waste water.

Vic FF2.2 Application

Application:

FF2.2 only applies to—

- (a) a Class 2 building or Class 4 part of a building; and
- (b) a Class 9a *health-care building*; and
- (c) a Class 9b *early childhood centre*; and

HEALTH AND AMENITY

- (d) a Class 9c building.

FF2.3

A building is to be provided with—

- (a) space and facilities for the preparation and cooking of food; and
- (b) suitable means for the sanitary disposal of associated waste water.

Application:

FF2.3 only applies to—

- (a) a Class 2 building or Class 4 part of a building; and
- (b) a Class 9a *health-care building*; and
- (c) a Class 9b *early childhood centre*; and
- (d) a Class 9c building.

FF2.4

A *sanitary compartment* is to have sufficient space or other means to permit an unconscious occupant to be removed from the compartment.

PERFORMANCE REQUIREMENTS

FP2.1

Suitable sanitary facilities for personal hygiene must be provided in a convenient location within or associated with a building, to the degree necessary, appropriate to—

- (a) the function or use of the building; and
- (b) the number and gender of the occupants; and
- (c) the disability or other particular needs of the occupants.

FP2.2

Laundry facilities or space for laundry facilities and the means for the sanitary disposal of waste water must be provided in a convenient location within or associated with a building appropriate to the function or use of the building.

Vic FP2.2 Application

Application:

FP2.2 only applies to—

- (a) a Class 2 building or Class 4 part of a building; and
- (b) a Class 9a *health-care building*; and
- (c) a Class 9b *early childhood centre*; and
- (d) a Class 9c building.

HEALTH AND AMENITY

FP2.3

A facility must be provided which includes—

- (a) a means for food rinsing, utensil washing and the sanitary disposal of associated waste water; and
- (b) a means for cooking food; and
- (c) a space for food preparation.

Application:

FP2.3 only applies to—

- (a) a Class 2 building or Class 4 part of a building; and
- (b) a Class 9a *health-care building*; and
- (c) a Class 9b *early childhood centre*; and
- (d) a Class 9c building.

FP2.4

Suitable means must be provided in a building containing wards or bedrooms to facilitate the emptying of sewage or dirty water from containers.

Application:

FP2.4 only applies to a Class 9a or 9c building.

FP2.5

A *sanitary compartment* must be constructed with sufficient space or other means to permit an unconscious occupant to be removed from the compartment.

FP2.6

NSW FP2.6

Hot water, warm water and cooling water systems installed in a building must control the accumulation of harmful levels of micro-organisms.

Limitation:

FP2.6 does not apply to a system serving only a single *sole-occupancy unit* in a Class 2 or 3 building or Class 4 part of a building.

PART F2 SANITARY AND OTHER FACILITIES

Deemed-to-Satisfy Provisions

F2.0 Deemed-to-Satisfy Provisions

Vic F2.0

- (a) Where a *Building Solution* is proposed to comply with the *Deemed-to-Satisfy Provisions*, *Performance Requirements FP2.1* to *FP2.6* are satisfied by complying with—
 - (i) **F2.1** to **F2.8**; and
 - (ii) for public transport buildings, **Part H2**.
- (b) Where a *Building Solution* is proposed as an *Alternative Solution* to the *Deemed-to-Satisfy Provisions* of **F2.1** to **F2.8** and **Part H2**, the relevant *Performance Requirements* must be determined in accordance with **A0.10**.

F2.1 Facilities in residential buildings

Sanitary and other facilities for Class 2, 3 and 9c buildings and for Class 4 parts of buildings must be provided in accordance with **Table F2.1**.

Table F2.1 PROVISION OF SANITARY AND OTHER FACILITIES IN RESIDENTIAL BUILDINGS

Class 2
Within each <i>sole-occupancy unit</i>, provide— (a) a kitchen sink and facilities for the preparation and cooking of food; and (b) a bath or shower; and (c) a closet pan and washbasin. Laundry facilities, provide either— (a) in each <i>sole-occupancy unit</i>— (i) clothes washing facilities, comprising at least one washtub and space for a washing machine; and (ii) clothes drying facilities comprising— (A) clothes line or hoist with not less than 7.5 m of line; or (B) space for one heat-operated drying cabinet or appliance in the same room as the clothes washing facilities; or Note: A kitchen sink or washbasin must not be counted as a laundry washtub. (b) a separate laundry for each 4 <i>sole-occupancy units</i>, or part thereof— (i) clothes washing facilities comprising at least one washtub and one washing machine; and (ii) clothes drying facilities comprising— (A) clothes line or hoist with not less than 7.5 m of line per <i>sole-occupancy unit</i>; or

HEALTH AND AMENITY

Deemed-to-Satisfy Provisions

Table F2.1 PROVISION OF SANITARY AND OTHER FACILITIES IN RESIDENTIAL BUILDINGS— continued

(B) one heat-operated drying cabinet or appliance for each 4 <i>sole-occupancy units</i>. Facilities for employees— If the building contains more than 10 <i>sole-occupancy units</i>, or a group of Class 2 buildings on the one allotment contains, in total, more than 10 <i>sole-occupancy units</i> — provide a closet pan and washbasin in a compartment or room at or near ground level and accessible to employees without entering a <i>sole-occupancy unit</i>.
Class 3 (other than Class 3 <i>residential aged care buildings</i>) Facilities for residents— For each building or group of buildings, provide— (a) a bath or shower; and (b) a closet pan and washbasin, for each 10 residents for whom private facilities are not provided, except that— (c) if one urinal is provided for each 25 males up to 50 and one additional urinal for each additional 50 males or part thereof, one closet pan for each 12 males may be provided. Facilities for employees — see F2.3. Note: These facilities need not be situated within the building.
Class 3 (<i>residential aged care buildings</i>) Facilities for residents— For each building or group of buildings, provide— (a) a shower, closet pan and wash basin for each 8 residents or part thereof for whom private facilities are not provided; and (b) a suitable bath for each 30 residents or part thereof. Note: Urinals must not be taken into consideration in calculating the number of facilities.
Class 4 For each <i>sole-occupancy unit</i>, provide— (a) a kitchen sink and facilities for the preparation and cooking of food; and (b) a bath or shower; and (c) a closet pan and washbasin; and (d) clothes washing facilities, comprising a washtub and space in the same room for a washing machine; and (e) a clothes line or hoist, or space for a heat-operated drying cabinet or similar appliance for the exclusive use of the occupants. Note: A kitchen sink or washbasin must not be counted as a laundry washtub.
Class 9c

HEALTH AND AMENITY

Deemed-to-Satisfy Provisions

Table F2.1 PROVISION OF SANITARY AND OTHER FACILITIES IN RESIDENTIAL BUILDINGS— continued

Facilities for residents—

For each building or group of buildings, provide—

- (a) a closet pan and wash basin for each 6 residents or part thereof for whom private facilities are not provided; and
- (b) a shower for each 7 residents or part thereof for whom private facilities are not provided; and
- (c) a suitable bath, fixed or mobile.

Other facilities, provide—

- (a) one kitchen or other adequate facility for the preparation and cooking or reheating of food including a kitchen sink and washbasin; and
- (b) laundry facilities for the cleansing and drying of linen and clothing or adequate facilities for holding and dispatch or treatment of soiled linen and clothing and the like and the receipt and storage of clean linen; and
- (c) one clinical hand washing basin for each 16 residents or part thereof.

Note: Urinals must not be taken into consideration in calculating the number of facilities.

F2.2 Calculation of number of occupants and facilities

- (a) The number of persons accommodated must be calculated according to [D1.13](#) if it cannot be more accurately determined by other means.
- (b) Unless the premises are used predominantly by one sex, sanitary facilities must be provided on the basis of equal numbers of males and females.
- (c) In calculating the number of sanitary facilities to be provided under [F2.1](#) and [F2.3](#), a unisex facility *required* for people with a disability may be counted once for each sex.
- (d) For the purposes of this Part, a unisex facility comprises one closet pan, one washbasin and means for the disposal of sanitary towels.

F2.3 Facilities in Class 3 to 9 buildings

- (a) Sanitary facilities must be provided for Class 3, 5, 6, 7, 8 or 9 buildings in accordance with [Table F2.3](#).
- (b) If not more than 10 people are employed, a unisex facility may be provided instead of separate facilities for each sex.
- (c) If the majority of employees are of one sex, not more than 2 employees of the other sex may share toilet facilities if the facilities are separated by means of walls, partitions and doors to afford privacy.
- (d) Employees and the public may share the same facilities in a Class 6 and 9b building (other than a *school* or *early childhood centre*) provided the number of facilities provided is not less than the total number of facilities *required* for employees plus those *required* for the public.
- (e) Adequate means of disposal of sanitary towels must be provided in sanitary facilities for use by females.

HEALTH AND AMENITY

Deemed-to-Satisfy Provisions

- (f) A Class 9a *health-care building* must be provided with—
- (i) one kitchen or other adequate facility for the preparation and cooking or reheating of food including a kitchen sink and washbasin; and
 - (ii) laundry facilities for the cleansing and drying of linen and clothing or adequate facilities for holding and dispatch or treatment of soiled linen and clothing, sanitary towels and the like and the receipt and storage of clean linen; and
 - (iii) one shower for each 8 patients or part thereof; and
 - (iv) one island-type plunge bath in each *storey* containing a *ward area*.

Vic F2.3(g) and (ga)

- (g) A Class 9b *early childhood centre* must be provided with—
- (i) a kitchen or food preparation area with a kitchen sink, separate hand washing facilities, space for a refrigerator and space for cooking facilities, with—
 - (A) the facilities protected by a door or gate with child proof latches to prevent unsupervised access to the facilities by children younger than 5 years old; and
 - (B) the ability to facilitate supervision of children from the facilities if the *early childhood centre* accommodates children younger than 2 years old; and
 - (ii) one bath, shower or shower-bath; and
 - (iii) if the centre accommodates children younger than 3 years old—
 - (A) a laundry facility comprising a washtub and space in the same room for a washing machine; and
 - (B) a bench type baby bath, which is within 1 m of the nappy change bench; and
 - (C) a nappy changing bench which—
 - (aa) is within 1 m of separate adult hand washing facilities and bench type baby bath; and
 - (bb) must be not less than 0.9 m² in area and at a height of not less than 850 mm, but not more than 900 mm above the finished floor level; and
 - (cc) must have a space not less than 800 mm high, 500 mm wide and 800 mm deep for the storage of steps; and
 - (dd) is positioned to permit a staff member changing a nappy to have visibility of the play area at all times.
 - (h) Class 9b theatres and sporting venues must be provided with one shower for each 10 participants or part thereof.
 - (i) Not less than one washbasin must be provided where closet pans or urinals are provided.

Tas Table F2.3

Vic Table F2.3

Table F2.3 SANITARY FACILITIES IN CLASS 3, 5, 6, 7, 8 OR 9 BUILDINGS

User Group	Closet Pans		Urinals		Washbasins	
	Design Occupancy	Number	Design Occupancy	Number	Design Occupancy	Number
Class 3, 5, 6 and 9 other than <i>schools</i>						
Male employees	1 — 20	1	1 — 10	0	1 — 30	1
	> 20	Add 1 per 20	11 — 25	1	> 30	Add 1 per 30
			26 — 50	2		
			> 50	Add 1 per 50		
Female employees	1 — 15	1			1 — 30	1
	> 15	Add 1 per 15			> 30	Add 1 per 30
Class 7 and 8						
Male employees	1 — 20	1	1 — 10	0	1 — 20	1
	> 20	Add 1 per 20	11 — 25	1	> 20	Add 1 per 20
			26 — 50	2		
			> 50	Add 1 per 50		
Female employees	1 — 15	1			1 — 20	1
	> 15	Add 1 per 15			> 20	Add 1 per 20
Note: Sanitary facilities need not be provided for a Class 8 <i>electricity network substation</i>						
Class 6 — department stores, shopping centres						
Male patrons	1 — 1200	1	1 — 600	1	1 — 600	1
	> 1200	Add 1 per 1200	> 600	Add 1 per 1200	> 600	Add 1 per 1200

Deemed-to-Satisfy Provisions

Table F2.3 SANITARY FACILITIES IN CLASS 3, 5, 6, 7, 8 OR 9 BUILDINGS — continued

User Group	Closet Pans		Urinals		Washbasins	
	Design Occupancy	Number	Design Occupancy	Number	Design Occupancy	Number
Female patrons	1 — 300	1			1 — 600	1
	301 — 600	2			601 — 1200	2
	>600	Add 1 per 1200			>1200	Add 1 per 1200
Note: Sanitary facilities need not be provided for patrons if the building accommodates not more than 600 people.						
Class 6 — restaurants, cafes, bars						
Male patrons	1 — 100	1	1 — 50	1	1 — 50	1
	101 — 300	2	51 — 100	2	51 — 200	2
	>300	Add 1 per 200	101 — 150	3	>200	Add 1 per 200
			151 — 200	4		
			201 — 250	5		
			>250	Add 1 per 100		
Female patrons	1 — 25	1			1 — 50	1
	26 — 50	2			51 — 150	2
	51 — 100	3			>150	Add 1 per 200
	101 — 150	4				
	151 — 200	5				
	201 — 250	6				
	>250	Add 1 per 100				
Note: Sanitary facilities need not be provided for patrons if the building accommodates not more than 20 people.						

Deemed-to-Satisfy Provisions

Table F2.3 SANITARY FACILITIES IN CLASS 3, 5, 6, 7, 8 OR 9 BUILDINGS — continued

User Group	Closet Pans		Urinals		Washbasins	
	Design Occupancy	Number	Design Occupancy	Number	Design Occupancy	Number
Class 9a — health-care buildings						
Male patients	1 — 16	2			1 — 8	1
	>16	Add 1 per 8			> 8	Add 1 per 8
Female patients	1 — 16	2			1 — 8	1
	>16	Add 1 per 8			> 8	Add 1 per 8
Class 9b — schools						
Male employees	1 — 20	1	1 — 10	0	1 — 30	1
	> 20	Add 1 per 20	11 — 20	1	> 30	Add 1 per 30
			21 — 45	2		
			>45	Add 1 per 30		
Female employees	1 — 5	1			1 — 30	1
	>5	Add 1 per 15			> 30	Add 1 per 30
Male students	1 — 25	1	1 — 50	1	1 — 10	1
	26 — 75	2	51 — 100	2	11 — 50	2
	76 — 150	3	>100	Add 1 per 100	51 — 100	3
	151 — 200	4			> 100	Add 1 per 75
	> 200	Add 1 per 100				
Female students	1 — 10	1			1 — 10	1
	11 — 25	2			11 — 50	2
	26 — 100	Add 1 per 25			51 — 100	3
	> 100	Add 1 per 50			> 100	Add 1 per 75

Deemed-to-Satisfy Provisions

Table F2.3 SANITARY FACILITIES IN CLASS 3, 5, 6, 7, 8 OR 9 BUILDINGS — continued

User Group	Closet Pans		Urinals		Washbasins	
	Design Occupancy	Number	Design Occupancy	Number	Design Occupancy	Number
Class 9b — <i>early childhood centres</i>						
Children	1 — 30	2			1 — 30	2
	> 30	Add 1 per 15			> 30	Add 1 per 15
Note: Facilities for use by children must be— (a) junior pans; and (b) washbasins with a rim height not exceeding 600mm; and (c) accessible from both indoor and outdoor play areas.						
Class 9b — theatres and cinemas with multiple auditoria, art galleries or the like						
Male participants	1 — 20	1	1 — 10	1	1 — 10	1
	> 20	Add 1 per 20	> 10	Add 1 per 10	> 10	Add 1 per 10
Female participants	1 — 10	1			1 — 10	1
	> 10	Add 1 per 10			> 10	Add 1 per 10
Male spectators or patrons	1 — 250	1	1 — 100	1	1 — 150	1
	251 — 500	2	>100	Add 1 per 100	>150	Add 1 per 150
	>500	Add 1 per 500				
Female spectators or patrons	1 — 10	1			1 — 80	1
	11 — 50	2			81 — 250	2
	>51	Add 1 per 60			251 — 430	3
					> 430	Add 1 per 200

Deemed-to-Satisfy Provisions

Table F2.3 SANITARY FACILITIES IN CLASS 3, 5, 6, 7, 8 OR 9 BUILDINGS — continued

User Group	Closet Pans		Urinals		Washbasins	
	Design Occupancy	Number	Design Occupancy	Number	Design Occupancy	Number
Class 9b —single auditorium theatres and cinemas						
Male patrons	1 — 50	0	1 — 50	0	1 — 50	0
	51 — 250	1	51 — 100	1	51 — 150	1
	251 — 500	2	>100	Add 1 per 100	>150	Add 1 per 150
	>500	Add 1 per 500				
Female patrons	1 — 50	0			1 — 50	0
	51 — 110	3			51 — 150	1
	111 — 170	4			>150	Add 1 per 150
	171 — 230	5				
	231 — 250	6				
	>250	Add 1 per 80				
Class 9b — sports venues or the like						
Male participants	1 — 20	1	1 — 10	1	1 — 10	1
	> 20	Add 1 per 20	> 10	Add 1 per 10	> 10	Add 1 per 10
Female participants	1 — 10	1			1 — 10	1
	> 10	Add 1 per 10			> 10	Add 1 per 10
Male spectators or patrons	1 — 250	1	1 — 100	1	1 — 150	1
	251 — 500	2	> 100	Add 1 per 100	> 150	Add 1 per 150
	> 500	Add 1 per 500				

Deemed-to-Satisfy Provisions

Table F2.3 SANITARY FACILITIES IN CLASS 3, 5, 6, 7, 8 OR 9 BUILDINGS — continued

User Group	Closet Pans		Urinals		Washbasins	
	Design Occupancy	Number	Design Occupancy	Number	Design Occupancy	Number
Female spectators or patrons	1 — 15	1			1 — 60	1
	16 — 60	2			61 — 200	2
	61 — 120	3			201 — 350	3
	> 120	Add 1 per 70			> 350	Add 1 per 150
Class 9b — churches, chapels or the like						
Male patrons	1 — 300	1	1 — 200	1	1 — 250	1
	>300	Add 1 per 500	> 200	Add 1 per 200	> 250	Add 1 per 250
Female patrons	1 — 150	1			1 — 250	1
	> 150	Add 1 per 150			> 250	Add 1 per 250`
Class 9b — public halls, function rooms or the like						
Male patrons	1 — 100	1	1 — 50	1	1 — 50	1
	>100	Add 1 per 200	51 — 100	2	51 — 200	2
			101 — 150	3	>200	Add 1 per 200
			151 — 200	4		
			201 — 250	5		
			>250	Add 1 per 100		

Deemed-to-Satisfy Provisions

Table F2.3 SANITARY FACILITIES IN CLASS 3, 5, 6, 7, 8 OR 9 BUILDINGS — continued

User Group	Closet Pans		Urinals		Washbasins	
	Design Occupancy	Number	Design Occupancy	Number	Design Occupancy	Number
Female patrons	1 — 25	1			1 — 50	1
	26 — 50	2			51 — 150	2
	51 — 100	3			>150	Add 1 per 200
	101 — 150	4				
	151 — 200	5				
	201 — 250	6				
	>250	Add 1 per 100				
Note: Sanitary facilities need not be provided for patrons if the building accommodates not more than 20 people.						
Notes: 1. Number — means the number of facilities <i>required</i>. 2. > — means greater than 3. Employees — a reference to employees includes owners and managers using the building. 4. A reference to "add 1 per 100 or 150, 250, 500" etc. includes any part of that number.						

HEALTH AND AMENITY

Deemed-to-Satisfy Provisions

F2.4 Accessible sanitary facilities

In a building *required* to be *accessible*—

SA F2.4(a)

- (a) *accessible* unisex *sanitary compartments* must be provided in *accessible* parts of the building in accordance with **Table F2.4(a)**; and

SA F2.4(b)

- (b) *accessible* unisex showers must be provided in accordance with **Table F2.4(b)**; and
- (c) at each bank of toilets where there is one or more toilets in addition to an *accessible* unisex *sanitary compartment* at that bank of toilets, a *sanitary compartment* suitable for a person with an ambulant disability in accordance with AS 1428.1 must be provided for use by males and females; and
- (d) an *accessible* unisex *sanitary compartment* must contain a closet pan, washbasin, shelf or bench top and adequate means of disposal of sanitary towels; and
- (e) the circulation spaces, fixtures and fittings of all *accessible* sanitary facilities provided in accordance with **Table F2.4(a)** and **Table F2.4(b)** must comply with the requirements of AS 1428.1; and
- (f) an *accessible* unisex sanitary facility must be located so that it can be entered without crossing an area reserved for one sex only; and
- (g) where two or more of each type of *accessible* unisex sanitary facility are provided, the number of left and right handed mirror image facilities must be provided as evenly as possible; and
- (h) where male sanitary facilities are provided at a separate location to female sanitary facilities, *accessible* unisex sanitary facilities are only *required* at one of those locations; and
- (i) an *accessible* unisex *sanitary compartment* or an *accessible* unisex shower need not be provided on a *storey* or level that is not *required* by **D3.3(f)** to be provided with a passenger lift or ramp complying with AS 1428.1.

Table F2.4(a) ACCESSIBLE UNISEX SANITARY COMPARTMENTS

Class of building	Minimum accessible unisex sanitary compartments to be provided
Class 1b	(a) Not less than 1; and (b) where private <i>accessible</i> unisex <i>sanitary compartments</i> are provided for every <i>accessible</i> bedroom, common <i>accessible</i> unisex <i>sanitary compartments</i> need not be provided.
Class 2	Where <i>sanitary compartments</i> are provided in common areas, not less than 1.

HEALTH AND AMENITY

Deemed-to-Satisfy Provisions

Table F2.4(a) ACCESSIBLE UNISEX SANITARY COMPARTMENTS — continued

Class of building	Minimum accessible unisex sanitary compartments to be provided
Class 3 and Class 9c	(a) In every <i>accessible sole-occupancy unit</i> provided with <i>sanitary compartments</i> within the <i>accessible sole-occupancy unit</i>, not less than 1; and (b) at each bank of <i>sanitary compartments</i> containing male and female <i>sanitary compartments</i> provided in common areas, not less than 1.
Class 5, 6, 7, 8 or 9 — except for within a <i>ward area</i> of a Class 9a <i>health-care building</i>	Where F2.3 requires closet pans— (a) 1 on every <i>storey</i> containing <i>sanitary compartments</i>; and (b) where a <i>storey</i> has more than 1 bank of <i>sanitary compartments</i> containing male and female <i>sanitary compartments</i>, at not less than 50% of those banks.
Class 10a except— (a) a Class 10a appurtenant to another Class of building; and (b) a <i>sanitary compartments</i> dedicated to a single caravan/camping site	At each bank of <i>sanitary compartments</i> containing male and female <i>sanitary compartments</i> , not less than 1.

SA Table F2.4(a)(i)

Table F2.4(b) ACCESSIBLE UNISEX SHOWERS

Class of building	Minimum accessible unisex showers to be provided
Class 1b	(a) Not less than 1; and (b) where private <i>accessible</i> unisex showers are provided for every <i>accessible</i> bedroom, common <i>accessible</i> unisex showers need not be provided.
Class 2	Where showers are provided in common areas, not less than 1
Class 3 and Class 9c	(a) In every <i>accessible sole-occupancy unit</i> provided with showers within the <i>accessible sole-occupancy unit</i>, not less than 1; and (b) 1 for every 10 showers or part thereof provided in common areas.
Class 5, 6, 7, 8 or 9 — except for within a <i>ward area</i> of a Class 9a <i>health-care building</i>	Where F2.3 requires 1 or more showers, not less than 1 for every 10 showers or part thereof.

HEALTH AND AMENITY

Deemed-to-Satisfy Provisions

Table F2.4(b) ACCESSIBLE UNISEX SHOWERS — continued

Class of building	Minimum accessible unisex showers to be provided
Class 10a except— (a) a Class 10a appurtenant to another Class of building; and (b) a <i>sanitary compartment</i> dedicated to a single caravan/camping site	Where showers are provided, 1 for every 10 showers or part thereof.

SA Table F2.4(b)(i)

F2.5 Construction of sanitary compartments

- (a) Other than in an *early childhood centre*, *sanitary compartments* must have doors and partitions that separate adjacent compartments and extend—
 - (i) from floor level to the ceiling in the case of a unisex facility; or
 - (ii) to a height of not less than 1.5 m above the floor if primary *school* children are the principal users; or
 - (iii) 1.8 m above the floor in all other cases.
- (b) The door to a fully enclosed *sanitary compartment* must—
 - (i) open outwards; or
 - (ii) slide; or
 - (iii) be readily removable from the outside of the *sanitary compartment*, unless there is a clear space of at least 1.2 m, measured in accordance with **Figure F2.5**, between the closet pan within the *sanitary compartment* and the doorway.


Vic F2.5(c)

- (c) In an *early childhood centre*, facilities for use by children must have each *sanitary compartment* screened by a partition which, except for the doorway, is opaque for a height of at least 900 mm but not more than 1200 mm above the floor level.

Deemed-to-Satisfy Provisions

Figure F2.5

CONSTRUCTION OF SANITARY COMPARTMENTS

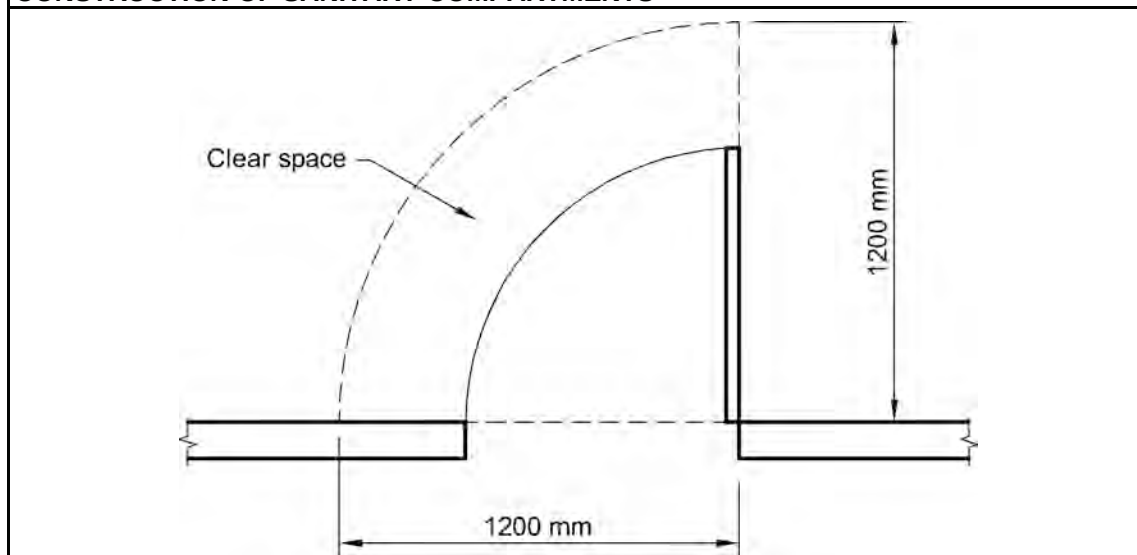

F2.6 Interpretation: Urinals and washbasins

- (a) A urinal may be—
 - (i) an individual stall or wall-hung urinal; or
 - (ii) each 600 mm length of a continuous urinal trough; or
 - (iii) a closet pan used in place of a urinal.
- (b) A washbasin may be—
 - (i) an individual basin; or
 - (ii) a part of a hand washing trough served by a single water tap.

F2.7 Microbial (legionella) control

NSW F2.7

Hot water, warm water and cooling water systems in a building other than a system serving only a single *sole-occupancy unit* in a Class 2 or 3 building or Class 4 part of a building must be installed in accordance with AS/NZS 3666.1.

F2.8 Waste management

- (a) In a Class 9a *health-care building*, at least one slop-hopper or other device, other than a water closet pan or urinal, must be provided—
 - (i) on any *storey* containing *ward areas* or bedrooms to facilitate emptying of containers of sewage or dirty water; and
 - (ii) with a flushing apparatus, tap and grating.

HEALTH AND AMENITY

Deemed-to-Satisfy Provisions

- (b) In a Class 9c building, the following facilities must be provided for every 60 beds or part thereof on each storey containing *resident use areas*—
- (i) one slop-hopper or other device other than a water closet pan or urinal for the safe handling and disposal of liquid and solid wastes with a flushing apparatus, tap and grating; and
 - (ii) an appliance for the disinfection of pans or an adequate means to dispose of receptacles.

Tas F2.101, F2.102

Vic F2.101