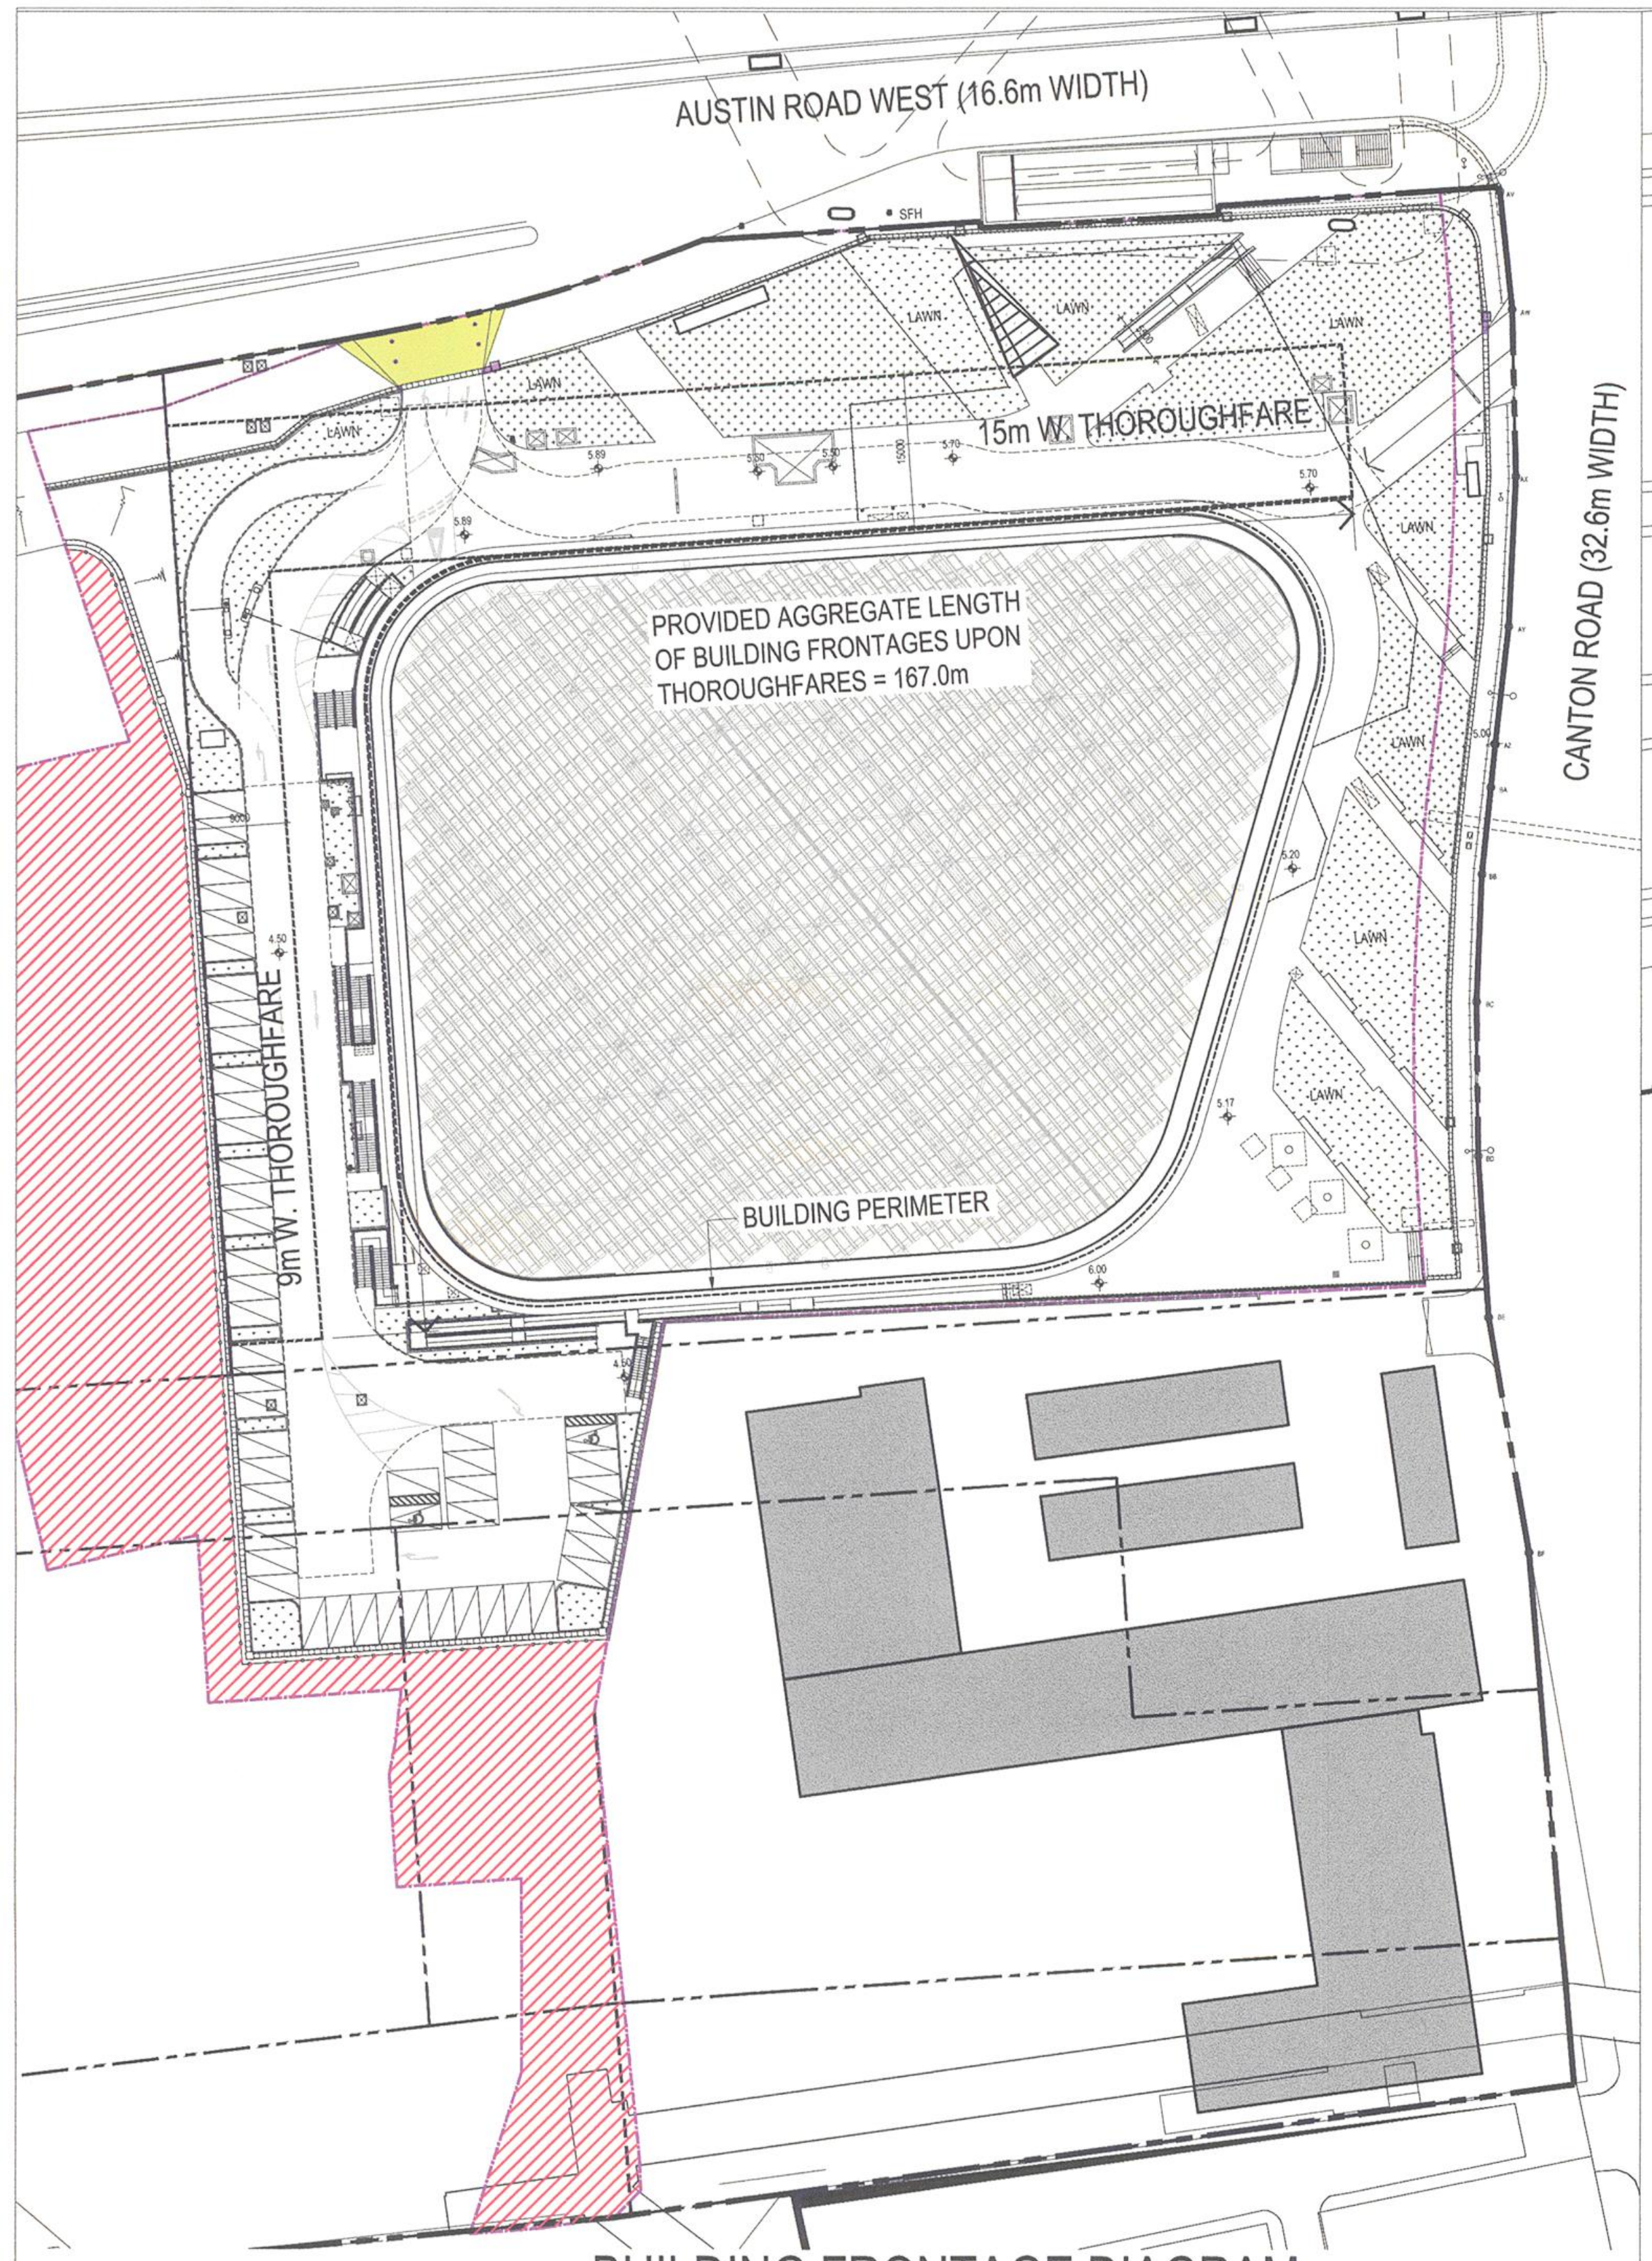
AUSTIN ROAD WEST (16.6m WIDTH)
15m W. THOROUGHFARE
CANTON ROAD (32.6m WIDTH)
PROVIDED AGGREGATE LENGTH OF BUILDING FRONTAGES UPON THOROUGHFARES = 167.0m
9m W. THOROUGHFARE
BUILDING PERIMETER
LAWN
SFH

BUILDING FRONTAGE DIAGRAM

SCALE: 1 : 800

CALCULATION OF BUILDING FRONTAGES UPON THOROUGHFARES IN ACCORDANCE WITH CODE OF PRACTICE FOR FIRE SAFETY IN BUILDING 2011

TOTAL LENGTH OF BUILDING PERIMETER = 297.866m

REQUIRED AGGREGATE LENGTH OF BUILDING FRONTAGES = 297.866m x 0.5 = 148.933m

PROVIDED AGGREGATE LENGTH OF BUILDING FRONTAGES = 167.00 m > 148.933m

CALCULATION FOR AGGREGATE LENGTH OF FACADES SERVED BY EVA

TOTAL LENGTH OF BUILDING PERIMETER = 297.866m

REQUIRED AGGREGATE LENGTH OF FACADES SERVED BY EVA = 297.866m x 0.5 = 148.933m

PROVIDED AGGREGATE LENGTH OF FACADES SERVED BY EVA = 155.781 m > 148.933m

RECEIVED BY

EVA MARKS

(S1) LAYOUT SIGN AT ENTRANCE

(S2) INDICATION SIGN ALONG EVA - IN FORM OF CARRIAGEWAY (NOT MORE THAN 100M)

KEEP CLEAR 不可阻塞

(S3) INDICATION SIGN ALONG EVA - NOT IN FORM OF CARRIAGEWAY (NOT MORE THAN 100M)

(S4) `NO PARKING' SIGN (NOT MORE THAN 50M)

LEGEND

▭	EMERGENCY VEHICULAR ACCESS (TO BE PROVIDED IN HARD PAVING & DESIGNATED FOR FIRE APPLIANCE OF 30 TONNES LOADING WITH 6M WIDTH & 4.5M HEADROOM MIN. GRADIENT < 1:10)
	EMERGENCY VEHICLE
	STREET FIRE HYDRANT BY OTHERS
F.S.A.P.	FIRE SERVICE ACCESS POINT

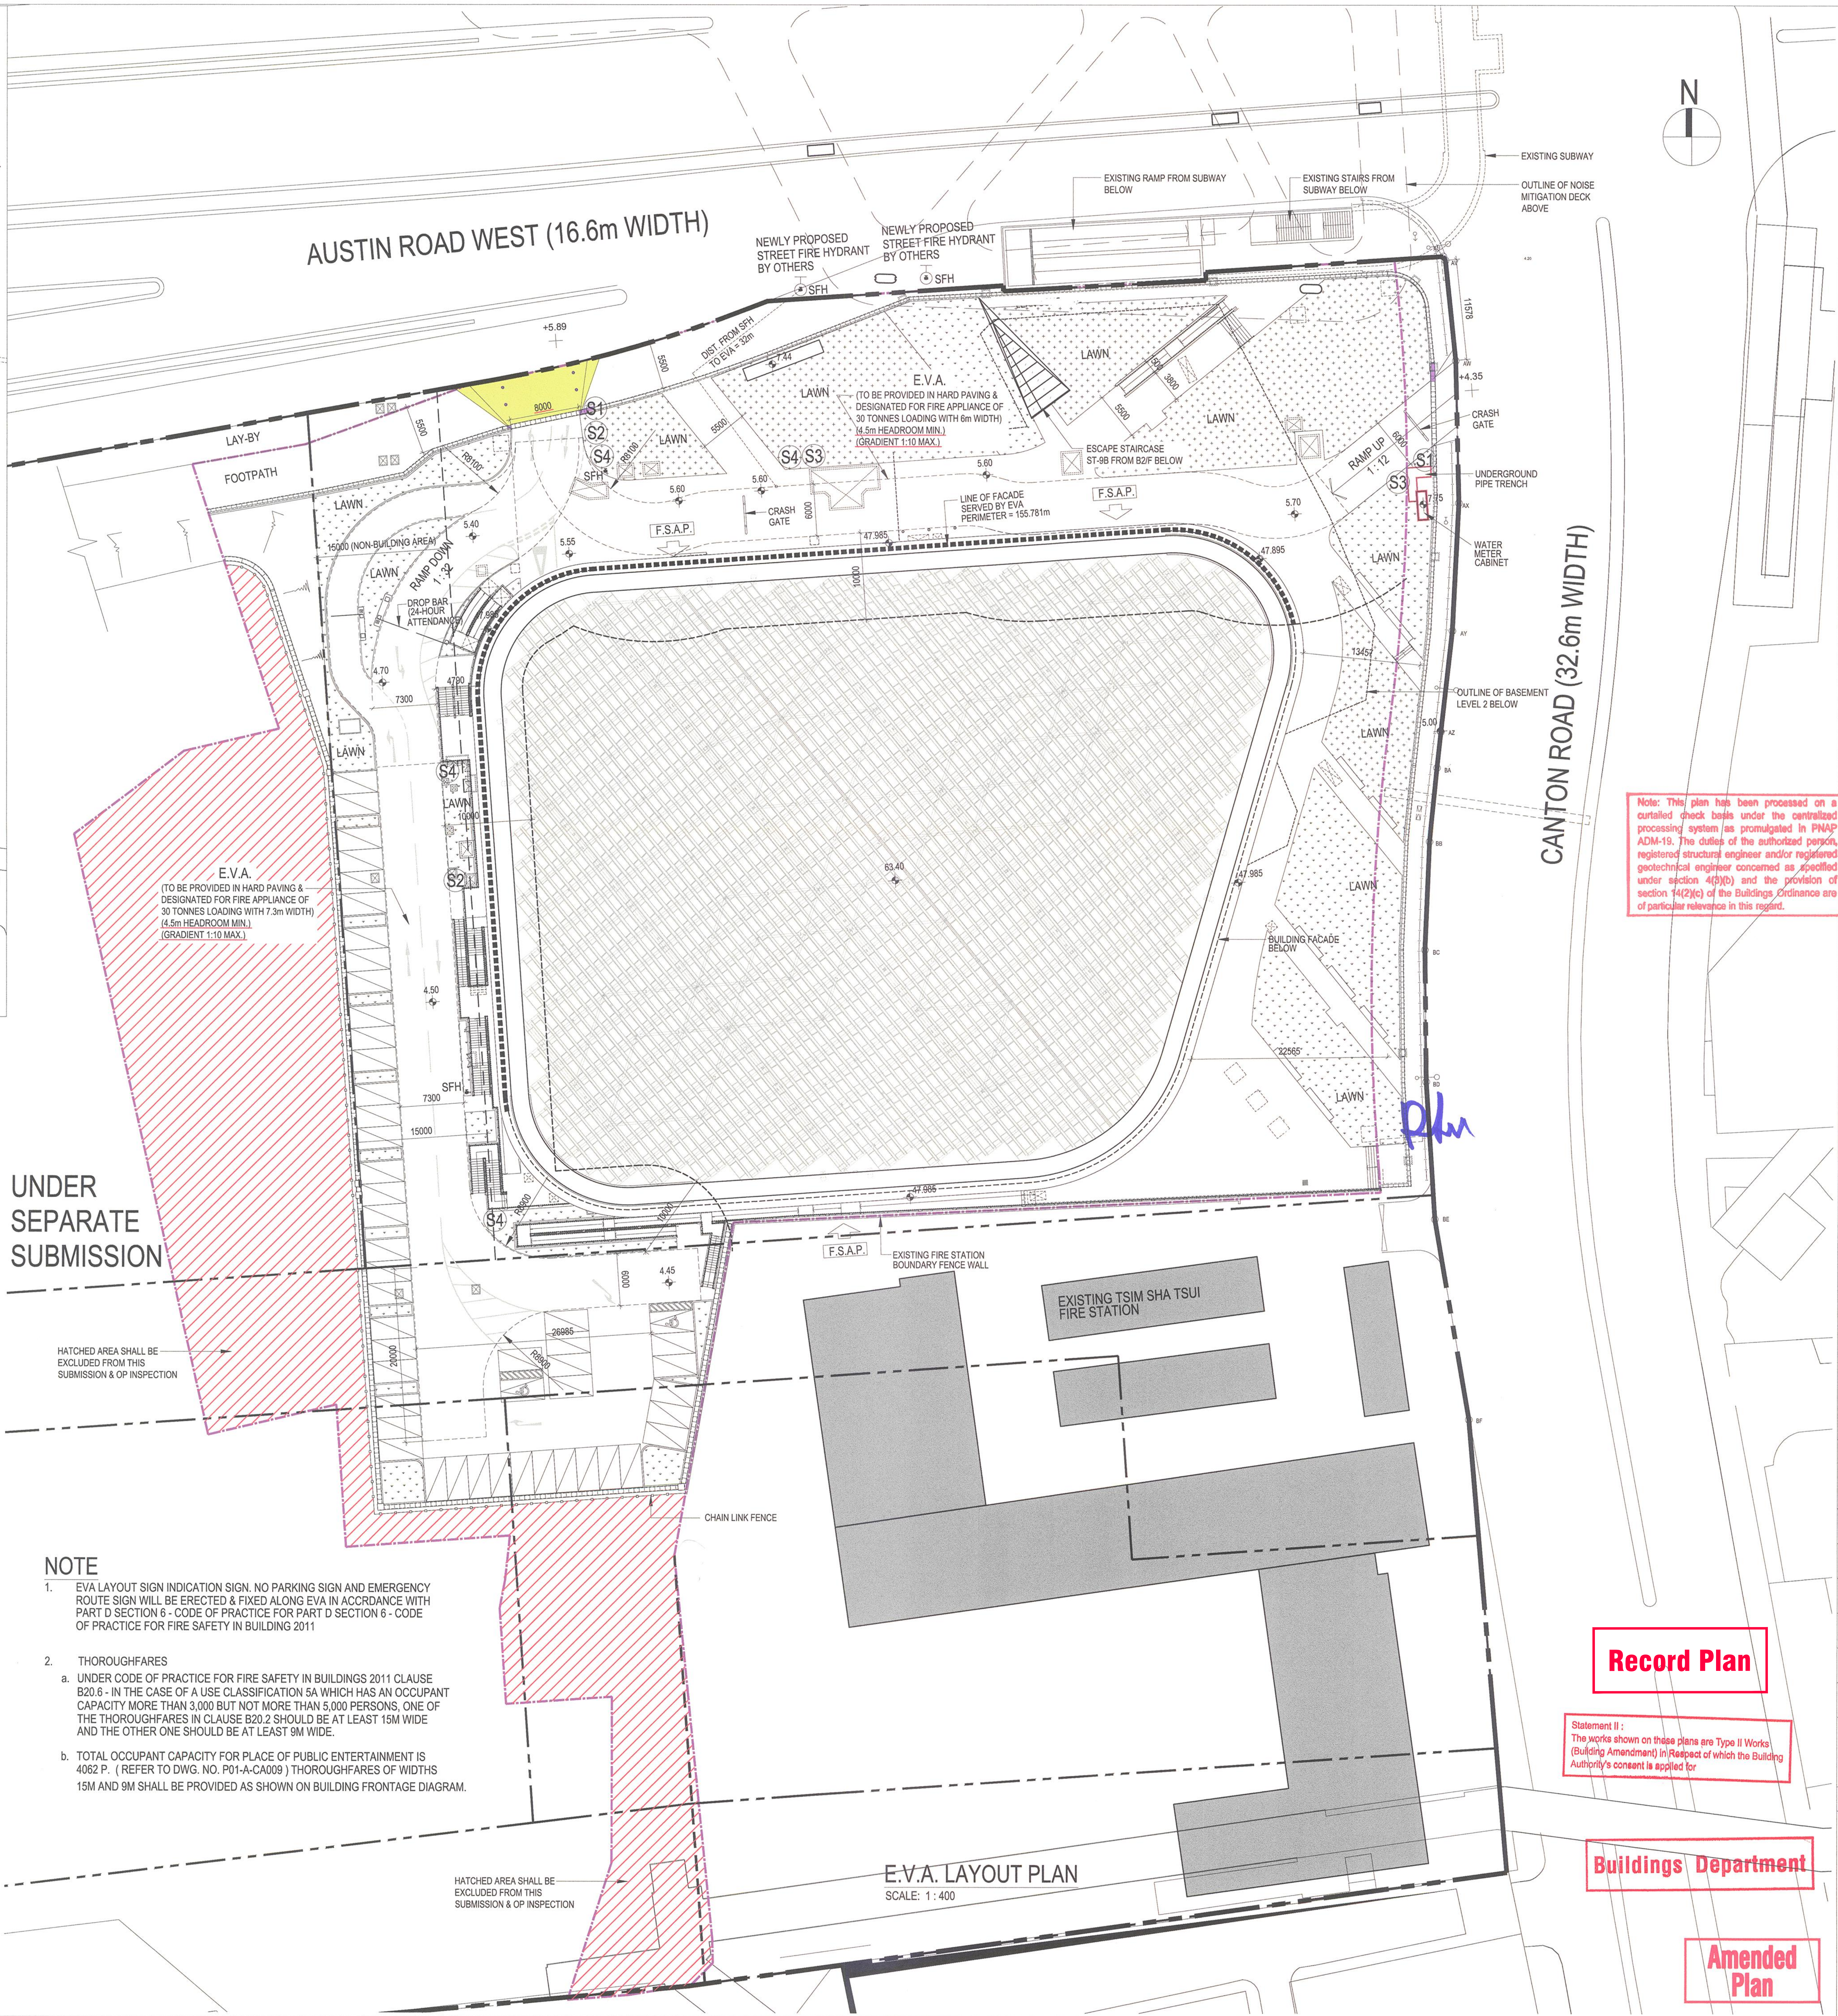
AUSTIN ROAD WEST (16.6m WIDTH)
CANTON ROAD (32.6m WIDTH)
N
NEWLY PROPOSED STREET FIRE HYDRANT BY OTHERS
SFH
NEWLY PROPOSED STREET FIRE HYDRANT BY OTHERS
SFH
EXISTING RAMP FROM SUBWAY BELOW
EXISTING STAIRS FROM SUBWAY BELOW
EXISTING SUBWAY
OUTLINE OF NOISE MITIGATION DECK ABOVE
+5.89
8000
5500
DIST. FROM SFH TO EVA = 32m
7.44
E.V.A.
(TO BE PROVIDED IN HARD PAVING & DESIGNATED FOR FIRE APPLIANCE OF 30 TONNES LOADING WITH 6m WIDTH)
(4.5m HEADROOM MIN.)
(GRADIENT 1:10 MAX.)
LAWN
LAY-BY
FOOTPATH
S1
S2
S4
S3
R8100
5.60
5.40
5.55
5.70
15000 (NON-BUILDING AREA)
RAMP DOWN 1 : 32
DROP BAR (24-HOUR ATTENDANCE)
CRASH GATE
6000
F.S.A.P.
ESCAPE STAIRCASE ST-9B FROM B2/F BELOW
LINE OF FACADE SERVED BY EVA PERIMETER = 155.781m
47.985
47.895
10000
3800
11578
+4.35
CRASH GATE
RAMP UP 1 : 12
UNDERGROUND PIPE TRENCH
7.75
WATER METER CABINET
13457
OUTLINE OF BASEMENT LEVEL 2 BELOW
5.00
4.70
4790
7300
E.V.A.
(TO BE PROVIDED IN HARD PAVING & DESIGNATED FOR FIRE APPLIANCE OF 30 TONNES LOADING WITH 7.3m WIDTH)
(4.5m HEADROOM MIN.)
(GRADIENT 1:10 MAX.)
4.50
SFH
15000
83.40
47.985
BUILDING FACADE BELOW
32565
R8900
4.45
26985
20000
47.985
EXISTING FIRE STATION BOUNDARY FENCE WALL
EXISTING TSIM SHA TSUI FIRE STATION
CHAIN LINK FENCE
HATCHED AREA SHALL BE EXCLUDED FROM THIS SUBMISSION & OP INSPECTION
HATCHED AREA SHALL BE EXCLUDED FROM THIS SUBMISSION & OP INSPECTION

UNDER SEPARATE SUBMISSION

E.V.A. LAYOUT PLAN

SCALE: 1 : 400

NOTE

1. EVA LAYOUT SIGN INDICATION SIGN. NO PARKING SIGN AND EMERGENCY ROUTE SIGN WILL BE ERECTED & FIXED ALONG EVA IN ACCRDANCE WITH PART D SECTION 6 - CODE OF PRACTICE FOR PART D SECTION 6 - CODE OF PRACTICE FOR FIRE SAFETY IN BUILDING 2011

2. THOROUGHFARES
   a. UNDER CODE OF PRACTICE FOR FIRE SAFETY IN BUILDINGS 2011 CLAUSE B20.6 - IN THE CASE OF A USE CLASSIFICATION 5A WHICH HAS AN OCCUPANT CAPACITY MORE THAN 3,000 BUT NOT MORE THAN 5,000 PERSONS, ONE OF THE THOROUGHFARES IN CLAUSE B20.2 SHOULD BE AT LEAST 15M WIDE AND THE OTHER ONE SHOULD BE AT LEAST 9M WIDE.
   b. TOTAL OCCUPANT CAPACITY FOR PLACE OF PUBLIC ENTERTAINMENT IS 4062 P. (REFER TO DWG. NO. P01-A-CA009) THOROUGHFARES OF WIDTHS 15M AND 9M SHALL BE PROVIDED AS SHOWN ON BUILDING FRONTAGE DIAGRAM.

Note: This plan has been processed on a curtailed check basis under the centralized processing system as promulgated in PNAP ADM-19. The duties of the authorized person, registered structural engineer and/or registered geotechnical engineer concerned as specified under section 4(3)(b) and the provision of section 14(2)(c) of the Buildings Ordinance are of particular relevance in this regard.

Record Plan

Statement II :
The works shown on these plans are Type II Works (Building Amendment) in Respect of which the Building Authority's consent is applied for

Buildings Department

Amended Plan

B.D. REF: BD 2/4012/13/1 (P)
F.S.D. REF: FP 8/27927 II

KEY PLAN

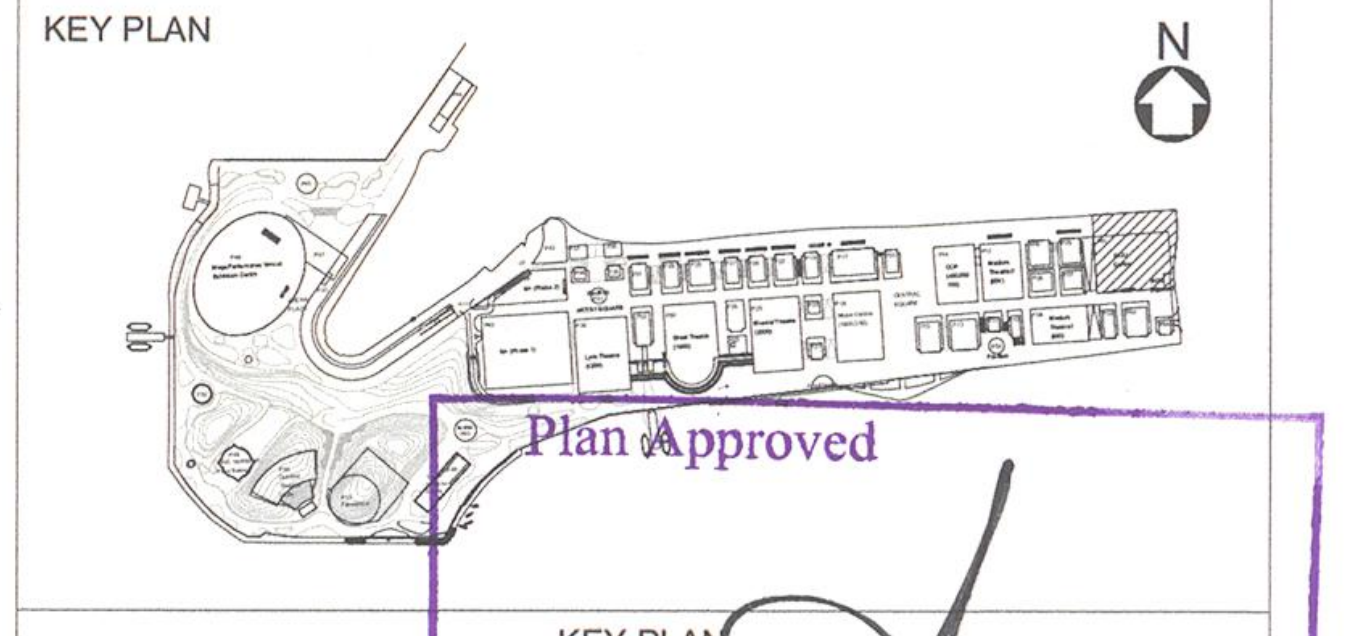

Plan Approved
LI Ming-cham, Gordon
Senior Building Surveyor
for BUILDING AUTHORITY
21 DEC 2017

KEY PLAN

NOTES:

▨	HATCHED AREA SHALL BE EXCLUDED FROM THIS SUBMISSION & OP INSPECTION
▬ ▬ ▬	SITE BOUNDARY OF WKCD UNDER MASTER REGISTER
— - - —	SUBMISSION PACKAGE BOUNDARY
-·-·-	SHORT TERM TENANCY BOUNDARY NO. KX2908 (CURRENT)
— — —	EXISTING FIRE STATION BOUNDARY
— —	NOISE MITIGATION DECK ABOVE

REV.	DATE	DESCRIPTION	INITIAL
q	6 SEP 2017	AMENDMENT SUBMISSION	AKC/AL
p	20 MAR 2017	AMENDMENT SUBMISSION	AKC/AL
n	4 JAN 2017	AMENDMENT SUBMISSION	AKC/AL
m	7 MAR 2016	AMENDMENT SUBMISSION	AKC/AL
k	27 NOV 2015	AMENDMENT SUBMISSION	AKC/AL
j	14 SEP 2015	AMENDMENT SUBMISSION	EUC/AL
h	12 JUN 2015	AMENDMENT SUBMISSION	EUC/AL
g	25 FEB 2015	AMENDMENT SUBMISSION	EUC/AL
f	17 OCT 2014	AMENDMENT SUBMISSION	EUC/AL
e	6 JUN 2014	AMENDMENT SUBMISSION	EUC/AL
d	24 DEC 2013	AMENDMENT SUBMISSION	EUC/AL
c	29 NOV 2013	AMENDMENT SUBMISSION	EUC/AL
b	25 OCT 2013	AMENDMENT SUBMISSION	EUC/AL
a	23 SEP 2013	AMENDMENT SUBMISSION (WITHDRAWN)	EUC/AL
-	29 MAY 2013	FIRST SUBMISSION	EUC/AL

AUTHORIZED PERSON'S SIGNATURE

YAM Chin-Pang
Authorized Person (Architect)

PROJECT TEAM

LEAD CONSULTANT / ARCHITECT	BTA RONALD LU & PARTNERS 33rd Floor Wu Chung House 213 Queen's Road East Wanchai, Hong Kong Tel +852 2891 2212 Fax +852 2834 5442 info@rlphk.com
STRUCTURAL, MEP, FIRE, SUSTAINABILITY & BEAM, LIGHTING, PEOPLE FLOW ENGINEER.	Buro Happold Consulting Engineers Buro Happold International LTD 3507-09 Hopewell Centre 183 Queen's Road East Wanchai, Hong Kong Tel: +852 3658 9608 Fax: +852 3658 9688 Web: www.burohappold.com
CIVIL AND GEOTECHNICAL ENGINEER	ATKINS
TRAFFIC CONSULTANT	MVA SYSTRA GROUP
THEATRE CONSULTANT	FDA Fisher Dachs Associates Theatre Planning & Design
ACOUSTIC CONSULTANT	SOUND SPACE DESIGN
LANDSCAPE CONSULTANT	SWA Sausalito Laguna Beach Houston Dallas San Francisco Los Angeles Shanghai 2200 Bridgeway Boulevard P O Box 5904 Sausalito CA 94966.5904 Fax 415.332.0719 Ph 415.332.5100 www.swagroup.com
SPECIAL LIGHTING CONSULTANT	HLB horton lees brogden lighting design new york | san francisco | los angeles | boston 8580 Washington Blvd, Culver City CA 90232 | 310.837.0929 | www.HLBlighting.com
FACADE CONSULTANT	Front

PROJECT

XIQU CENTRE
JUNCTION OF CANTON ROAD AND AUSTIN ROAD WEST, WEST KOWLOON CULTURAL DISTRICT

DRAWING TITLE

E.V.A. LAYOUT PLAN

SCALE	1 : 400	PRINTED	A1
CHECKED	AHC	DATE	MAY 2013
APPROVED	AL	DATE	MAY 2013
DRAWN	FKC/LKH/VOL	DATE	26 JUL 2013
CONTRACT NO.	-		
ZONING NO.	01		
DRAWING NO.	P01-A-LA002	REV.	q

CAD REF NAME: ....DRAWING\SUB\GBP\CURRENT\PLOT\P01-A-LA002.dwg

CLIENT:

WEST KOWLOON CULTURAL DISTRICT
西九文化區管理局
West Kowloon Cultural District Authority