


12345678

A

A

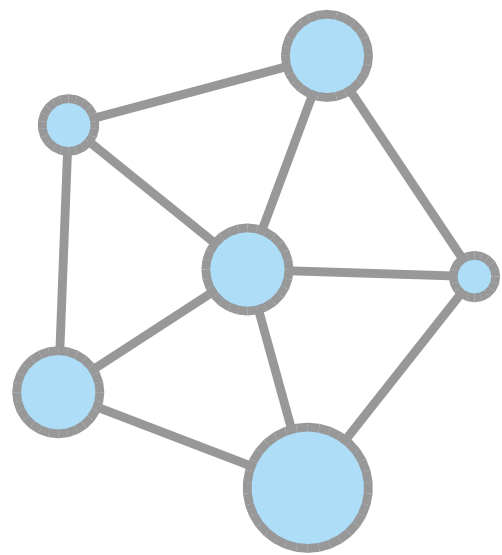

BATFER
Investment S.A.



DIGITO

B

B


C

C

Client: MMA
Project: mSafe3 PP
Description Document: 76425 DIAGRAMA ELÉCTRICO mSafe PP
Document Number: 76425ZPL
Revision: 0
Fecha: 24-09-2025

APROBADO PARA PRODUCCIÓN

APROBADO: –
FECHA: –



BATFER
Investment S.A.

D

D

Installation
Place

E


E

F

F

–	–	–	–	–	–
–	–	–	–	–	–
–	–	–	–	–	–
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222–1
CLIENT: MMA



BATFER
Investment S.A.



DIGITO


DOC NUMBER: 76425 ZPL
TITLE: DIAGRAMA ELÉCTRICO mSafe PP
CARÁTULA
–

GRAL REV: 0
PAG: 00
REV: 0
CONT: 01

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

1		2					3			4		5					6			7			8																								
Pag.	Page Title	Revision							Additional Comments	Pag.	Page Title	Revision							Additional Comments	Pag.	Page Title	Revision							Additional Comments																		
		0	1	2	3	4	5	6				7	0	1	2	3	4	5				6	7	0	1	2	3	4		5	6	7															
A	00	CÁRATULA	X								45	FREE																																			
	01	ÍNDICE	X								46	ENTRADAS DIGITALES EXTERNAS	X																																		
	02	TOPOGRÁFICO EXTERIOR	X								47	FREE																																			
	03	TOPOGRÁFICO INTERIOR	X								48	FREE																																			
B	04	TOPOGRÁFICO INTERIOR DETALLES	X								49	FREE																																			
	05	FREE									50	FREE																																			
	06	FREE									51	FREE																																			
	07	FREE									52	FREE																																			
	08	FREE									53	FREE																																			
	09	LISTA DE MATERIALES	X								54	FREE																																			
	10	REFERENCIA DE SIMBOLOS	X								55	FREE																																			
	11	ALIMENTACIÓN Y DISTRIBUCIÓN 220VAC	X								56	FREE																																			
C	12	ALIMENTACIÓN DE CIRCUITO DE POTENCIA DC	X								57	FREE																																			
	13	DISTRIBUCIÓN DE VOLTAJE DE CONTROL	X								58	FREE																																			
	14	ALIMENTACIÓN PLACA ELECTRÓNICA E2.5	X								59	FREE																																			
	15	ALIMENTACIÓN DE BARRERAS Y MÓDULOS	X								60	FREE																																			
	16	FREE									61	FREE																																			
	17	FREE									62	SALIDAS DIGITALES INTERNAS	X																																		
	18	FREE									63	FREE																																			
	19	FREE									64	FREE																																			
	20	FREE									65	FREE																																			
	21	PLACA ELECTRÓNICA E2.5 – DISTRIBUCIÓN DE CONEXIONES	X								66	FREE																																			
	22	FREE									67	FREE																																			
	23	FREE									68	FREE																																			
D	24	FREE									69	FREE																																			
	25	FREE									70	FREE																																			
	26	FREE									71	FREE																																			
	27	FREE									72	FREE																																			
	28	FREE									73	FREE																																			
	29	FREE									74	FREE																																			
	30	FREE									75	FREE																																			
	31	ENTRADA ANALÓGICA INTERNA	X								76	FREE																																			
	32	ENTRADAS ANALÓGICAS EXTERNAS	X								77	FREE																																			
	33	ENTRADA ANALÓGICA EXTERNA DE MÓDULO EXEMYS	X								78	FREE																																			
	34	FREE									79	FREE																																			
	35	FREE									80	FREE																																			
E	36	FREE									81	COMUNICACIÓN	X																																		
	37	FREE									82	FREE																																			
	38	FREE									83	FREE																																			
	39	FREE									84	FREE																																			
	40	FREE									85	FREE																																			
	41	ENTRADA DIGITAL INTERNA	X								86	FREE																																			
	42	FREE									87	FREE																																			
	43	ENTRADAS DIGITALES EXTERNAS	X								88	FREE																																			
44	FREE									89	FREE																																				
F	–	–	–	–	–	–	–	–	–	PROJECT: C.J. CONTROLADOR mSafe PP										DOC NUMBER: 76425 ZPL										GRAL REV: 0																	
	–	–	–	–	–	–	–	–	–	CODE: 76222–1										TITLE: DIAGRAMA ELÉCTRICO mSafe PP										PAG: 01					REV: 0												
	–	–	–	–	–	–	–	–	–	CLIENT: MMA										Índice.										–					CONT: 02												
	0	For Manufacturing		24/09/25	LM	MD	MPV																																								
	REV	DESCRIPTION		DATE	PROJ.	DW.	APR.																																								


NOTE: cables not indicated will be black 0.75mm²/18 AWG

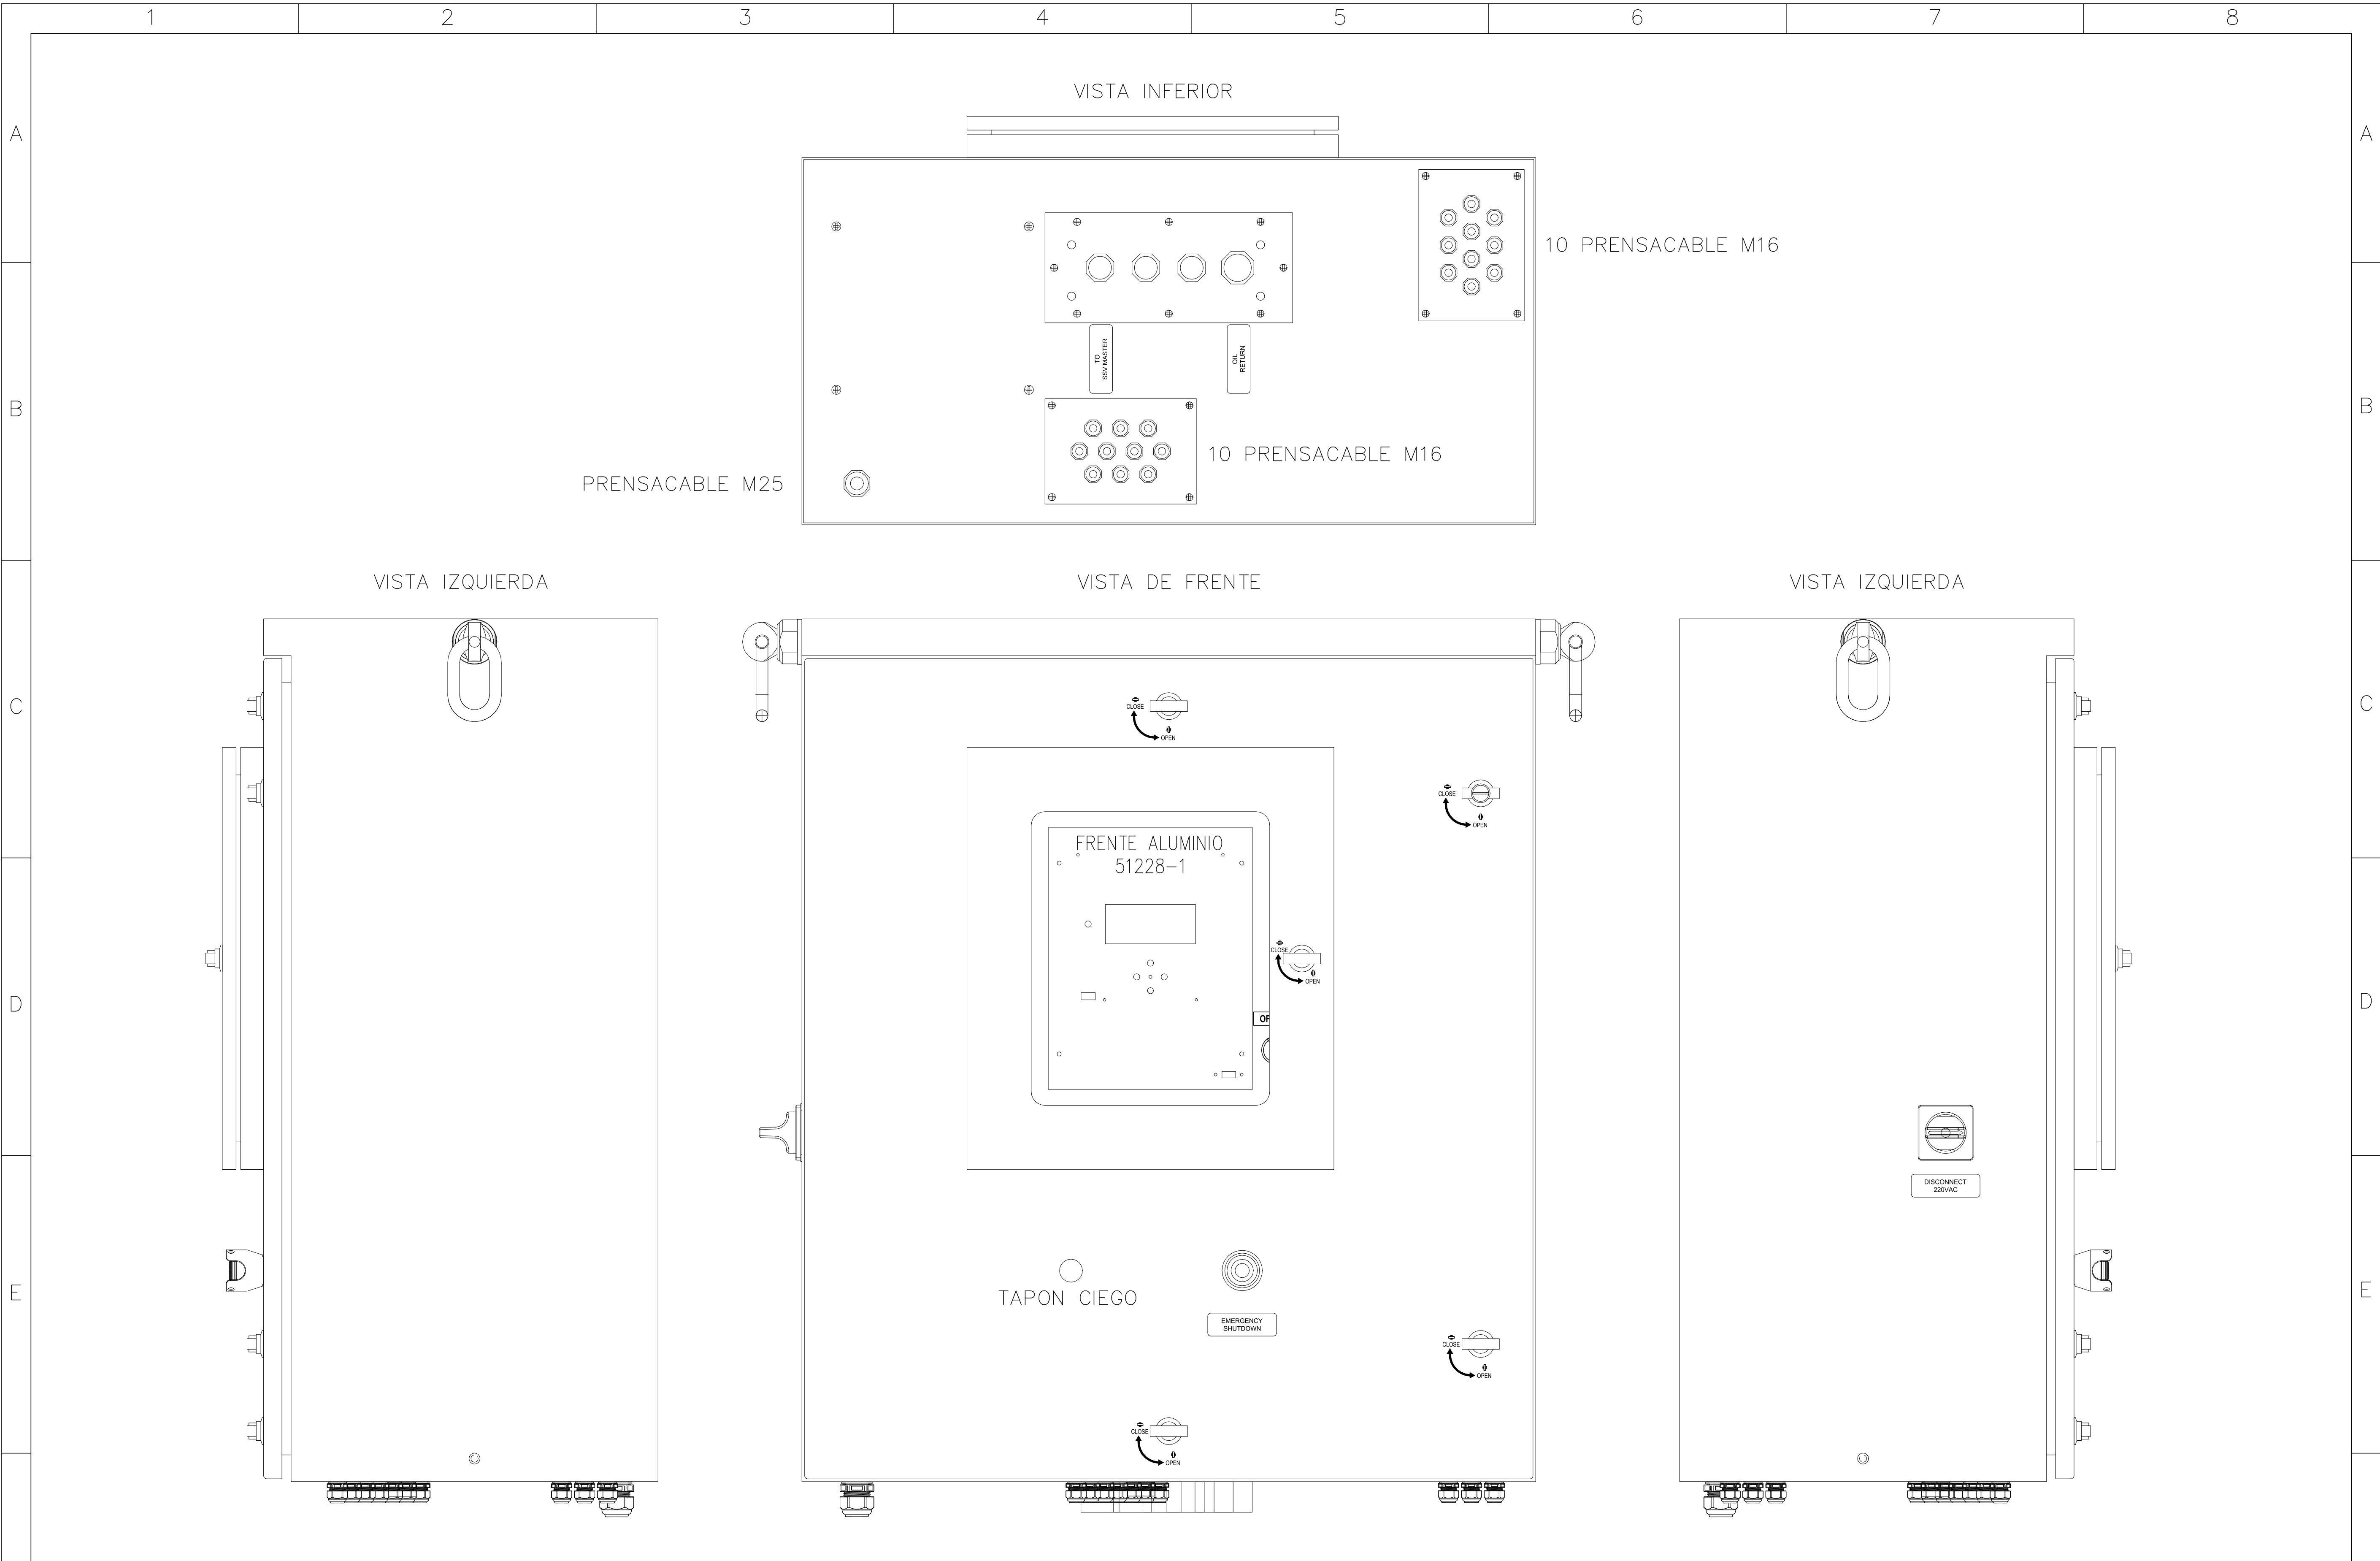

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT:
MMA




BATFER
Investment S.A.



DIGITO


DOC NUMBER:	76425 ZPL	GRAL REV:	0
TITLE:	DIAGRAMA ELÉCTRICO mSafe PP TOPOGRÁFICO EXTERIOR	PAG:	02
		REV:	0
		CONT:	03

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

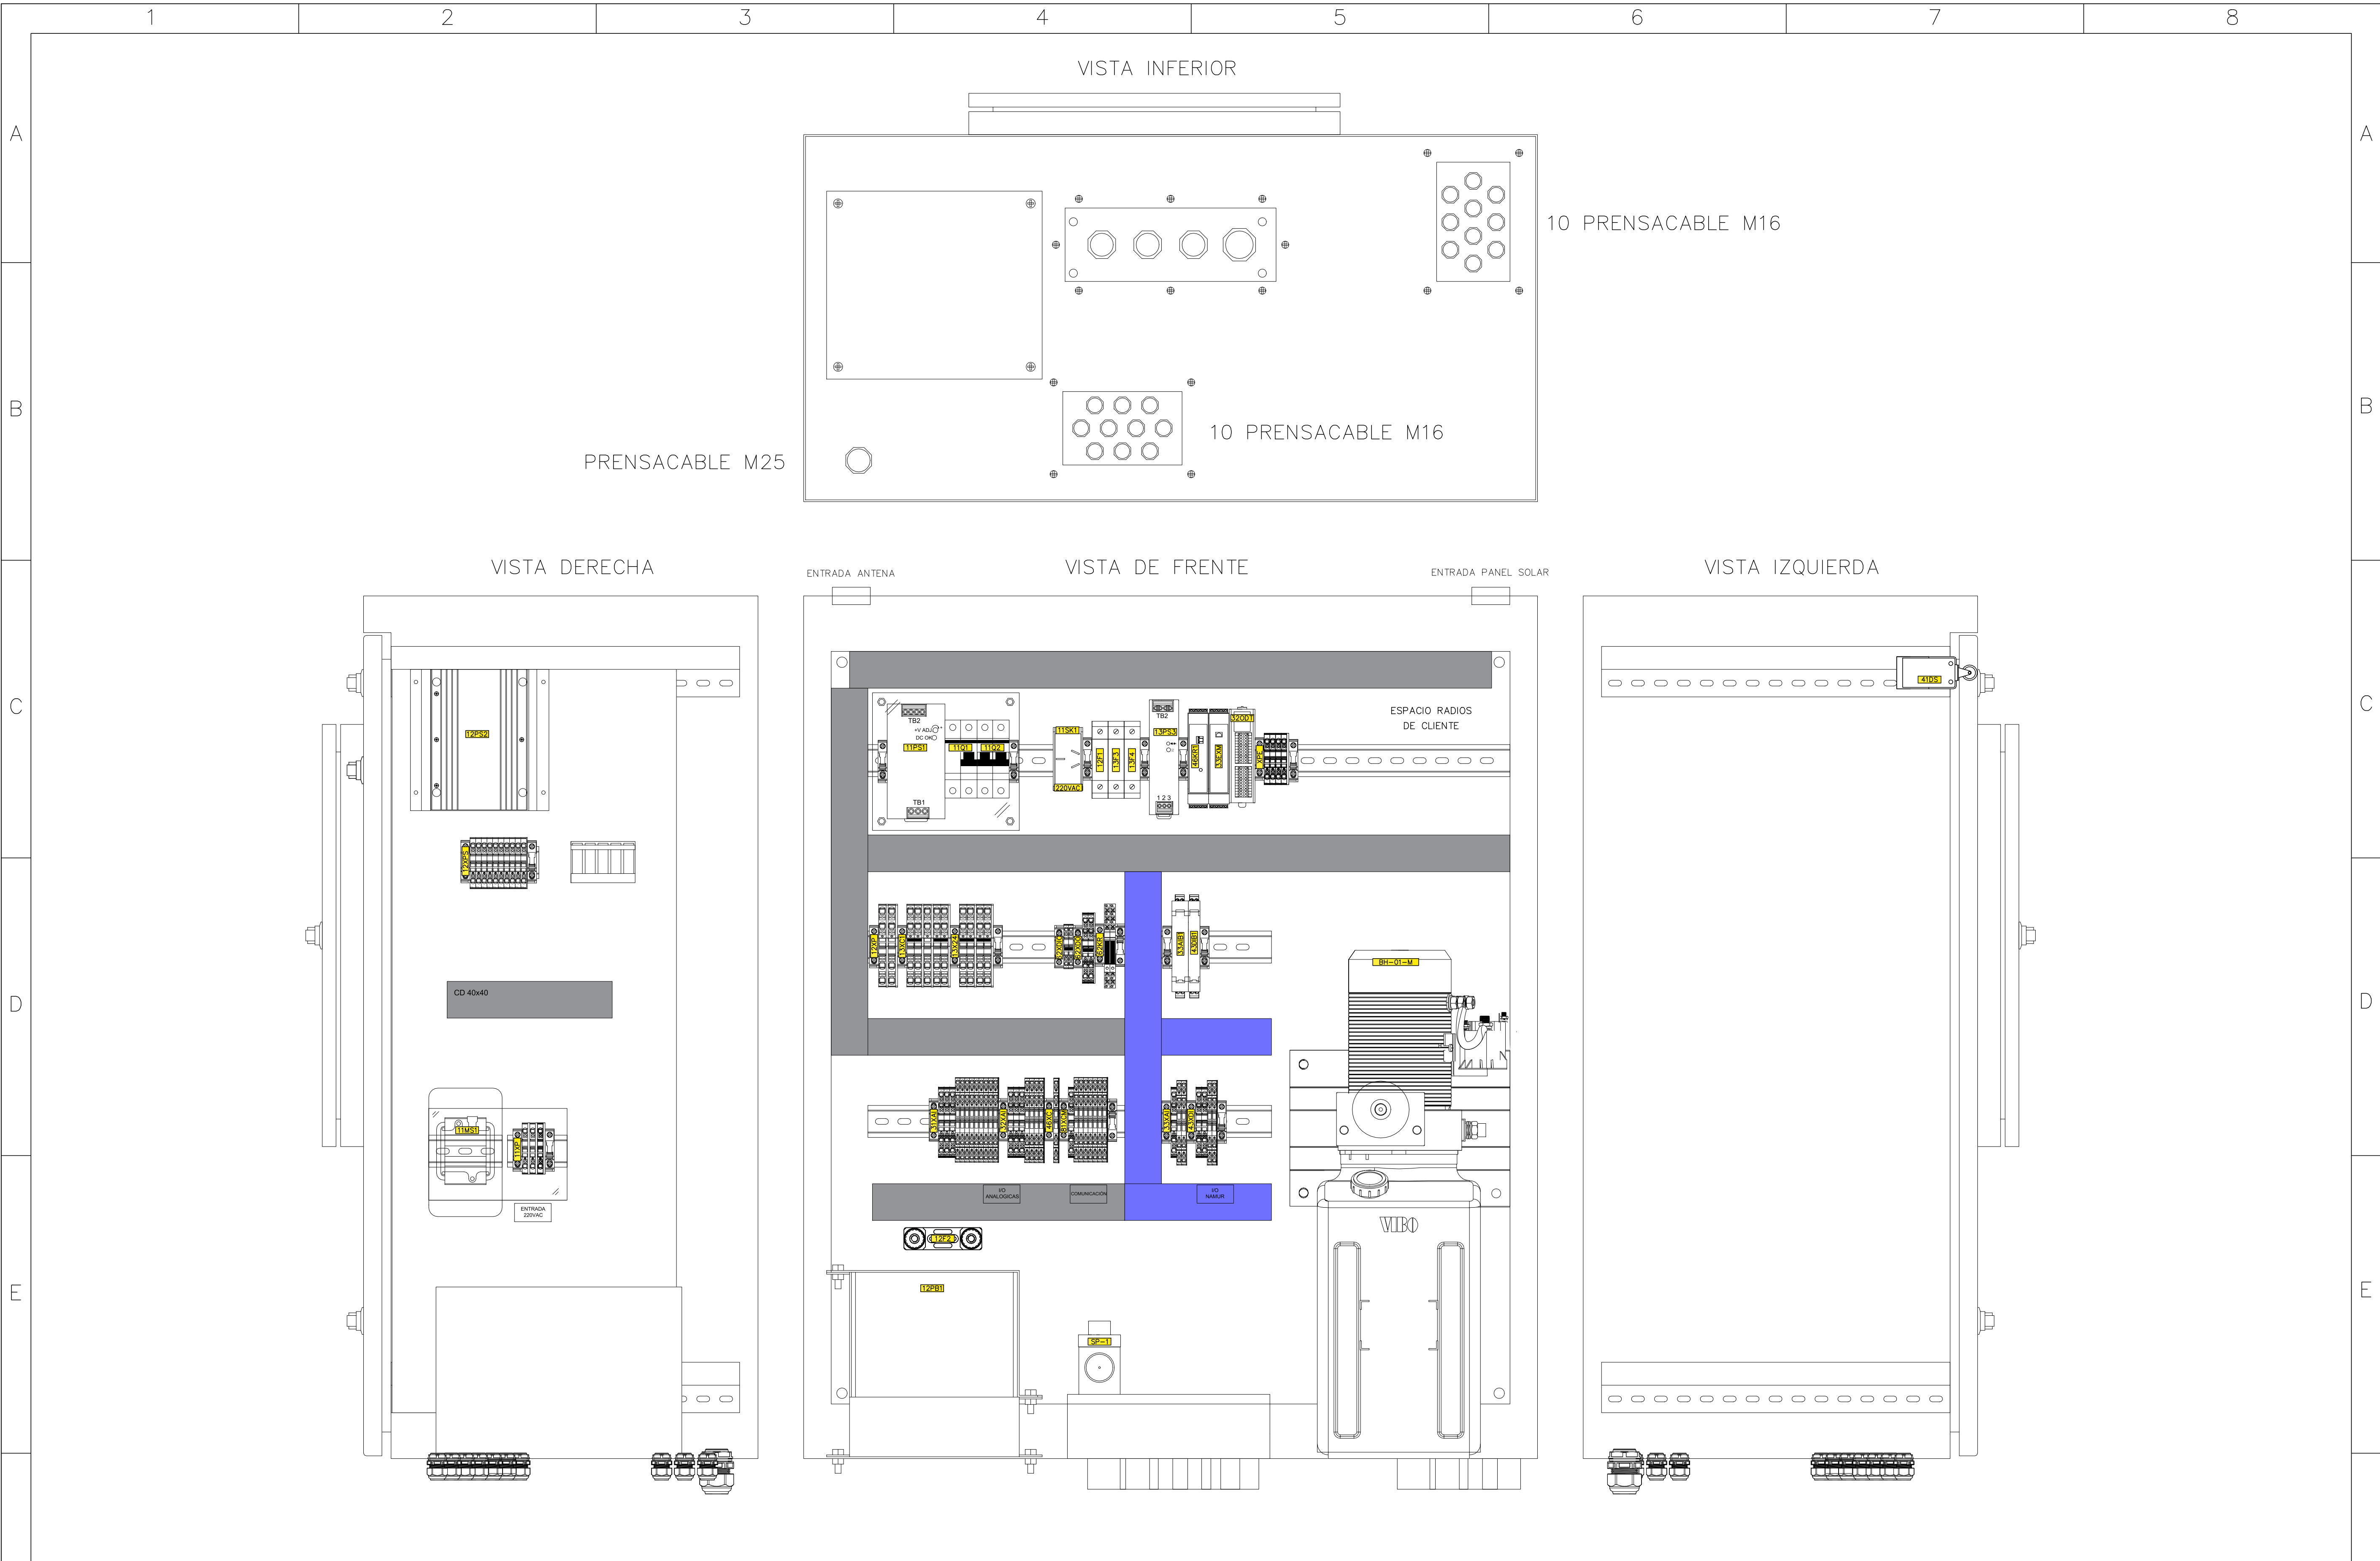

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT: MMA




BATFER
Investment S.A.





DIGITO

DOC NUMBER:	76425 ZPL	GRAL REV:	0
TITLE:	DIAGRAMA ELÉCTRICO mSafe PP TOPOGRÁFICO INTERIOR	PAG:	03
		REV:	0
		CONT:	04

NOTE: cables not indicated will be black 0.75mm²/18 AWG

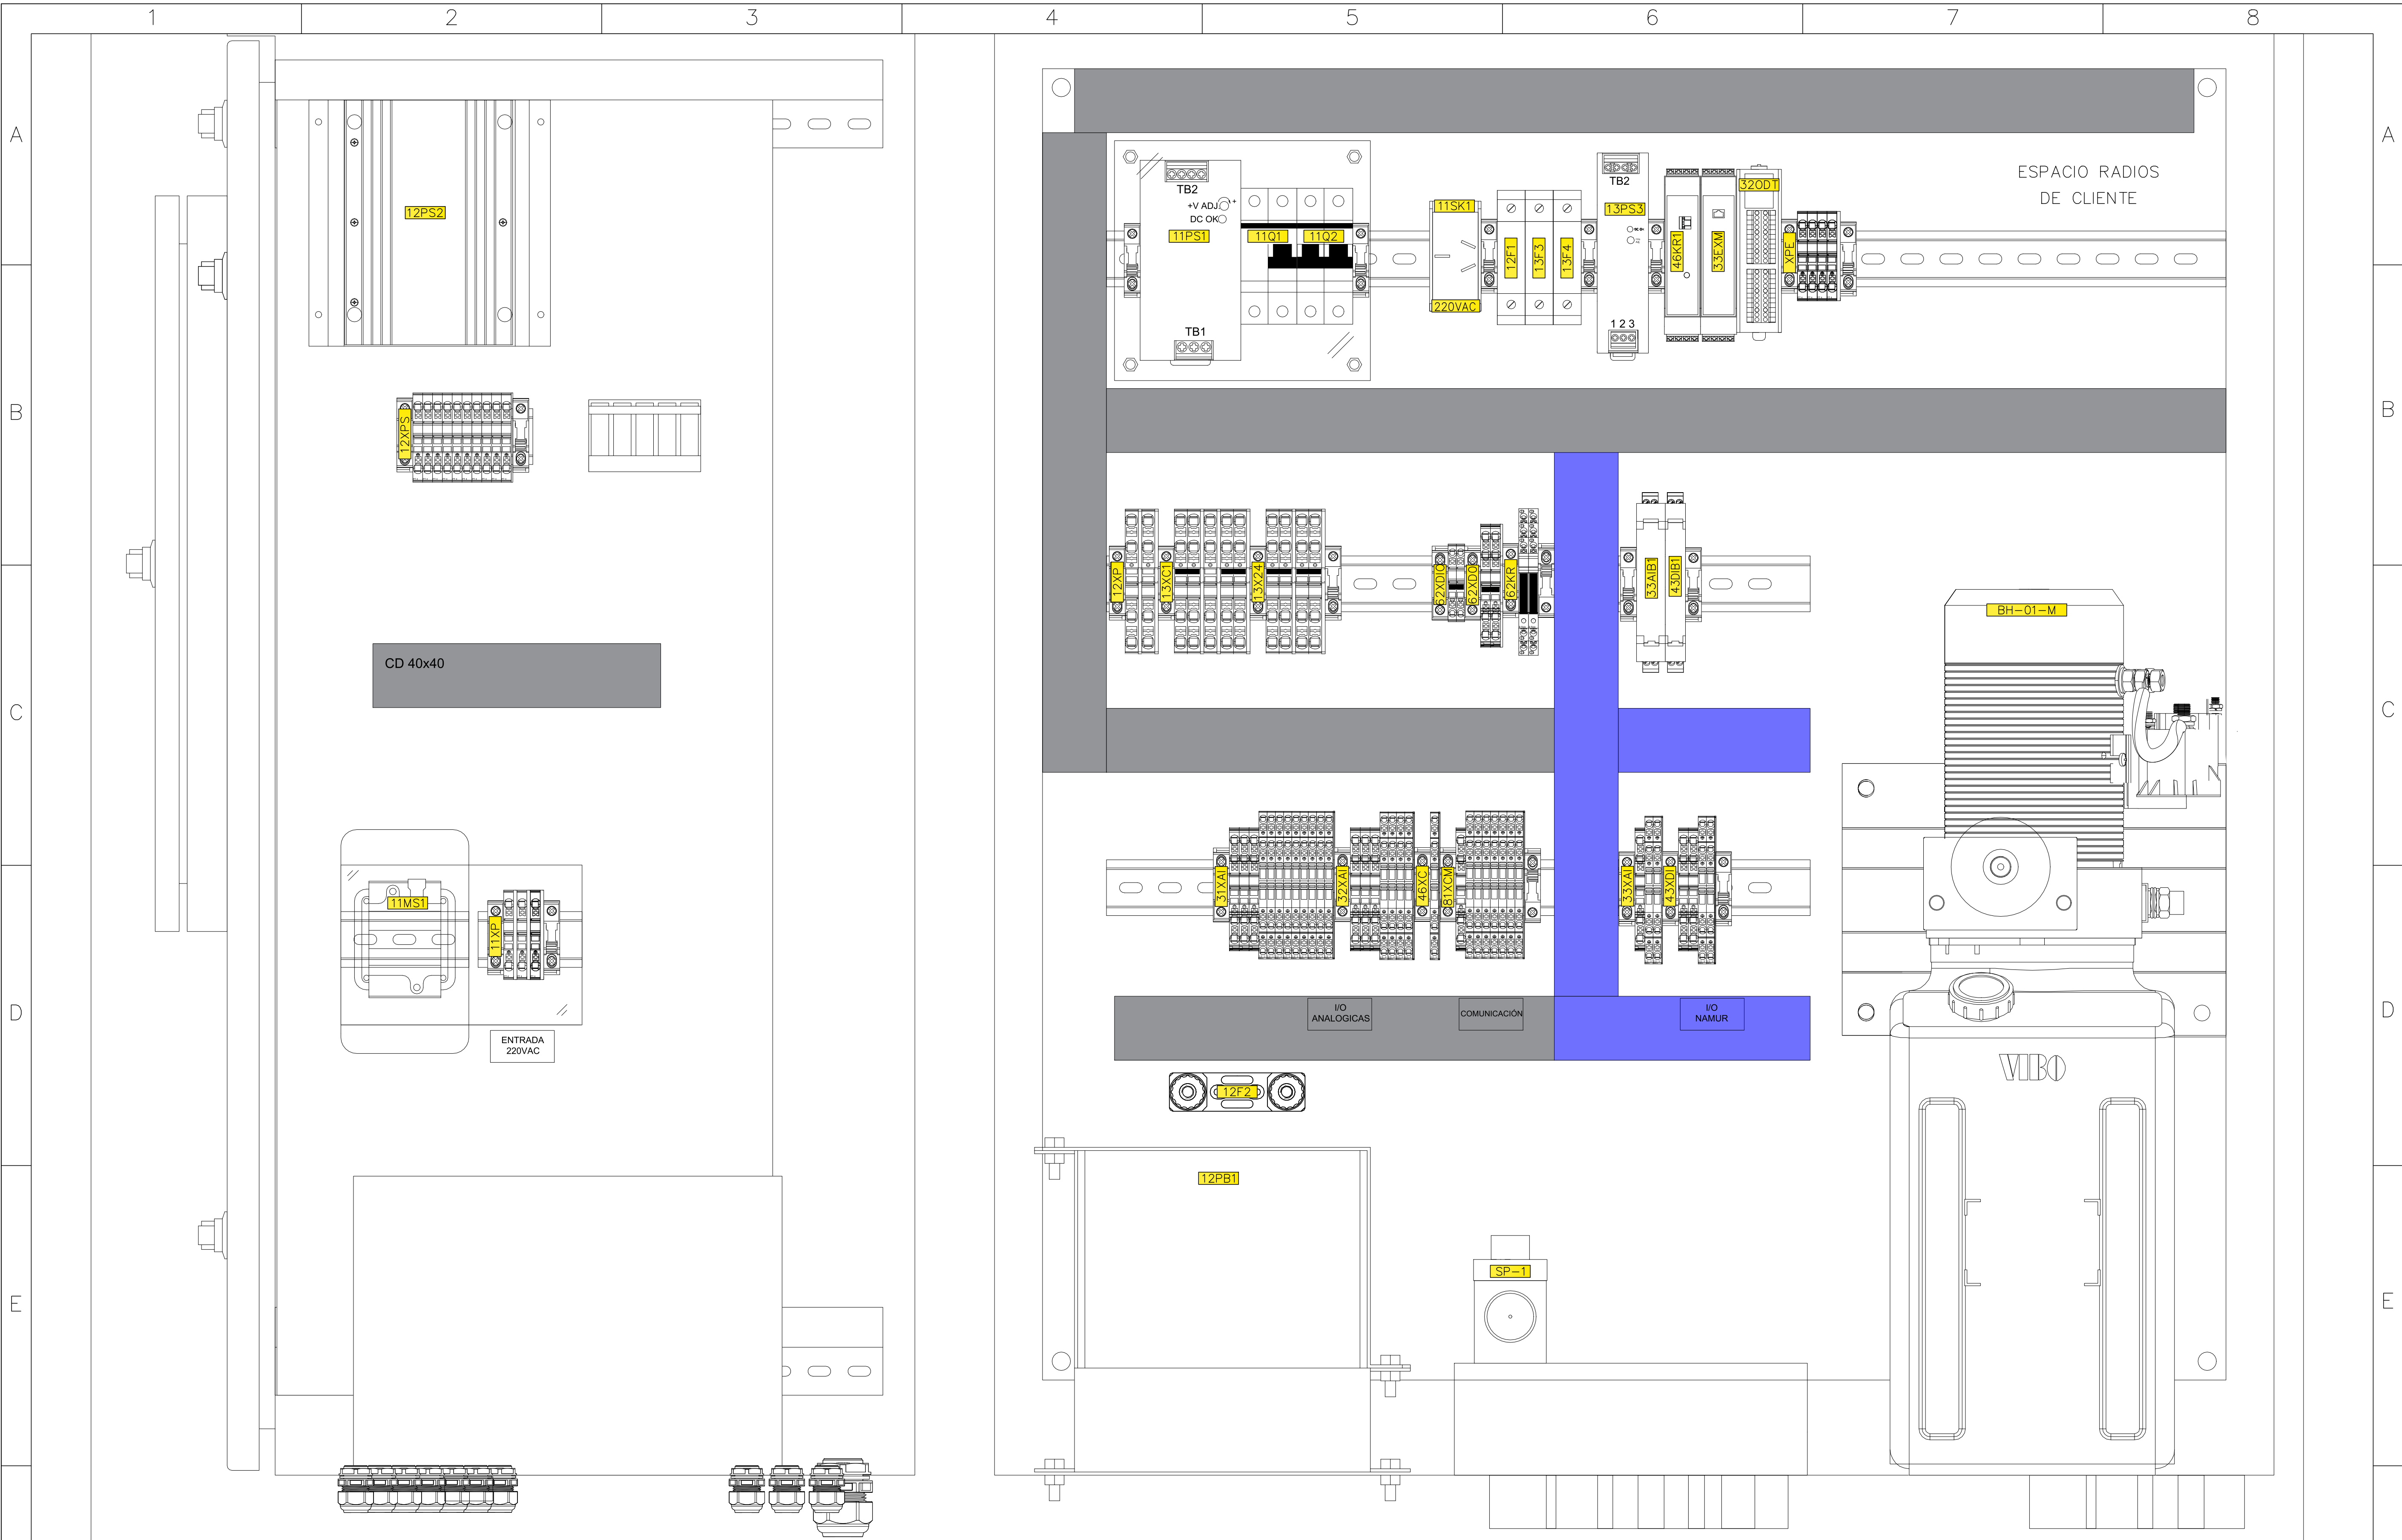

















—	—	—	—	—	—	PROJECT: CJ. CONTROLADOR mSafe PP	 	DOC NUMBER: 76425 ZPL	GRAL REV: 0		F
—	—	—	—	—	—	CODE: 76222-1		TITLE: DIAGRAMA ELÉCTRICO mSafe PP	PAG: 04	REV: 0	
—	—	—	—	—	—	CLIENT: MMA		TOPOGRÁFICO INTERIOR			
0	For Manufacturing	24/09/25	LM	MD	MPV			DETALLES			
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.				CONT: 09		

WATER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.


1		2		3		4		5		6		7		8																																																												
A	TAG	DESCRIPTION					BRAND			MODEL / CODE					A																																																											
	11XP	Bornes de alimentación					PHOENIX CONTACT			PT 6																																																																
	11MS1	Interruptor Seccionador					SCHNEIDER			VBF1																																																																
	11PS1	Fuente de alimentación 110–240 Vac a 24 VDC					MEAN WELL			NDR–120–24																																																																
	11Q1	Disyuntor diferencial 25A – 30mA					SCHNEIDER			EZ9R36225																																																																
	11Q2	Interruptor termomagnético 2x10A curva C					SCHNEIDER			EZ9F34210																																																																
	11SK1	Toma corriente IRAM					VIVION			–																																																																
B	BH–01–ZV	Contactor de bomba de 12 VDC					TROMBETTA			684–1261–212–17					B																																																											
	12XPS	Bornes de cargador de Batería					PHOENIX CONTACT			PT 6																																																																
	12PS2	Cargador de Baterías					EPEVER			MPPT TRACER5210BP																																																																
	12XP	Bornes de distribución de voltaje de 12VDC					PHOENIX CONTACT			PT 6 QUATTRO																																																																
	12F1	Base de fusible para alimentación de batería					SCHNEIDER			DF101 10x38																																																																
	–	Fusible cerámico cilíndrico 20A 10x38mm gL					–			–																																																																
	12F2	Base para fusible tipo MEGA					MEGA			–																																																																
	–	Fusible tipo MEGA 150A					–			–																																																																
	13XC1	Distribución de voltaje de control 12VDC					PHOENIX CONTACT			PT 6 QUATTRO																																																																
	13PS2	Conversor 12/24VDC					MEAN WELL			DDR–120A–24																																																																
	13F3	Base de fusible para alimentacion 12VDC					SCHNEIDER			DF101 10x38																																																																
	–	Fusible cerámico cilíndrico 10A 10x38mm gL					–			–																																																																
	13F4	Base de fusible para alimentacion 12VDC					SCHNEIDER			DF101 10x38																																																																
	–	Fusible cerámico cilíndrico 10A 10x38mm gL					–			–																																																																
C	13X24	Distribución de voltaje de control 24VDC					PHOENIX CONTACT			PT 6 QUATTRO					C																																																											
	21PCB01	Placa Electrónica de Control Principal					MMA			L03–60591–01																																																																
	31XAI	Bornes de entradas analógicas internas					PHOENIX CONTACT			PTT 2,5–2MT																																																																
	PT–001	Transmisor de presión de la bomba hidráulica					NOSHOK			PT20–250bar–1–1–10–8																																																																
	32XAI	Bornes de entradas analógicas externas					PHOENIX CONTACT			PTT 2,5–2 MT																																																																
	32ODT	Módulo 4–20 mA a MODBUS RTU					ODOT			B32–MR–3B–00																																																																
	33XAI	Bornes de entradas analógicas externas					PHOENIX CONTACT			PTT 2,5–2 MT BU																																																																
	33EXM	Módulo conversor HART a MODBUS					EXEMYS			EGW1–MB–HT																																																																
	33AIB1	Entrada Analógica – Barrera Seg. Intrínseca					CHENZHU			GS8536–EX																																																																
	41DS	Interruptor limite de puerta					OMRON			HL–5200																																																																
	43XDI	Bornes de entradas digitales					PHOENIX CONTACT			PTT 2,5–2 MT BU																																																																
	43DIB1...3	Entrada Digital – Barrera Seg. Intrínseca					CHENZHU			GS8512–EX.22																																																																
	46KR	Relé de seguridad SIL 3 24VDC					PHOENIX CONTACT			PSR–SCP– 24UC/ESA2/4X1/1X2/B																																																																
	46DB1	Botón de paro de emergencia.					SCHNEIDER			ZBE–101																																																																
D	46XC	Bornes de comando externo 24 VDC					PHOENIX CONTACT			PTT 2,5–2 MT					D																																																											
	62KR	Borne relé 12VDC					PHOENIX CONTACT			RIF–0–RPT–12DC/21																																																																
	62XDO	Bornes de comandos					PHOENIX CONTACT			PTT 2,5																																																																
	62XDIO	Bornes diodo antiparalelo de supresion					PHOENIX CONTACT			PT 2,5–DIO/L–R																																																																
	SP–1...3	Válvula solenoide					–			–																																																																
	81XCM	Borne de comunicación					PHOENIX CONTACT			PTT 2,5–2MT																																																																
	BORNES DE TIERRA	Borne doble de tierra					PHOENIX CONTACT			PT 2,5–QUATTRO–PE																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
E	–	–					–			–					E																																																											
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
	–	–					–			–																																																																
F	–	–					–			–					F																																																											
	–	–					–			–																																																																
	–	–					–			–																																																																
	0	For Manufacturing					24/09/25			LM			MD			MPV																																																										
	REV	DESCRIPTION					DATE			PROJ.			DW.			APR.																																																										
PROJECT: C.J. CONTROLADOR mSafe PP															DOC NUMBER: 76425 ZPL															GRAL REV: 0																																												
CODE: 76222–1															 															TITLE: DIAGRAMA ELÉCTRICO mSafe PP															PAG: 09															REV: 0														
CLIENT: MMA																														Lista de materiales.															0															0														
																																													CONT: 10																													

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

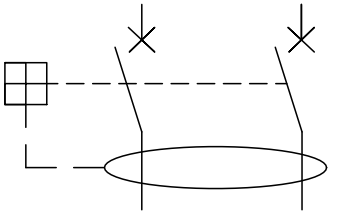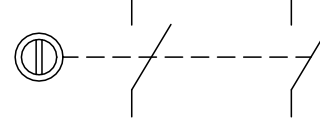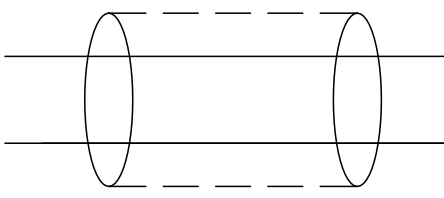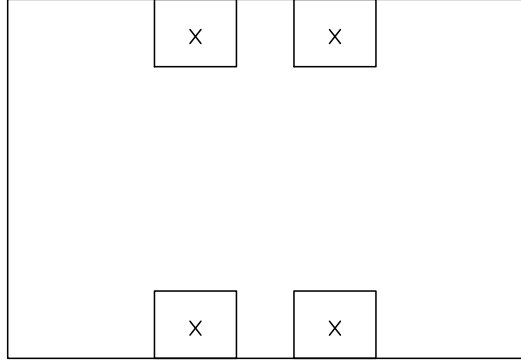1	2	3	4	5	6	7	8
A	Símbolo	Descripción	Símbolo	Descripción	Símbolo	Descripción	
B		Diferencial / Disyuntor		Borne Doble		Tag de cable	
				Borne simple			
		Termomagnética		Borne Seccionable			
				Borne con diodo			
C		Seccionador Rotativo		Electroválvula		Resistencia	
		Tomacorriente		Switch			
		Fusible seccionable		Instrumento		Tierra	
D		Fusible fijo		Referencias			
		Selector		Cable mallado			
		Parada de Emergencia (Golpe de puño tipo Hongo)					
E		Bobina de Motor		Componente Simbolo general			
		Motor Bomba Hidráulica					


—	—	—	—	—	—	PROJECT: C.J. CONTROLADOR mSafe PP	 	DOC NUMBER: 76425 ZPL		GRAL REV: 0	
—	—	—	—	—	—	CODE: 76222–1		TITLE: DIAGRAMA ELÉCTRICO mSafe PP		PAG:	REV:
—	—	—	—	—	—	CLIENT: MMA		Simbología		10	0
0	For Manufacturing	24/09/25	LM	MD	MPV			—		CONT: 11	
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.						

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

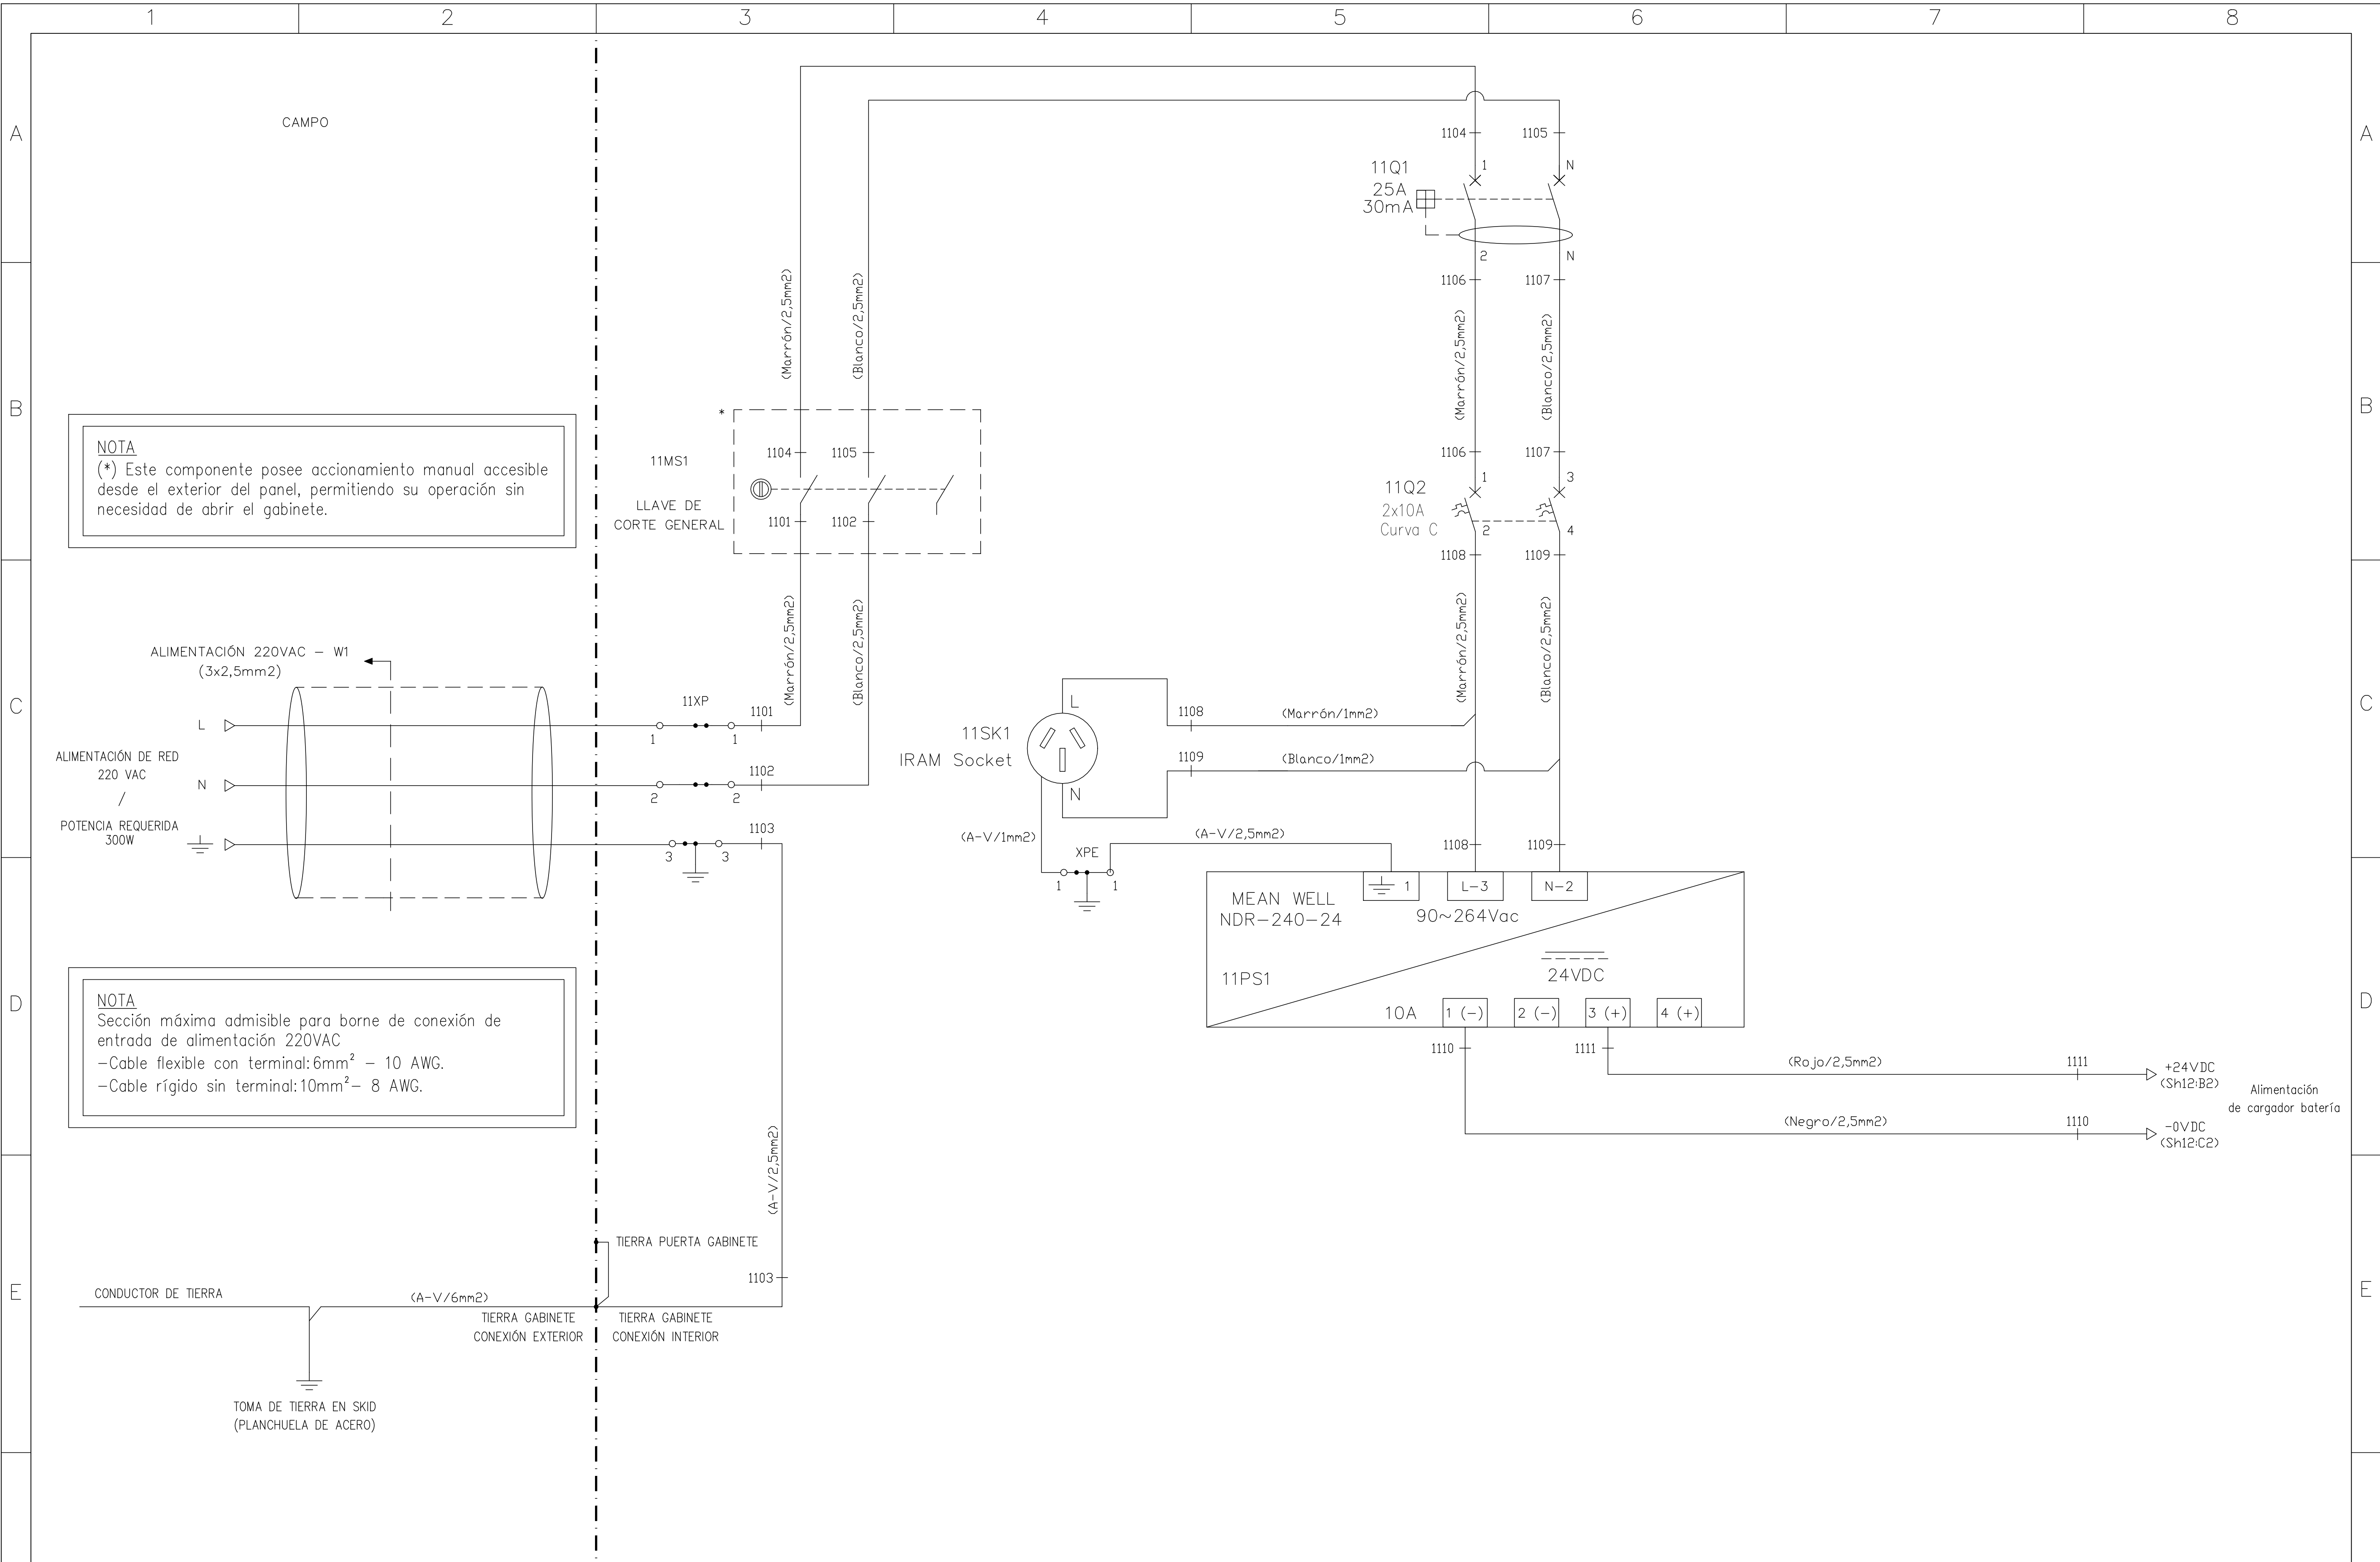

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT: MMA



BATFER
Investment S.A.




DIGITO

DOC NUMBER: 76425 ZPL	GRAL REV: 0
TITLE: DIAGRAMA ELÉCTRICO mSafe PP Alimentación y distribución 220 VAC.	PAG: 11 REV: 0
---	CONT: 12


BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

NOTE: cables not indicated will be black 0.75mm²/18 AWG

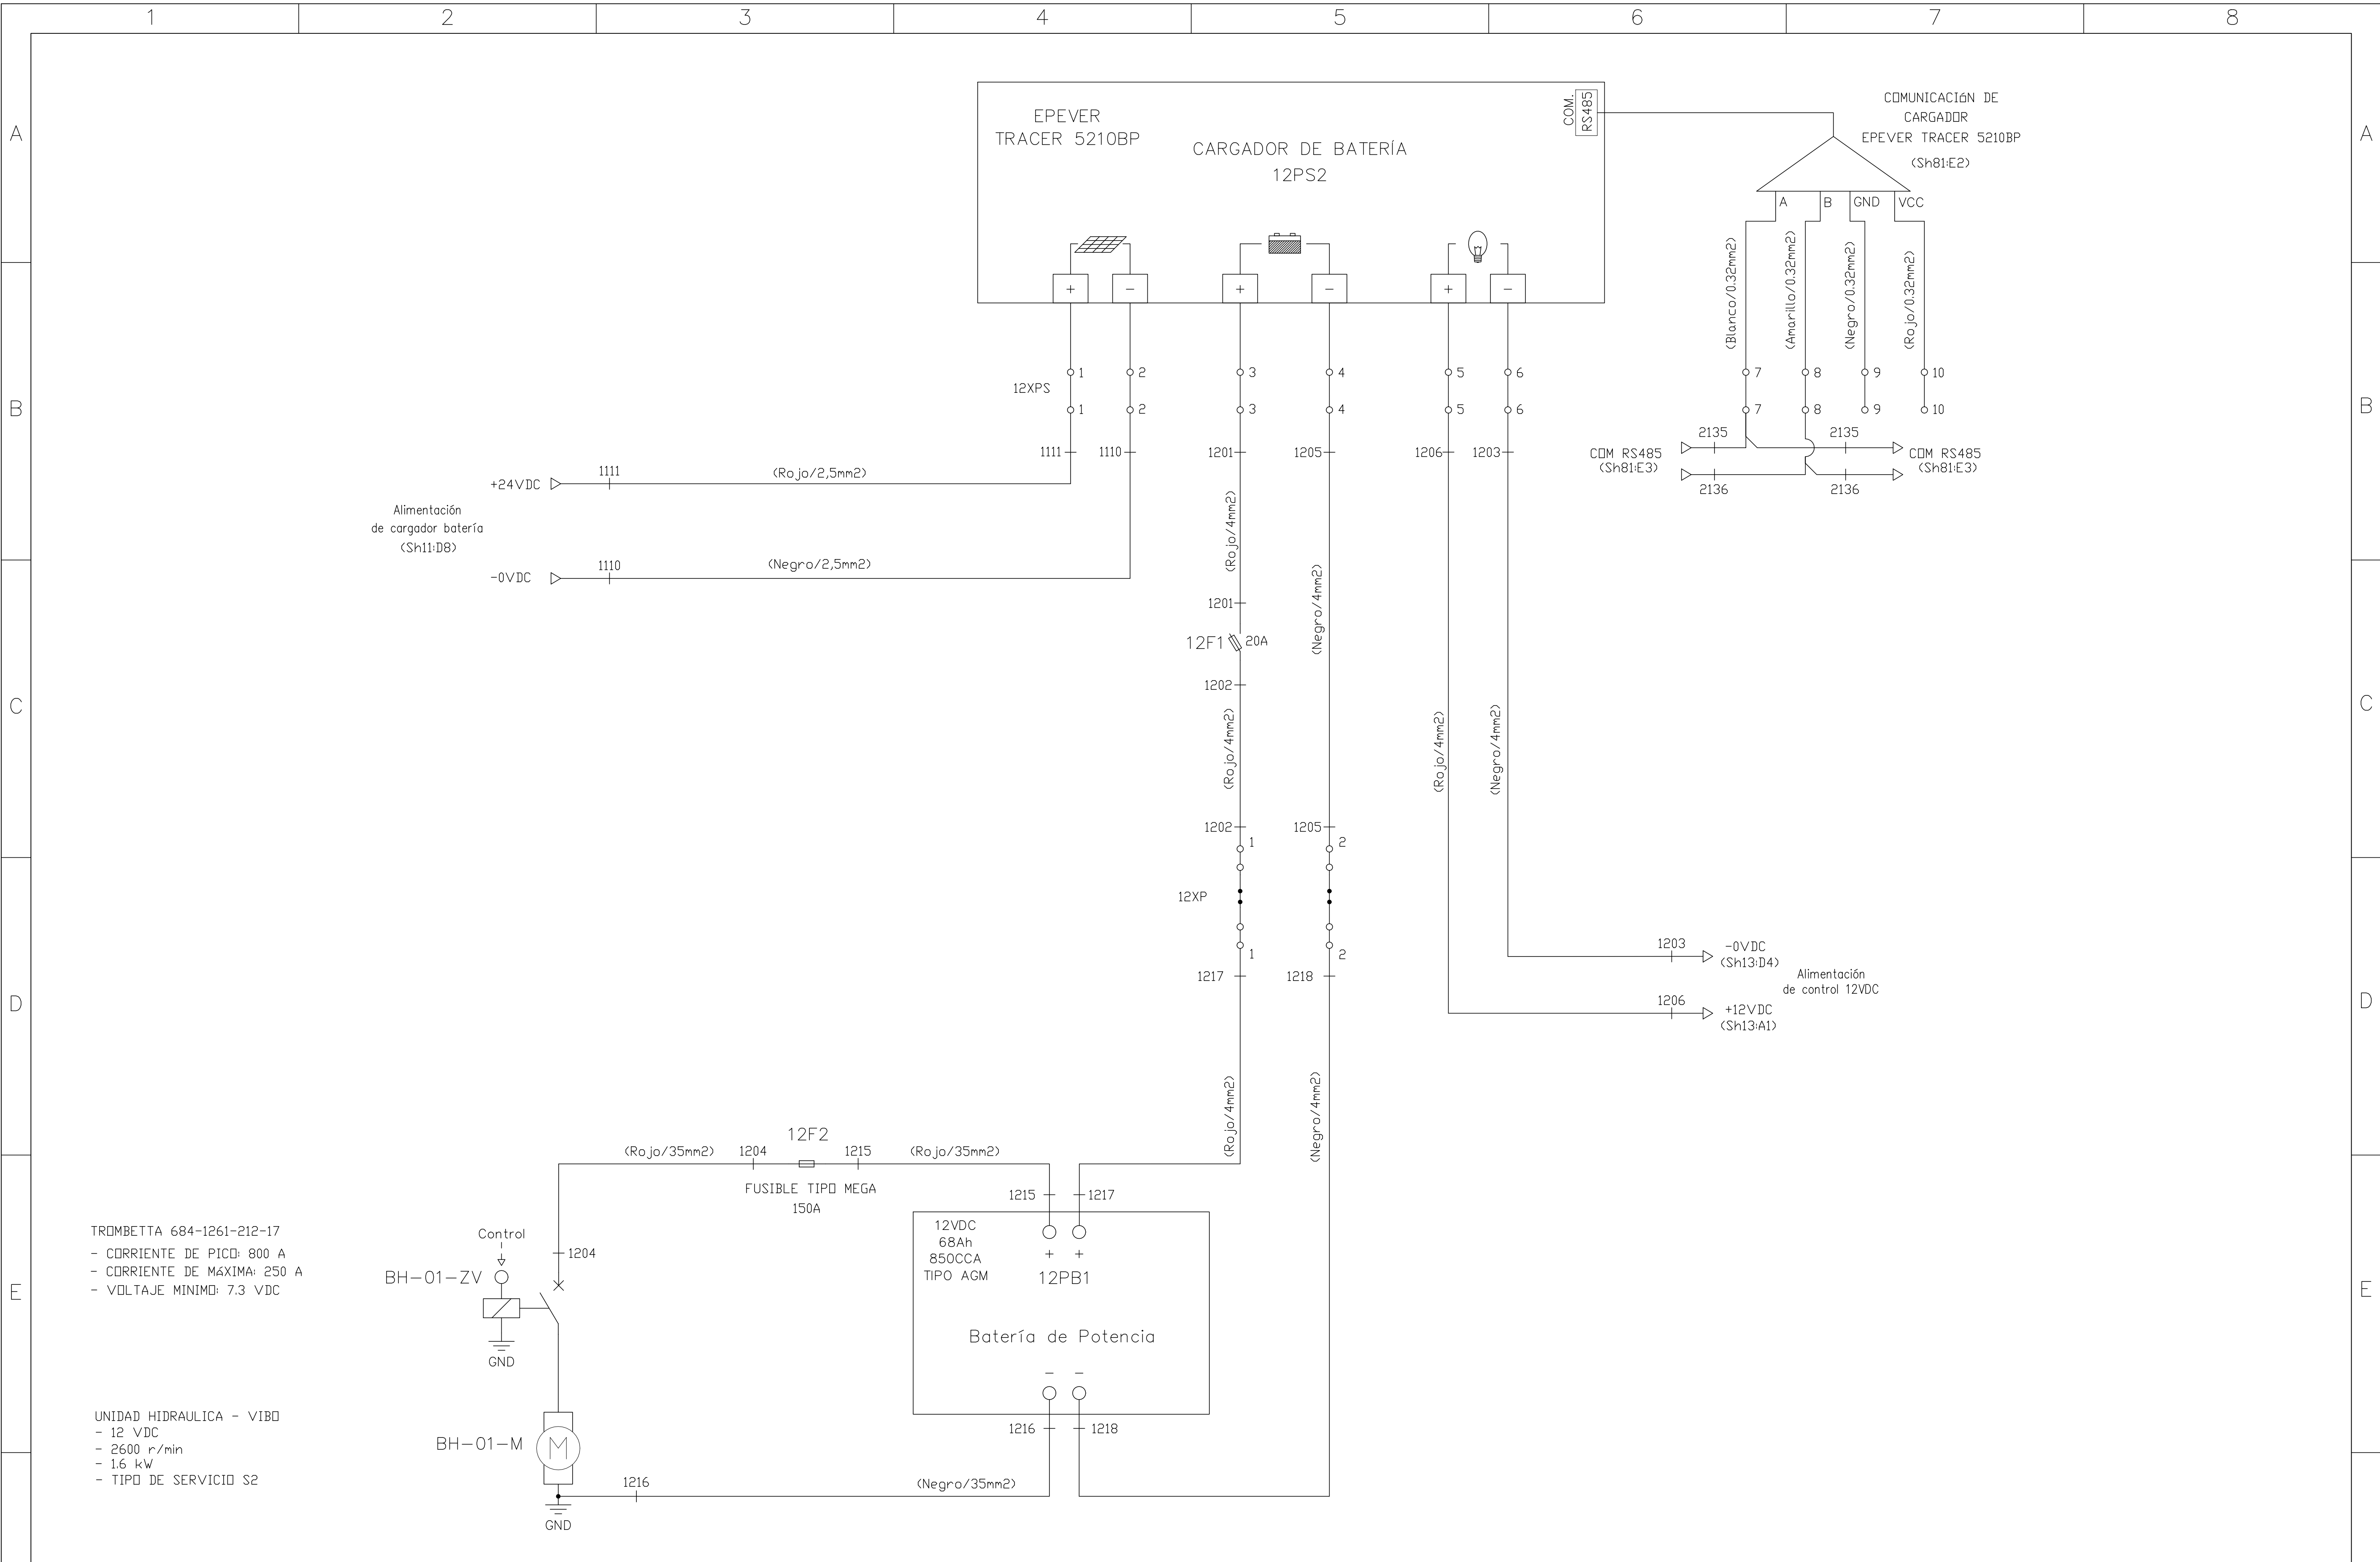

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT: MMA




BATFER
Investment S.A.



DOC NUMBER: 76425 ZPL	GRAL REV: 0
TITLE: DIAGRAMA ELÉCTRICO mSafe PP Alimentación de circuito de potencia DC.	PAG: 12 REV: 0
	CONT: 13

NOTE: cables not indicated will be black 0.75mm²/18 AWG


NOTA
El elevador de 12 a 24VDC tiene integrada la protección de sobrecargar (auto reset)

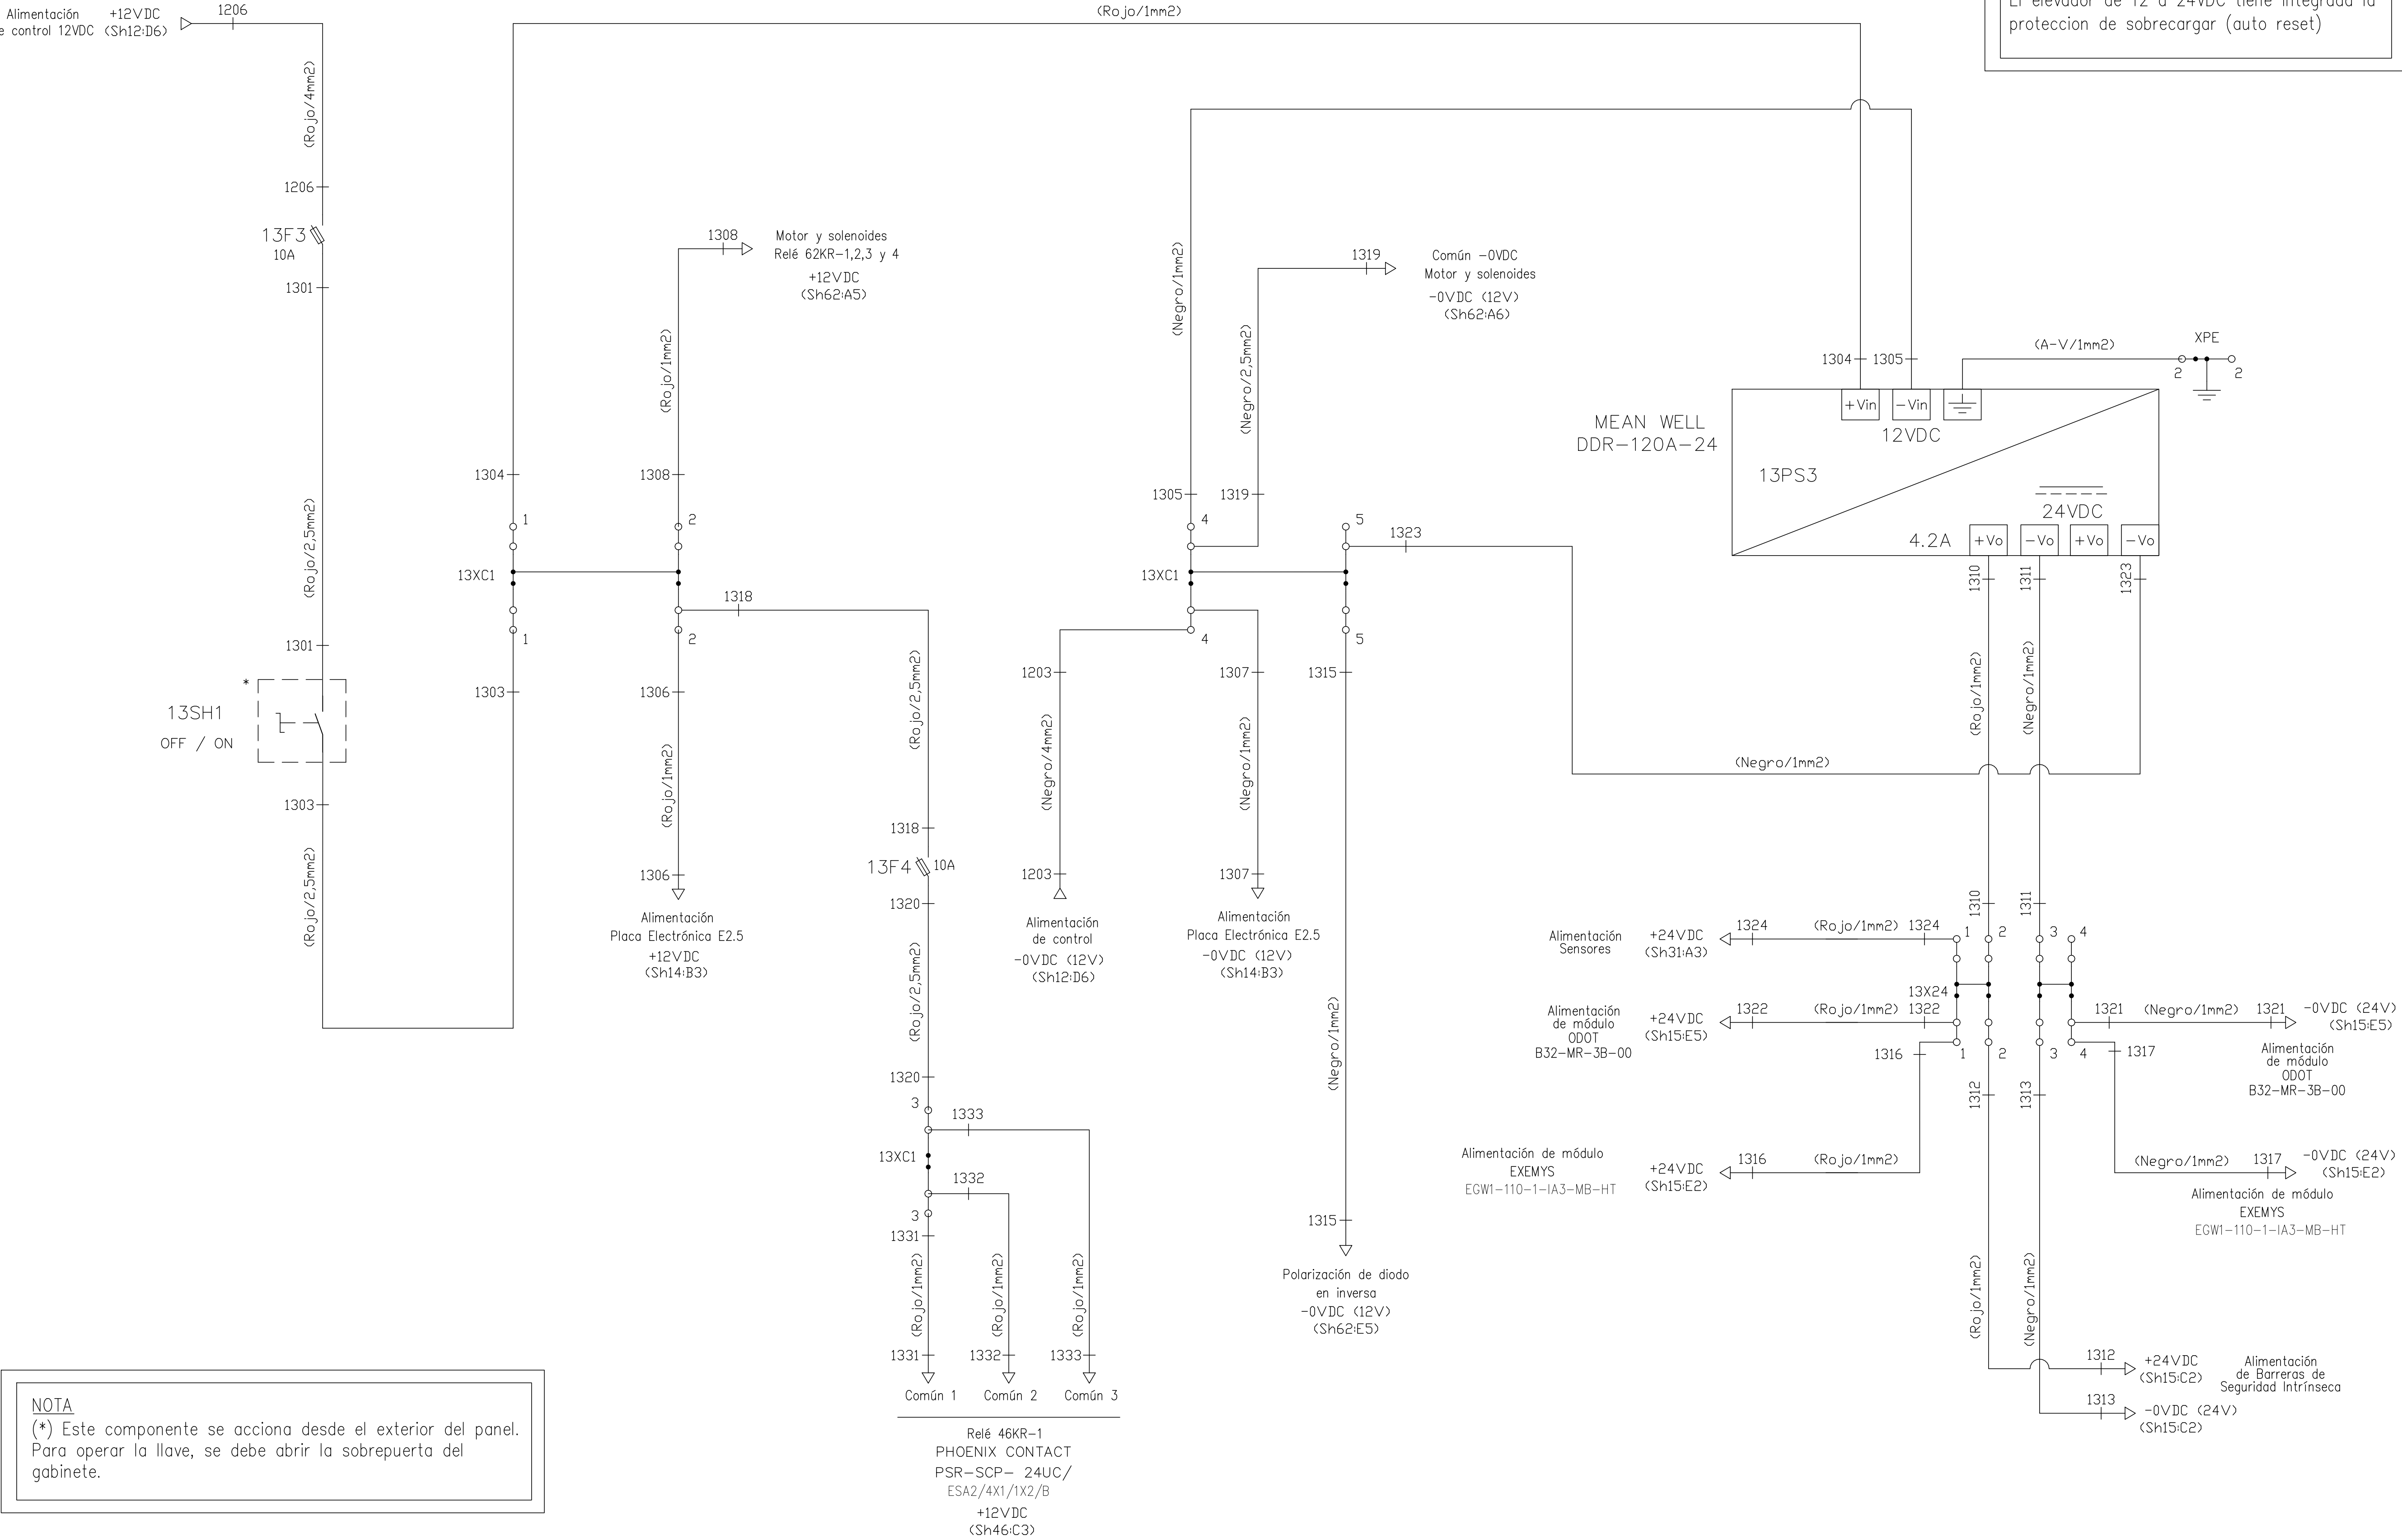

NOTA
(*) Este componente se acciona desde el exterior del panel. Para operar la llave, se debe abrir la sobrepuerta del gabinete.

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT: MMA




BATFER
Investment S.A.



DIGITO


DOC NUMBER: 76425 ZPL
TITLE: DIAGRAMA ELÉCTRICO mSafe PP
Distribución de voltaje de control.

GRAL REV: 0	PAG: 13	REV: 0
CONT: 14		

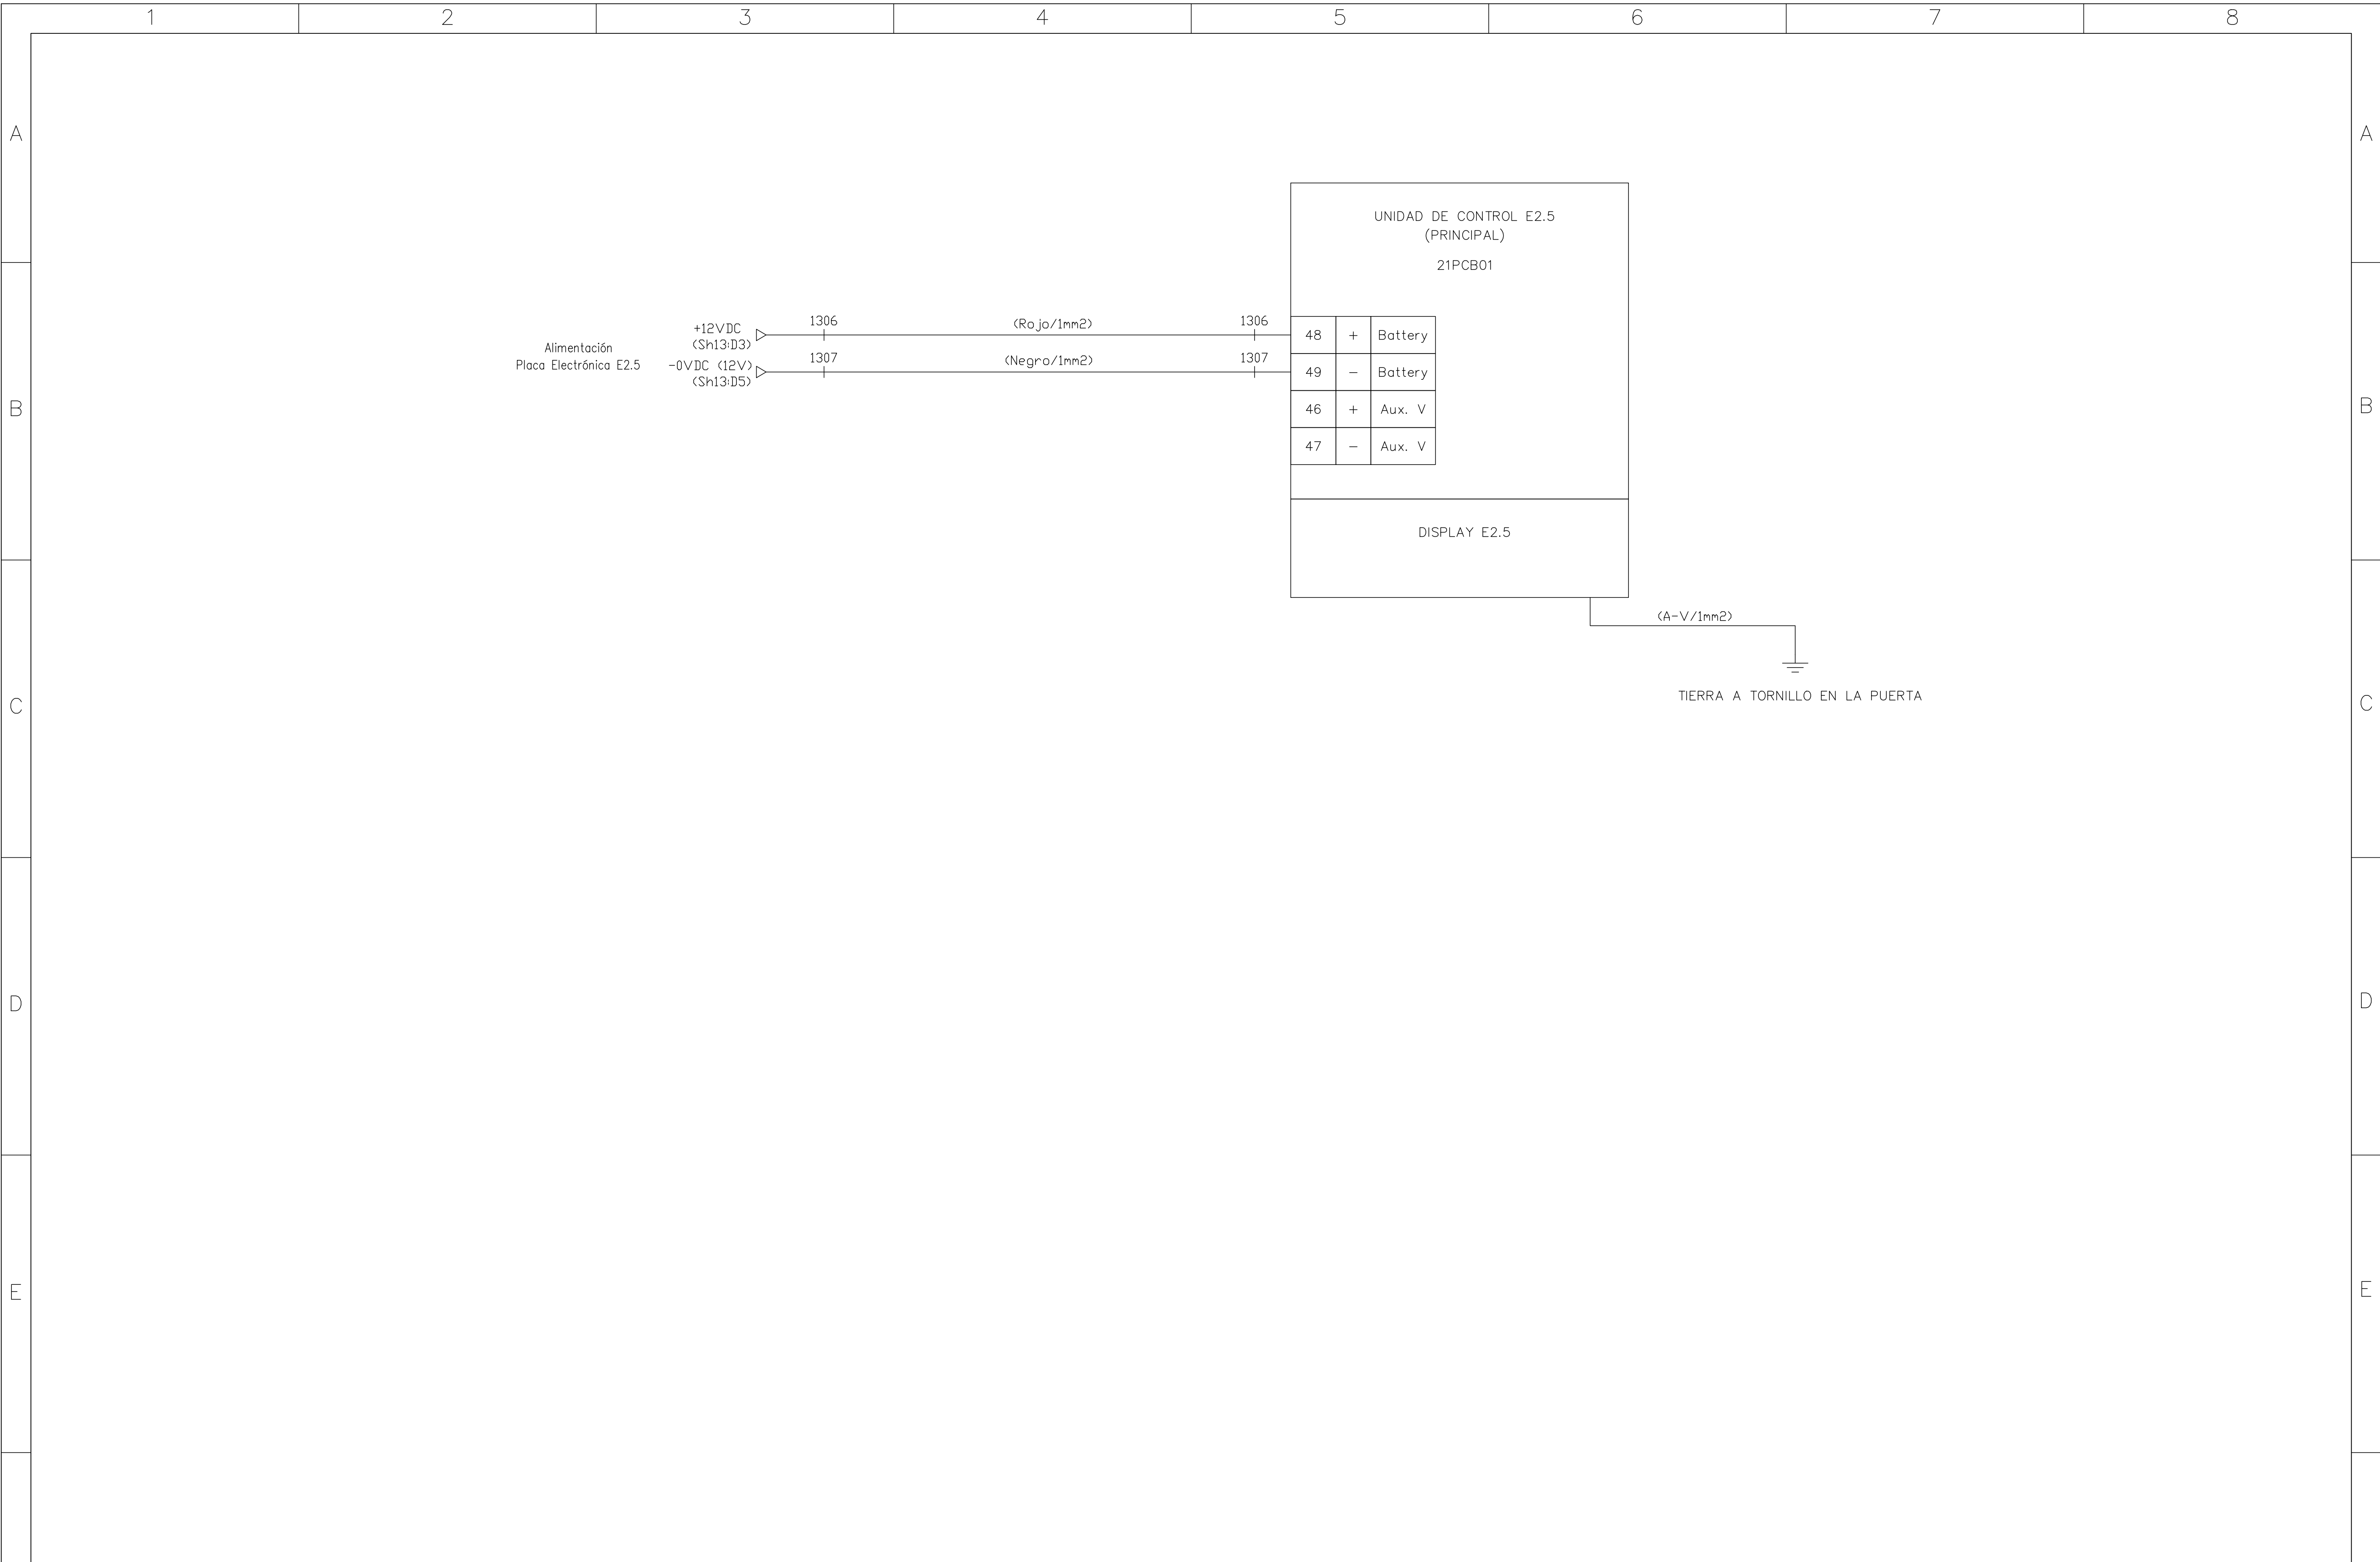

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.


PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT: MMA




BATFER
Investment S.A.



DOC NUMBER: 76425 ZPL	GRAL REV: 0
TITLE: DIAGRAMA ELÉCTRICO mSafe PP Alimentación placa electrónica E2.5.	PAG: 14 REV: 0
-	CONT: 15

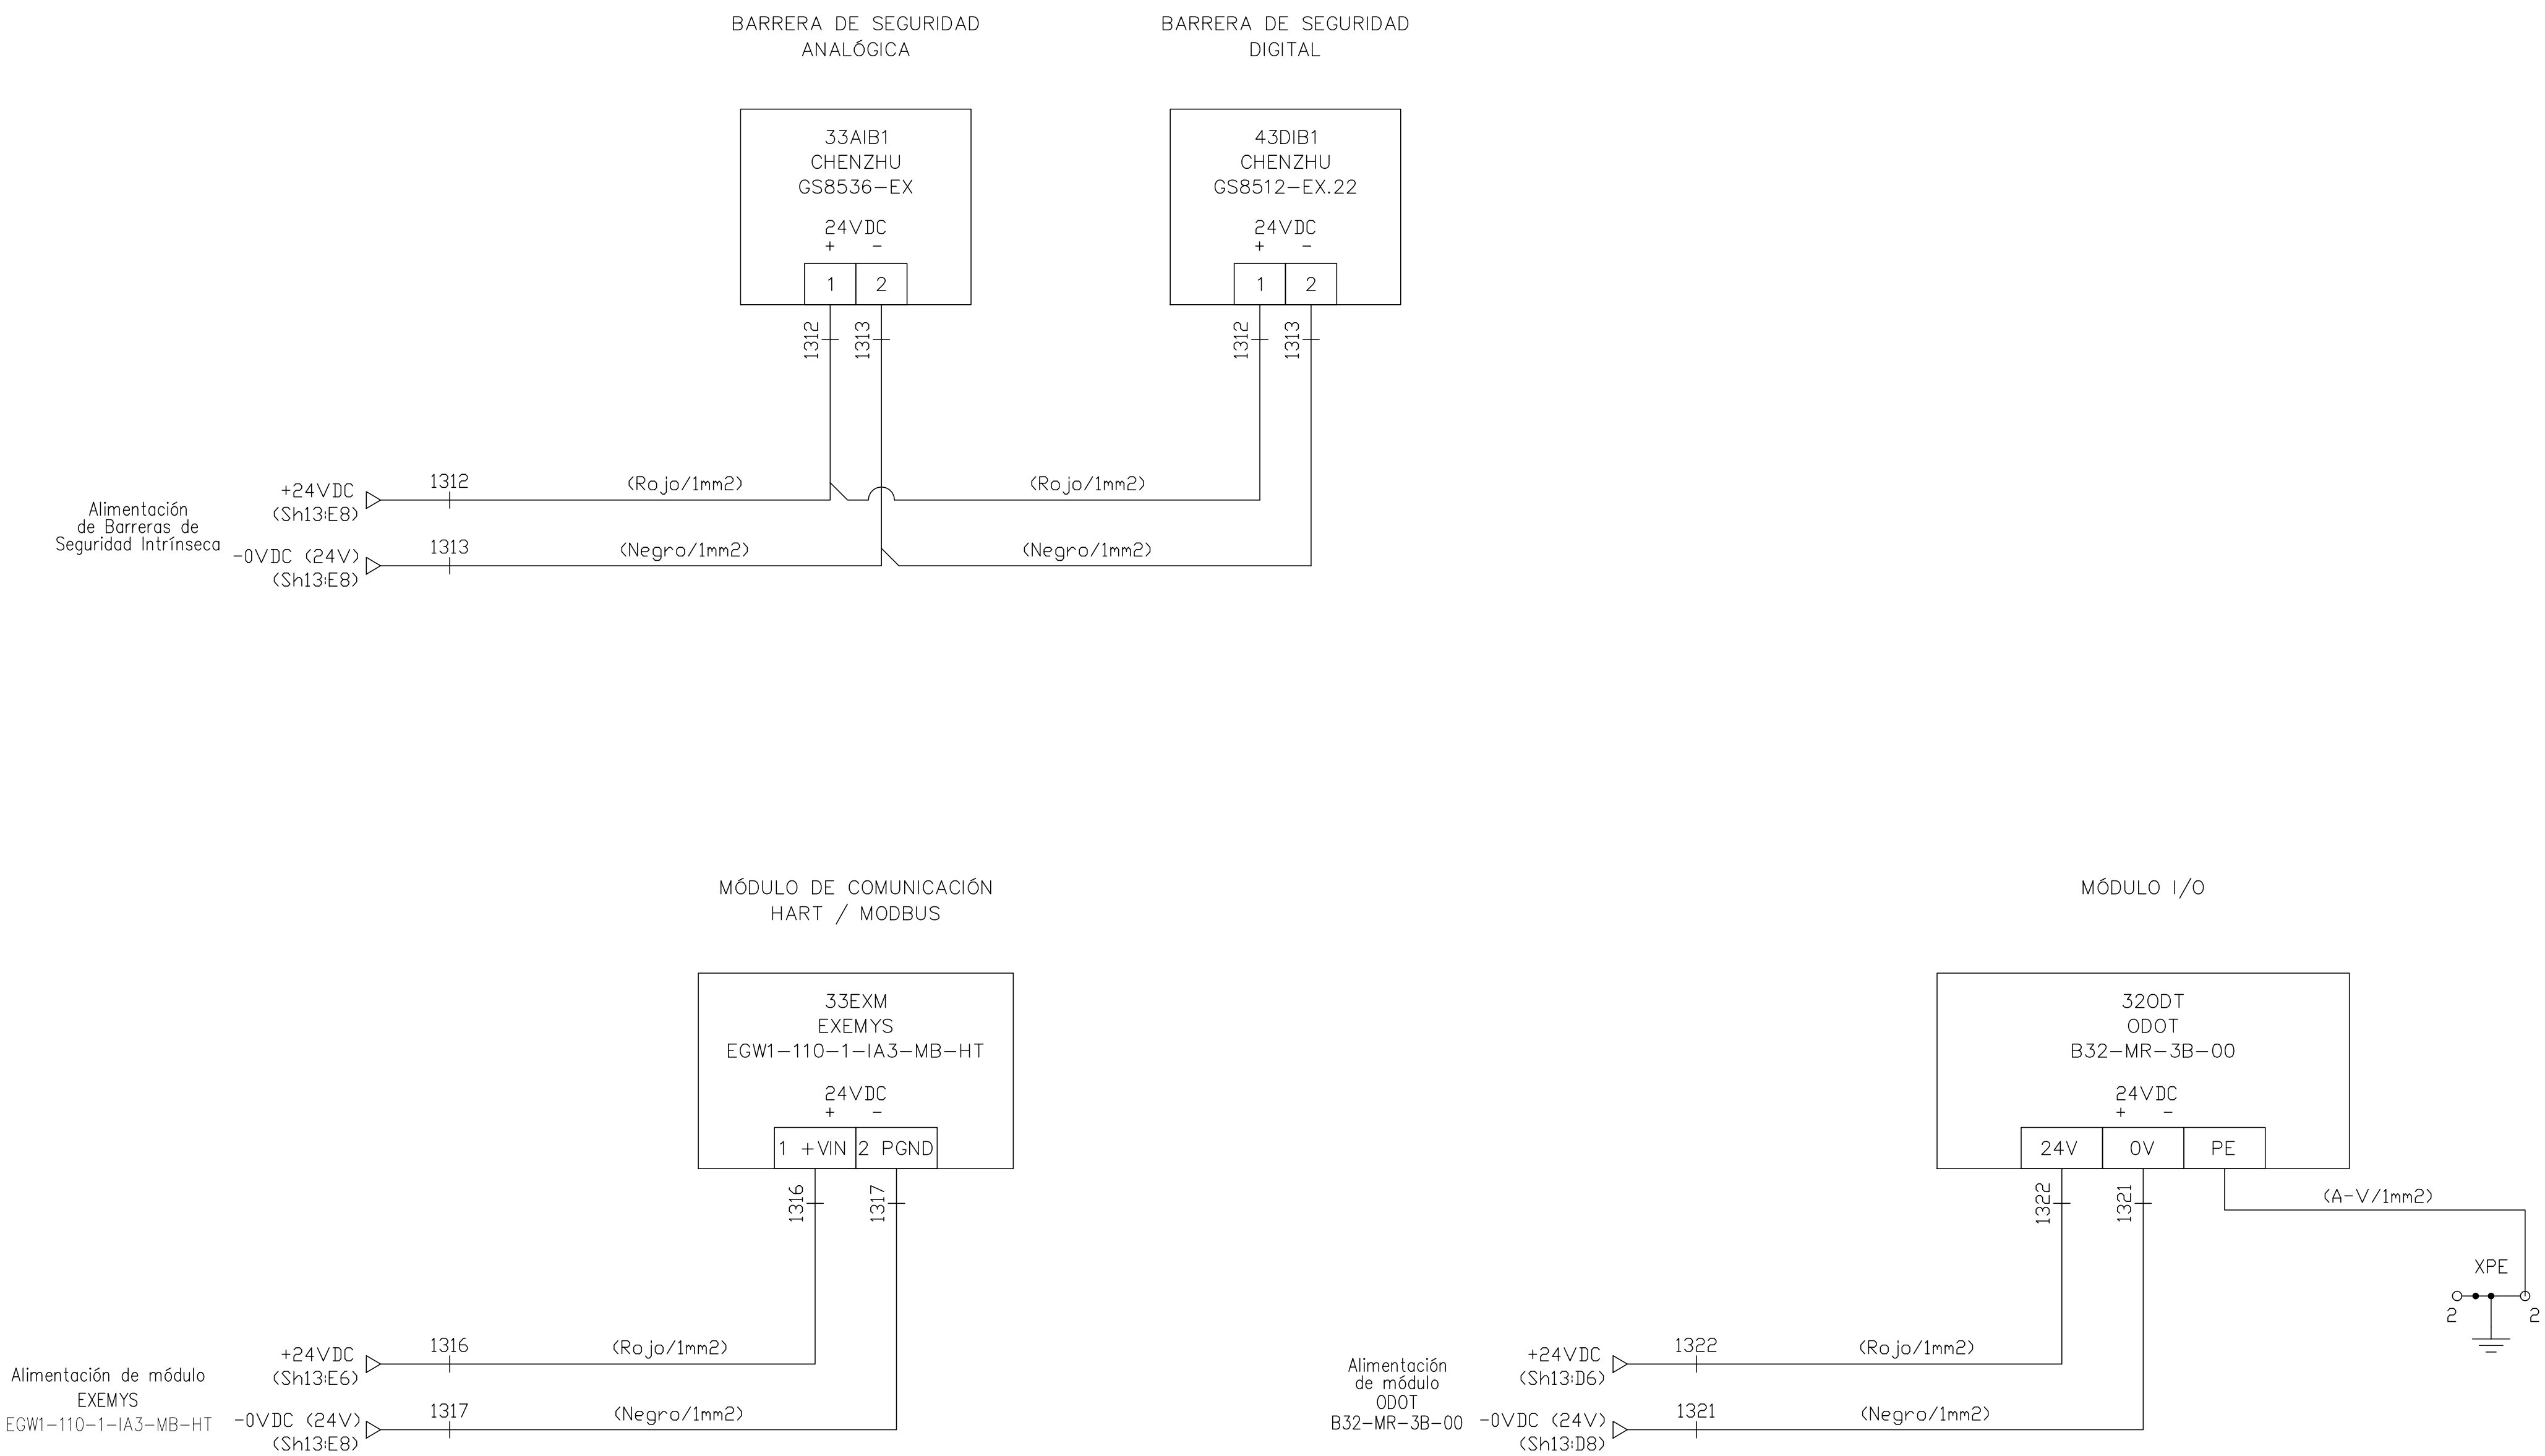

-	-	-	-	-	-	PROJECT: C.J. CONTROLADOR mSafe PP
-	-	-	-	-	-	CODE: 76222-1
-	-	-	-	-	-	CLIENT:
0	For Manufacturing	24/09/25	LM	MD	MPV	MMA
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.	




BATFER
Investment S.A.



DOC NUMBER:	76425 ZPL	GRAL REV:	0
TITLE:	DIAGRAMA ELÉCTRICO mSafe PP Alimentación de barreras de seguridad intrínseca.	PAG:	15
		REV:	0
		CONT:	21




BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

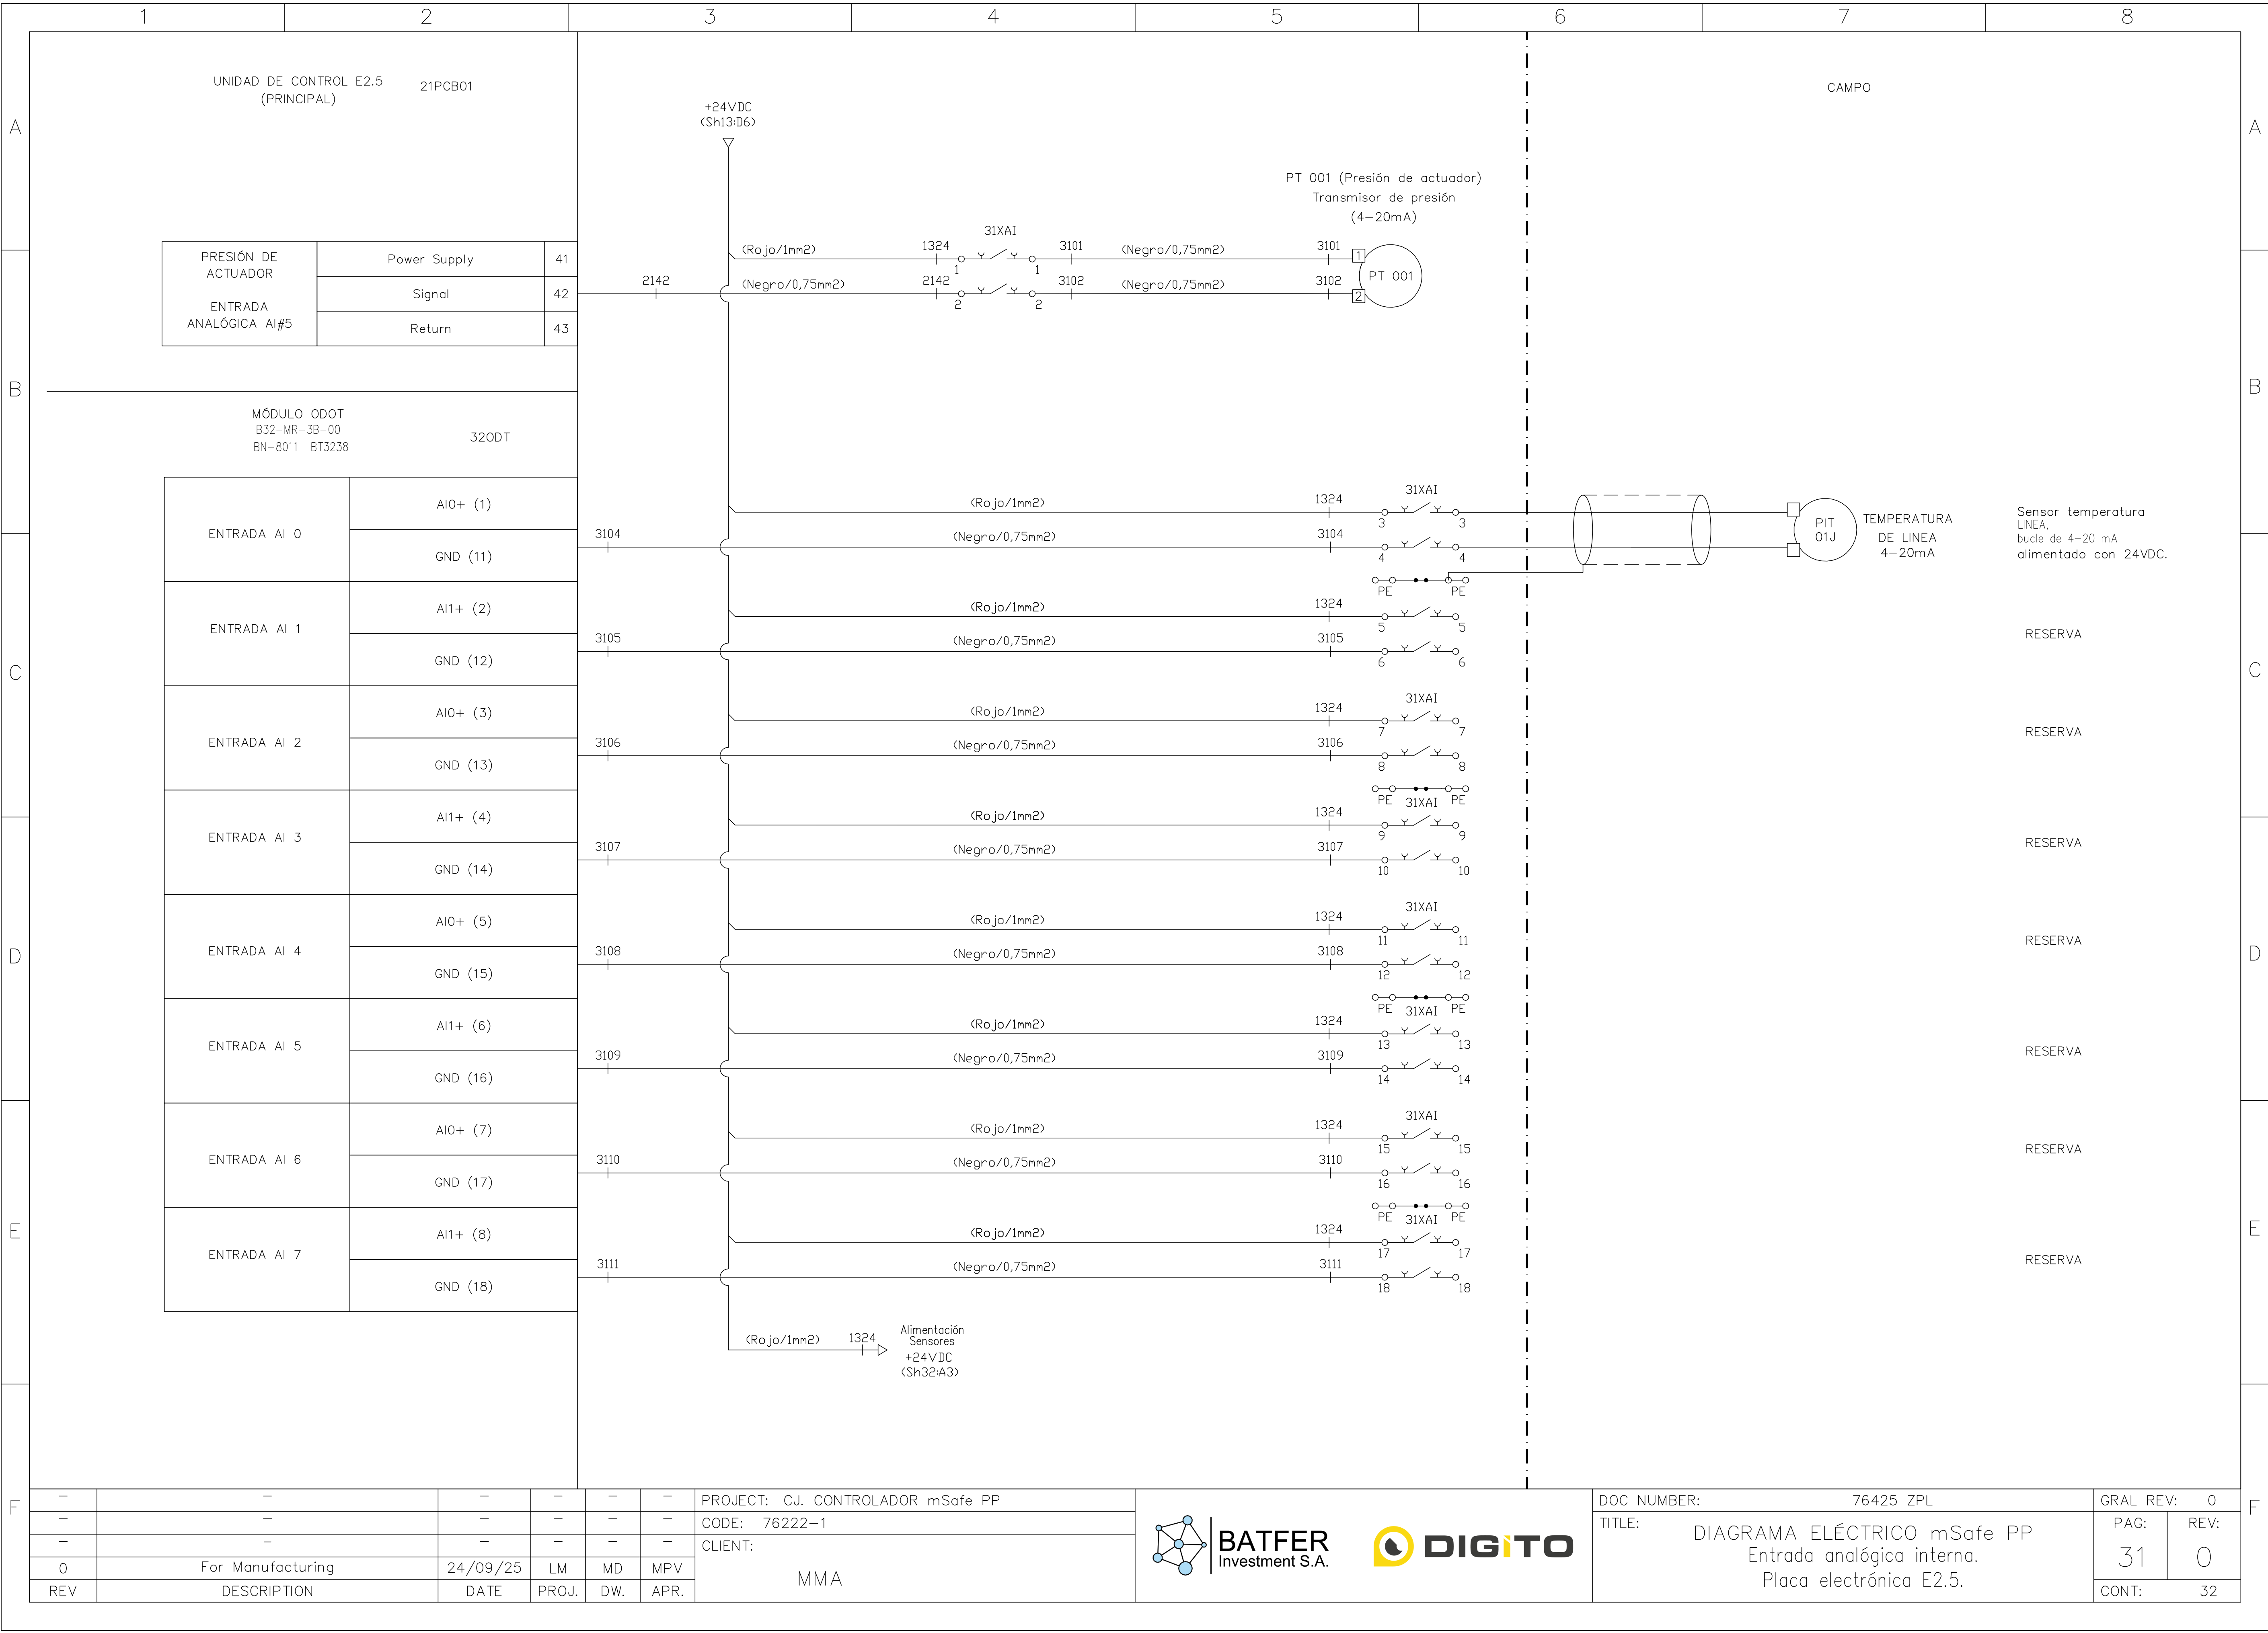

-	-	-	-	-	-	PROJECT: C.J. CONTROLADOR mSafe PP
-	-	-	-	-	-	CODE: 76222-1
-	-	-	-	-	-	CLIENT:
0	For Manufacturing	24/09/25	LM	MD	MPV	MMA
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.	




DOC NUMBER:	76425 ZPL	GRAL REV:	0
TITLE:	DIAGRAMA ELÉCTRICO mSafe PP Entrada analógica interna. Placa electrónica E2.5.	PAG:	31
		REV:	0
		CONT:	32

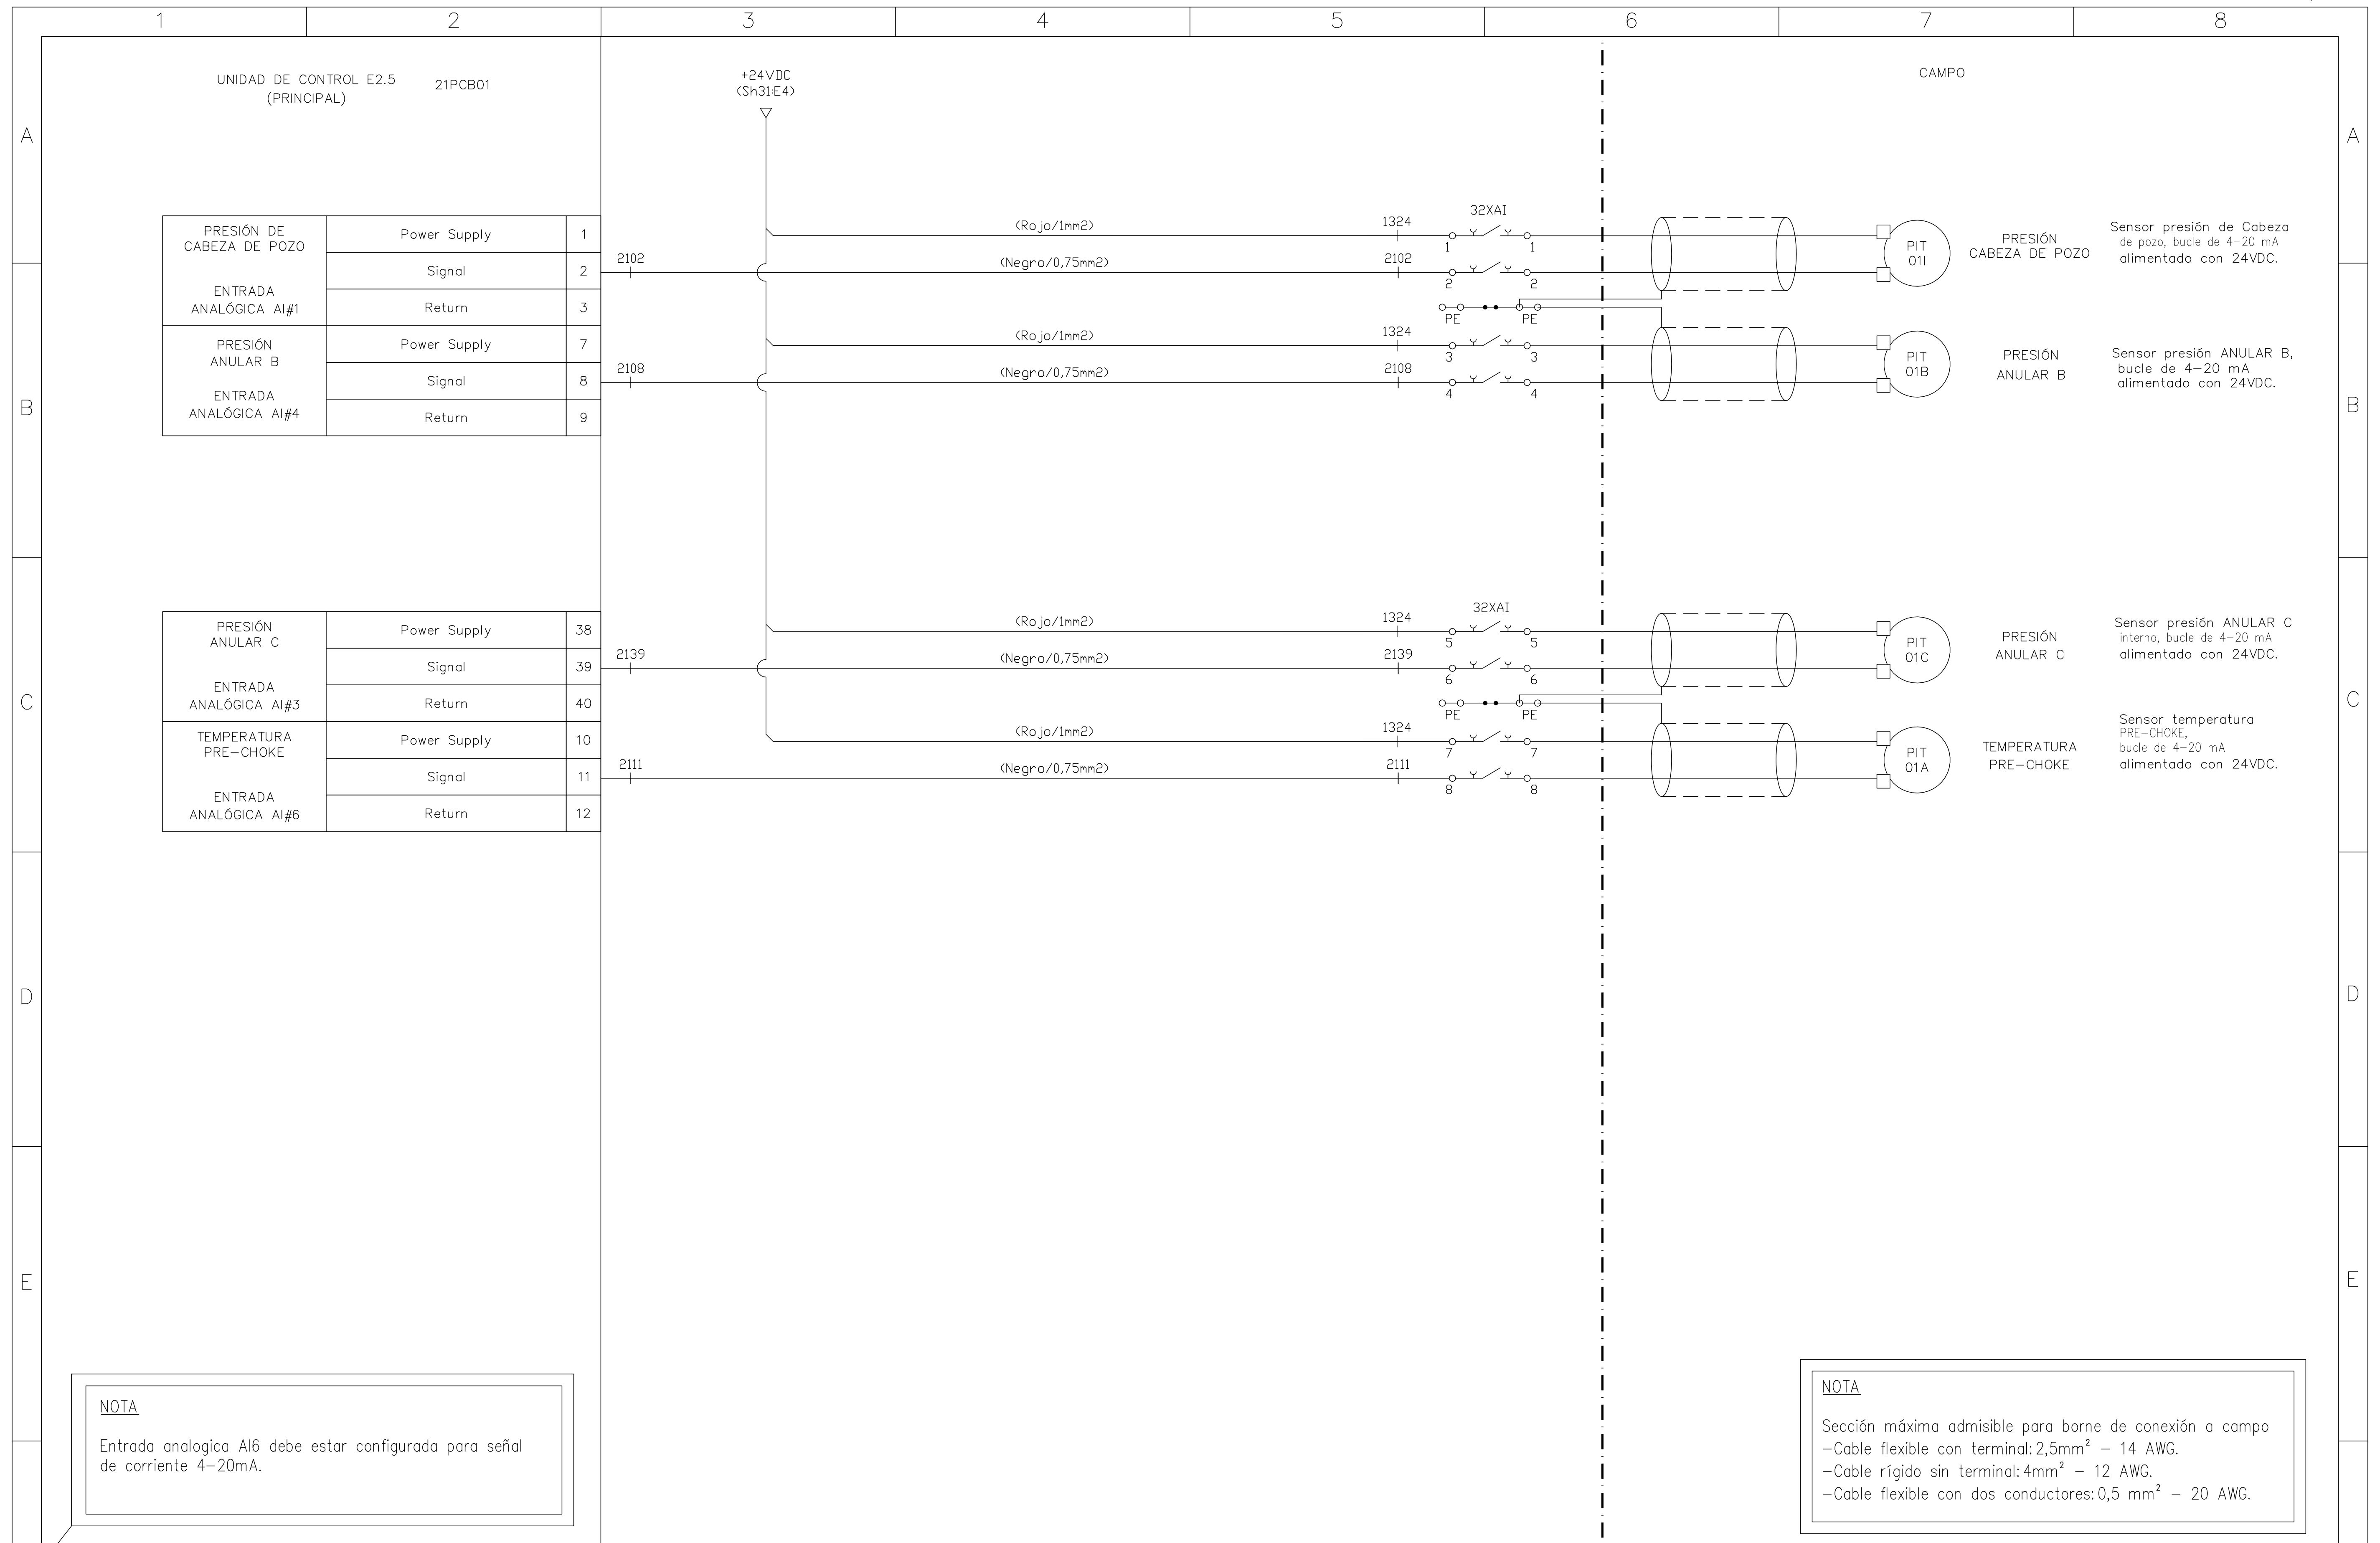

—	—	—	—	—	PROJECT: C.J. CONTROLADOR mSafe PP	 	DOC NUMBER: 76425 ZPL		GRAL REV: 0	
—	—	—	—	—	CODE: 76222-1			PAG:	REV:	
—	—	—	—	—	CLIENT:			32	0	
0	For Manufacturing	24/09/25	LM	MD	MPV			—		
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.			CONT: 33		

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

NOTE: cables not indicated will be black 0.75mm²/18 AWG

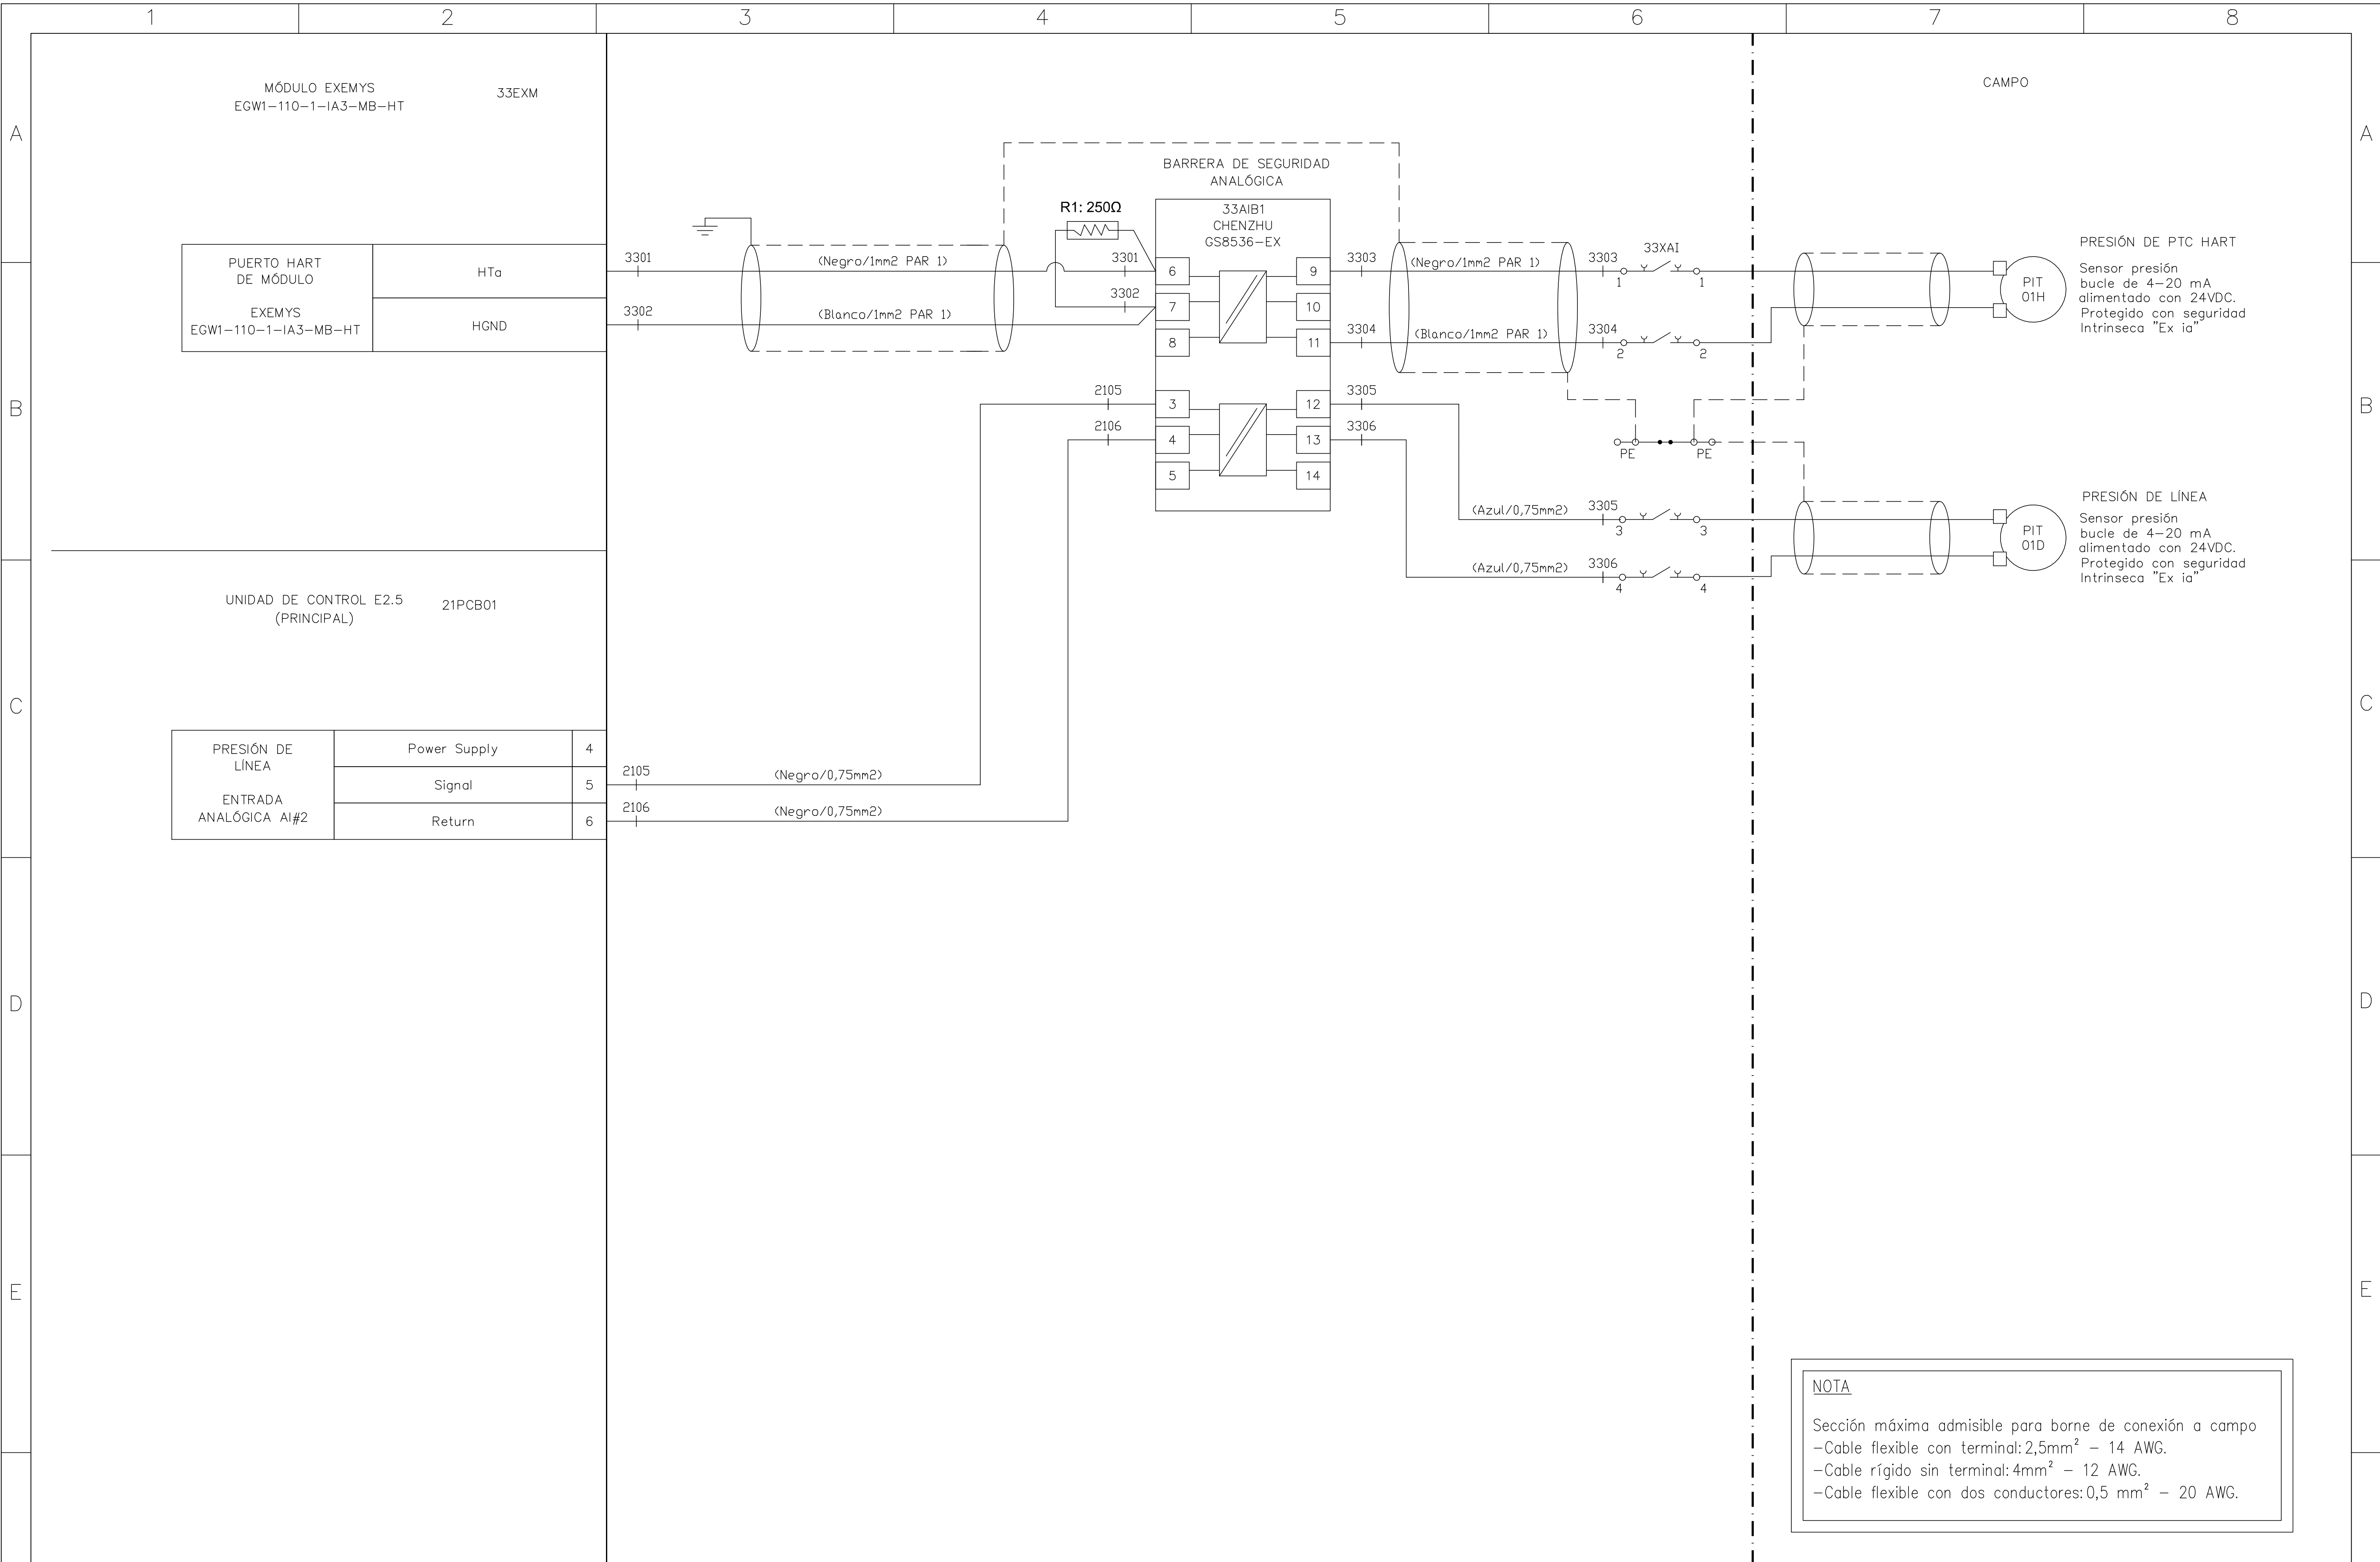


NOTA

Sección máxima admisible para borne de conexión a campo

- Cable flexible con terminal: 2,5mm² - 14 AWG.
- Cable rígido sin terminal: 4mm² - 12 AWG.
- Cable flexible con dos conductores: 0,5 mm² - 20 AWG.

-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT:
MMA




BATFER
Investment S.A.



DIGITO


DOC NUMBER:	76425 ZPL	GRAL REV:	0
TITLE:	DIAGRAMA ELÉCTRICO mSafe PP Entrada analógica externa. Modulo EXEMYS.	PAG:	33
		REV:	0
		CONT:	41

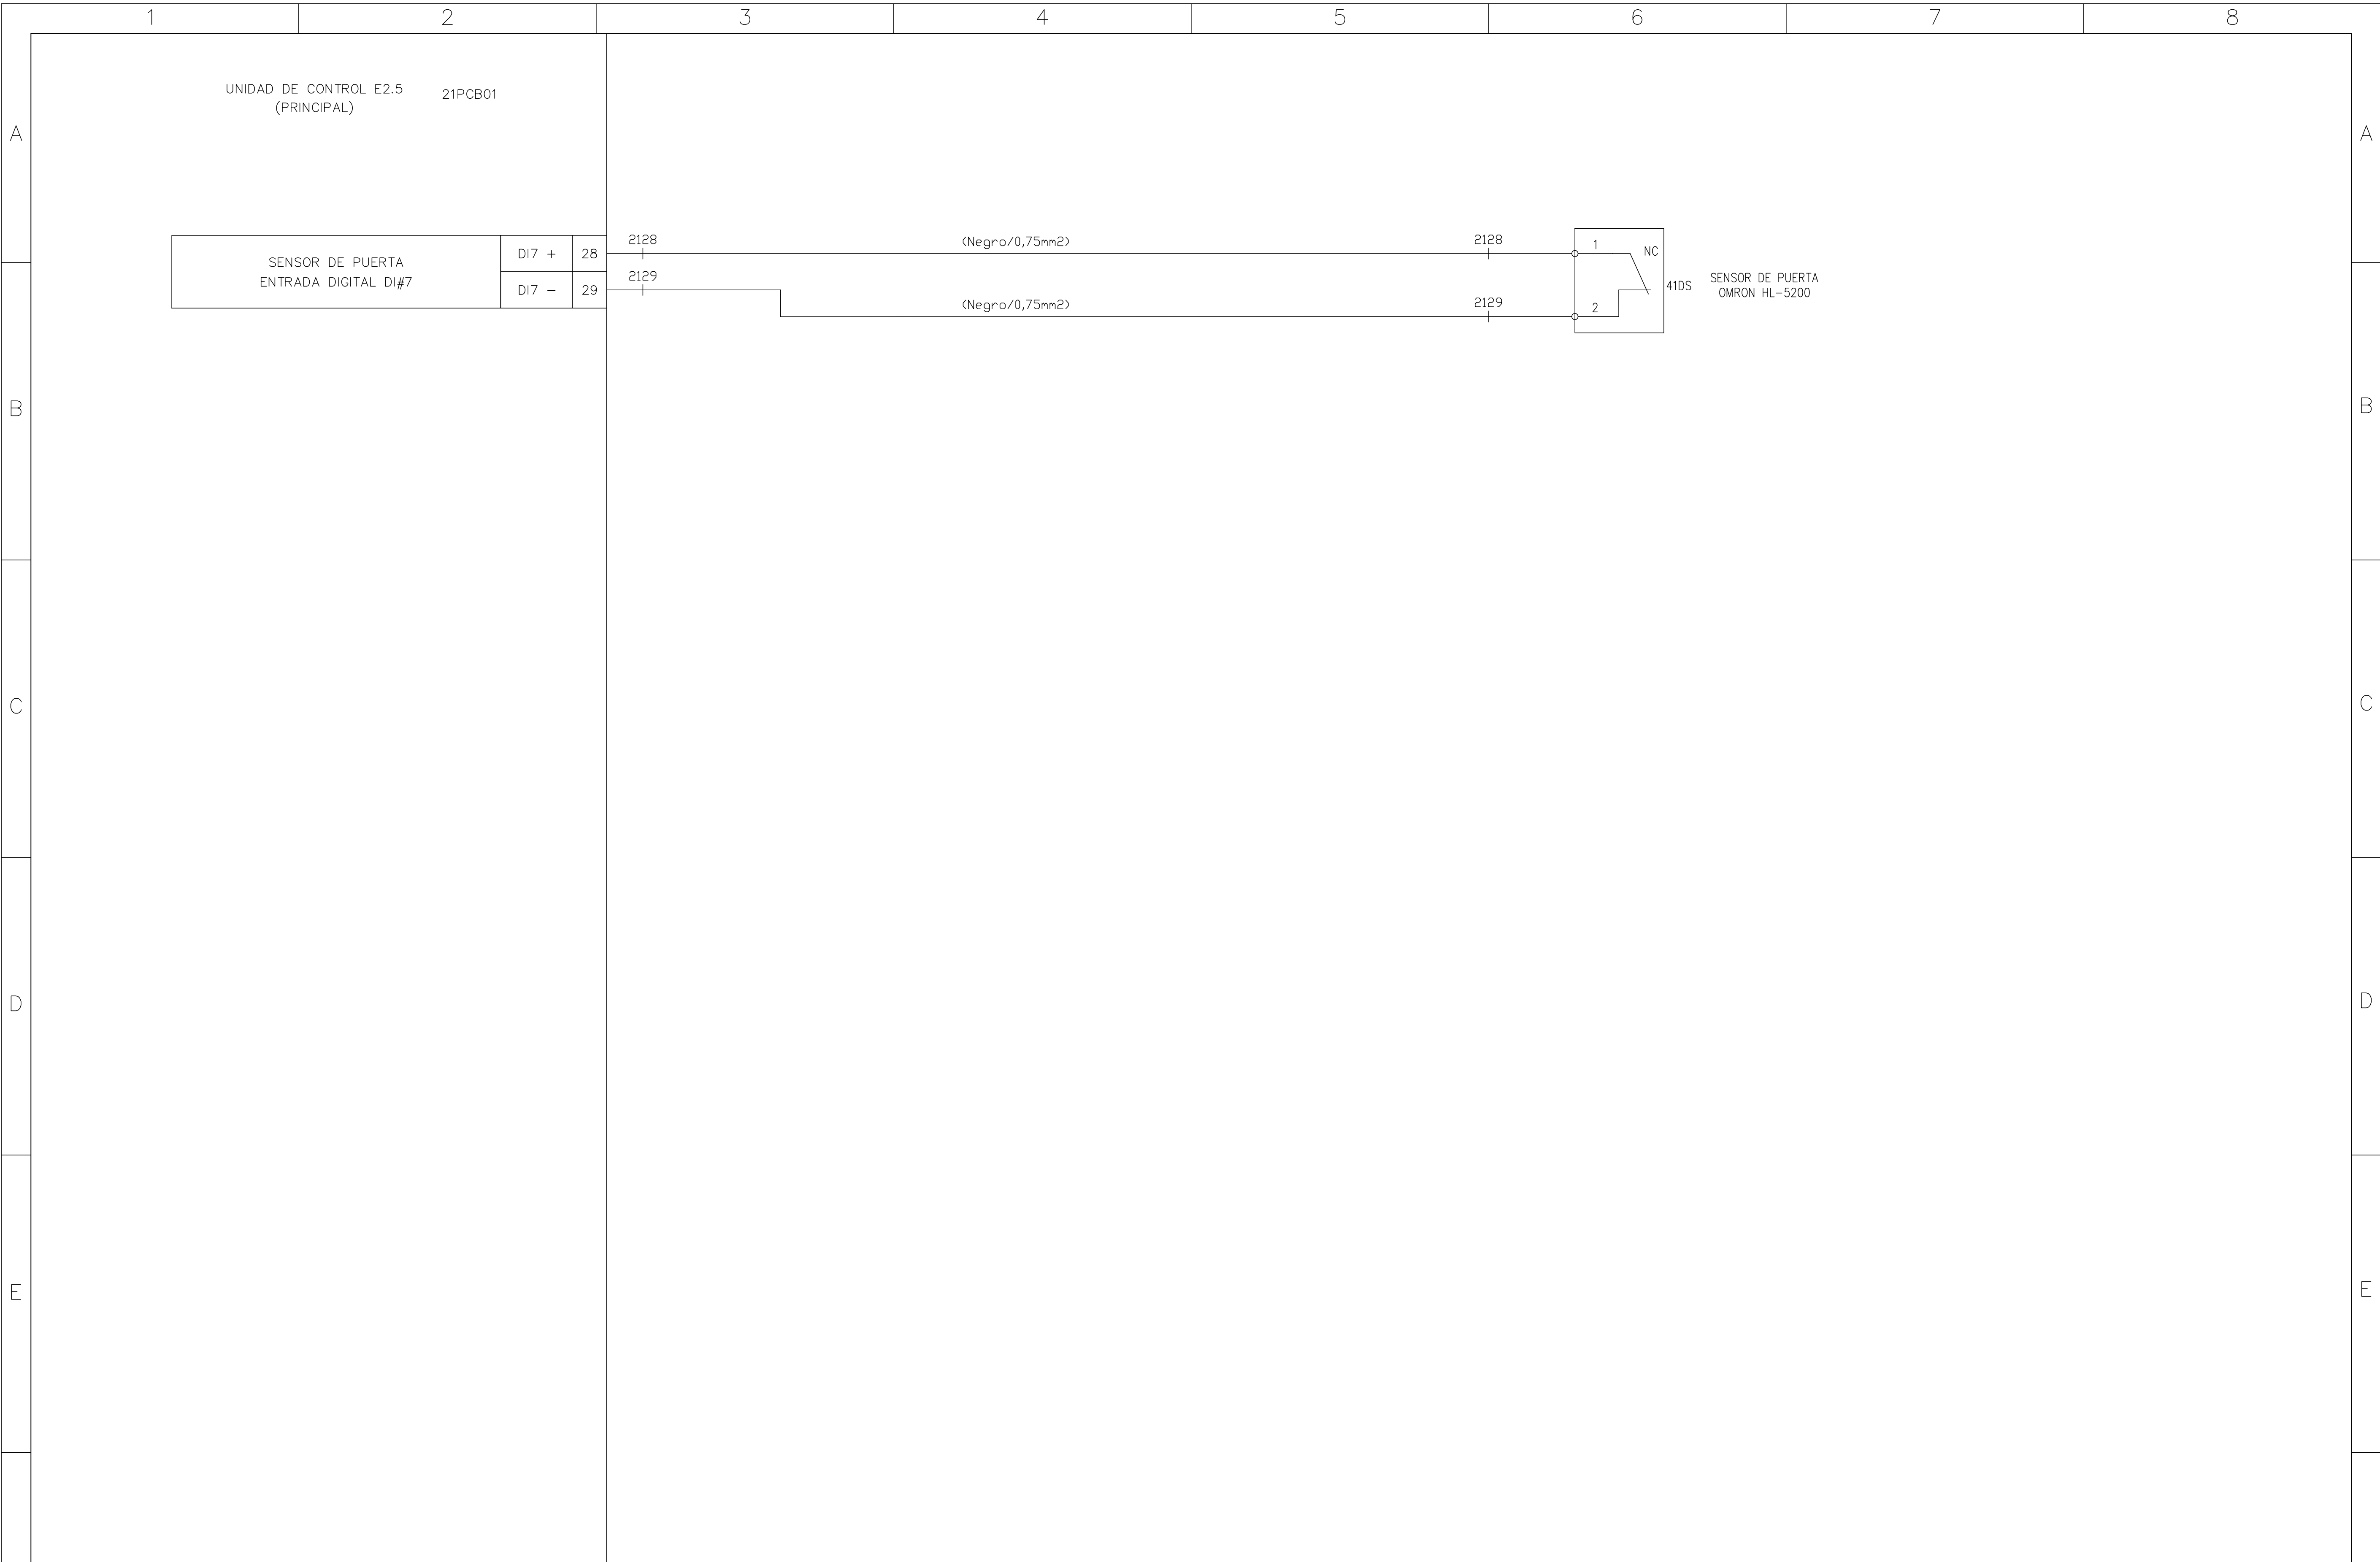

BATFER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.


-	-	-	-	-	-
-	-	-	-	-	-
-	-	-	-	-	-
0	For Manufacturing	24/09/25	LM	MD	MPV
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.

PROJECT: C.J. CONTROLADOR mSafe PP
CODE: 76222-1
CLIENT: MMA

**BATFER**
Investment S.A.






DOC NUMBER: 76425 ZPL	GRAL REV: 0
TITLE: DIAGRAMA ELÉCTRICO mSafe PP Entradas digital interna. Placa electrónica E2.5.	PAG: 41 REV: 0
	CONT: 43

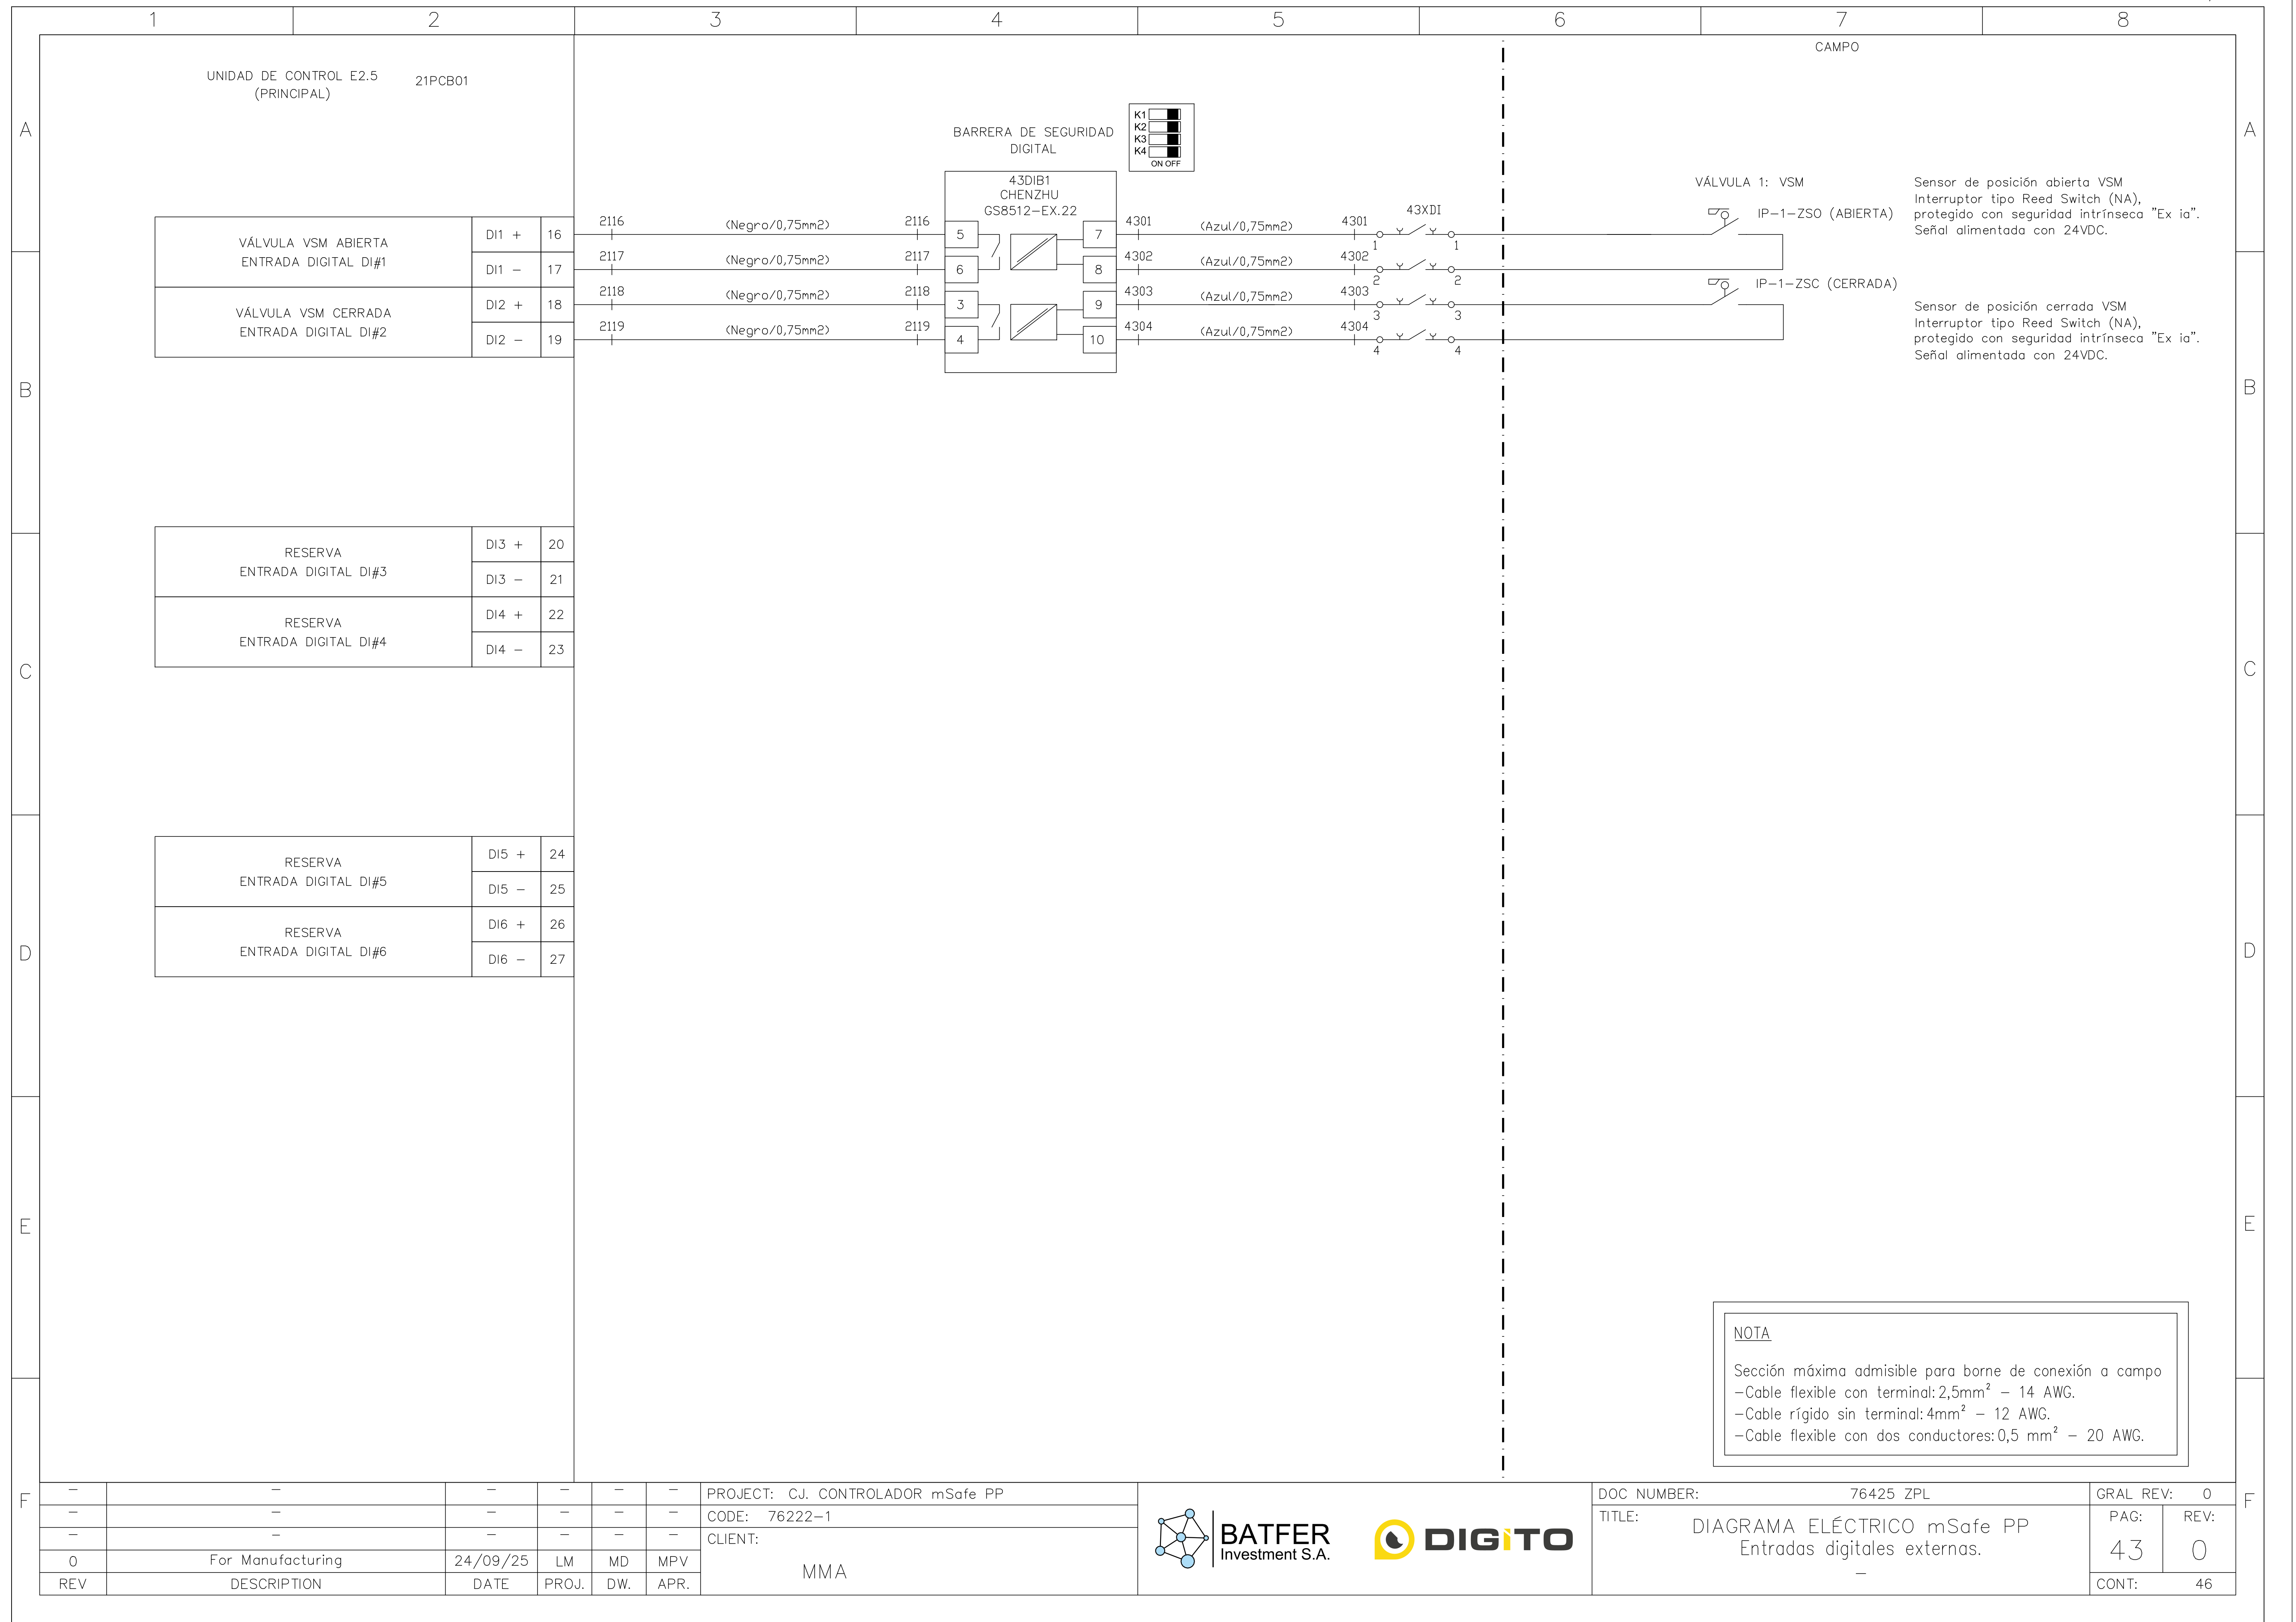



NOTE: cables not indicated will be black 0.75mm²/18 AWG

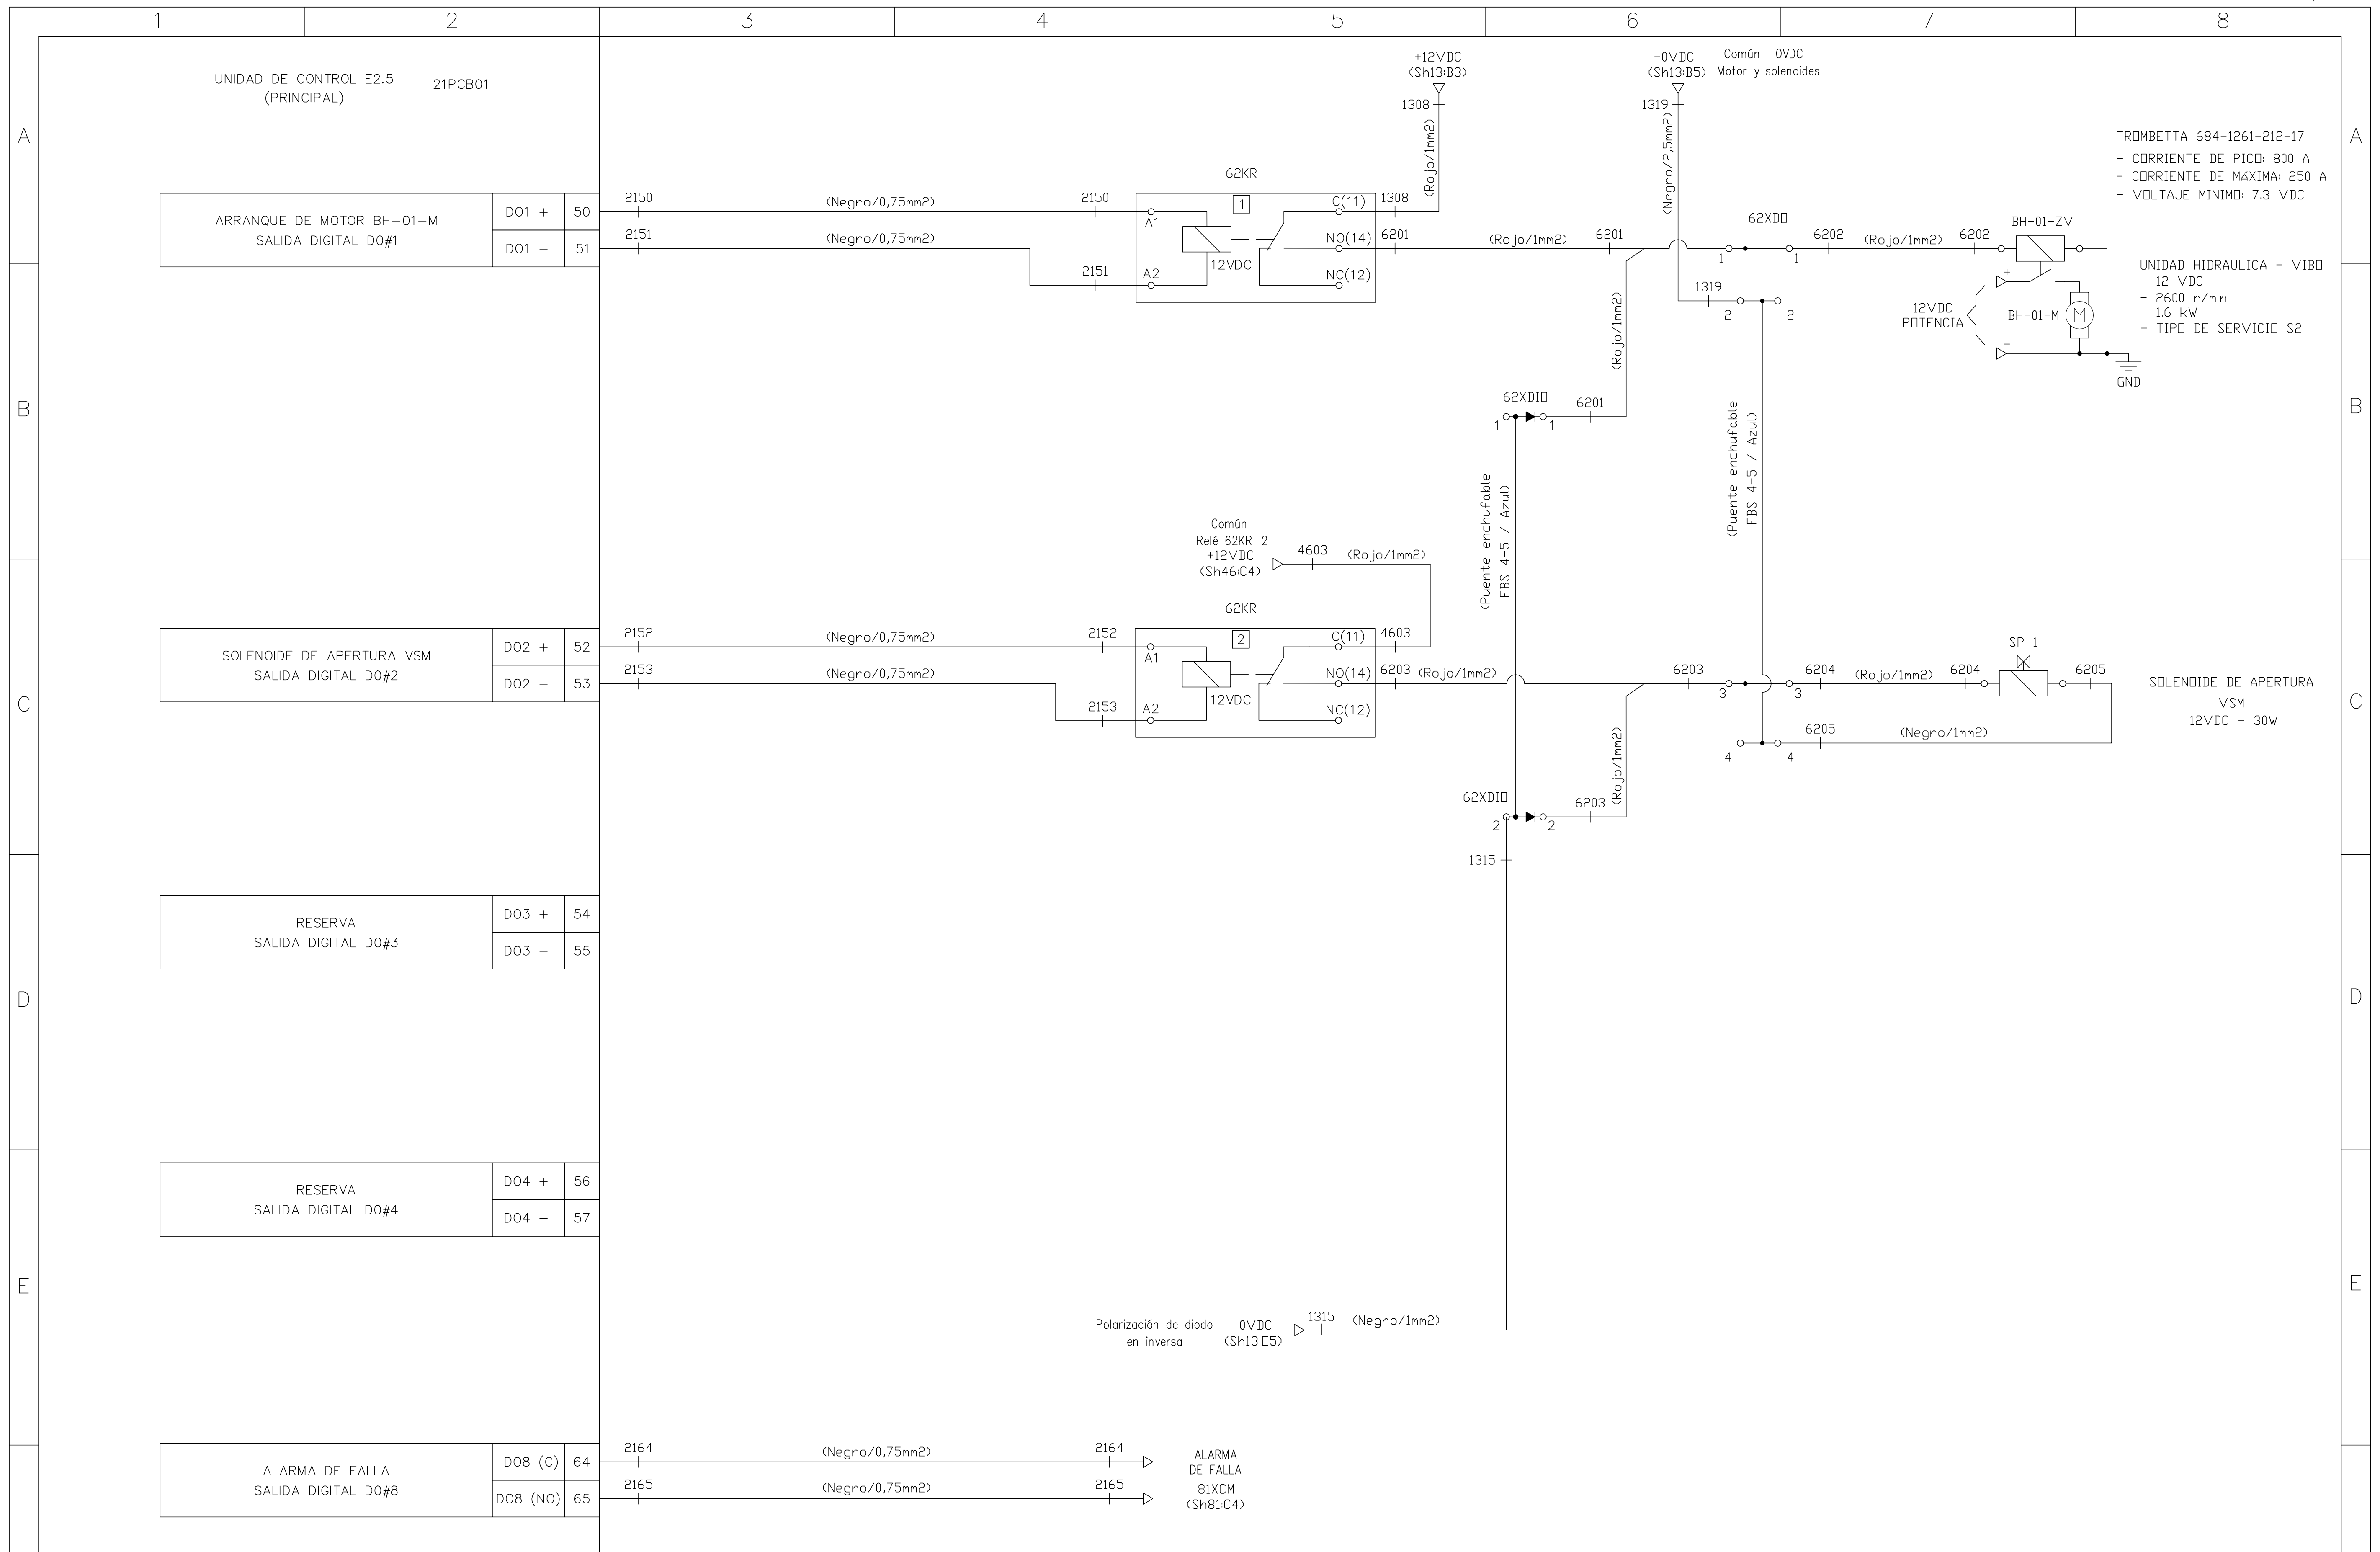

—	—	—	—	—	PROJECT: CJ. CONTROLADOR mSafe PP	 	DOC NUMBER: 76425 ZPL	GRAL REV: 0		F
—	—	—	—	—	CODE: 76222-1		TITLE: DIAGRAMA ELÉCTRICO mSafe PP	PAG: 62	REV: 0	
—	—	—	—	—	CLIENT: MMA		Salidas digitales internas.			
0	For Manufacturing	24/09/25	LM	MD	MPV		—			
REV	DESCRIPTION	DATE	PROJ.	DW.	APR.			CONT: 81		

BATTER INVESTMENT S.A. RESERVES THE OWNERSHIP OF THIS DOCUMENT. IT IS PROHIBITED TO REPRODUCE, MODIFY OR TRANSFER WITHOUT PRIOR WRITTEN AUTHORIZATION.

