


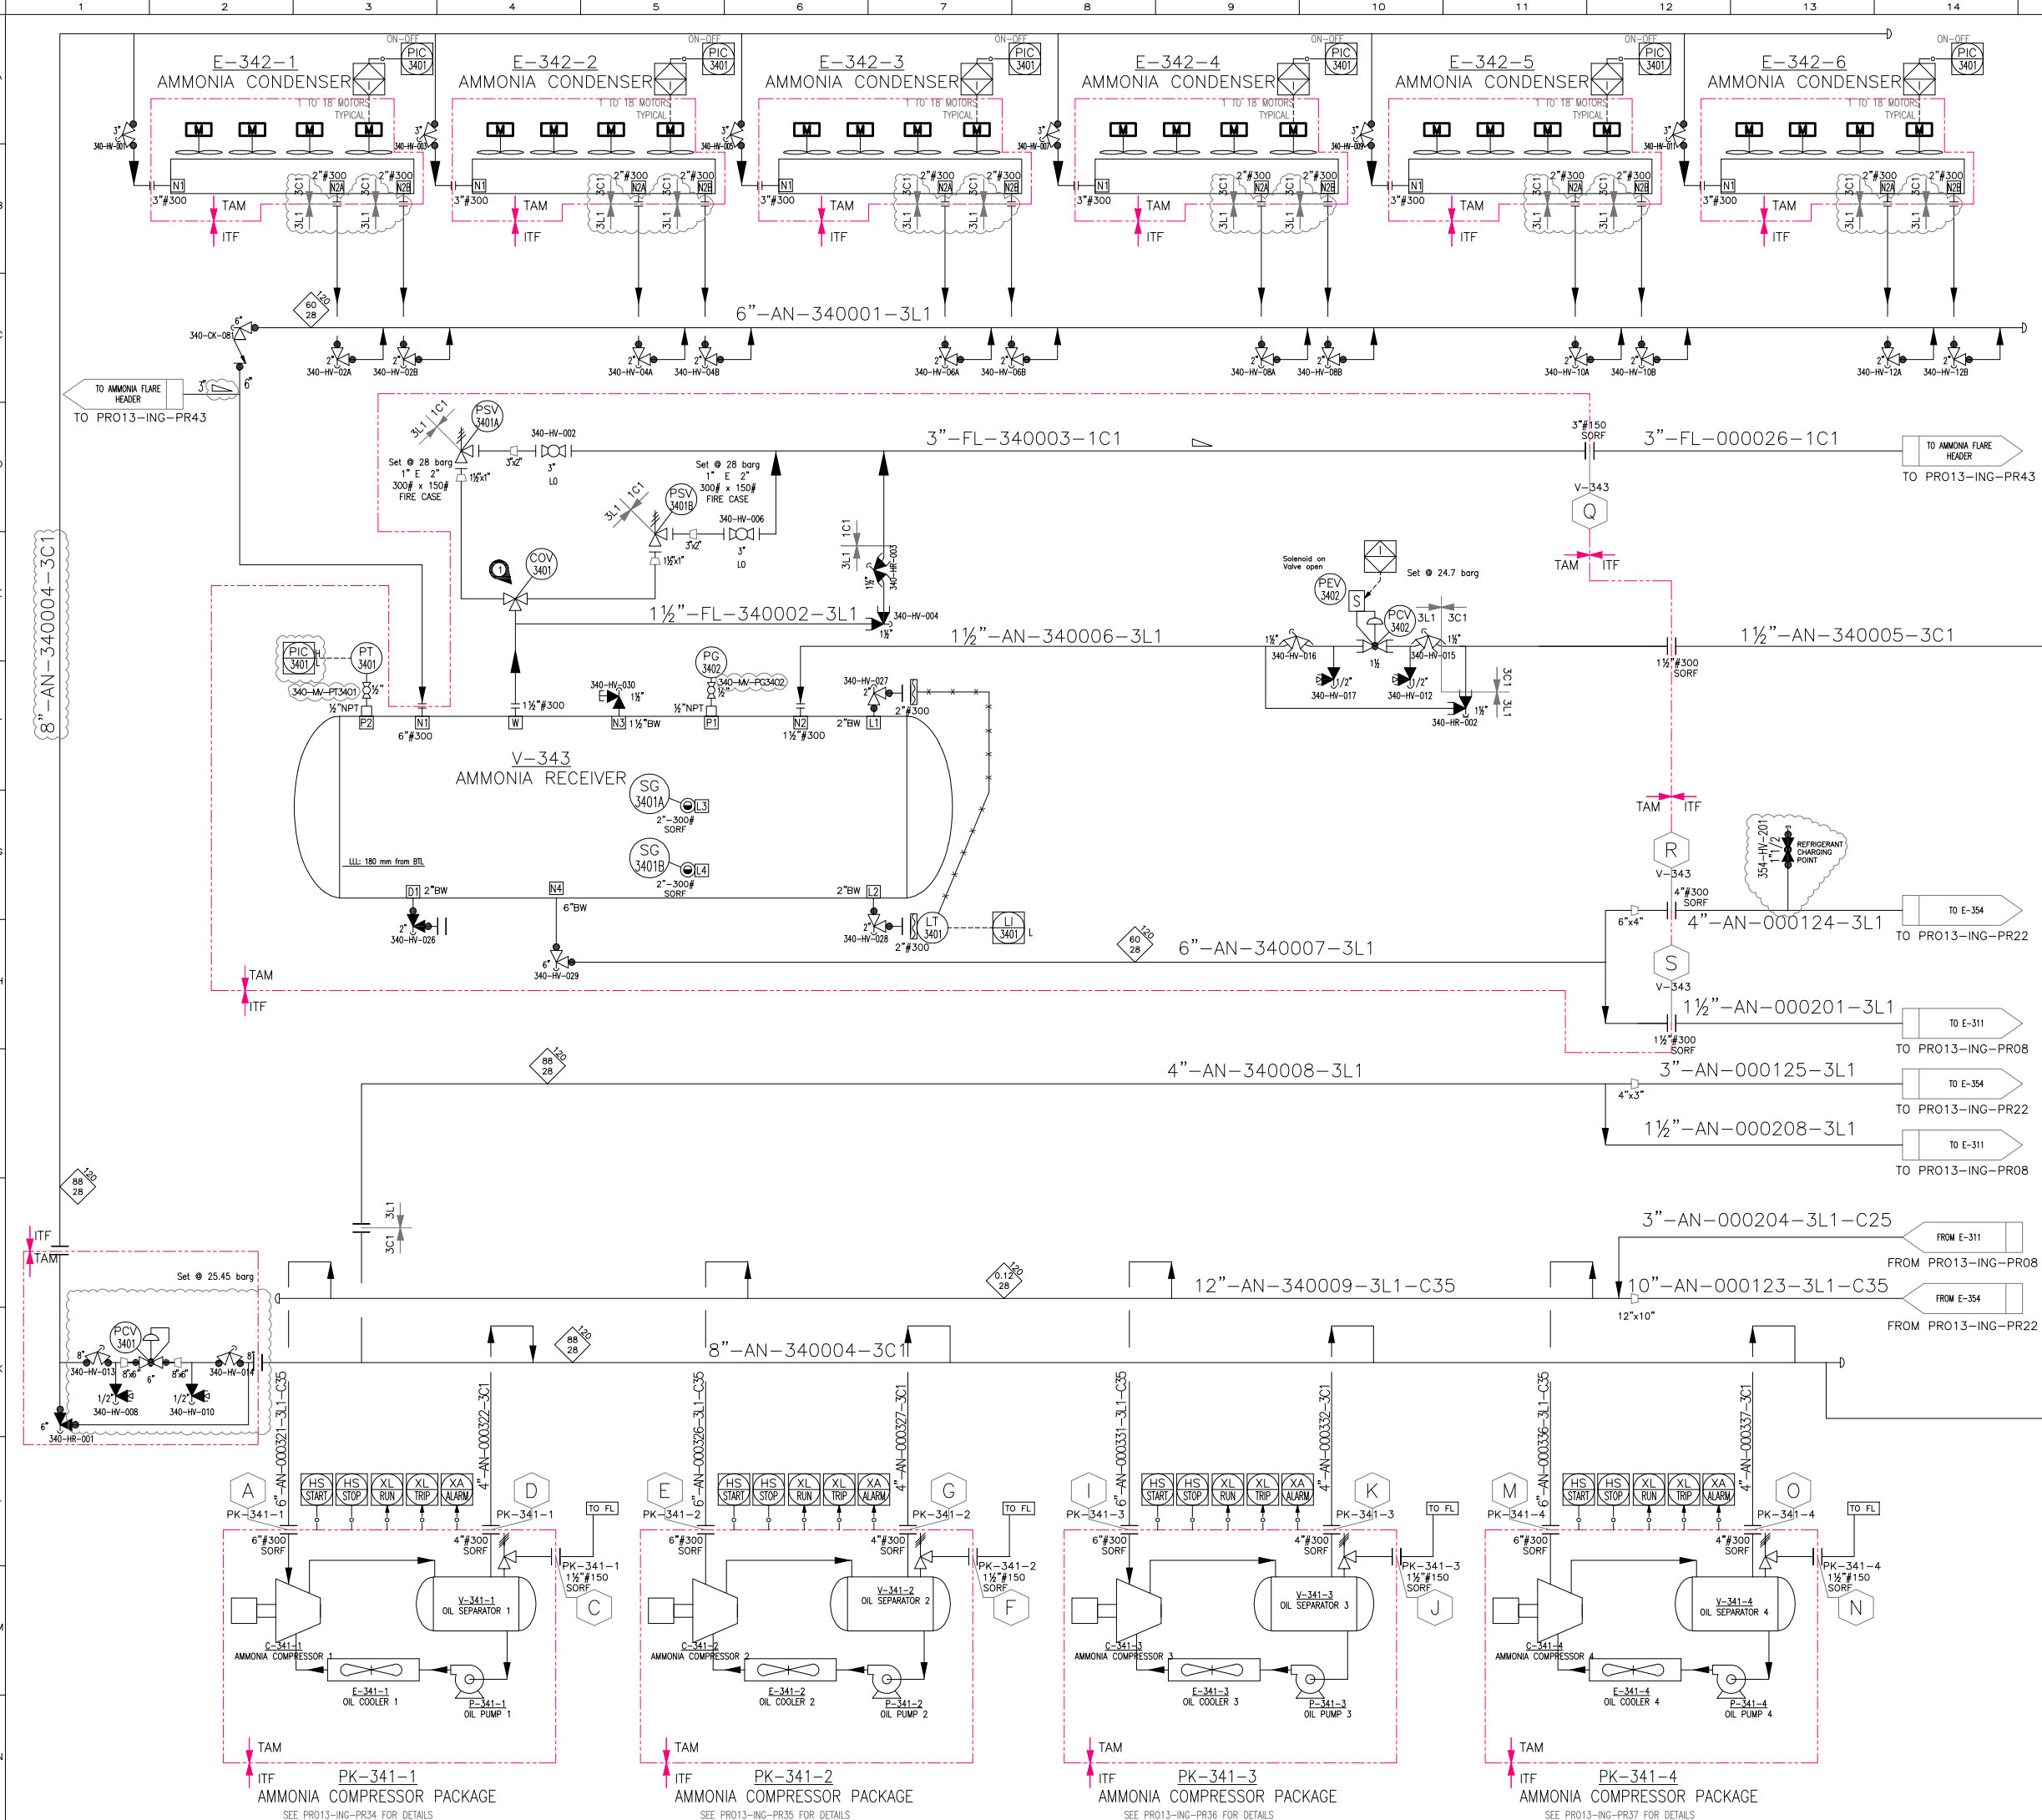

REFERENCE DOCUMENTS

P&ID LEGEND	PRO13-ING-PRO0
PROCESS FLOW DIAGRAM	21044-PR-PID-00000
UTILITY FLOW DIAGRAM	PRO10-ING-PRO7
MATERIAL SELECTION DIAGRAM	21044-PR-MSD-00001

V-343
AMMONIA RECEIVER

DESIGN PRESSURE	RV/28 bar g
DESIGN TEMPERATURE	-45/120 °C
INTERNAL DIAMETER	800 mm
TL TO TL	5000 mm
CORROSION ALLOWANCE	0 mm
INSULATION	NO
LINING/CLADDING	N.A.
MATERIAL	LTCS
INTERNAL VOLUME	2.5 m ³
INTERNAL ELEMENTS	---

E-342-1.6
AMMONIA CONDENSER

DESIGN DUTY	5116 kW
DESIGN PRES.	RV/28 bar g
DESIGN TEMP.	-45/120 °C
MATERIAL	304 tube / Al fin
CORR. ALL.	0 mm
FAN Qty	18 (each)
FAN RATED POWER each	4 kW
SURFACE AREA	HOLD m ²

F-342-1.6/1..18
FAN

SPEED	HOLD rpm
RATED CAPACITY	HOLD m ³ /h
ABSORBED POWER	3 kW

MF-342-1-1/1-18/.../6-1/6-18
FAN ELECTRIC MOTOR

SPEED	HOLD rpm
RATED POWER	4 kW
VOLTAGE	400 Vac
FREQUENCY	50 Hz
STARTING	DOL
ENCLOSURE PROTECTION	IP55
STD	IEC
FRAME SIZE	HOLD

PK-341-1.4
AMMONIA COMPRESSOR PACKAGE

TYPE	OIL FLOODED SCREW
MANUFACTURER	TECHNICAL GROUP

NOTES

1

CHANGE OVER VALVE WITH LOCK DEVICE

2

ALL INSTRUMENTS AND MANUAL VALVES ON THIS P&ID AND OUT OF SKID LIMITS WILL BE SUPPLIED BY TAM AS LOOSE ITEMS.

----- TAM SUPPLY LIMIT

7	03 Mar 2026	APPROVED FOR CONSTRUCTION	TAM (JB)	TAM (MM)	LOAMPLONE
6	12 Jun 2025	APPROVED FOR CONSTRUCTION	TAM (JB)	TAM (MM)	LOAMPLONE
5	24 Mar 2025	APPROVED FOR CONSTRUCTION	TAM (LD)	LOAMPLONE	W.BOUILLAI
4	24 Jun 2024	APPROVED FOR CONSTRUCTION	TAM (LD)	LOAMPLONE	W.BOUILLAI
3	18 Aug 2023	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUILLAI
2	08 Nov 2022	ISSUED FOR APPROVAL	TAM (LD)	LOAMPLONE	W.BOUILLAI
1	14 Jul 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUILLAI
0	30 Jun 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUILLAI

Customer:

MANAENERGY

Contractor:

ITALFLUID

Engineering:

ITALFLUID

Technology Vendor:

TECHNICAL AMERICA INC

Offices:

Mahaj Riad Center, Batiment 6, 3eme etage, Avenue Al Arz, Hay Ryad, 10100 Rabat, Morocco

Offices:

VIA VIVALDI,4 MONTESILVANO (ITALY)

Tel.+39 085 4224374 fax+39 085 4220742

Offices:

VIA VIVALDI,4 MONTESILVANO (ITALY)

Tel.+39 085 4224374 fax+39 085 4220742

Offices:

301 N Smith Avenue, 92880 Corona, California (USA)

Ph.+1 951 272 9540

TITLE:

LNG TENDRARA PLANT

OBJECT:

P&ID REFRIGERATION UNIT UNIT 340

TYPE	SCALE	DOCUMENTS ID:	VENDOR DOC. CODE	SHEET/OF
A1	N/A	PRO13-ING-PR38	21044-PR-PID-34005	1/1