


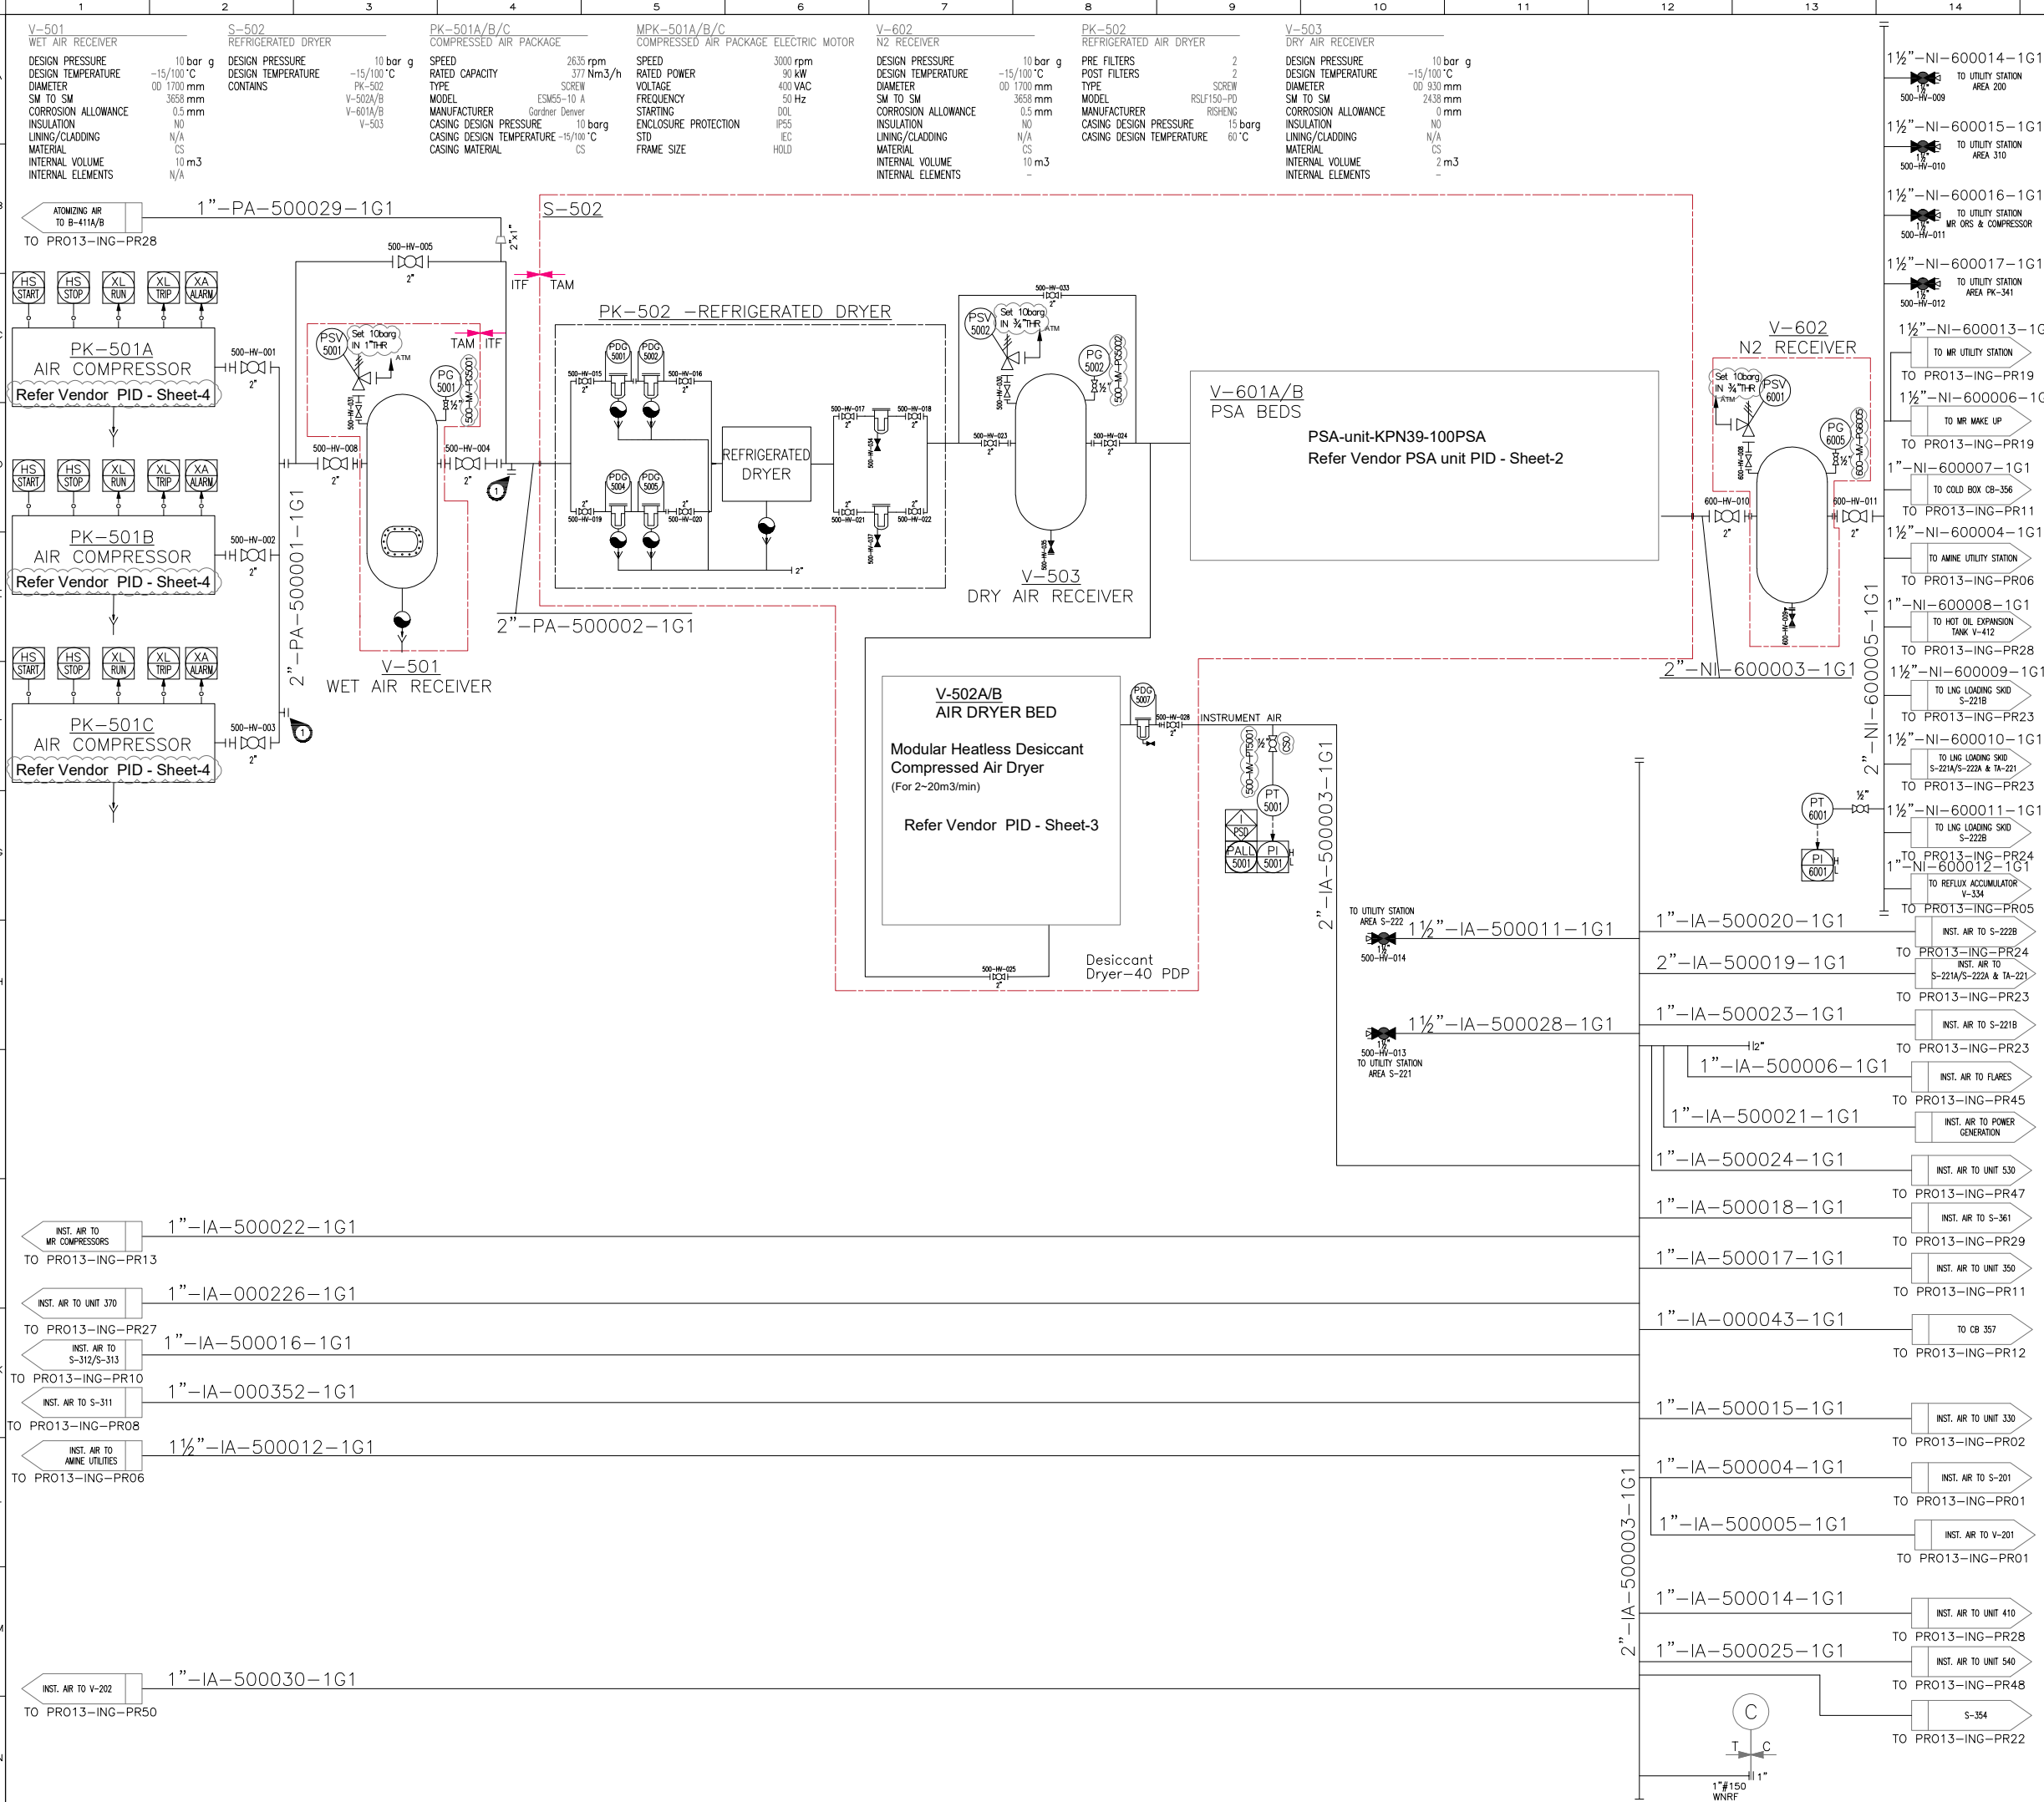

REFERENCE DOCUMENTS

P&ID LEGEND	PRO13-ING-PR00 21044-PR-PID-00000
PROCESS FLOW DIAGRAM	PRO10-ING-PR01/02/03/04 21044-PR-PFD-00001
UTILITY FLOW DIAGRAM	PRO10-ING-PR11 21044-PR-UFD-00001
MATERIAL SELECTION DIAGRAM	PRO08-ING-FR01 21044-PR-MSD-00001

NOTES

1


BLIND CONNECTIONS FOR INSTALLING AN ADDITIONAL WET AIR RECEIVER IF NECESSARY.

----- TAM SUPPLY LIMIT

Rev.	6	03 Apr 2026	APPROVED FOR CONSTRUCTION	TAM (JB)	TAM (MM)	LOAMPLONE
5	24 Jun 2024	APPROVED FOR CONSTRUCTION	TAM (LD)	LOAMPLONE	W.BOUJALI	
4	18 Aug 2023	ISSUED FOR APPROVAL	TAM (LD)	LOAMPLONE	W.BOUJALI	
3	02 Nov 2022	ISSUED FOR APPROVAL	TAM (LD)	LOAMPLONE	W.BOUJALI	
2	26 Jul 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUJALI	
1	08 Jul 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUJALI	
0	30 Jun 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUJALI	
Rev.	Date	Description	Draft	Check'd	Approved	
Customer: MANAENERGY			OFFICES: Mahaj Riad Center, Batiment 6, 3eme etage, Avenue Al Az, Hay Ryad, 10100 Rabat, Morocco			
Contractor: ITALFLUID			OFFICES: VIA VIVALDI,4 MONTESILVANO (ITALY) Tel.+39 085 4224374 fax+39 085 4220742			
Engineering: ITALFLUID			OFFICES: VIA VIVALDI,4 MONTESILVANO (ITALY) Tel.+39 085 4224374 fax+39 085 4220742			
Technology Vendor: TECHNICAL AMERICA INC			OFFICES: 301 N Smith Avenue, 92880 Corona, California (USA) Ph.+1 951 272 9540			
TITLE: LNG TENDRARA PLANT			OBJECT: P&ID AIR/NITROGEN - UNIT 500/600			
TYPE	SCALE	DOCUMENTS ID:	VENDOR DOC. CODE		SHEET/OF	
A1	N/A	PRO13-ING-PR39	21044-PR-PID-50001		1/4	


Documento di proprietà aziendale. La Società tutela i propri diritti a termine di legge.

This document is Company property. The Company lawfully reserves all rights.

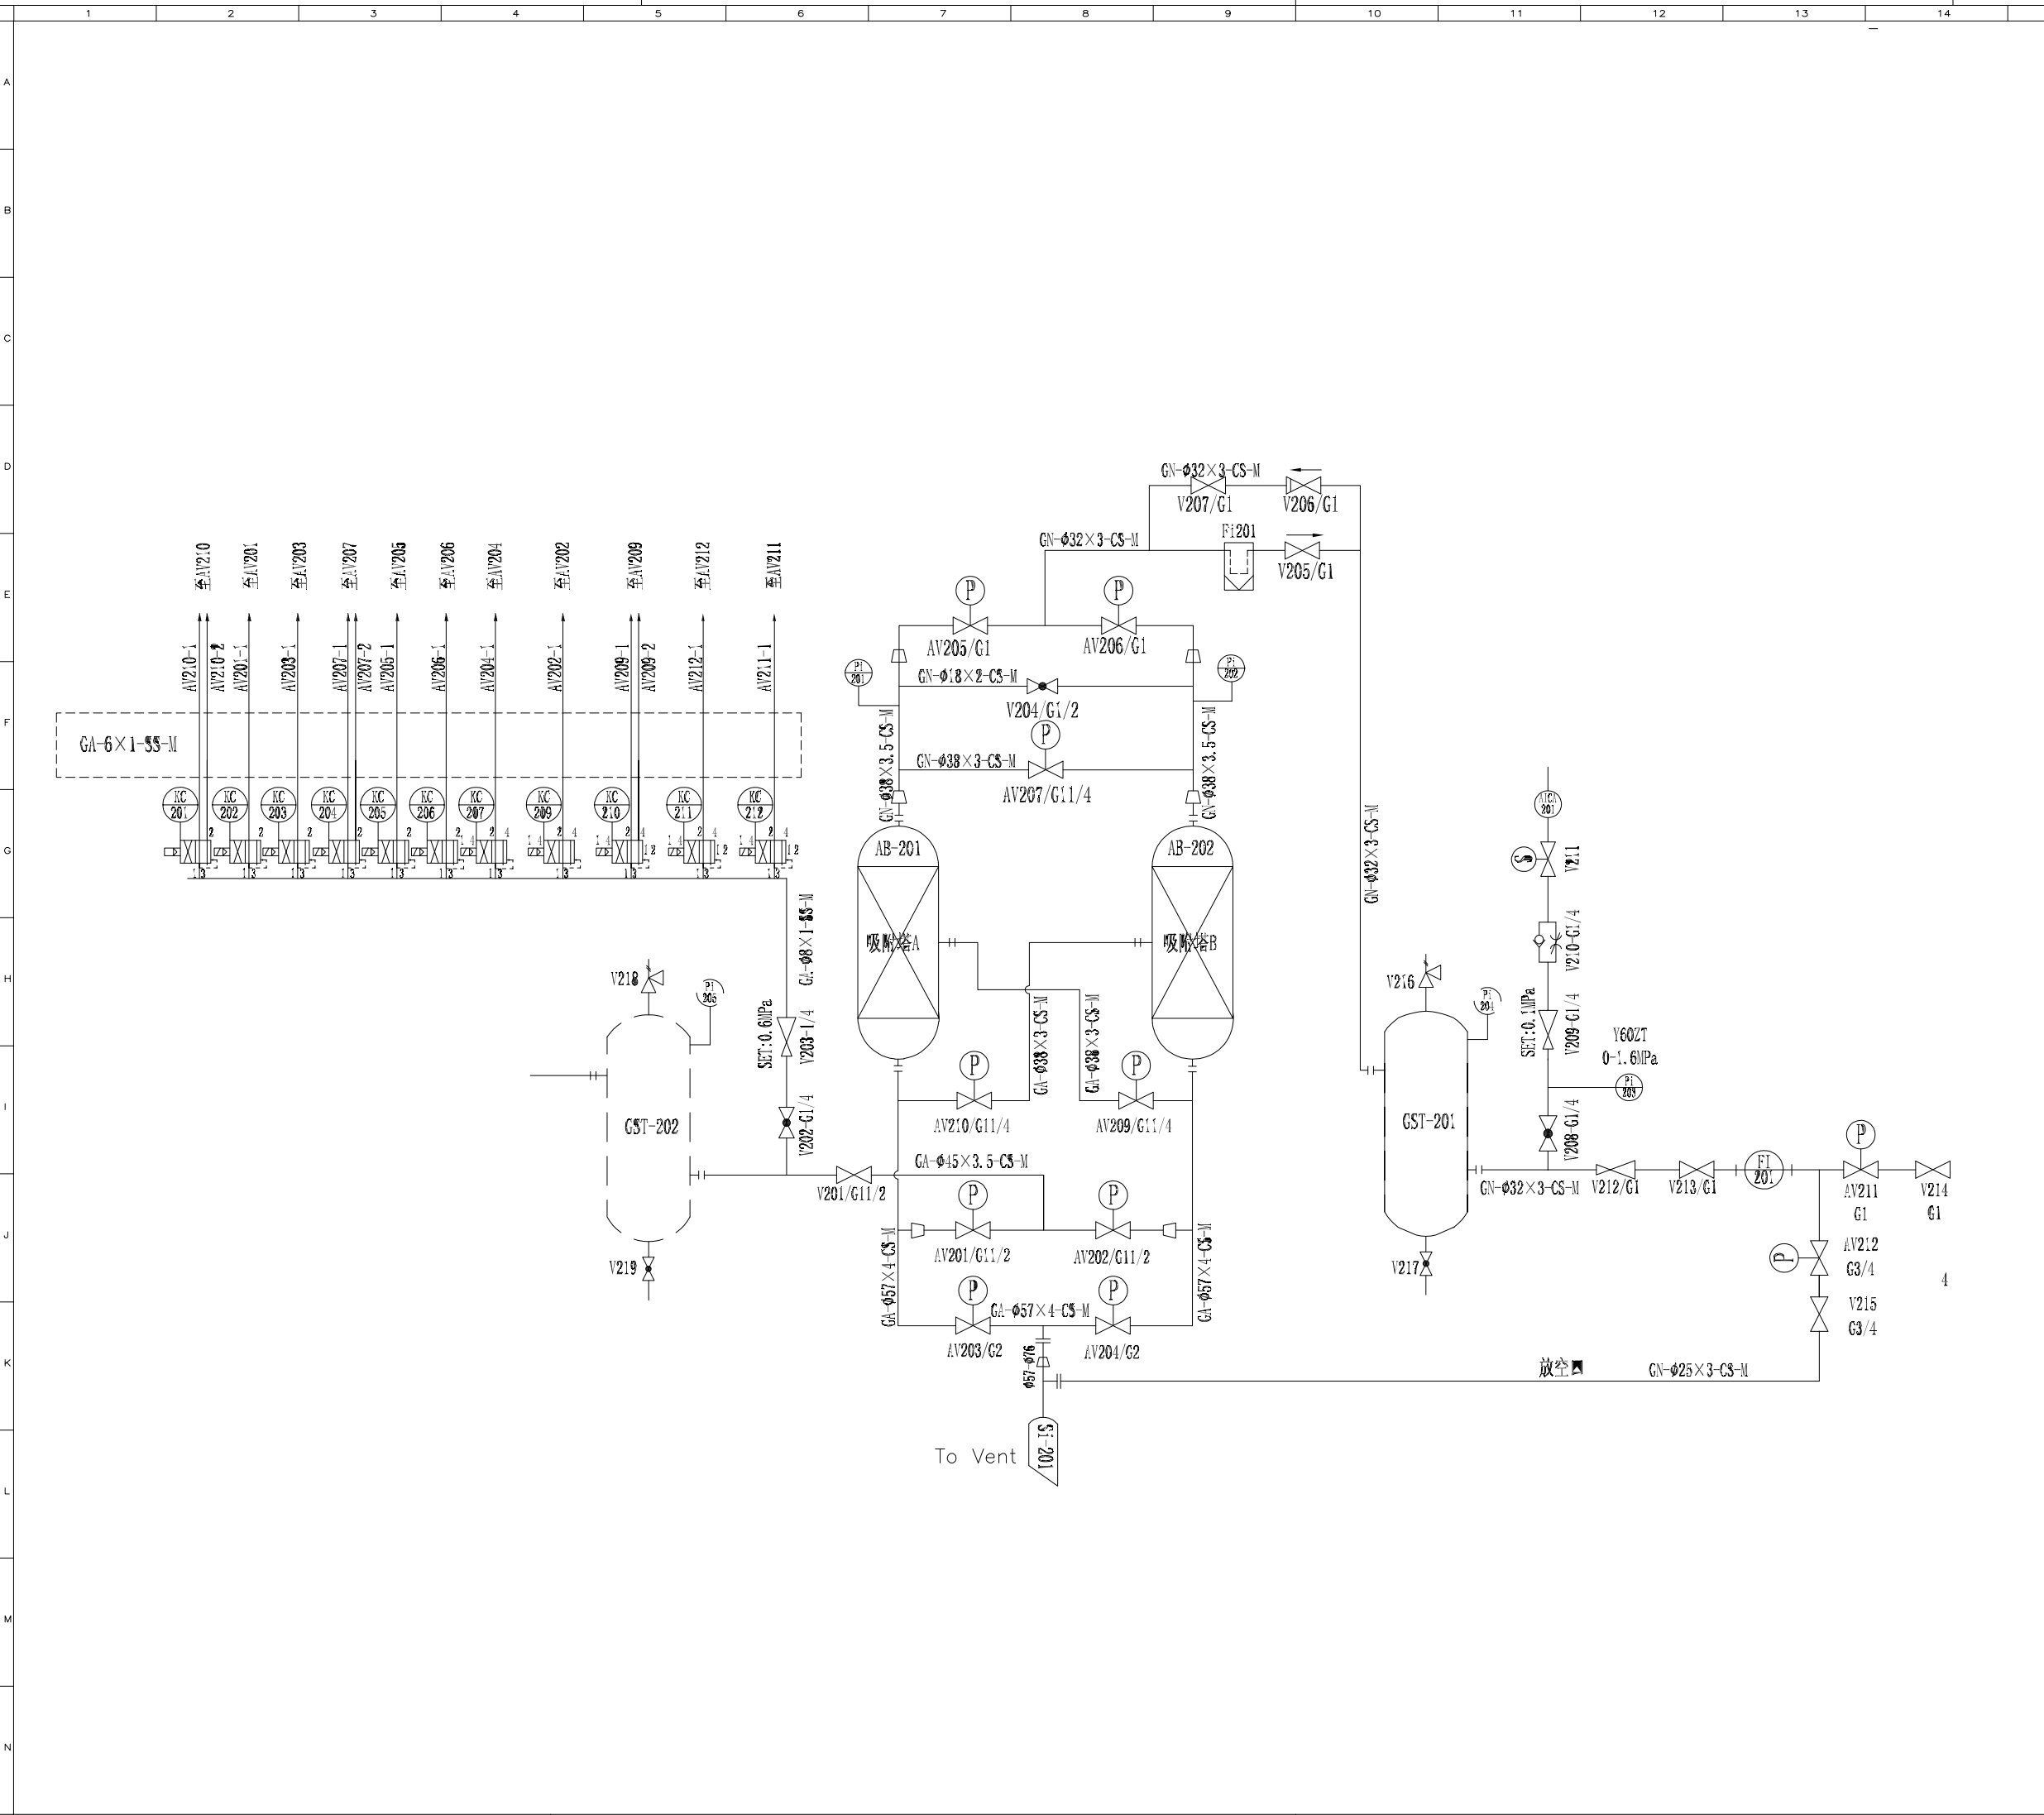

15		16		17		18					
REFERENCE DOCUMENTS											
P&ID LEGEND				PRO13-ING-PROO 21044-PR-PID-00000							
PROCESS FLOW DIAGRAM				PRO10-ING-PRO1/02/03/04 21044-PR-PFD-00001							
UTILITY FLOW DIAGRAM				PRO10-ING-PR11 21044-PR-UFD-00001							
MATERIAL SELECTION DIAGRAM				PRO08-ING-FR01 21044-PR-MSD-00001							
NOTES 1 BLIND CONNECTIONS FOR INSTALLING AN ADDITIONAL WET AIR RECEIVER IF NECESSARY. Technical characteristics: 1. Gas volume: 100 Nm3/h 2. Nitrogen purity: 99.9% 3. Power: 0.2 kw 4. Working pressure: 7-7.5 bar 5. Working temperature: normal temperature											
6		03 Apr 2026		APPROVED FOR CONSTRUCTION		TAM (JB)		TAM (MM)		LOAMPLONE	
5		24 Jun 2024		APPROVED FOR CONSTRUCTION		TAM (LD)		LOAMPLONE		W.BOUALAI	
4		18 Aug 2023		ISSUED FOR APPROVAL		TAM (LD)		LOAMPLONE		W.BOUALAI	
3		02 Nov 2022		ISSUED FOR APPROVAL		TAM (LD)		LOAMPLONE		W.BOUALAI	
2		26 Jul 2022		ISSUED FOR APPROVAL		TAM (ES)		LOAMPLONE		W.BOUALAI	
1		08 Jul 2022		ISSUED FOR APPROVAL		TAM (ES)		LOAMPLONE		W.BOUALAI	
0		30 Jun 2022		ISSUED FOR APPROVAL		TAM (ES)		LOAMPLONE		W.BOUALAI	
Rev.		Date		Description		Draft		Check'd		Approved	
Customer:				MANAENERGY				OFFICES:			
								Mahaj Riad Center, Batiment 6, 3eme etage, Avenue Al Arz, Hay Ryad, 10100 Rabat, Morocco			
Contractor:				ITALFLUID				OFFICES:			
								VIA VIVALDI,4 Tel.+39 085 4224374 fax+39 085 4220742			
Engineering:				ITALFLUID				OFFICES:			
								VIA VIVALDI,4 Tel.+39 085 4224374 fax+39 085 4220742			
Technology Vendor:				TECHNICAL AMERICA INC				OFFICES:			
								301 N Smith Avenue, 92880 Corona, California (USA) Ph.+1 951 272 9540			
TITLE:						OBJECT:					
LNG TENDRARA PLANT						P&ID AIR/NITROGEN - UNIT 500/600					
TYPE		SCALE		DOCUMENTS ID:		VENDOR DOC. CODE		SHEET/OF			
A1		N/A		PRO13-ING-PR39		21044-PR-PID-50001		2/4			

Modular Heatless Desiccant Compressed Air Dryer
(For 2~20m3/min)

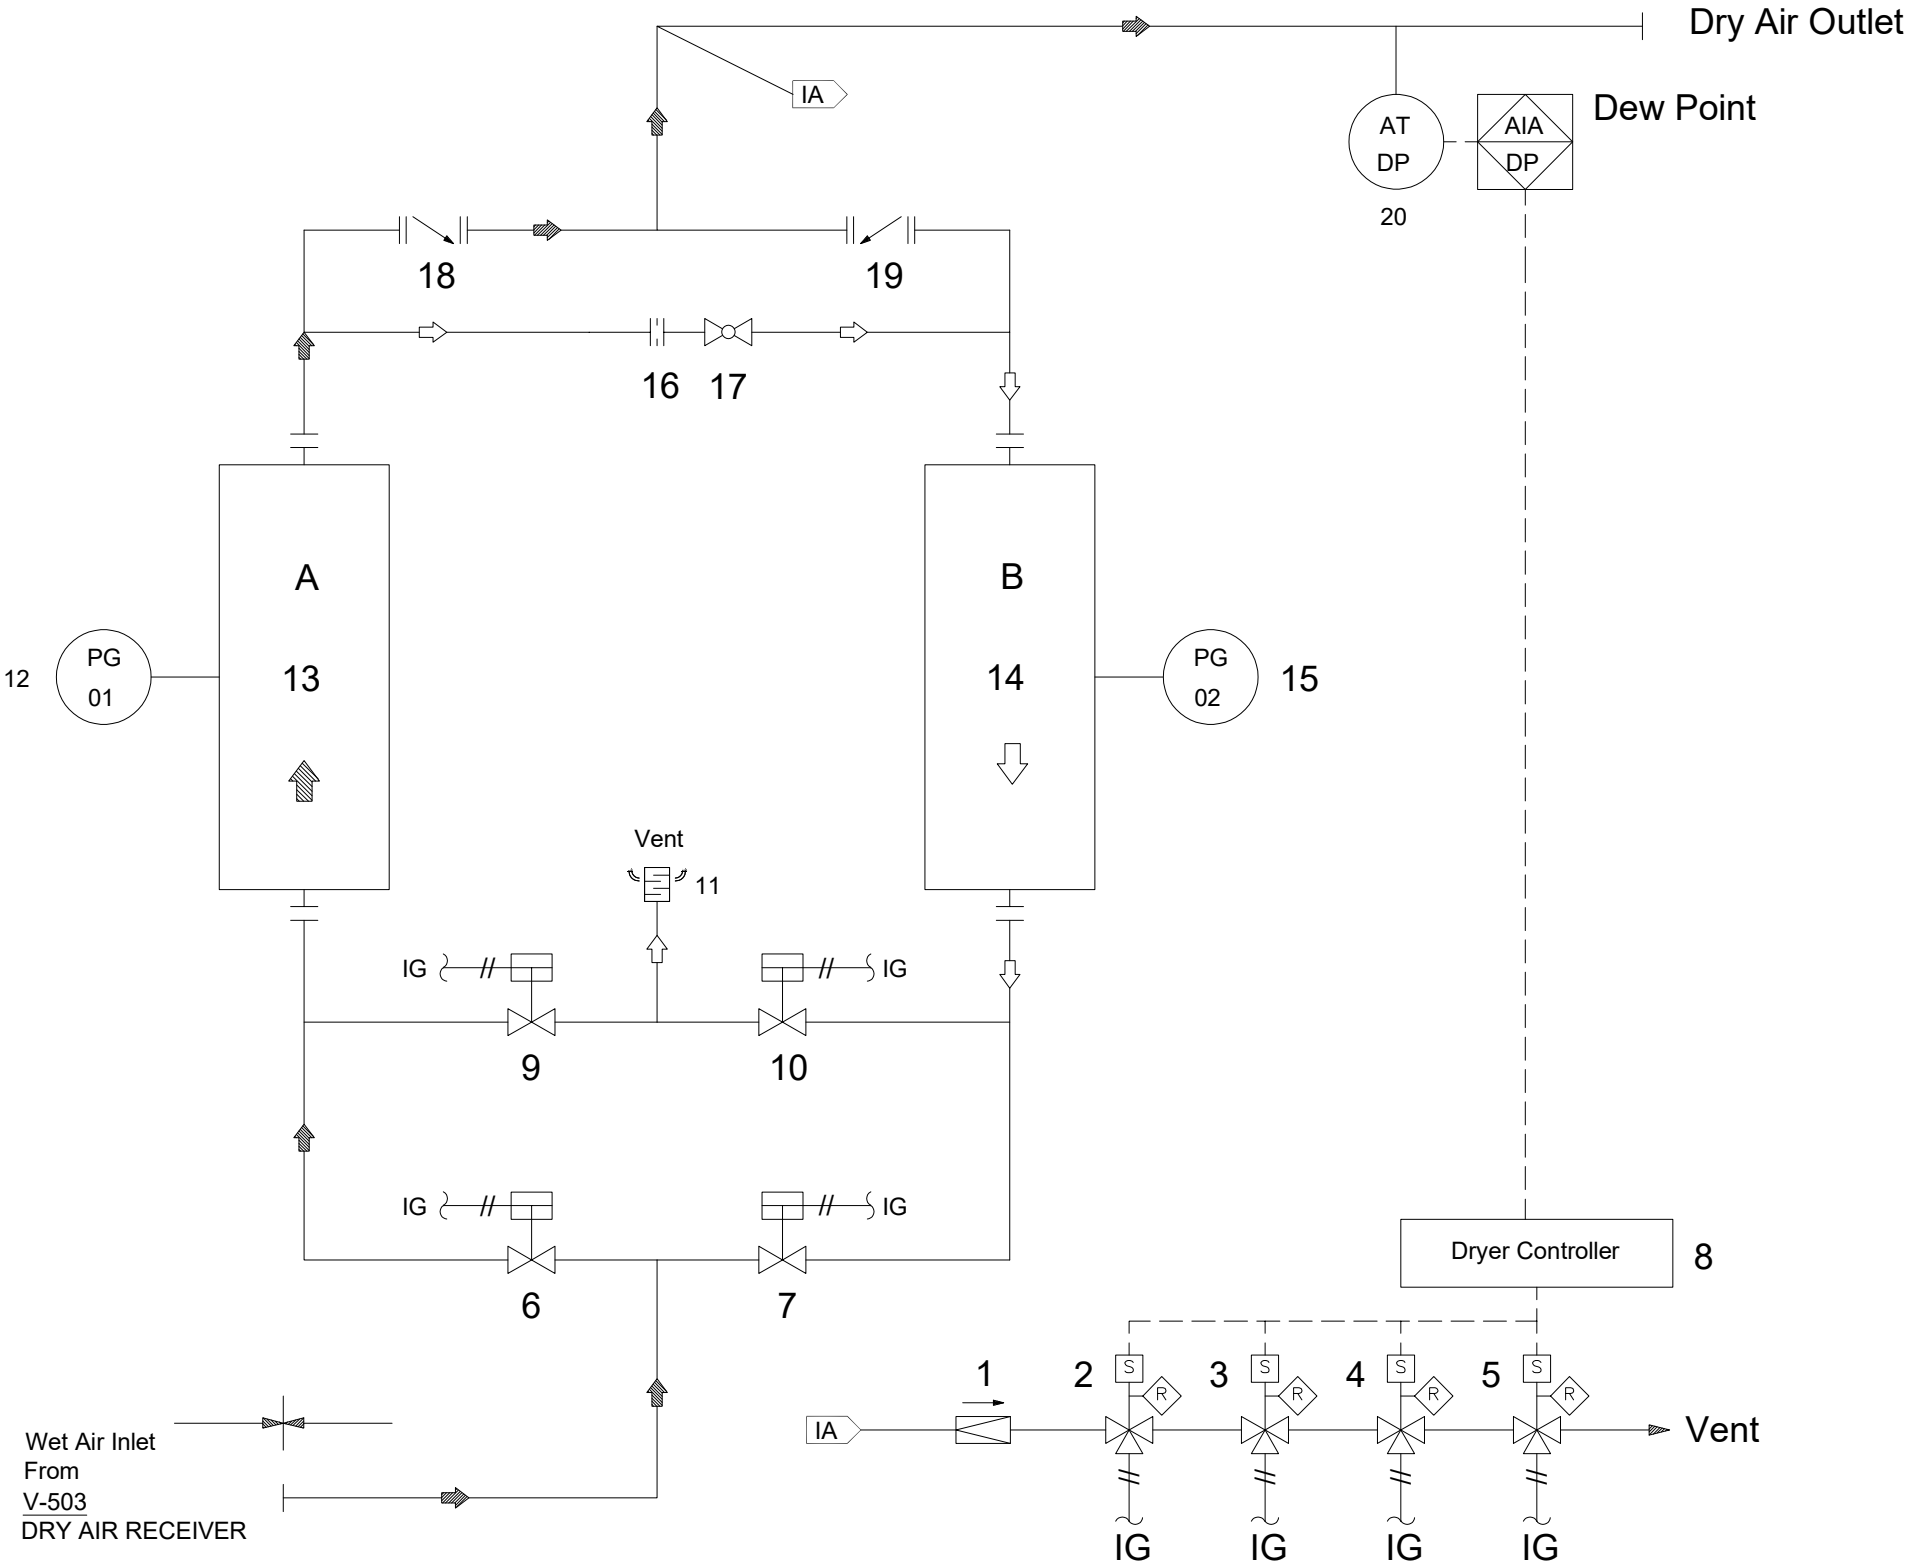

Note :
Some of the optional part are only applicable for specific PLC control option only. For more details, please consult the manufacturer.

REFERENCE DOCUMENTS	
P&ID LEGEND	PRO13-ING-PRO0 21044-PR-PID-00000
PROCESS FLOW DIAGRAM	PRO10-ING-PRO1/02/03/04 21044-PR-PFD-00001
UTILITY FLOW DIAGRAM	PRO10-ING-PR11 21044-PR-UFD-00001
MATERIAL SELECTION DIAGRAM	PRO08-ING-FR01 21044-PR-MSD-00001

NOTES

BLIND CONNECTIONS FOR INSTALLING AN
ADDITIONAL WET AIR RECEIVER IF NECESSARY.


Arrow Symbols :

Adsorption
Regeneration

Supply
120-220V/1Ph/50-60Hz

Tag. No.	Parts List
Y-01	1. Pressure Regulator
SV1	2. Solenoid Valve
SV2	3. Solenoid Valve
SV3	4. Solenoid Valve
SV4	5. Solenoid Valve
A2	6. Pneumatic Valve
A1	7. Pneumatic Valve
B1	8. Dryer Controller
B2	9. Pneumatic Valve
B2	10. Pneumatic Valve
B2	11. Exhaust Silencer
PG-01	12. Pressure Gauge
PG-01	13. Left Tower
PG-02	14. Right Tower
PG-02	15. Pressure Gauge
PG-02	16. Orifice
PG-02	17. Manual Ball Valve
PG-02	18. Check Valve
PG-02	19. Check Valve
[Option]	20. Dew Point Sensor

6	03 Apr 2026	APPROVED FOR CONSTRUCTION	TAM (JB)	TAM (MM)	LOAMPLONE
5	24 Jun 2024	APPROVED FOR CONSTRUCTION	TAM (LD)	LOAMPLONE	W.BOUALAI
4	18 Aug 2023	ISSUED FOR APPROVAL	TAM (LD)	LOAMPLONE	W.BOUALAI
3	02 Nov 2022	ISSUED FOR APPROVAL	TAM (LD)	LOAMPLONE	W.BOUALAI
2	26 Jul 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUALAI
1	08 Jul 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUALAI
0	30 Jun 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUALAI
Rev.	Date	Description	Draft	Check'd	Approved
Customer:		MANAENERGY	OFFICES: Mahaj Riad Center, Batiment 6, 3eme etage, Avenue Al Az, Hay Ryad, 10100 Rabat, Morocco		
Contractor:		ITALFLUID	OFFICES: VIA VIVALDI,4 Tel.+39 085 4224374 fax+39 085 4220742		
Engineering:		ITALFLUID	OFFICES: VIA VIVALDI,4 Tel.+39 085 4224374 fax+39 085 4220742		
Technology Vendor:		TECHNICAL AMERICA INC	OFFICES: 301 N Smith Avenue, 92880 Corona, California (USA) Ph.+1 951 272 9540		
TITLE:		LNG TENDRARA PLANT	OBJECT: P&ID AIR/NITROGEN – UNIT 500/600		
TYPE	SCALE	DOCUMENTS ID:	VENDOR DOC. CODE		SHEET/OF
A1	N/A	PRO13-ING-PR39	21044-PR-PID-50001		3/4

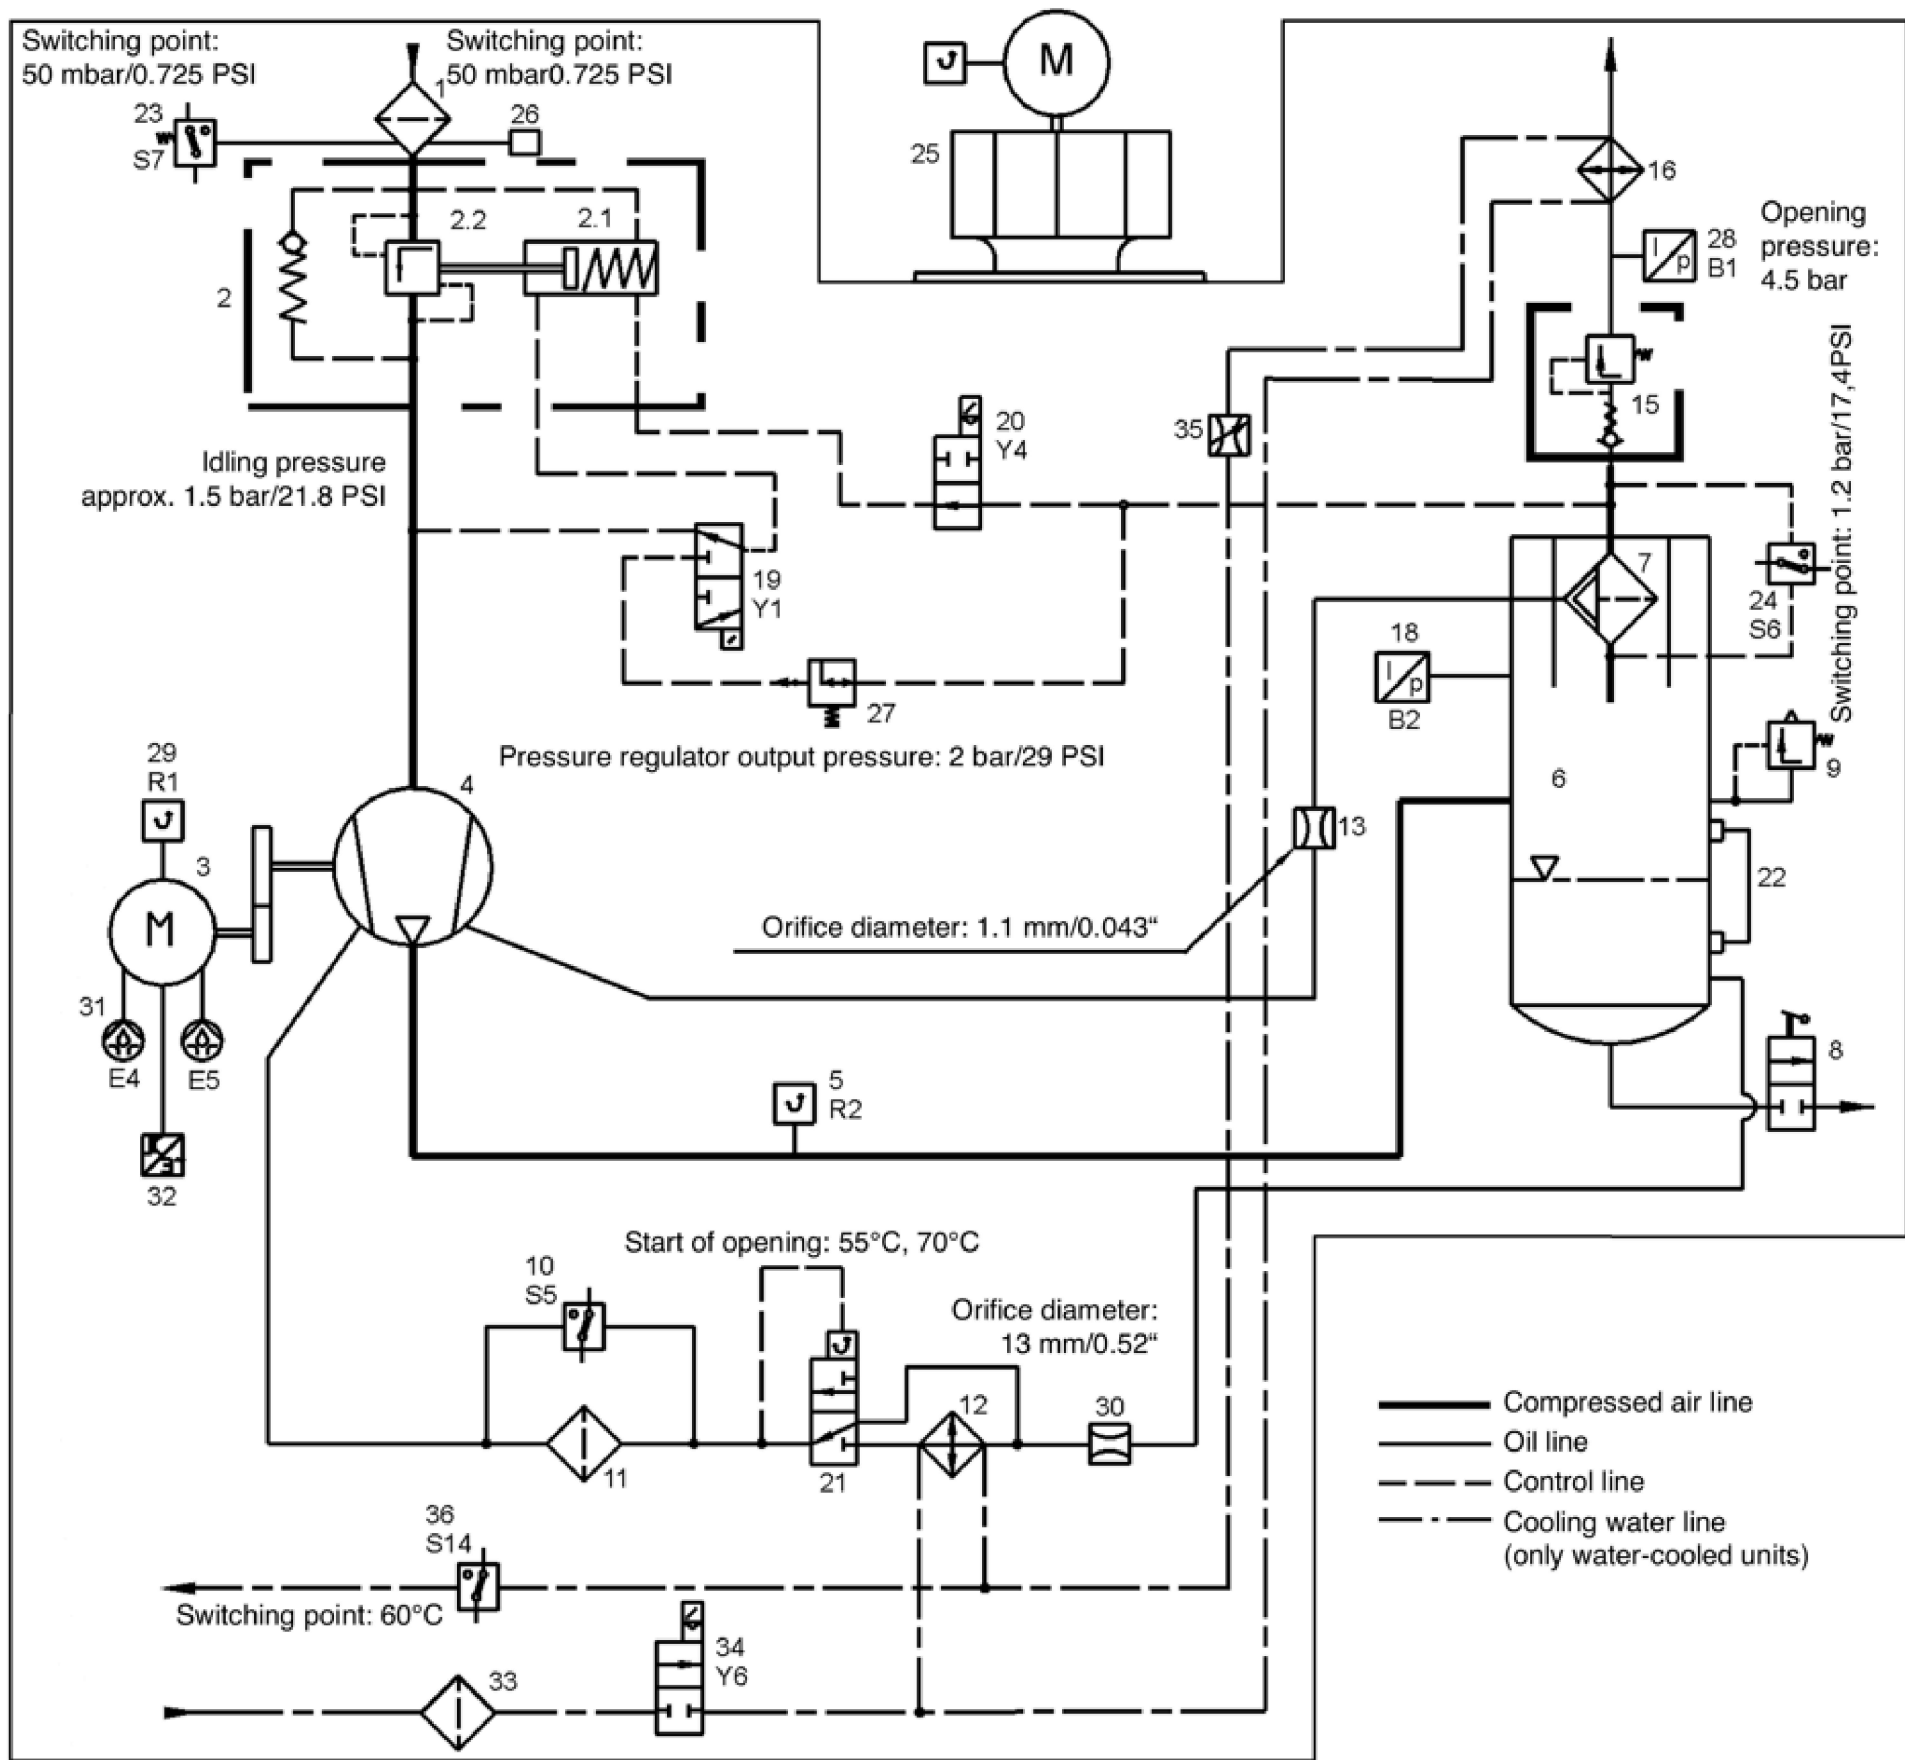

- | | | |
|---|---|---|
| 1 Intake filter | 10 Oil filter monitor (S5) (Option) | 21 Oil temperature regulator |
| 2 Intake regulator | 11 Oil filter | 22 Oil level indicator |
| 2.1 Actuator | 12 Oil cooler | 23 Intake filter monitor (S7) (Option) |
| 2.2 Throttle valve | 13 Throttle | 24 Fine separator monitor (S6) (Option) |
| 3 Electric motor | 15 Pressure holding and check valve | 25 Cooling air ventilator |
| 4 Compressor | 16 Compressed air after-cooler | 26 Intake monitor, visual |
| 5 Final compression temperature sensor (R2) | 18 Final compression pressure sensor (B2) | 27 Pressure regulator |
| 6 Pressure reservoir | 19 3/2-way solenoid valve (control valve) (Y1) | 28 Network pressure sensor (B1) |
| 7 Fine separator | 20 2/2-way solenoid valve (Blow-off valve) (Y4) | 29 Motor temperature (R1) |
| 8 Oil drain | | 30 Oil flow throttle |
| 9 Safety valve | | 31 Motor lubrication system E4, E5 |

- | |
|--|
| 32 Frequency converter (only VS 55-VS 75) |
| 33 Dirt interceptor (only watercooled units) |
| 34 Cooling-water solenoid valve (Y6) (only water-cooled units) |
| 35 Manual regulating valve (only water-cooled units) |
| 36 Monitoring cooling-water temperature (S14) (only watercooled units) |

REFERENCE DOCUMENTS

P&ID LEGEND	PRO13-ING-PRO0
PROCESS FLOW DIAGRAM	21044-PR-PID-00000
UTILITY FLOW DIAGRAM	PRO10-ING-PR01/02/03/04
MATERIAL SELECTION DIAGRAM	21044-PR-PFD-00001
	PRO10-ING-PR11
	21044-PR-UFD-00001
	PRO08-ING-FR01
	21044-PR-MSD-00001

NOTES

- BLIND CONNECTIONS FOR INSTALLING AN ADDITIONAL WET AIR RECEIVER IF NECESSARY.

6	03 Apr 2026	APPROVED FOR CONSTRUCTION	TAM (JB)	TAM (MM)	LOAMPLONE
5	24 Jun 2024	APPROVED FOR CONSTRUCTION	TAM (LD)	LOAMPLONE	W.BOUALAI
4	18 Aug 2023	ISSUED FOR APPROVAL	TAM (LD)	LOAMPLONE	W.BOUALAI
3	02 Nov 2022	ISSUED FOR APPROVAL	TAM (LD)	LOAMPLONE	W.BOUALAI
2	26 Jul 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUALAI
1	08 Jul 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUALAI
0	30 Jun 2022	ISSUED FOR APPROVAL	TAM (ES)	LOAMPLONE	W.BOUALAI
Rev.	Date	Description	Draft	Check'd	Approved
Customer: MANAENERGY			OFFICES: Mahaj Riad Center, Batiment 6, 3eme etage, Avenue Al Az, Hay Ryad, 10100 Rabat, Morocco		
Contractor: ITALFLUID			OFFICES: VIA VIVALDI,4 MONTESILVANO (ITALY) Tel.+39 085 4224374 fax+39 085 4220742		
Engineering: ITALFLUID			OFFICES: VIA VIVALDI,4 MONTESILVANO (ITALY) Tel.+39 085 4224374 fax+39 085 4220742		
Technology Vendor: TECHNICAL AMERICA INC			OFFICES: 301 N Smith Avenue, 92880 Corona, California (USA) Ph.+1 951 272 9540		
TITLE: LNG TENDRARA PLANT			OBJECT: P&ID AIR/NITROGEN - UNIT 500/600		
TYPE	SCALE	DOCUMENTS ID:	VENDOR DOC. CODE		SHEET/OF
A1	N/A	PRO13-ING-PR39	21044-PR-PID-50001		4/4