


E-335
AMINE REFLUX CONDENSER
DESIGN DUTY 1024 kW
DESIGN PRES. 5 bar g
DESIGN TEMP. -15/200 °C
MATERIAL SS304
CORR. ALL. 0 mm
FAN Qty 8
FAN RATED POWER each HOLD kW
SURFACE AREA HOLD m2

MF-335-1..8
AMINE REFLUX CONDENSER FAN ELECTRIC MOTORS
SPEED HOLD rpm
RATED POWER HOLD kW
VOLTAGE 400 Vac
FREQUENCY 50 Hz
STARTING DOL
ENCLOSURE PROTECTION IP54 min IEC
STD IEC
FRAME SIZE HOLD
F-335-1..8
FAN
SPEED HOLD rpm
RATED CAPACITY HOLD m3/h
ABSORBED POWER HOLD kW

V-334
REFLUX ACCUMULATOR
DESIGN PRESSURE 5 bar g
DESIGN TEMPERATURE -15/200 °C
INTERNAL DIAMETER 900 mm
TL TO TL 3000 mm
CORROSION ALLOWANCE 0 mm
INSULATION NO
LINING/CLADDING N/A
MATERIAL SS304
INTERNAL VOLUME 2.1 m3
INTERNAL ELEMENTS NO

P-334A/B
AMINE REGENERATOR REFLUX PUMPS
SPEED HOLD rpm
RATED CAPACITY 2 m3/h
HEAD 2 bar
TYPE Volumetric
MANUFACTURER HOLD
CASING DESIGN PRESSURE 5 barg
CASING DESIGN TEMPERATURE -15/160 °C
MODEL
ABS POWER 1.3 kW
CASING MATERIAL SS316

MP-334A/B
AMINE REGENERATOR REFLUX PUMPS ELECTRIC MOTORS
SPEED HOLD rpm
RATED POWER 1.5 kW
VOLTAGE 690 VAC
FREQUENCY 50 Hz
STARTING VFD
ENCLOSURE PROTECTION IP54 min IEC
STD IEC
FRAME SIZE HOLD

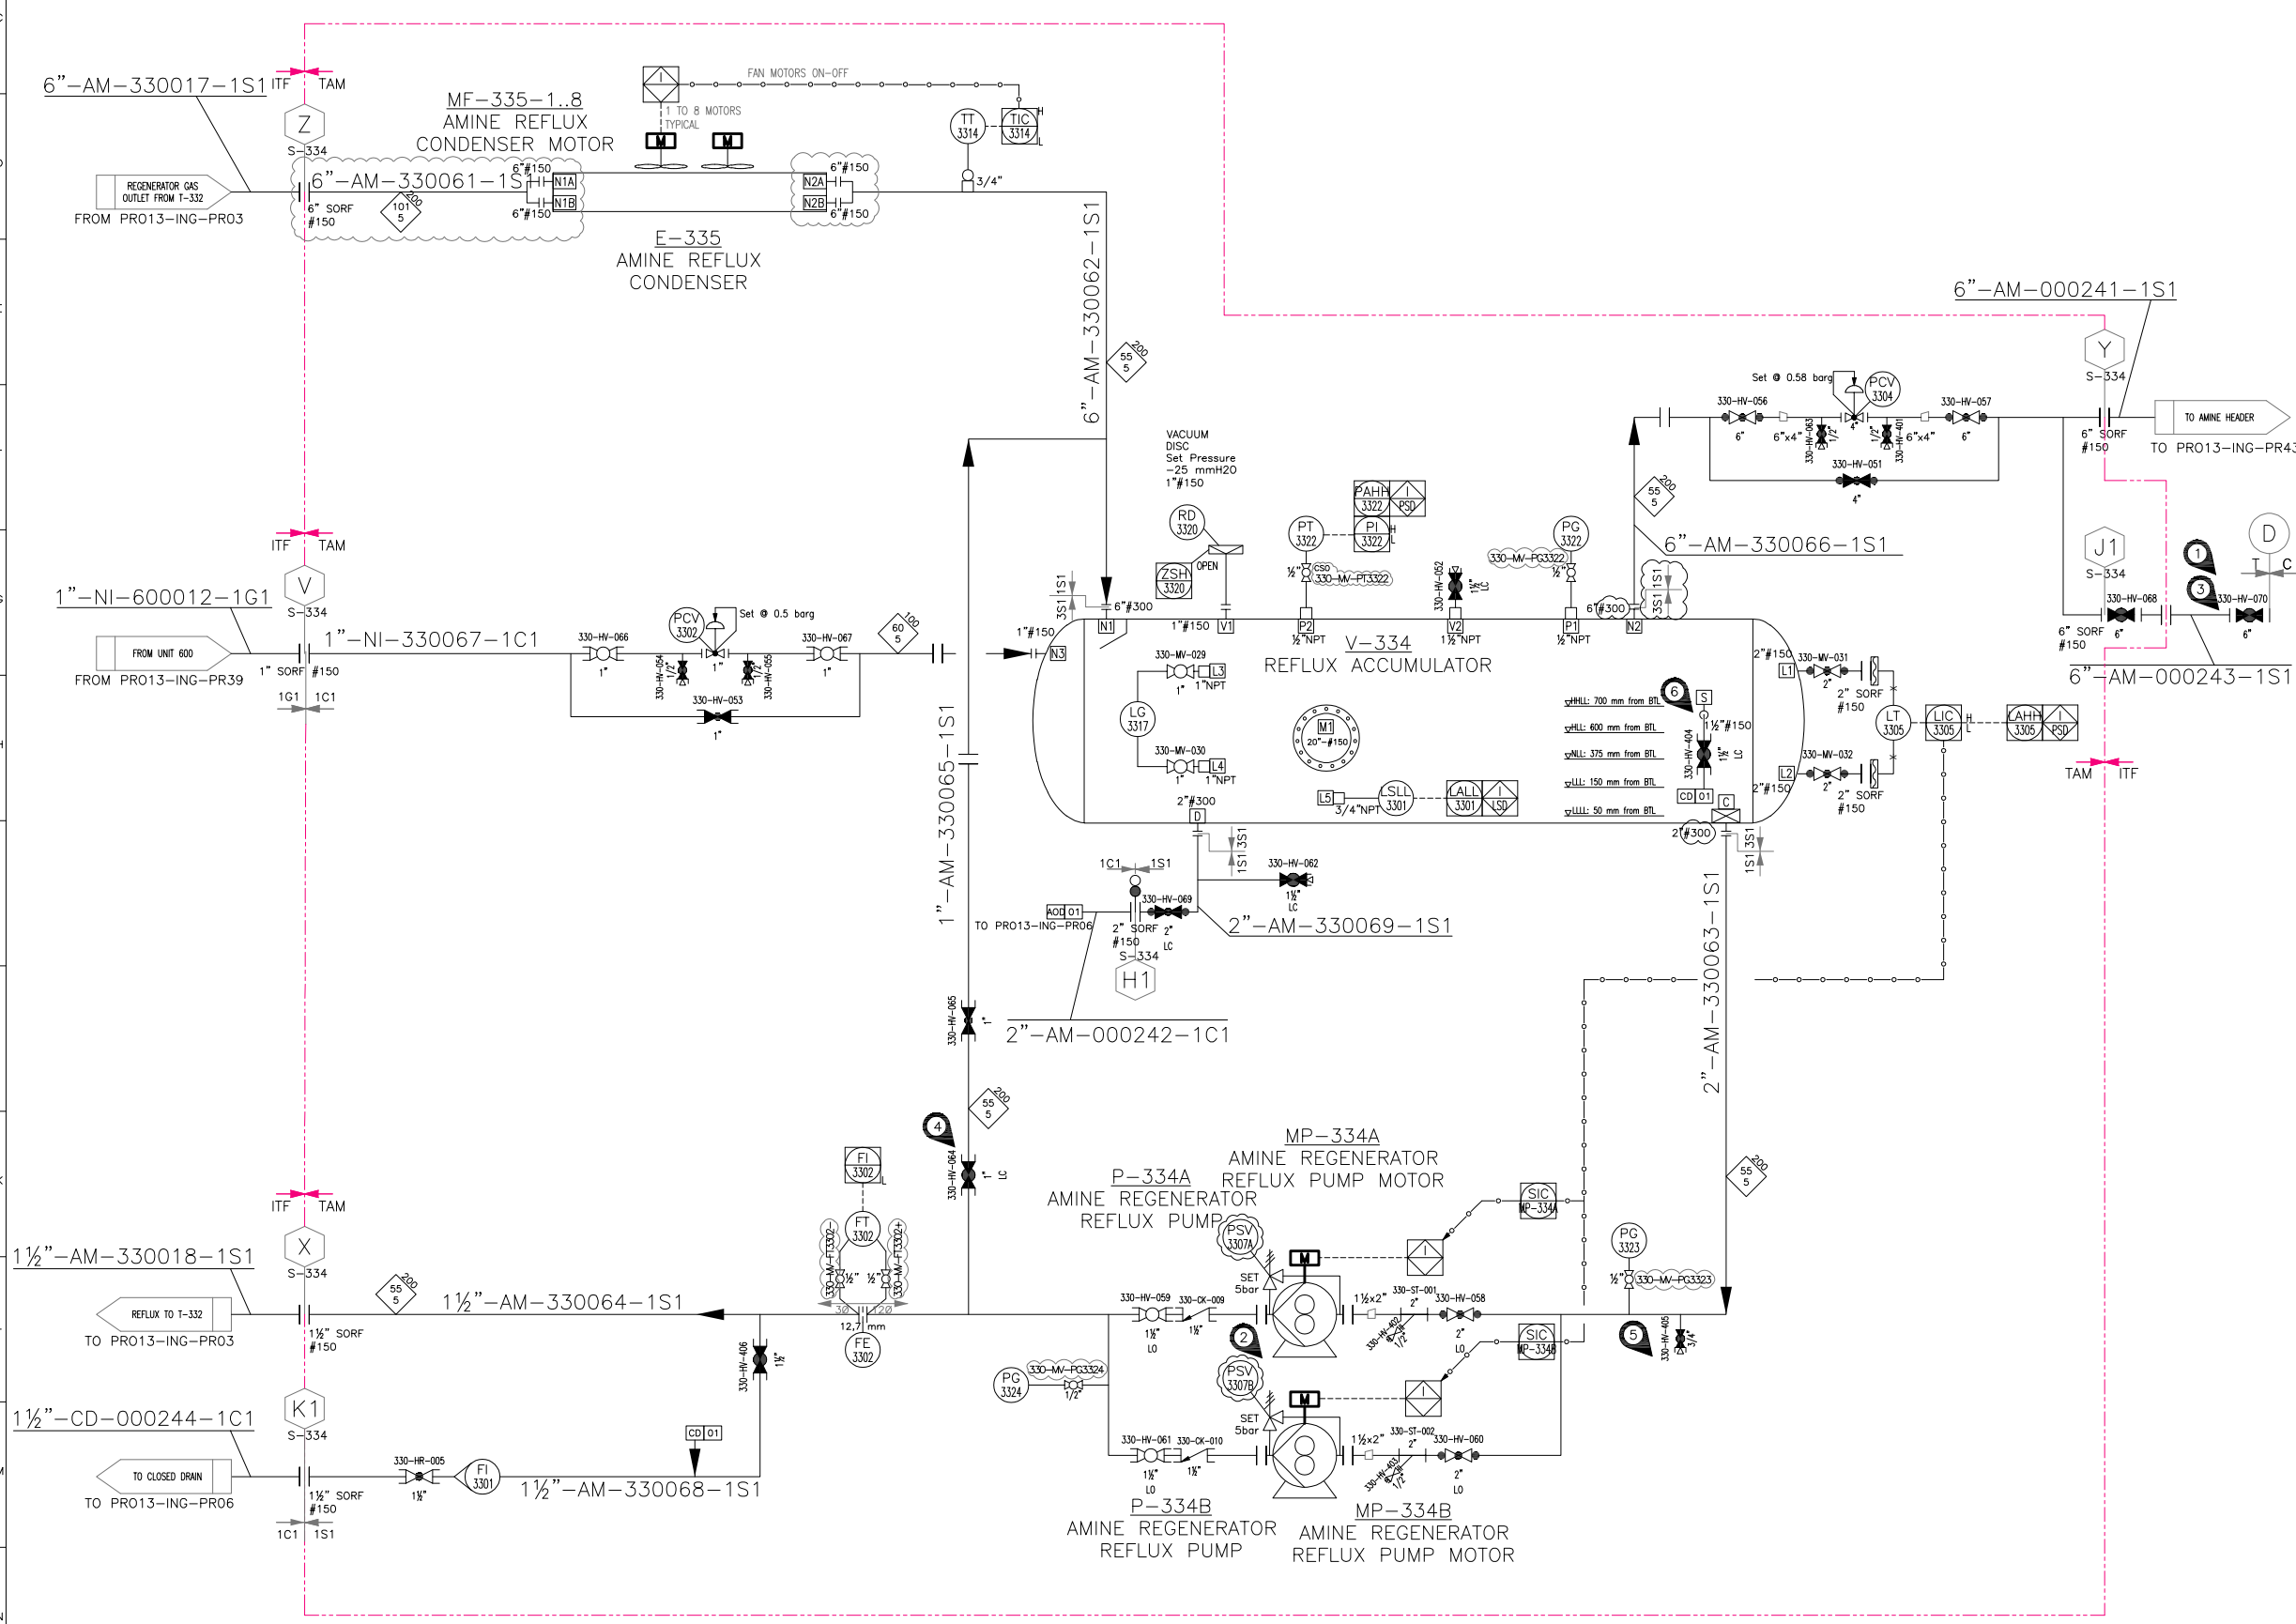

REFERENCE DOCUMENTS

P&ID LEGEND	PRO13-ING-PRO0
PROCESS FLOW DIAGRAM	21044-PR-PID-00000
UTILITY FLOW DIAGRAM	PRO10-ING-PRO1/02/03/04
MATERIAL SELECTION DIAGRAM	21044-PR-PFD-00001
	PRO10-ING-PR11
	21044-PR-UFD-00001
	PRO08-ING-FR01
	21044-PR-MSD-00001

AMINE DRAIN

NOTES:

- FUTURE CONNECTION TO CO2 RECOVERY PLANT FOR THE TREATMENT AND BOTTLING OF CO2 ON SITE, FOR SALE ON THE LOCAL MARKET.
- PCS PREVENTS TO RUN BOTH PUMPS AT THE SAME TIME. WHEN OPERATOR NEEDS TO SWITCH THE OPERATING PUMP FOR THE STAND BY PUMP, THE PUMPS WILL BE ALLOWED TO RUN SIMULTANEOUSLY FOR 5 MINUTES.
- VALVE SHOULD BE PLACED AT AN ACCESSIBLE LOCATION CLOSE TO THE PLANT BOUNDARY. (SUPPLIED BY TAM)
- VALVE TO BE USED ONLY DURING START UP. AFTER START UP, 330-HV-064 SHALL BE LOCKED CLOSED.
- AMINE SAMPLING POINT.
- SKIMMING CONNECTION TO BE LOCATED AT 500 mm FROM BTL.

TAM SUPPLY LIMIT

5	30 Mar 2026	APPROVED FOR CONSTRUCTION	TAM (JB)	TAM (MM)	I.CAMPLONE
4	24 Jun 2024	APPROVED FOR CONSTRUCTION	TAM (LD)	I.CAMPLONE	W.BOUALAI
3	25 Jul 2023	ISSUED FOR APPROVAL	TAM (LD)	I.CAMPLONE	W.BOUALAI
2	02 Nov 2022	ISSUED FOR APPROVAL	TAM (LD)	I.CAMPLONE	W.BOUALAI
1	21 Jul 2022	ISSUED FOR APPROVAL	TAM (MT)	TAM (LD)	I.CAMPLONE
0	24 Jun 2022	ISSUED FOR APPROVAL	TAM (MT)	TAM (LD)	I.CAMPLONE
Rev.	Date	Description	Draft	Check d	Approval
Customer: MANAENERGY			OFFICES: Mahaj Riad Center, Batiment 6, Jeme etage, Avenue Al Az, Hay Ryad, 10100 Rabat, Morocco		
Contractor: ITALFLUID			OFFICES: VIA VIVALDI,4 MONTESILVANO (ITALY) Tel.+39 085 4224374 fax+39 085 4220742		
Engineering: ITALFLUID			OFFICES: VIA VIVALDI,4 MONTESILVANO (ITALY) Tel.+39 085 4224374 fax+39 085 4220742		
Technology Vendor: TECHNICAL AMERICA INC			OFFICES: 301 N Smith Avenue, 92880 Corona, California (USA) Ph:+1 951 272 9540		
TITLE: LNG TENDRARA PLANT			OBJECT: P&ID – SWEETENING UNIT 330 SKID S-334		
TYPE	SCALE	DOCUMENTS ID:	VENDOR DOC. CODE		SHEET
A1	N/A	PRO13-ING-PRO5	21044-PR-PID-33004		1/1