


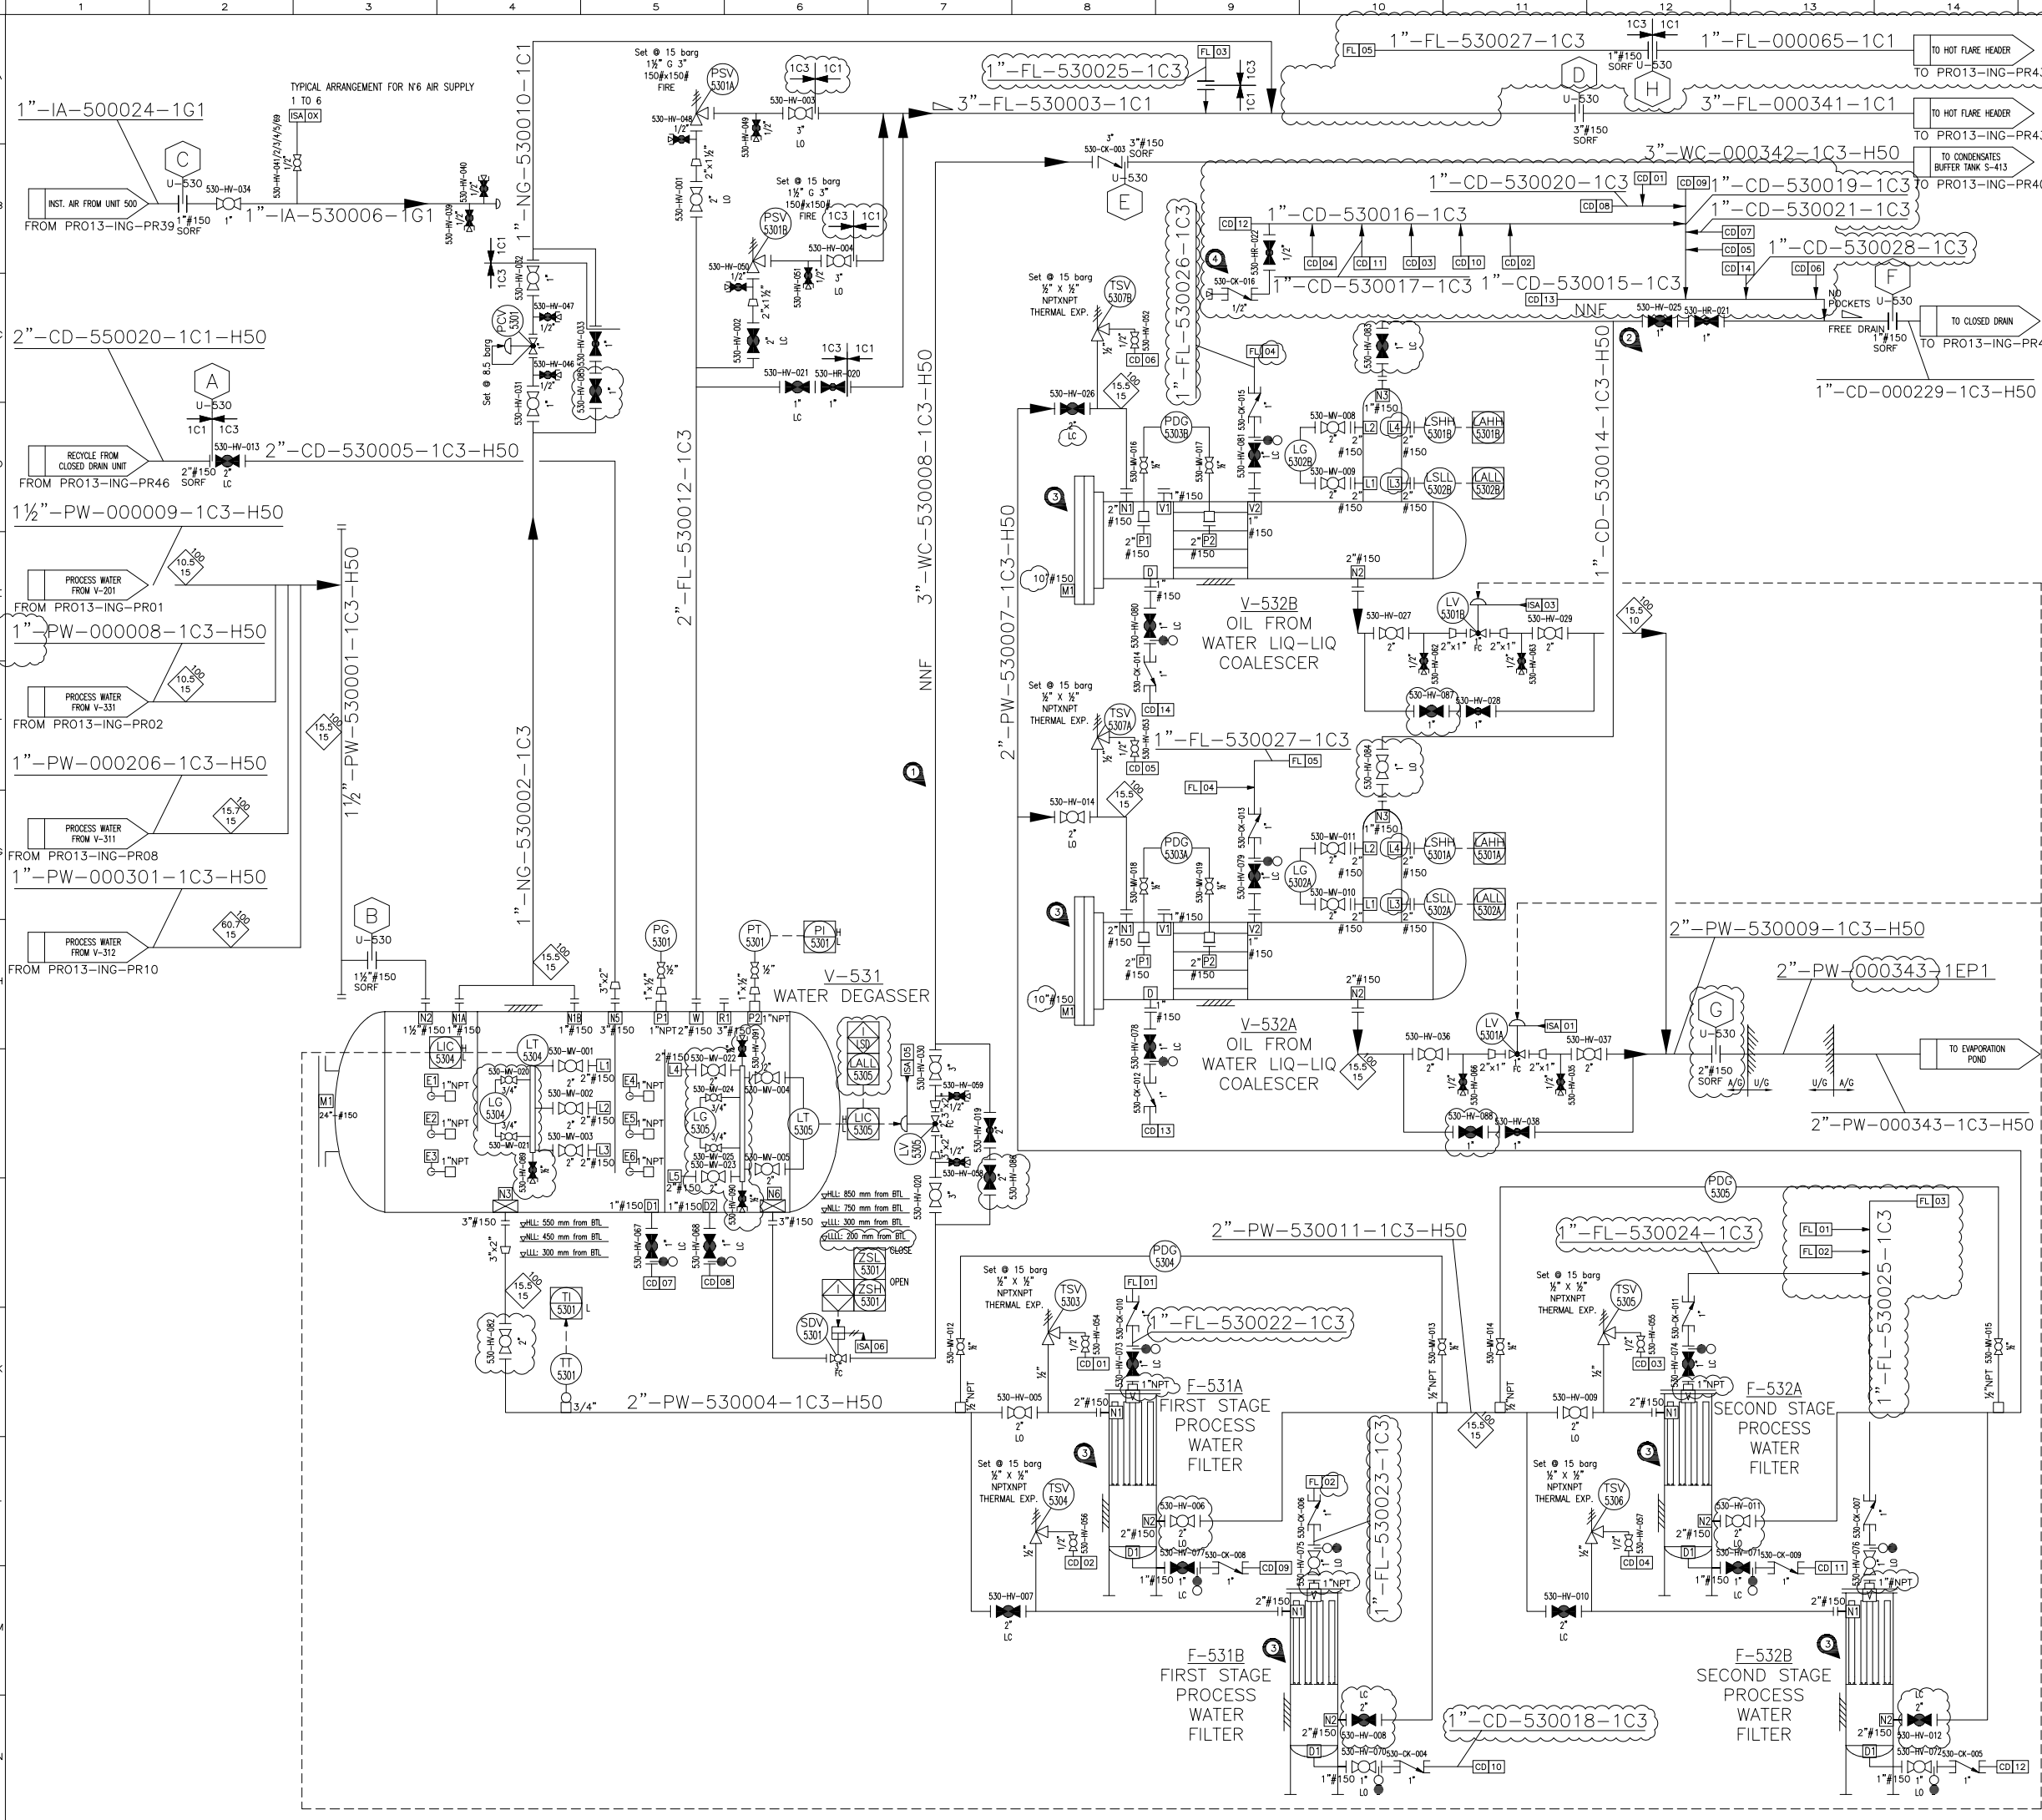

REFERENCE DOCUMENTS

P&ID LEGEND	PRO13-ING-PRO0
PROCESS FLOW DIAGRAM	21044-PR-PID-00000
UTILITY FLOW DIAGRAM	PRO10-ING-PRO1/02/03/04
MATERIAL SELECTION DIAGRAM	21044-PR-PFD-00001
	PRO10-ING-PR11/12
	21044-PR-UFD-00001
	PRO08-ING-FR01
	21044-PR-MSD-00001

INSTRUMENT SUPPLY AIR

CLOSED DRAIN TO DRAIN HEADER

NORMALLY NO FLOW

V-531

WATER DEGASSER

DESIGN PRESSURE 15 bar g

DESIGN TEMPERATURE -15/100 °C

INTERNAL DIAMETER 1186 mm

TL TO TL 4000 mm

CORROSION ALLOWANCE 6 mm

INSULATION H (50 mm)

LINING/CLADDING N.A.

MATERIAL C.S.

INTERNAL VOLUME 5 m³

INTERNAL ELEMENTS VORTEX BREAKER

F-531A/B

FIRST STAGE PROCESS WATER FILTER

DESIGN PRESSURE 15 bar g

DESIGN TEMPERATURE -15/100 °C

EXTERNAL DIAMETER 219.1 mm

OVERALL HEIGHT 2042 mm

CORROSION ALLOWANCE 6 mm

INSULATION H (50 mm)

LINING/CLADDING N.A.

MATERIAL C.S.

INTERNAL VOLUME 0.05 m³

INTERNAL ELEMENTS (1) Cartridge 152 mm OD (50 micron rating)

F-532A/B

SECOND STAGE PROCESS WATER FILTER

DESIGN PRESSURE 15 bar g

DESIGN TEMPERATURE -15/100 °C

EXTERNAL DIAMETER 219.1 mm

OVERALL HEIGHT 2042 mm

CORROSION ALLOWANCE 6 mm

INSULATION H (50 mm)

LINING/CLADDING N.A.

MATERIAL C.S.

INTERNAL VOLUME 0.05 m³

INTERNAL ELEMENTS (1) Cartridge 152 mm OD (10 micron rating)

V-532A/B

OIL FROM WATER LIQ-LIQ COALESCER

DESIGN PRESSURE 15 bar g

DESIGN TEMPERATURE -15/100 °C

EXTERNAL DIAMETER 273 mm

OVERALL LENGTH ~3100 mm

CORROSION ALLOWANCE 6 mm

INSULATION H (50 mm)

LINING/CLADDING N.A.

MATERIAL C.S.

INTERNAL VOLUME 0.16 m³

INTERNAL ELEMENTS (2) cartridges 95.3 mm OD (LL coalescence)

NOTES

1 DISCONTINUOUS FLOW. OIL WILL BE PRESENT ONLY WHEN IT IS NECESSARY TO EMPTY CLOSED DRAIN TANK V-551.

2 DISCONTINUOUS FLOW.

3 IT IS MANDATORY TO EMPTY THE STAND BY EQUIPMENT AND TO LOCK OPEN ITS DRAIN AND VENT VALVES.

4 NITROGEN SUPPLY FOR LINE EMPTYING.

5	24 June 2024	APPROVED FOR CONSTRUCTION	TAM (MT)	L.CAMPLONE	W. BOULALI
4	22 Aug 2023	ISSUED FOR APPROVAL	TAM (MT)	L.CAMPLONE	W. BOULALI
3	8 Nov 2022	ISSUED FOR APPROVAL	TAM (MT)	L.CAMPLONE	W. BOULALI
2	26 July 2022	ISSUED FOR APPROVAL	TAM (MT)	L.CAMPLONE	W. BOULALI
1	8 July 2022	ISSUED FOR APPROVAL	TAM (ES)	L.CAMPLONE	W. BOULALI
0	21 June 2022	ISSUED FOR APPROVAL	TAM (ES)	L.CAMPLONE	W. BOULALI

Customer: SOUND ENERGY

Contractor: ITALFLUID

Engineering: ITALFLUID

Technology Vendor: TECHNICAL AMERICA INC

Customer: Espace les Patios 1st floor, Avenue Amakhal Hay Riad, Rabat 10100

Contractor: Regus Maroc Twin Center, Tour Ouest, Casablanca Tel: +213/ 29 73 31 91 Fax +213/ 29 73 18 92

Engineering: VIA VVALDI,4 Tel: +39 085 4224374

Technology Vendor: Ph.+1 951 272 9540

TITLE: LNG TENDRARA PLANT

OBJECT: P&ID UNIT 530 - OILY WATER

TYPE	SCALE	DOCUMENTS ID	VENDOR DOC. CODE	SHEET/OF
A1	N/A	PRO13-ING-PR47	21044-PR-PID-53001	1/1

Documento di proprietà aziendale. La Società tutela i propri diritti a termine di legge. This document is Company property. The Company lawfully reserves all rights.