










1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20						
Customer:		SOUND ENERGY																							
Contractor:		I.M.S.P. MOROCCO																							
Engineering:		ITALFLUID																							
Technology vendor:		 TECHNICAL AMERICA INC																							
Title:		LNG TENDRARA PLANT																							
objet:		Customer code:		-																Sheets :		13			
		By:		-																S/N. :		IE25072_SE01			
		File :		-																					
 esa esalettromeccanica.com INGEGNERIA ELETTRICA - QUADRI DI DISTRIBUZIONE E AUTOMAZIONE - CABINE DI TRASFORMAZIONE MT/BT - PLC - HMI - SCADA - ENERGIE RINNOVABILI CONTRADA TESINO, 47 - 63065 RIPATRANSONE (AP) - ITALY - TEL. +39 0735 90523 WWW.ESAELETTROMECCANICA.COM - INFO@ESAELETTROMECCANICA.COM - ESA@PEC.IT - P.IVA e C.F. 00768110447 																									
General Contractor :		Manufacture : 		Project : P-PN-OU420.1 FUEL GAS DISTRIBUTION		Customer : 						Object :													
												Rev. 2				Data : 11/04/2025				Date : 17/02/2025					
												Rev. 3				Data : 17/04/2025				Sheet : 1		of : 13			
						Contract : IE25072																			
						S/N : IE25072_SE01																			

CIRCUIT SYMBOLS ACCORDING TO CEI STANDARD

	ISOLATOR		ELECTRONIC TIMER WITH PICK-UP DELAY		MUSHROOM PUSH-BUTTON PULSE CONTACT WITH STAY-PUT MAKE CONTACT OPERATED BY STRIKING		STEDY OR FLASHING LIGHT
	FUSED ISOLATOR		ELECTRIC PULSE METER		KEY OPERATING DEVICE FOR SELECTORS, PUSH-BUTTON, ETC.		PLC UNIT
	CIRCUIT BREAKER WITH THERMAL AED MAGNETIC OVERCURRENT RELEASES		FUSE CARRIER		PRESSURE SWITCH		CONTROL INSTRUMENT
	CIRCUIT BREAKER WITH MAGNETIC RELEASE		MAKE CONTACT OF CONTACTOR		TEMPERATURE SWITCH		ENERGY METER
	CIRCUIT BREAKER WITH THERMAL, MAGNETIC AND DIFFERENTIAL RELEASES		MAKE CONTACT OF CONTACTOR		FLOW SWITCH		MEASURING INSTRUMENT
	RESIDUAL CURRENT CIRCUIT BREAKER "AC" TYPE FOR ALTERNATING CURRENT "A" TYPE FOR ALTERNATING OR PULSATING CURRENTS		MAKE AND BREAK CONTACT		FLOAT SWITCH		VOLTAGE TRANSFORMER
	THERMAL RELAY (OVERLOAD RELAY)		MAKE AND BREAK CONTACT WITH DROP-OUT DELAY		BUCHHOLZ RELAY		CURRENT TRANSFORMER
	COIL OF CONTACTOR RELAY		MAKE AND BREAK CONTACT WITH PICK-UP DELAY		CAM OPERATED DEVICE		ACOUSTIC SIGNALLING DEVICE
	COIL OF SHUT-OFF ALARM MAKE CONTACT ON ENERGIZATION		MAKE AND BREAK CONTACT WITH DROP-OUT AND PICK-UP DELAY (FLIP-FLOP)		PROXIMITY SWITCH		RESISTANCE
	COIL OF SHUT-OFF ALARM DENERGIZES IN CASE OF UNDERVOLTAGE		MAKE AND BREAK CONTACT OF THERMAL RELAY		TEMPERATURE SENSOR		CAPACITOR
	COIL OF OPERATING DEVICE WITH DROP-OUT DELAY		MAKE AND BREAK CONTACT OF LIMIT SWITCH		PHOTOELECTRIC SENSOR		SINGLE-PHASE ELECTRIC MOTOR
	COIL OF OPERATING DEVICE WITH PICK-UP DELAY		MULTI POSITION SWITCH (GENERAL SYMBOL)		SOLENOID VALVE		THREE-PHASE ELECTRIC MOTOR
	COIL OF OPERATING DEVICE WITH DROP-OUT AND PICK-UP DELAYS		MAKE AND BREAK CONTACT OPERATED BY TURNING WITH SPRING RETURN		PHOTOCELL		
	COIL OF LATCHING RELAY (STEP-BY-STEP FUNCTION)		MAKE AND BREAK CONTACT OPERATED BY PUSHING WITH SPRING RETURN				
	ELECTRONIC OR ELECTRO-MECHANICAL TIME SWITCH		MAKE AND BREAK CONTACT OPERATED BY PULLING WITH OR WITHUOT SPRING RETURN				


CONDUCTOR COLOR CODING INSIDE CONTROL PANEL	
AC AND DC POWER CIRCUIT	BLACK
NEUTRAL CONDUCTOR OF POWER CIRCUIT	LIGHT–BLUE
PROTECTIVE CONDUCTOR (EARTH CONDUCTOR)	YELLOW–GREEN
110/220V AC AUXILIARY CIRCUIT (*)	RED
24V AC AUXILIARY CIRCUIT	WHITE
24V AC AND DC PLC INPUT	GRAY
24V AC PLC OUTPUT	WHITE
24V AC AND DC INTERLOCKING CIRCUIT	ORANGE
24V DC AUXILIARY CIRCUIT AND PLC OUTPUT	DARK–BLUE
INTRINSIC SAFE SIGNAL	BLUE
(*) : RED FOR 110V AND BROWN FOR 220V, IN CASE BOTH VOLTAGE ARE USED	

CODE COLOUR	
COLOUR	CODE LETTERS
BLACK	BK
BROWN	BN
RED	RD
ORANGE	OG
YELLOW	YE
GREEN	GN
BLUE	BU
GREY	GY
WHITE	WH
SILVER	SR
CLEAR	CL
GREEN AND YELLOW	GNYE

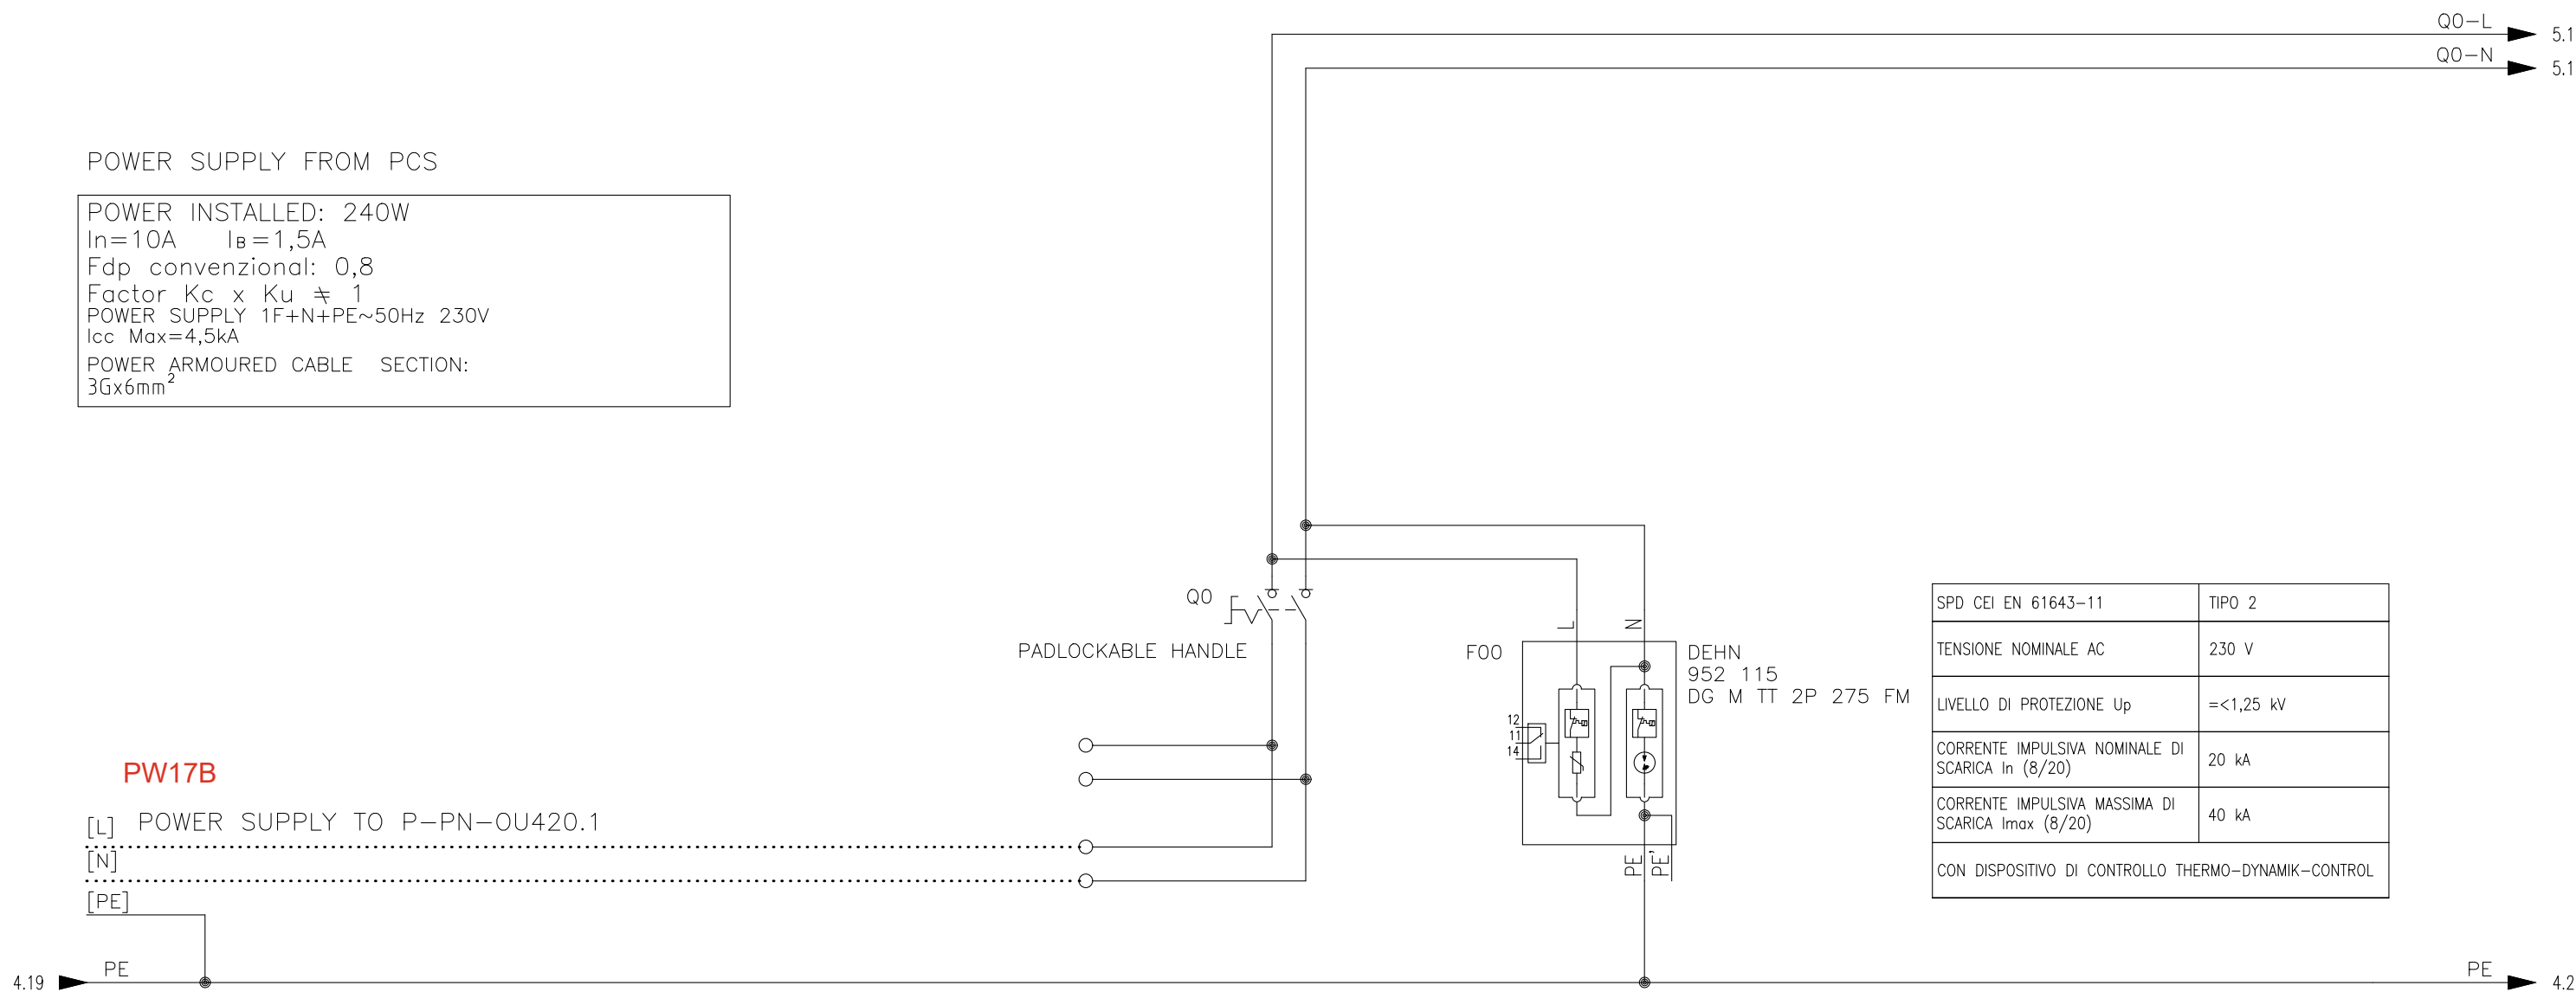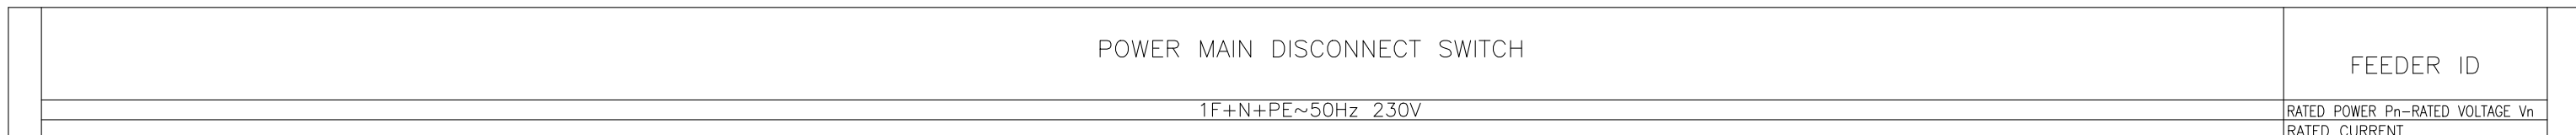

SPD CEI EN 61643-11	TIPO 2
TENSIONE NOMINALE AC	230 V
LIVELLO DI PROTEZIONE Up	=<1,25 kV
CORRENTE IMPULSIVA NOMINALE DI SCARICA In (8/20)	20 kA
CORRENTE IMPULSIVA MASSIMA DI SCARICA I _{max} (8/20)	40 kA
CON DISPOSITIVO DI CONTROLLO THERMO-DYNAMIK-CONTROL	

PROTECTION	TECHNOR PSRC-220	TYPE
		RATED BREAKING CAPACITY I _{cu}
	20A	RATED or THERMAL CURRENT I _n or I _{th}
		MAGNETIC RELEASE CHARACTERISTICS I _m
		RATED R.C. SENSITIVITY I _{dn}
CONDUCTOR		WIRE SECTION
		CABLE TYPE
		CABLE CARRYING LOAD I _z
		CABLE LENGHT
		LINE ID
		WIRE ID ON TERMINAL

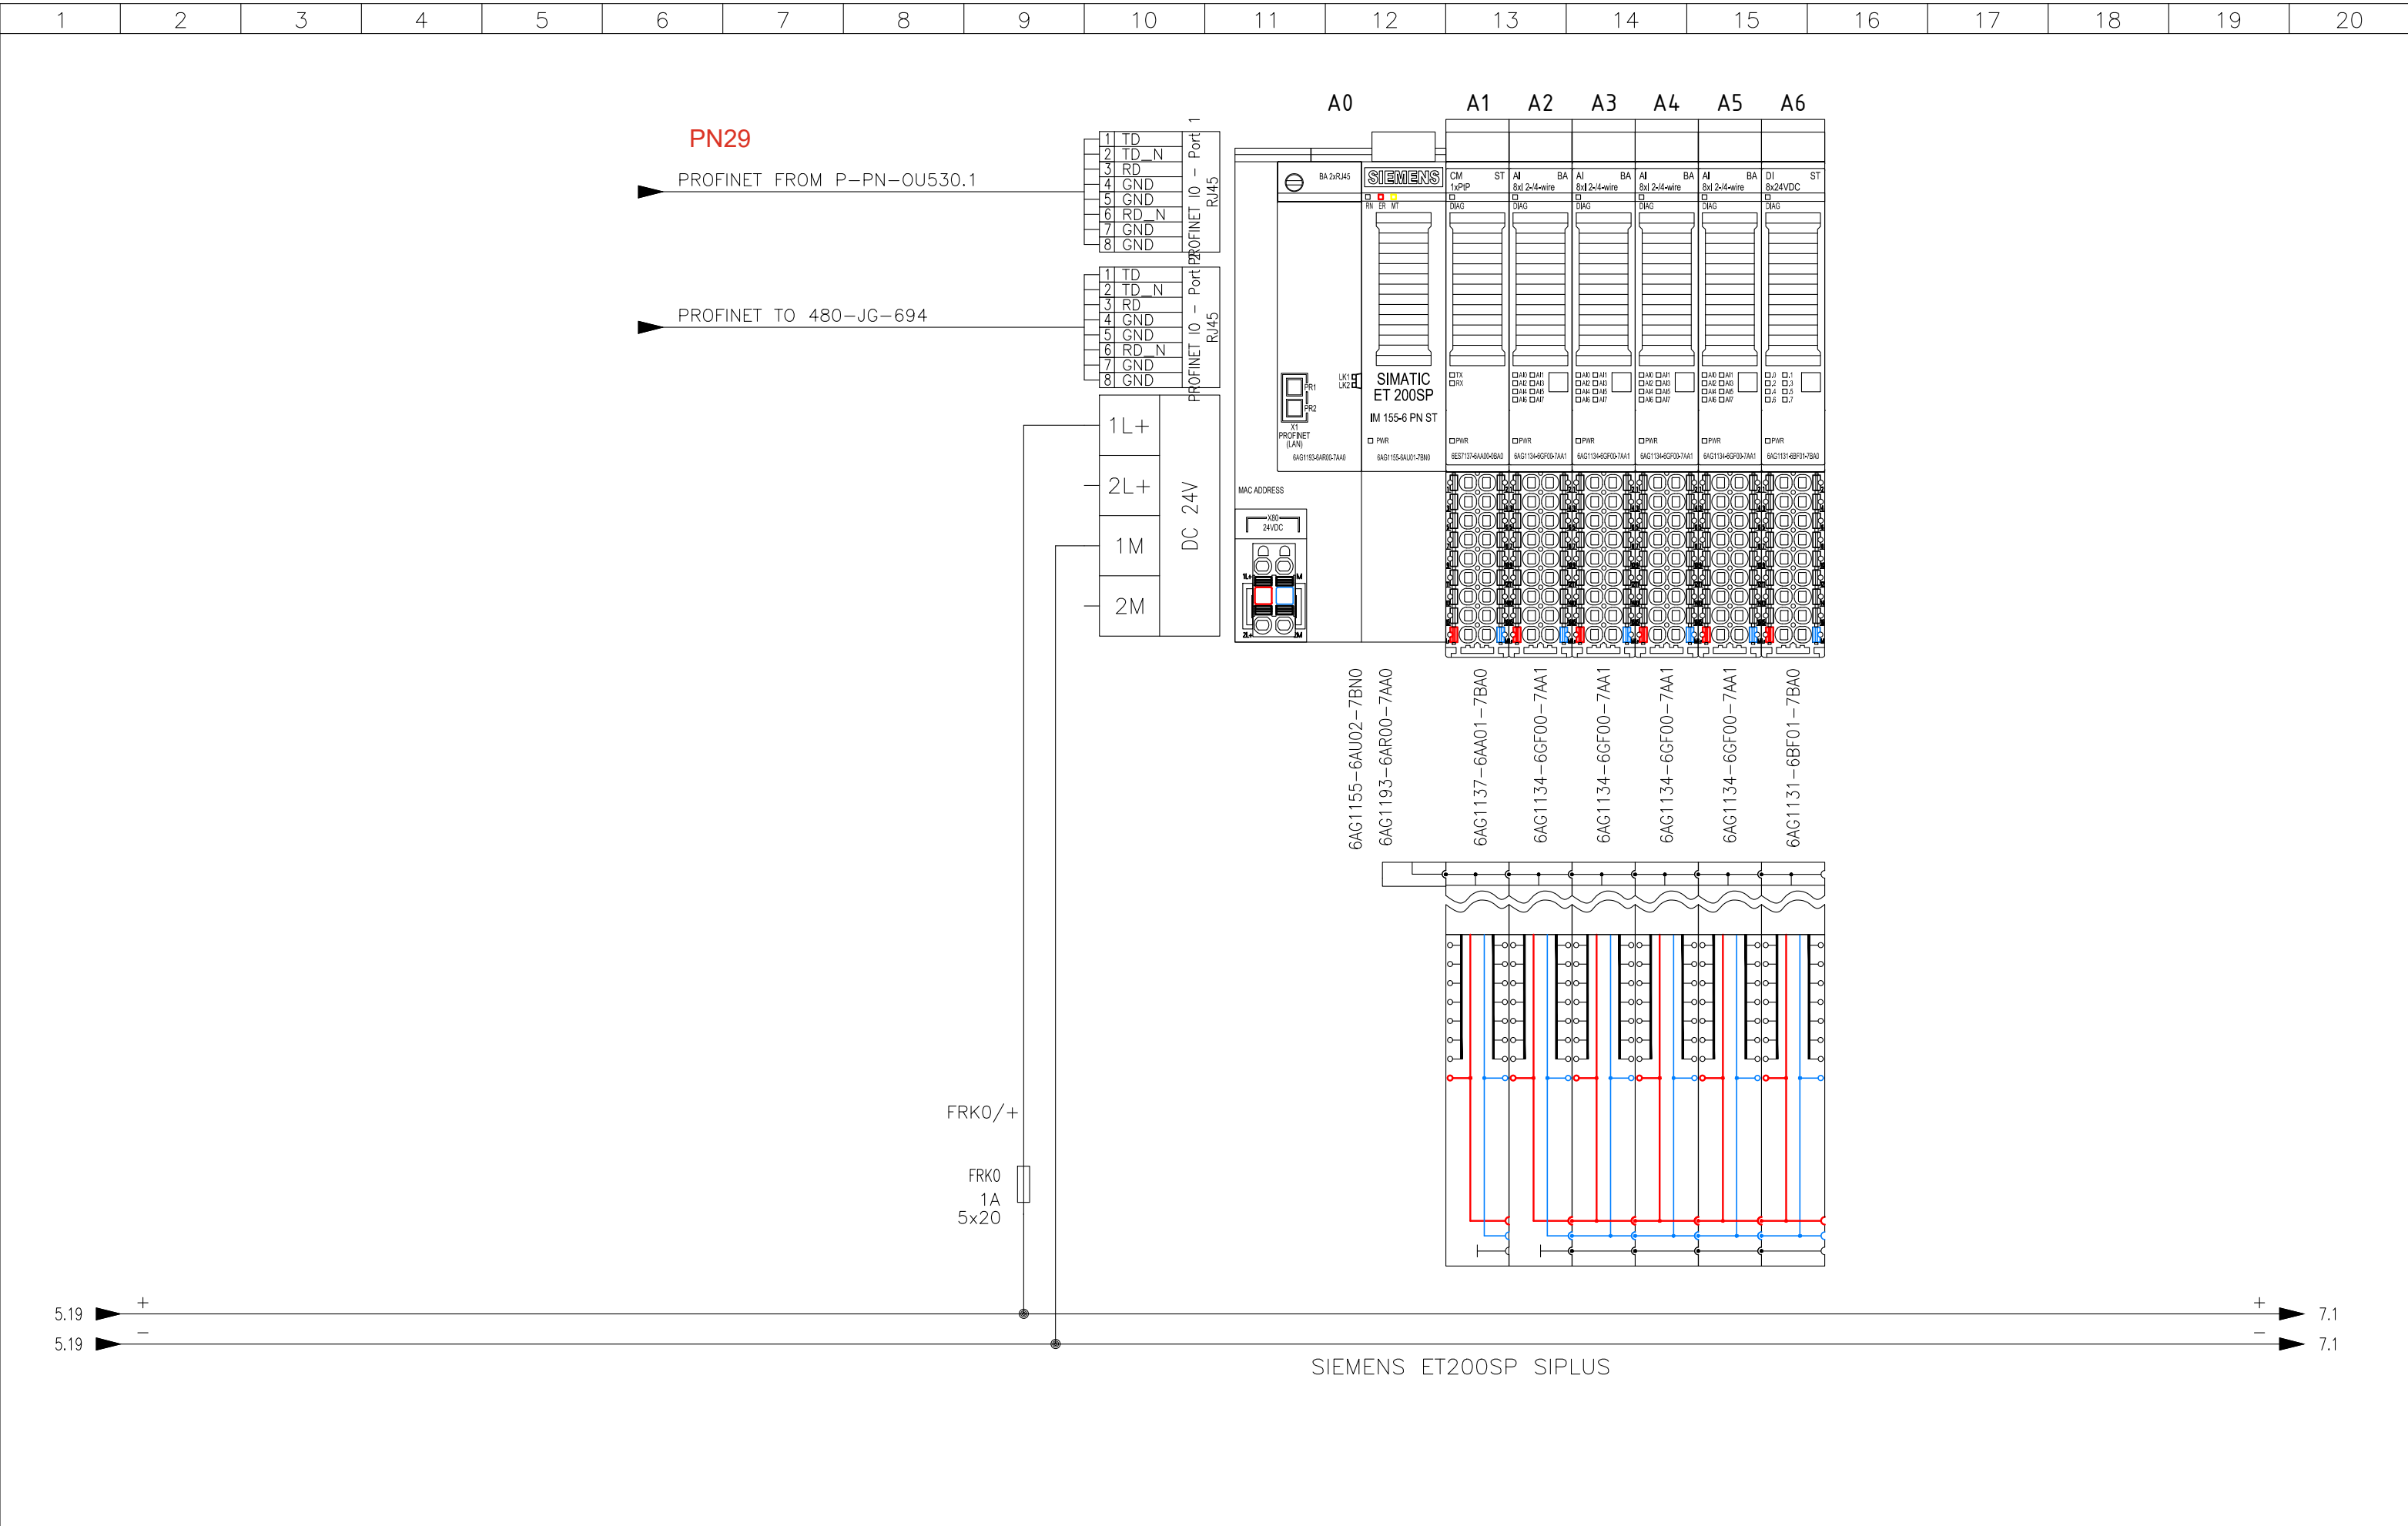

6.19 +

6.19 -

8.1 +

8.1 -

Name:					Sheet:				
CPU: A0 MOD. A1									
123456789/10									

MB06

T/RA-

T/RB+

F2
1A
5x20


F2/+

L+ M

111213141516					L+M	
CPU: A0 MOD. A1					CPU: A0 MOD. A1	
Name:			Sheet:		Name:	Sheet:
GAS CHROMATOGRAPH (AT-4801)						

General Contractor : Manufacture : 		Project : P-PN-0U420.1 FUEL GAS DISTRIBUTION	Customer :  Contract : IE25072 S/N : IE25072_SE01	Object :		By :	
				Rev. 2	Data : 11/04/2025	Date : 17/02/2025	
				Rev. 3	Data : 17/04/2025	Sheet : 7	of : 13

F3
1A
5x20

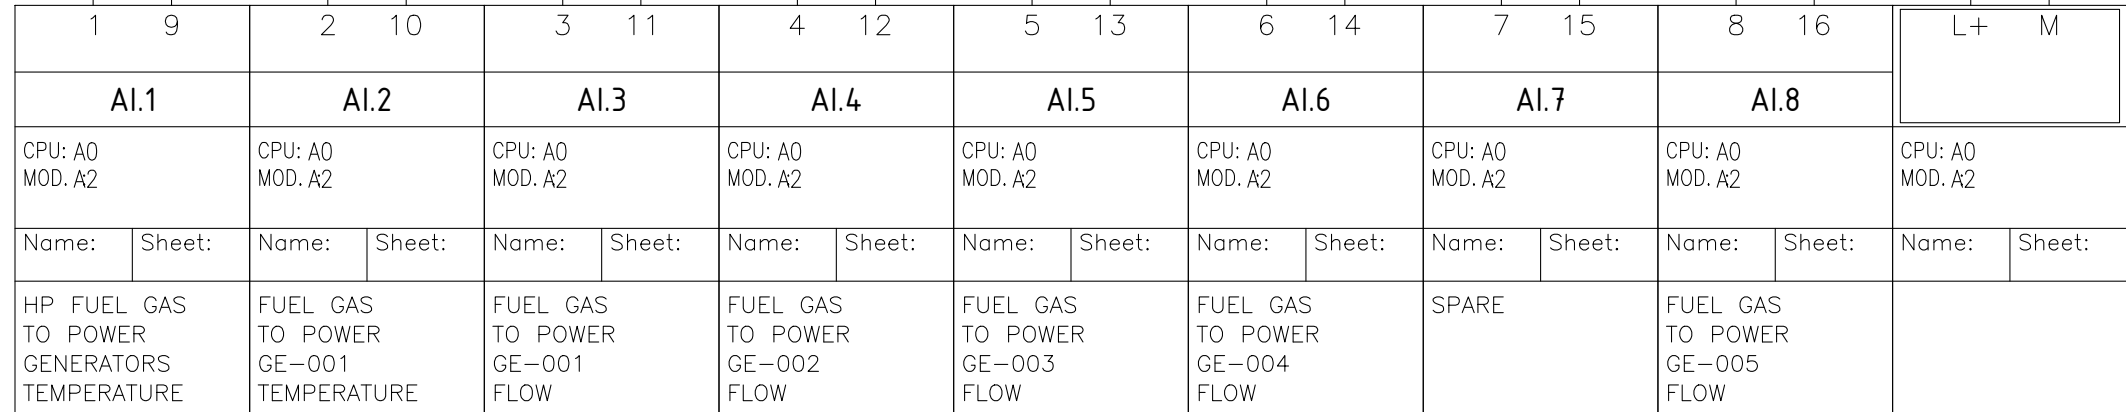

8.19	+	10.1
8.19	-	10.1

3" 150# RF

S272

4÷20mA

EEEx-d

FT-4806

-/AI.9

+/AI.9

3" 150# RF

S274

4÷20mA

EEEx-d

FT-4807

-/AI.10

+/AI.10

1" 150# RF

S276

4÷20mA

EEEx-d

FT-4811

-/AI.11

+/AI.11

1" 150# RF

S278

4÷20mA

EEEx-d

FT-4812

-/AI.12

+/AI.12

1" 150# RF

S280

4÷20mA

EEEx-d

FT-4813

-/AI.13

+/AI.13

1" 150# RF

S282

4÷20mA

EEEx-d

FT-4814

-/AI.14

+/AI.14

1" 150# RF

S284

4÷20mA

EEEx-d

FT-4815

-/AI.15

+/AI.15

1" 150# RF

S286

4÷20mA


EEEx-d


FT-4816

-/AI.16

+/AI.16


1	9	2	10	3	11	4	12	5	13	6	14	7	15	8	16	L+	M
AI.9		AI.10		AI.11		AI.12		AI.13		AI.14		AI.15		AI.16			
CPU: A0 MOD. A3		CPU: A0 MOD. A3		CPU: A0 MOD. A3		CPU: A0 MOD. A3		CPU: A0 MOD. A3		CPU: A0 MOD. A3		CPU: A0 MOD. A3		CPU: A0 MOD. A3		CPU: A0 MOD. A3	
Name:	Sheet:	Name:	Sheet:	Name:	Sheet:	Name:	Sheet:	Name:	Sheet:	Name:	Sheet:	Name:	Sheet:	Name:	Sheet:	Name:	Sheet:
FUEL GAS TO POWER GE-006 FLOW		FUEL GAS TO POWER GE-007 FLOW		FUEL GAS TO POWER GE-001 FLOW		FUEL GAS TO POWER GE-002 FLOW		FUEL GAS TO POWER GE-003 FLOW		FUEL GAS TO POWER GE-004 FLOW		FUEL GAS TO POWER GE-005 FLOW		FUEL GAS TO POWER GE-006 FLOW			

General Contractor :		Manufacture : 	Project : P-PN-0U420.1 FUEL GAS DISTRIBUTION	Customer : 	Object :			
					By :			
				Contract : IE25072	Rev. 2	Data : 11/04/2025	Date : 17/02/2025	
					S/N : IE25072_SE01	Rev. 3	Data : 17/04/2025	Sheet : 9

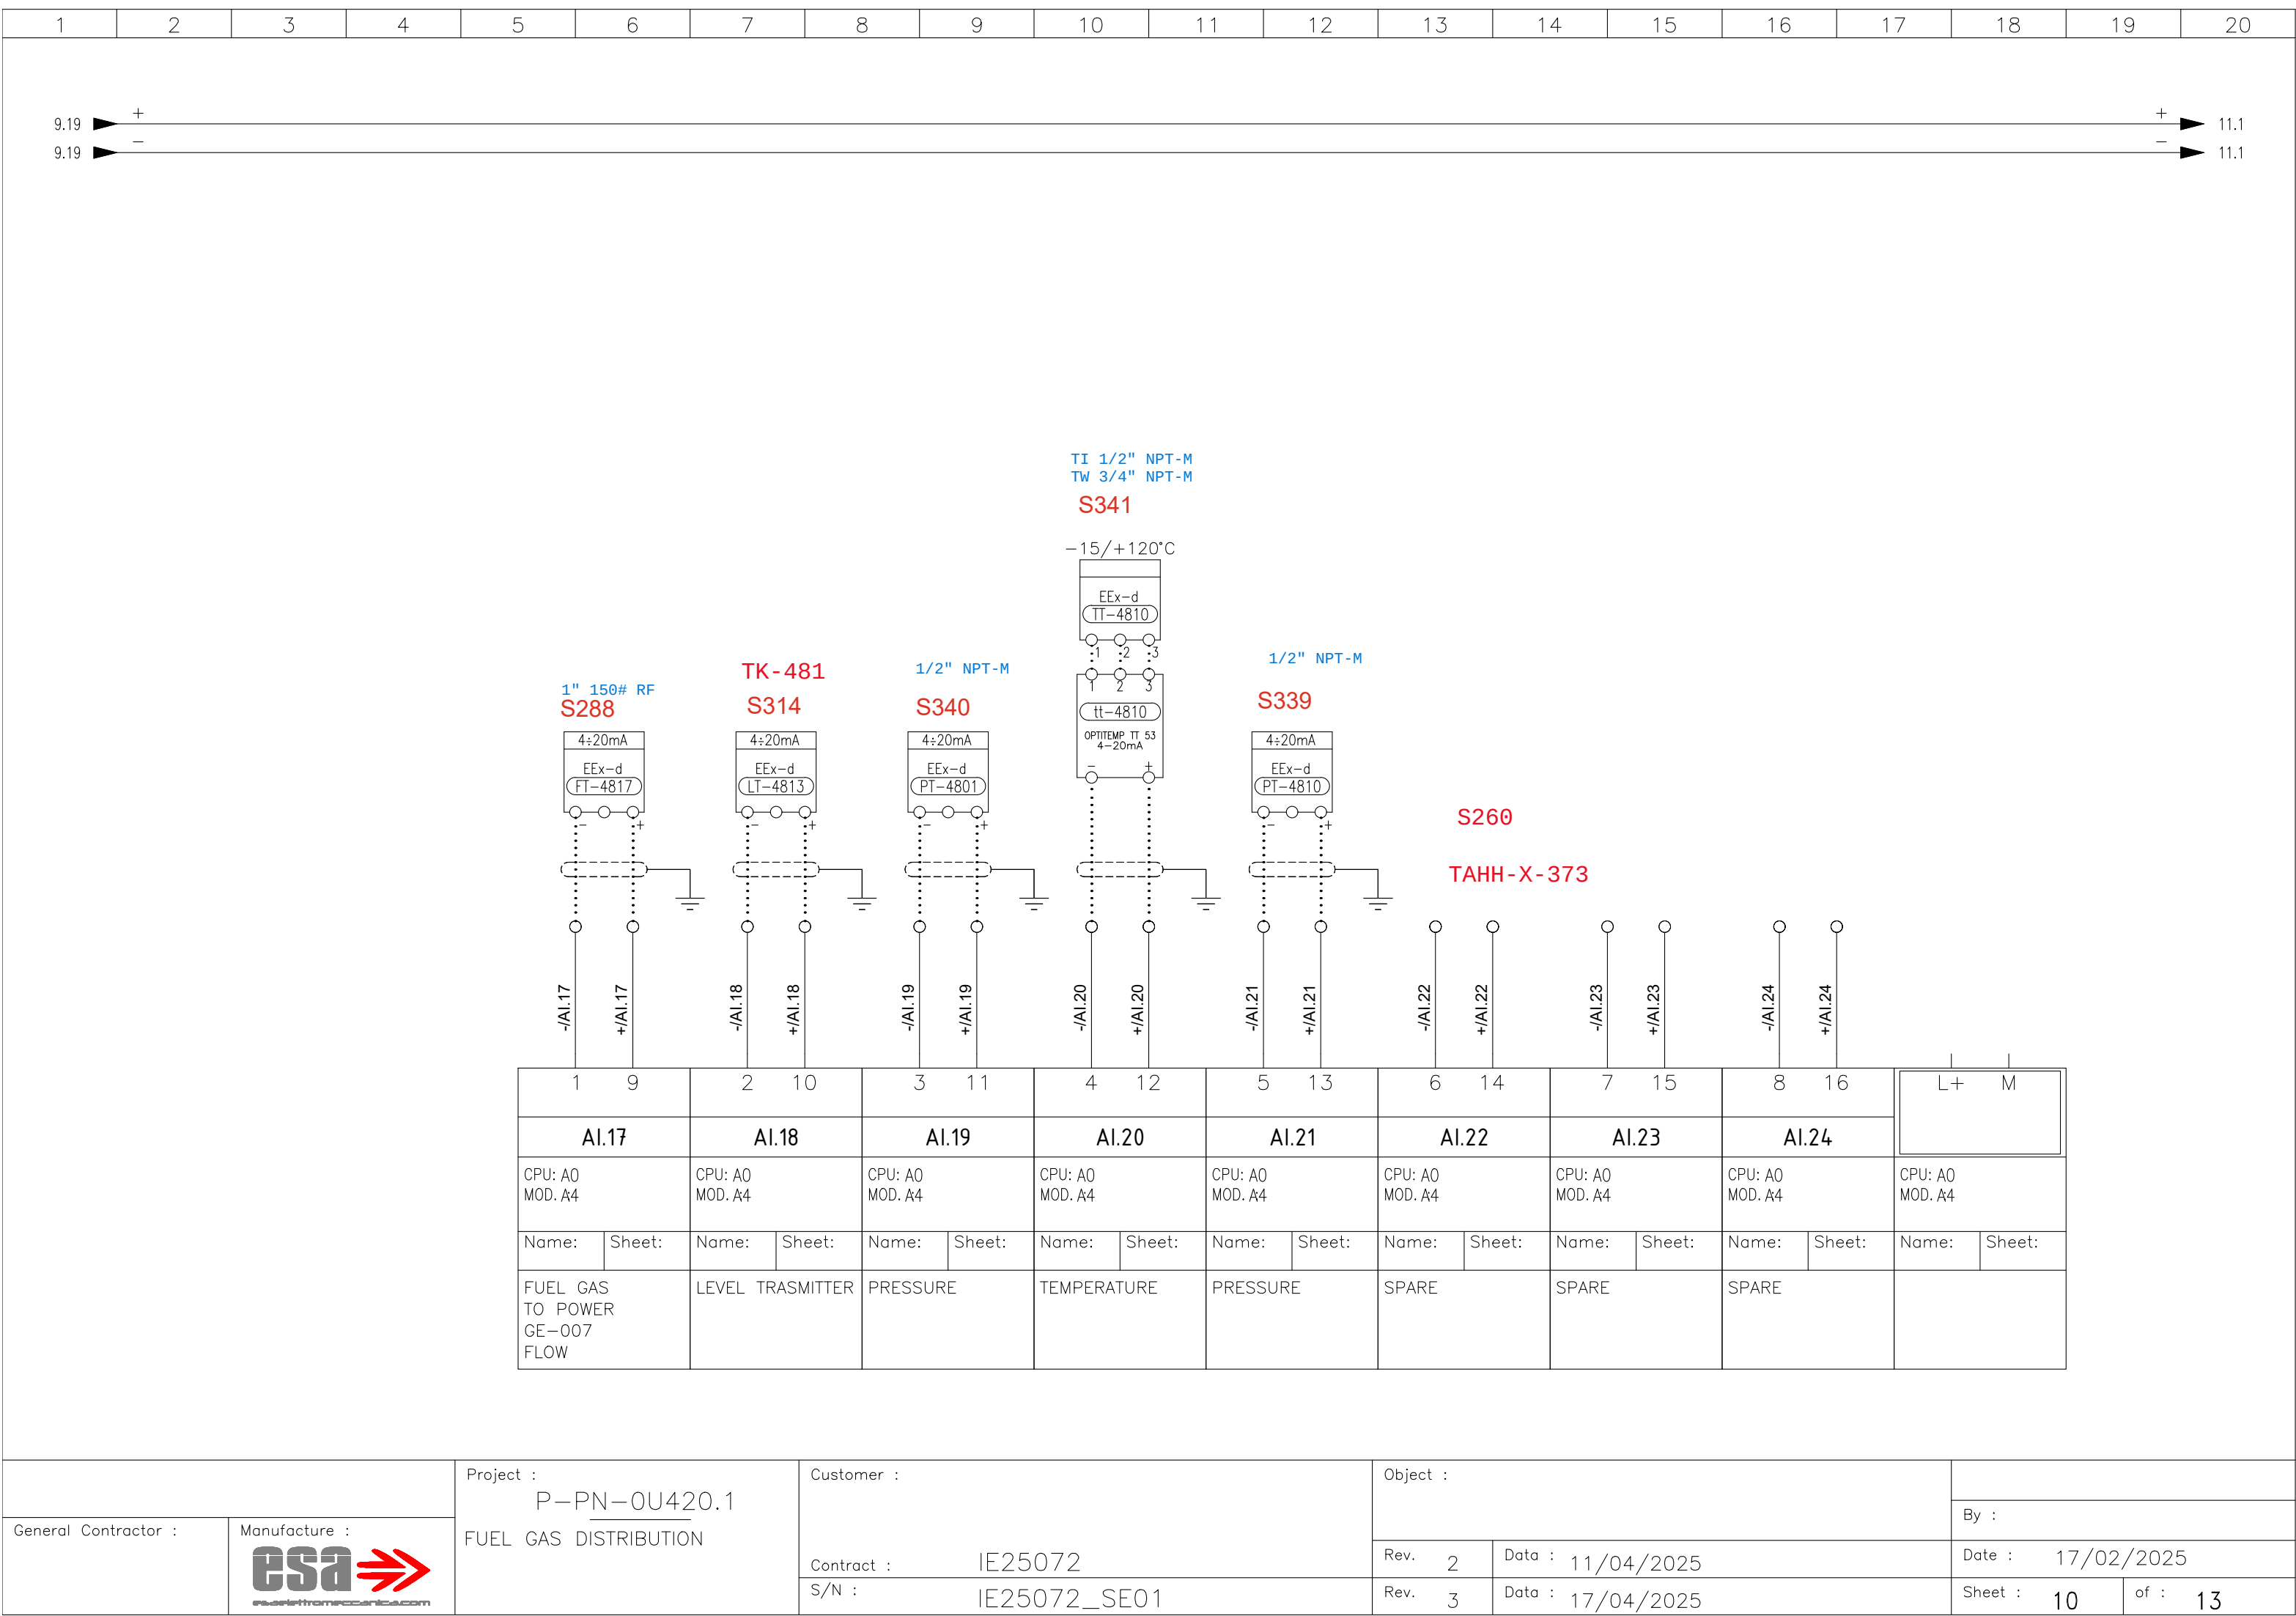

[illegible]

General Contractor : Manufacture : 		Project : P-PN-0U420.1 FUEL GAS DISTRIBUTION	Customer : Contract : IE25072 S/N : IE25072_SE01	Object :		By :	
				Rev. 2	Data : 11/04/2025	Date : 17/02/2025	
				Rev. 3	Data : 17/04/2025	Sheet : 11	of : 13

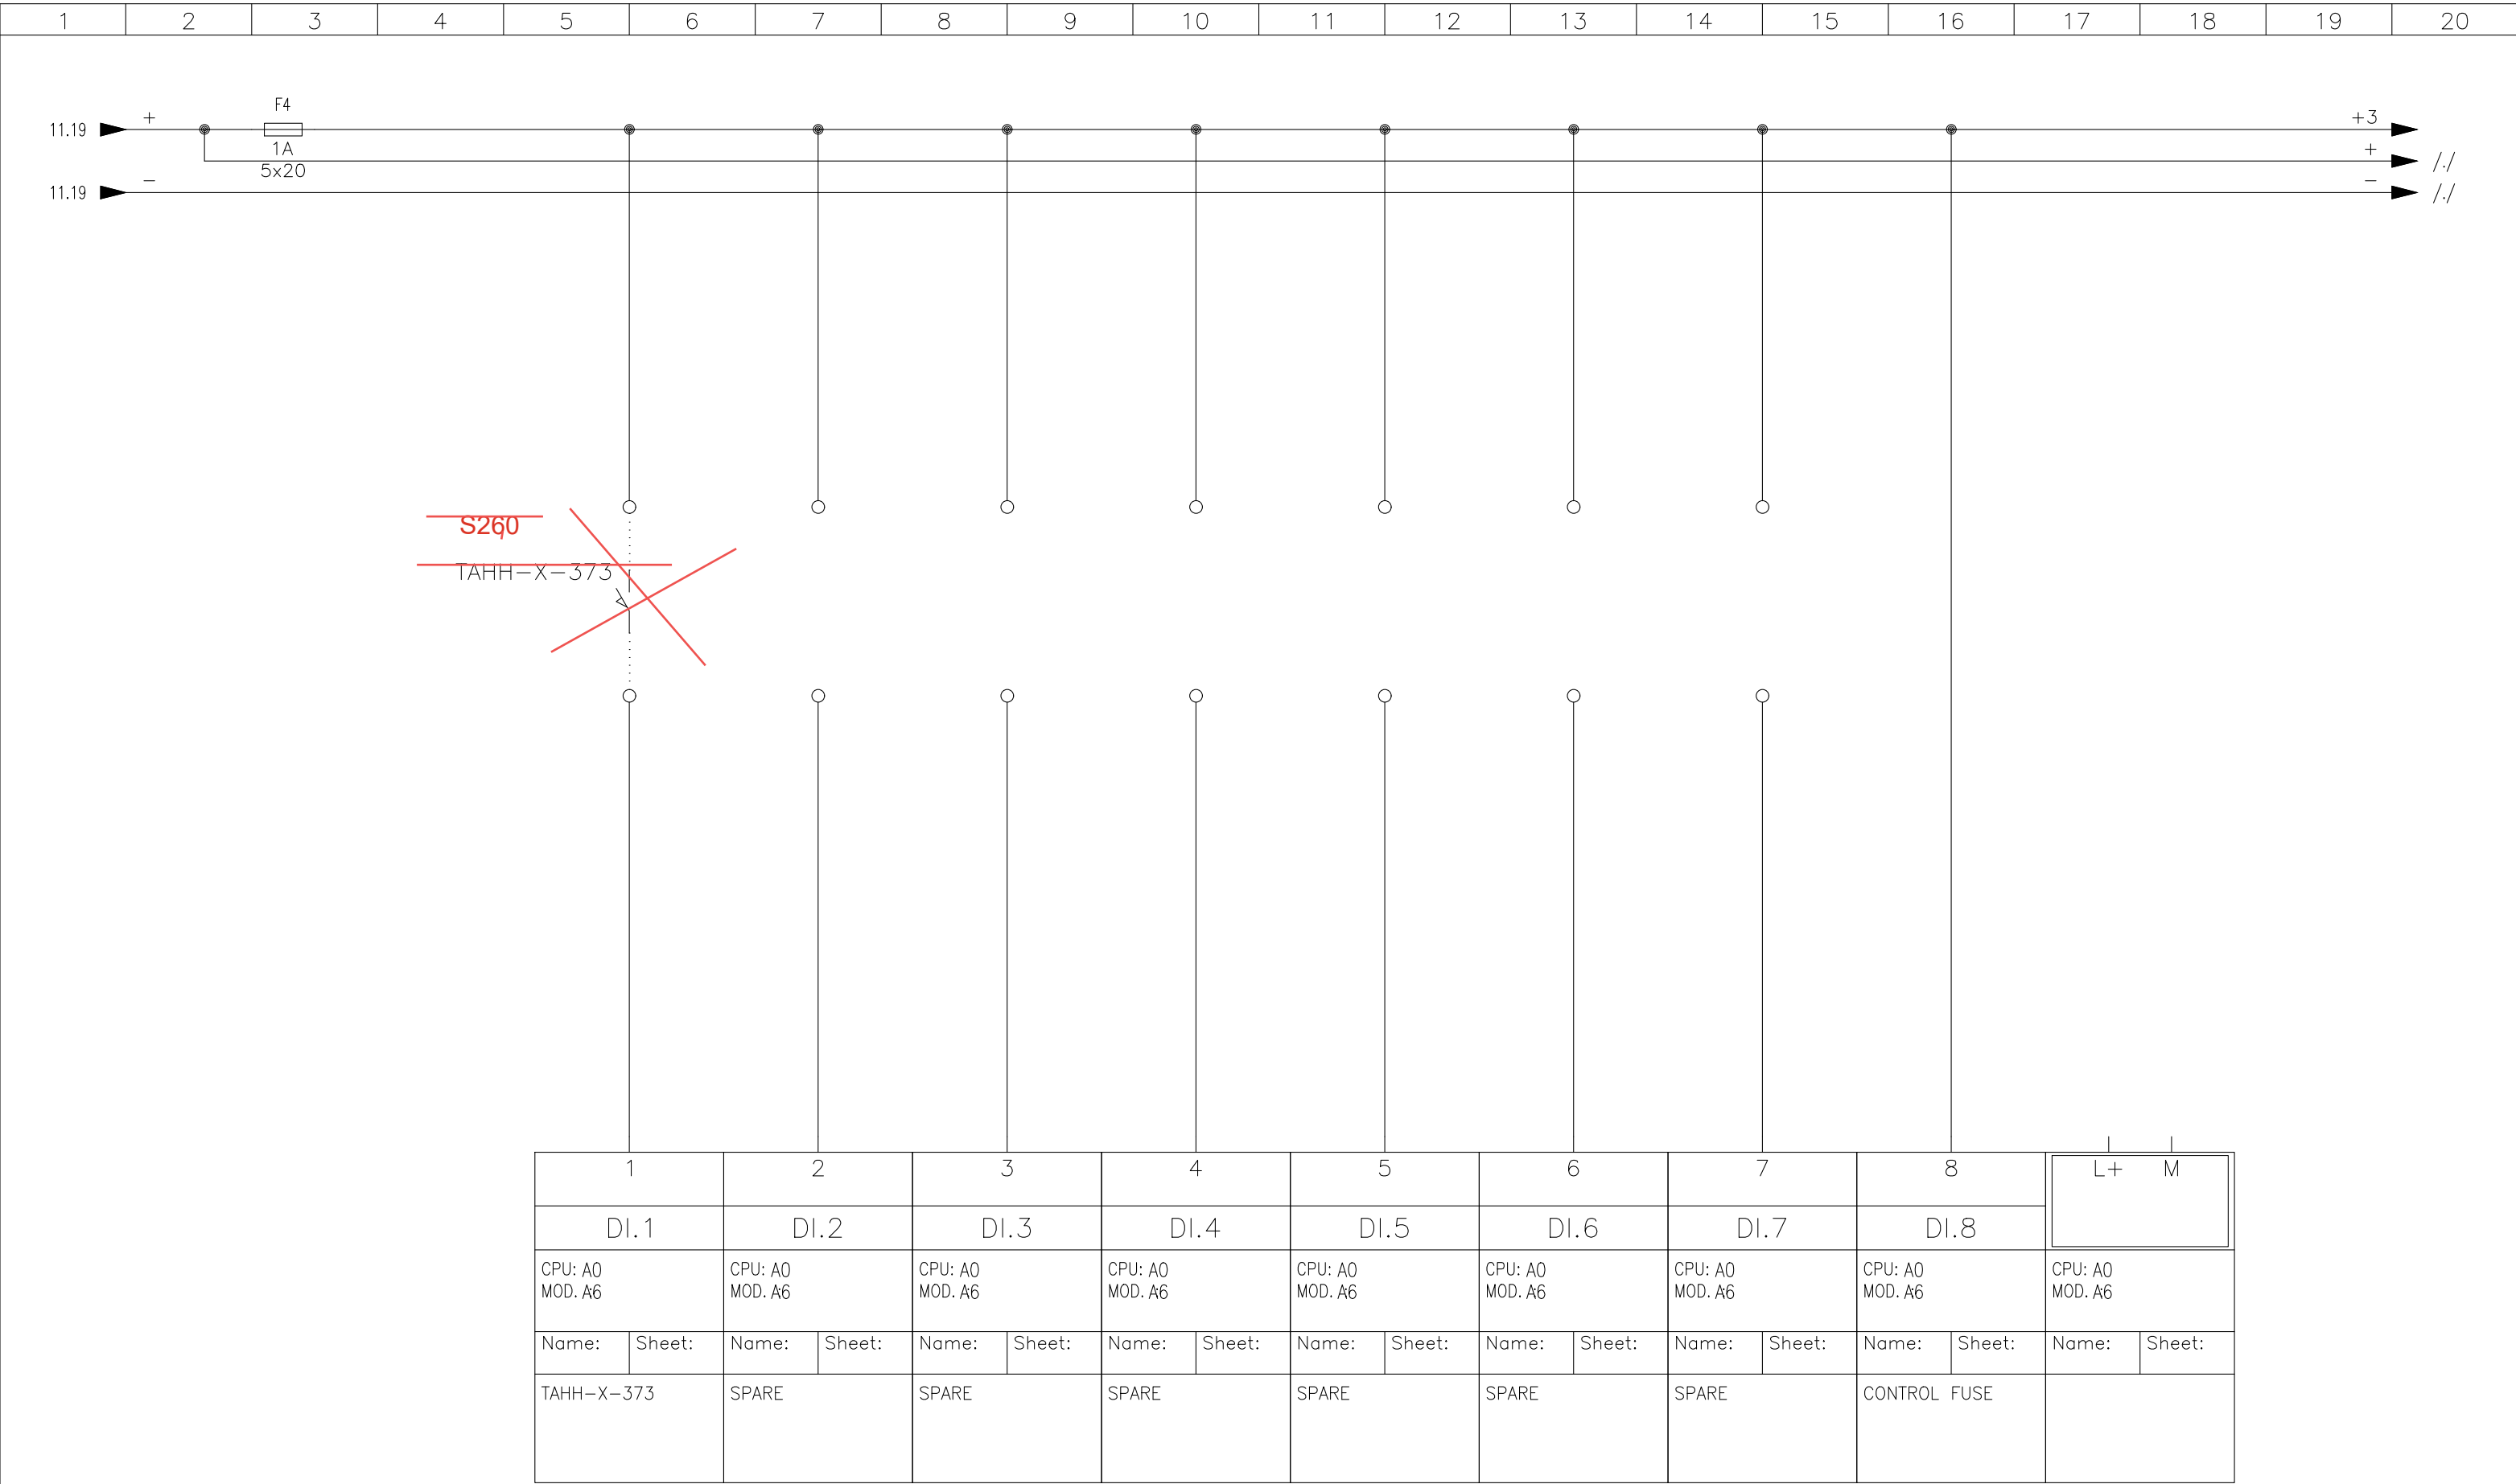

NOTE

- Type : EJB-G
- Ex-d IIB T6 IP65 ATEX -20/+50°C
- Installation area is zone 2 IIA T1
- Power dissipation 45W

