














1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20															
Customer:		SOUND ENERGY																																
Contractor:		I.M.S.P. MOROCCO																																
Engineering:		ITALFLUID																																
Technology vendor:		EPS Engineered Process Systems TECHNICAL AMERICA TECHNICAL AMERICA INC																																
Title:		LNG TENDRARA PLANT																																
objet:		<table><tr><td>P-PN-TA221.1</td><td>Customer code:</td><td>-</td><td>Sheets :</td><td>13</td></tr><tr><td>LNG TANK</td><td>By:</td><td>-</td><td>S/N. :</td><td>IE25072_SE03</td></tr><tr><td></td><td>File :</td><td>-</td><td></td><td></td></tr></table>																		P-PN-TA221.1	Customer code:	-	Sheets :	13	LNG TANK	By:	-	S/N. :	IE25072_SE03		File :	-		
P-PN-TA221.1	Customer code:	-	Sheets :	13																														
LNG TANK	By:	-	S/N. :	IE25072_SE03																														
	File :	-																																
 esalettromeccanica.com  INGEGNERIA ELETTRICA - QUADRI DI DISTRIBUZIONE E AUTOMAZIONE - CABINE DI TRASFORMAZIONE MT/BT - PLC - HMI - SCADA - ENERGIE RINNOVABILI CONTRADA TESINO, 47 - 63065 RIPATRANSONE (AP) - ITALY - TEL. +39 0735 90523 WWW.ESAELETTROMECCANICA.COM - INFO@ESAELETTROMECCANICA.COM - ESA@PEC.IT - P.IVA e C.F. 00768110447																																		
General Contractor :		Manufacture : 		Project :		Customer :						Object :																						
				P-PN-TA221.1												By :																		
				LNG TANK		Contract : IE25072						Rev. 2		Data : 11/04/2025		Date : 17/02/2025																		
						S/N : IE25072_SE03						Rev. 3		Data : 17/04/2025		Sheet : 1		of : 13																


CIRCUIT SYMBOLS ACCORDING TO CEI STANDARD

	ISOLATOR		ELECTRONIC TIMER WITH PICK-UP DELAY		MUSHROOM PUSH-BUTTON PULSE CONTACT WITH STAY-PUT MAKE CONTACT OPERATED BY STRIKING		STEDY OR FLASHING LIGHT
	FUSED ISOLATOR		ELECTRIC PULSE METER		KEY OPERATING DEVICE FOR SELECTORS, PUSH-BUTTON, ETC.		PLC UNIT
	CIRCUIT BREAKER WITH THERMAL AED MAGNETIC OVERCURRENT RELEASES		FUSE CARRIER		PRESSURE SWITCH		CONTROL INSTRUMENT
	CIRCUIT BREAKER WITH MAGNETIC RELEASE		MAKE CONTACT OF CONTACTOR		TEMPERATURE SWITCH		ENERGY METER
	CIRCUIT BREAKER WITH THERMAL, MAGNETIC AND DIFFERENTIAL RELEASES		MAKE CONTACT OF CONTACTOR		FLOW SWITCH		MEASURING INSTRUMENT
	RESIDUAL CURRENT CIRCUIT BREAKER "AC" TYPE FOR ALTERNATING CURRENT "A" TYPE FOR ALTERNATING OR PULSATING CURRENTS		MAKE AND BREAK CONTACT		FLOAT SWITCH		VOLTAGE TRANSFORMER
	THERMAL RELAY (OVERLOAD RELAY)		MAKE AND BREAK CONTACT WITH DROP-OUT DELAY		BUCHHOLZ RELAY		CURRENT TRANSFORMER
	COIL OF CONTACTOR RELAY		MAKE AND BREAK CONTACT WITH PICK-UP DELAY		CAM OPERATED DEVICE		ACOUSTIC SIGNALLING DEVICE
	COIL OF SHUT-OFF ALARM MAKE CONTACT ON ENERGIZATION		MAKE AND BREAK CONTACT WITH DROP-OUT AND PICK-UP DELAY (FLIP-FLOP)		PROXIMITY SWITCH		RESISTANCE
	COIL OF SHUT-OFF ALARM DENERGIZES IN CASE OF UNDERVOLTAGE		MAKE AND BREAK CONTACT OF THERMAL RELAY		TEMPERATURE SENSOR		CAPACITOR
	COIL OF OPERATING DEVICE WITH DROP-OUT DELAY		MAKE AND BREAK CONTACT OF LIMIT SWITCH		PHOTOELECTRIC SENSOR		SINGLE-PHASE ELECTRIC MOTOR
	COIL OF OPERATING DEVICE WITH PICK-UP DELAY		MULTI POSITION SWITCH (GENERAL SYMBOL)		SOLENOID VALVE		THREE-PHASE ELECTRIC MOTOR
	COIL OF OPERATING DEVICE WITH DROP-OUT AND PICK-UP DELAYS		MAKE AND BREAK CONTACT OPERATED BY TURNING WITH SPRING RETURN		PHOTOCELL		
	COIL OF LATCHING RELAY (STEP-BY-STEP FUNCTION)		MAKE AND BREAK CONTACT OPERATED BY PUSHING WITH SPRING RETURN				
	ELECTRONIC OR ELECTRO-MECHANICAL TIME SWITCH		MAKE AND BREAK CONTACT OPERATED BY PULLING WITH OR WITHUOT SPRING RETURN				


CONDUCTOR COLOR CODING INSIDE CONTROL PANEL	
AC AND DC POWER CIRCUIT	BLACK
NEUTRAL CONDUCTOR OF POWER CIRCUIT	LIGHT–BLUE
PROTECTIVE CONDUCTOR (EARTH CONDUCTOR)	YELLOW–GREEN
110/220V AC AUXILIARY CIRCUIT (*)	RED
24V AC AUXILIARY CIRCUIT	WHITE
24V AC AND DC PLC INPUT	GRAY
24V AC PLC OUTPUT	WHITE
24V AC AND DC INTERLOCKING CIRCUIT	ORANGE
24V DC AUXILIARY CIRCUIT AND PLC OUTPUT	DARK–BLUE
INTRINSIC SAFE SIGNAL	BLUE
(*) : RED FOR 110V AND BROWN FOR 220V, IN CASE BOTH VOLTAGE ARE USED	

CODE COLOUR	
COLOUR	CODE LETTERS
BLACK	BK
BROWN	BN
RED	RD
ORANGE	OG
YELLOW	YE
GREEN	GN
BLUE	BU
GREY	GY
WHITE	WH
SILVER	SR
CLEAR	CL
GREEN AND YELLOW	GNYE

	POWER MAIN DISCONNECT SWITCH																	FEEDER ID	
	1F+N+PE~50Hz 230V																	RATED POWER Pn-RATED VOLTAGE Vn	
																		RATED CURRENT	

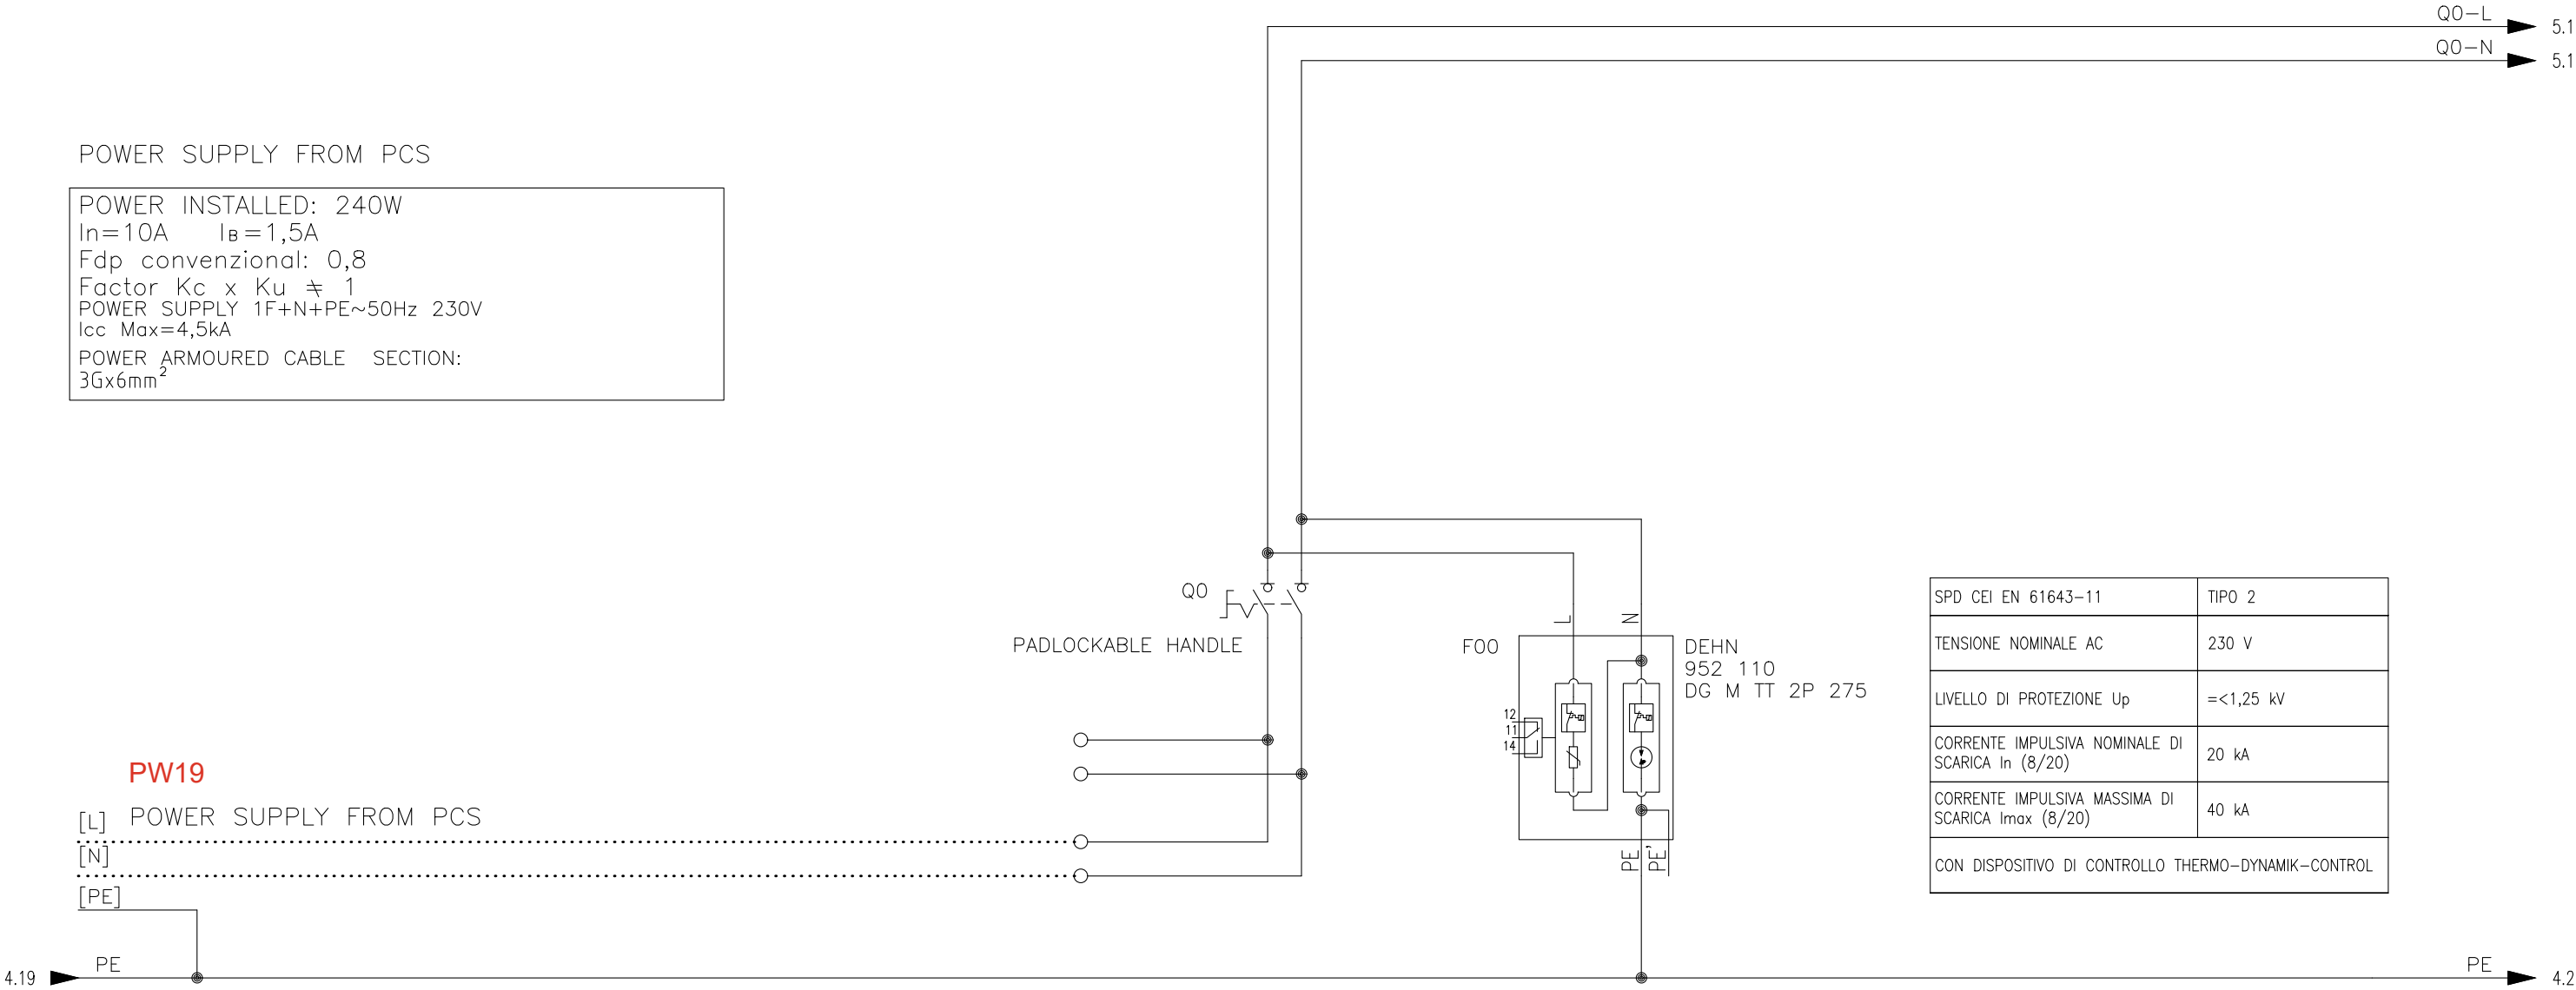


CONDUCTOR PROTECTION	TECHNOR PSRC-220																	TYPE	CONDUCTOR PROTECTION
	20A																	RATED BREAKING CAPACITY Icu	
																		RATED or THERMAL CURRENT In or Ith	
																		MAGNETIC RELEASE CHARACTERISTICS Im	
																		RATED R.C. SENSITIVITY Idn	
																		WIRE SECTION	
																		CABLE TYPE	
																		CABLE CARRYING LOAD Iz	
																		CABLE LENGHT	
																		LINE ID	
																	WIRE ID ON TERMINAL		

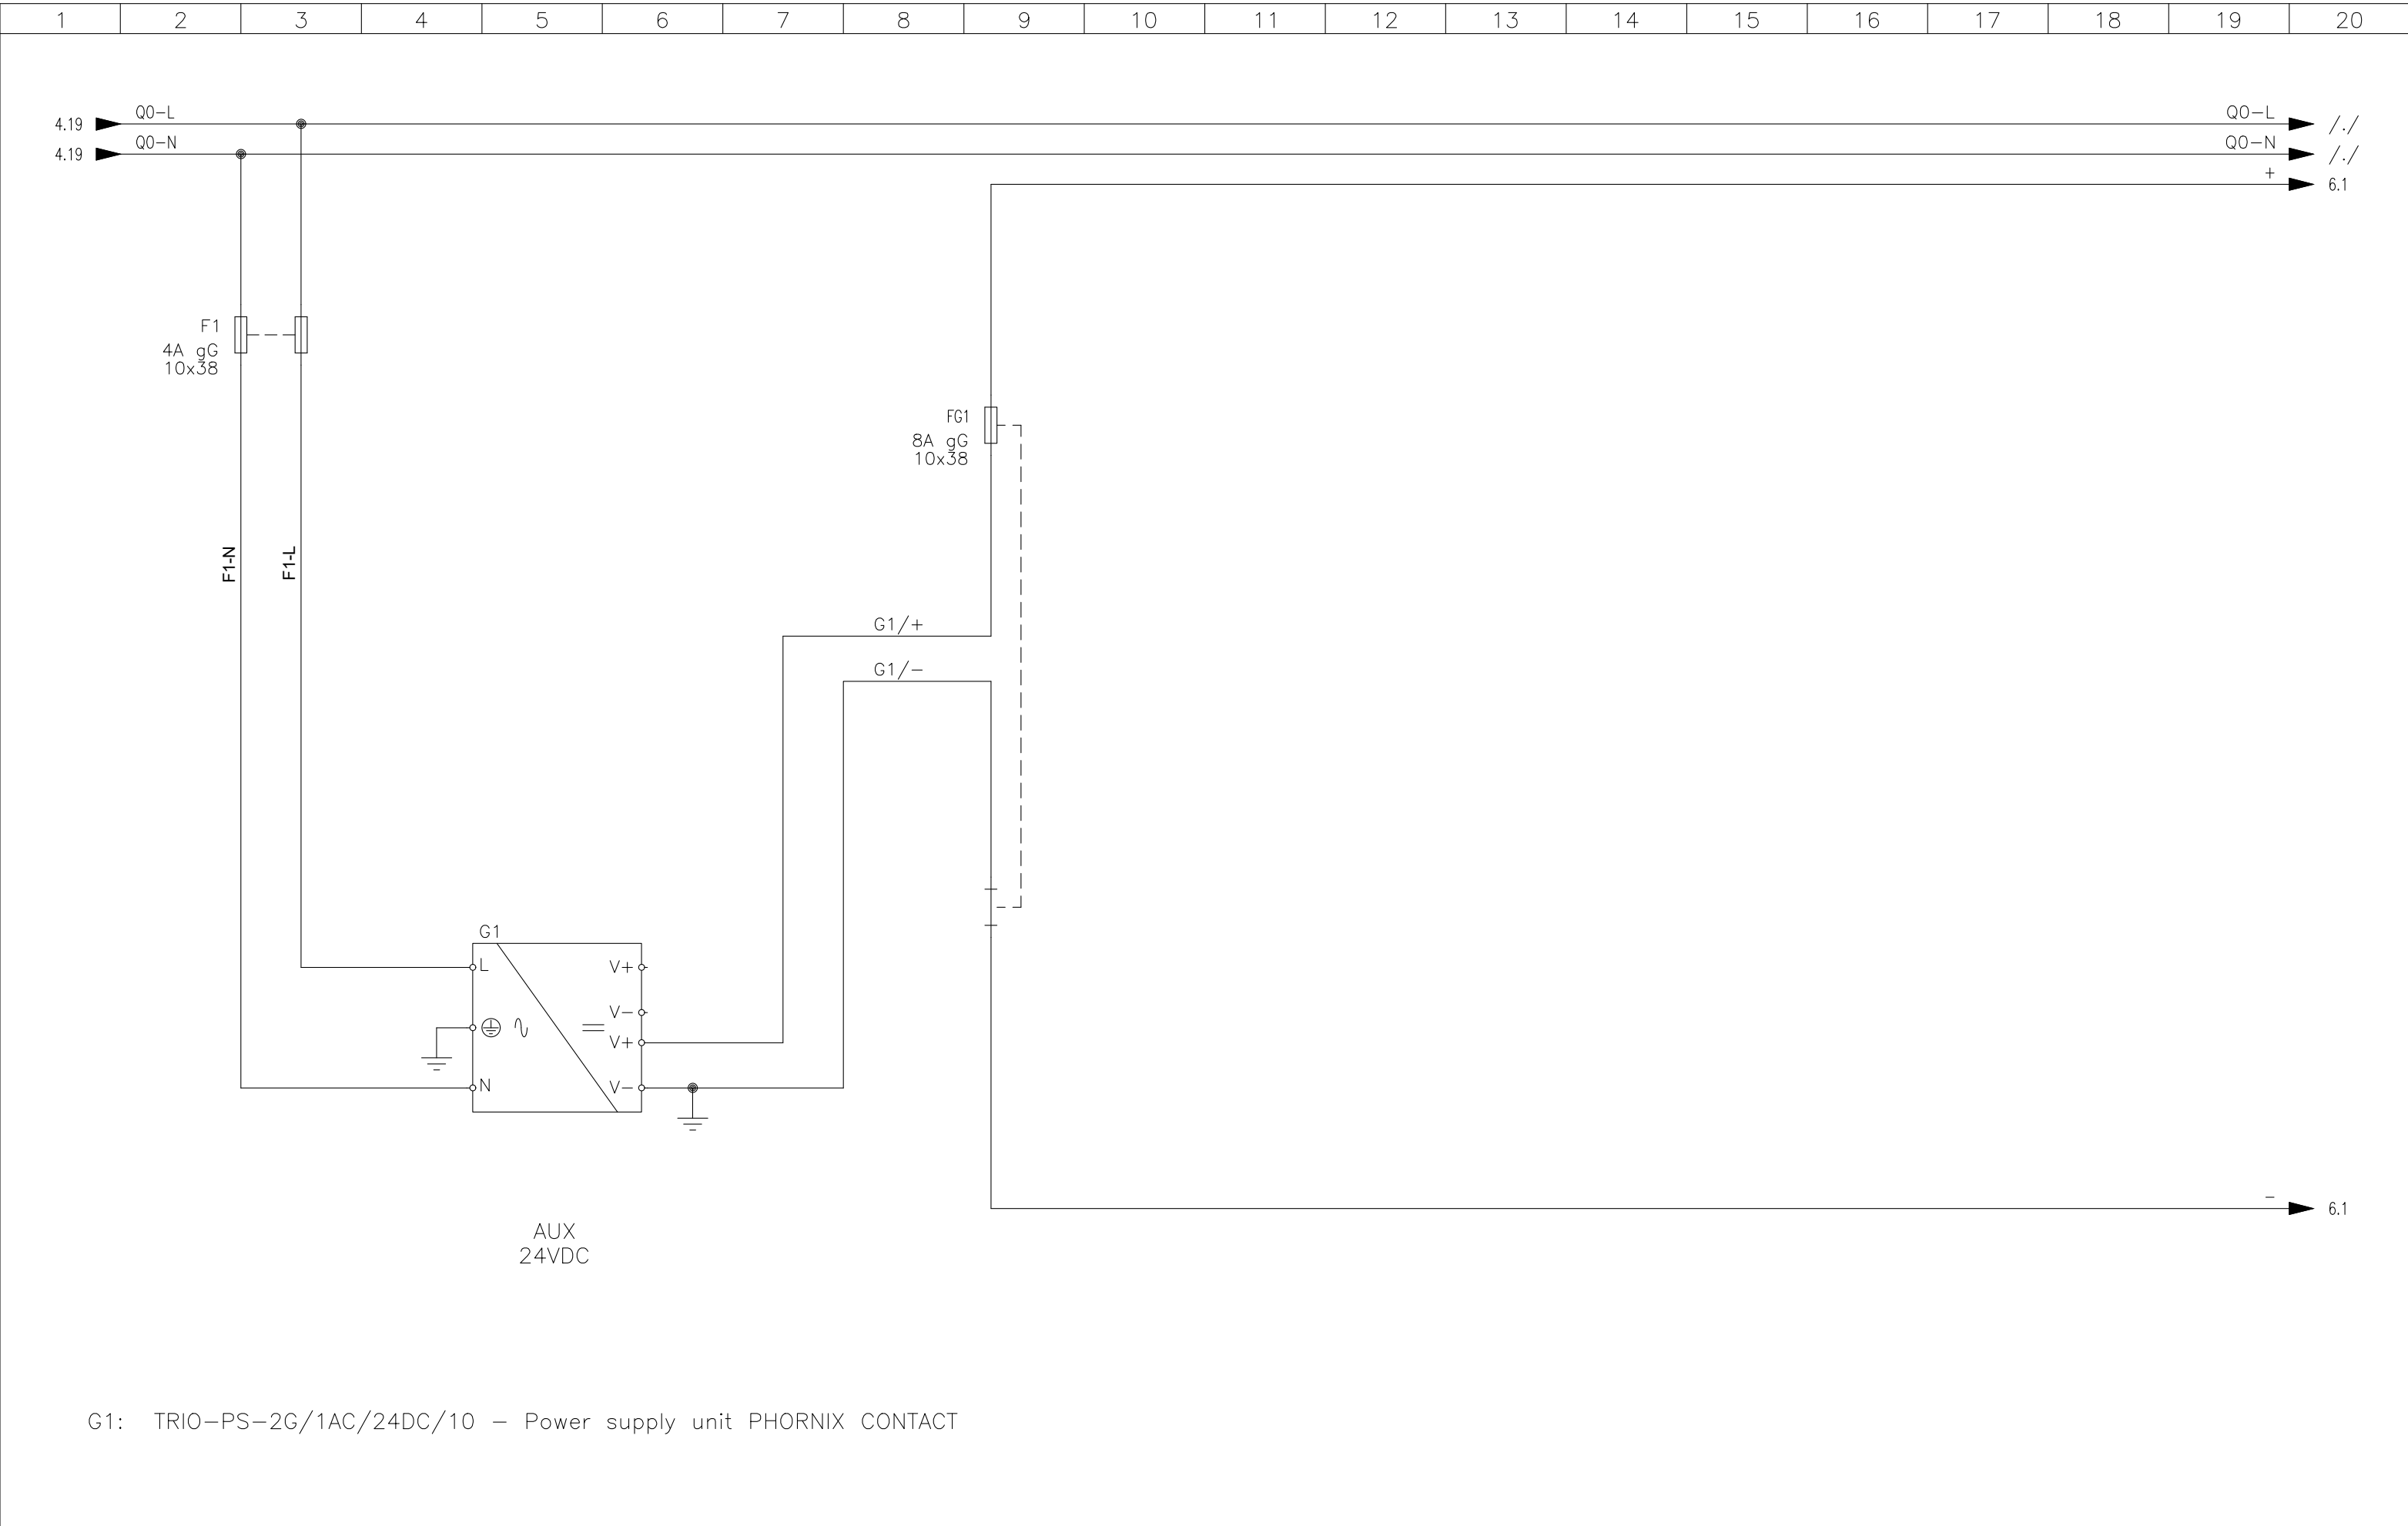

G1: TRIO-PS-2G/1AC/24DC/10 - Power supply unit PHORNIX CONTACT

General Contractor : Manufacture : esa esa.electronic@esa.com
--

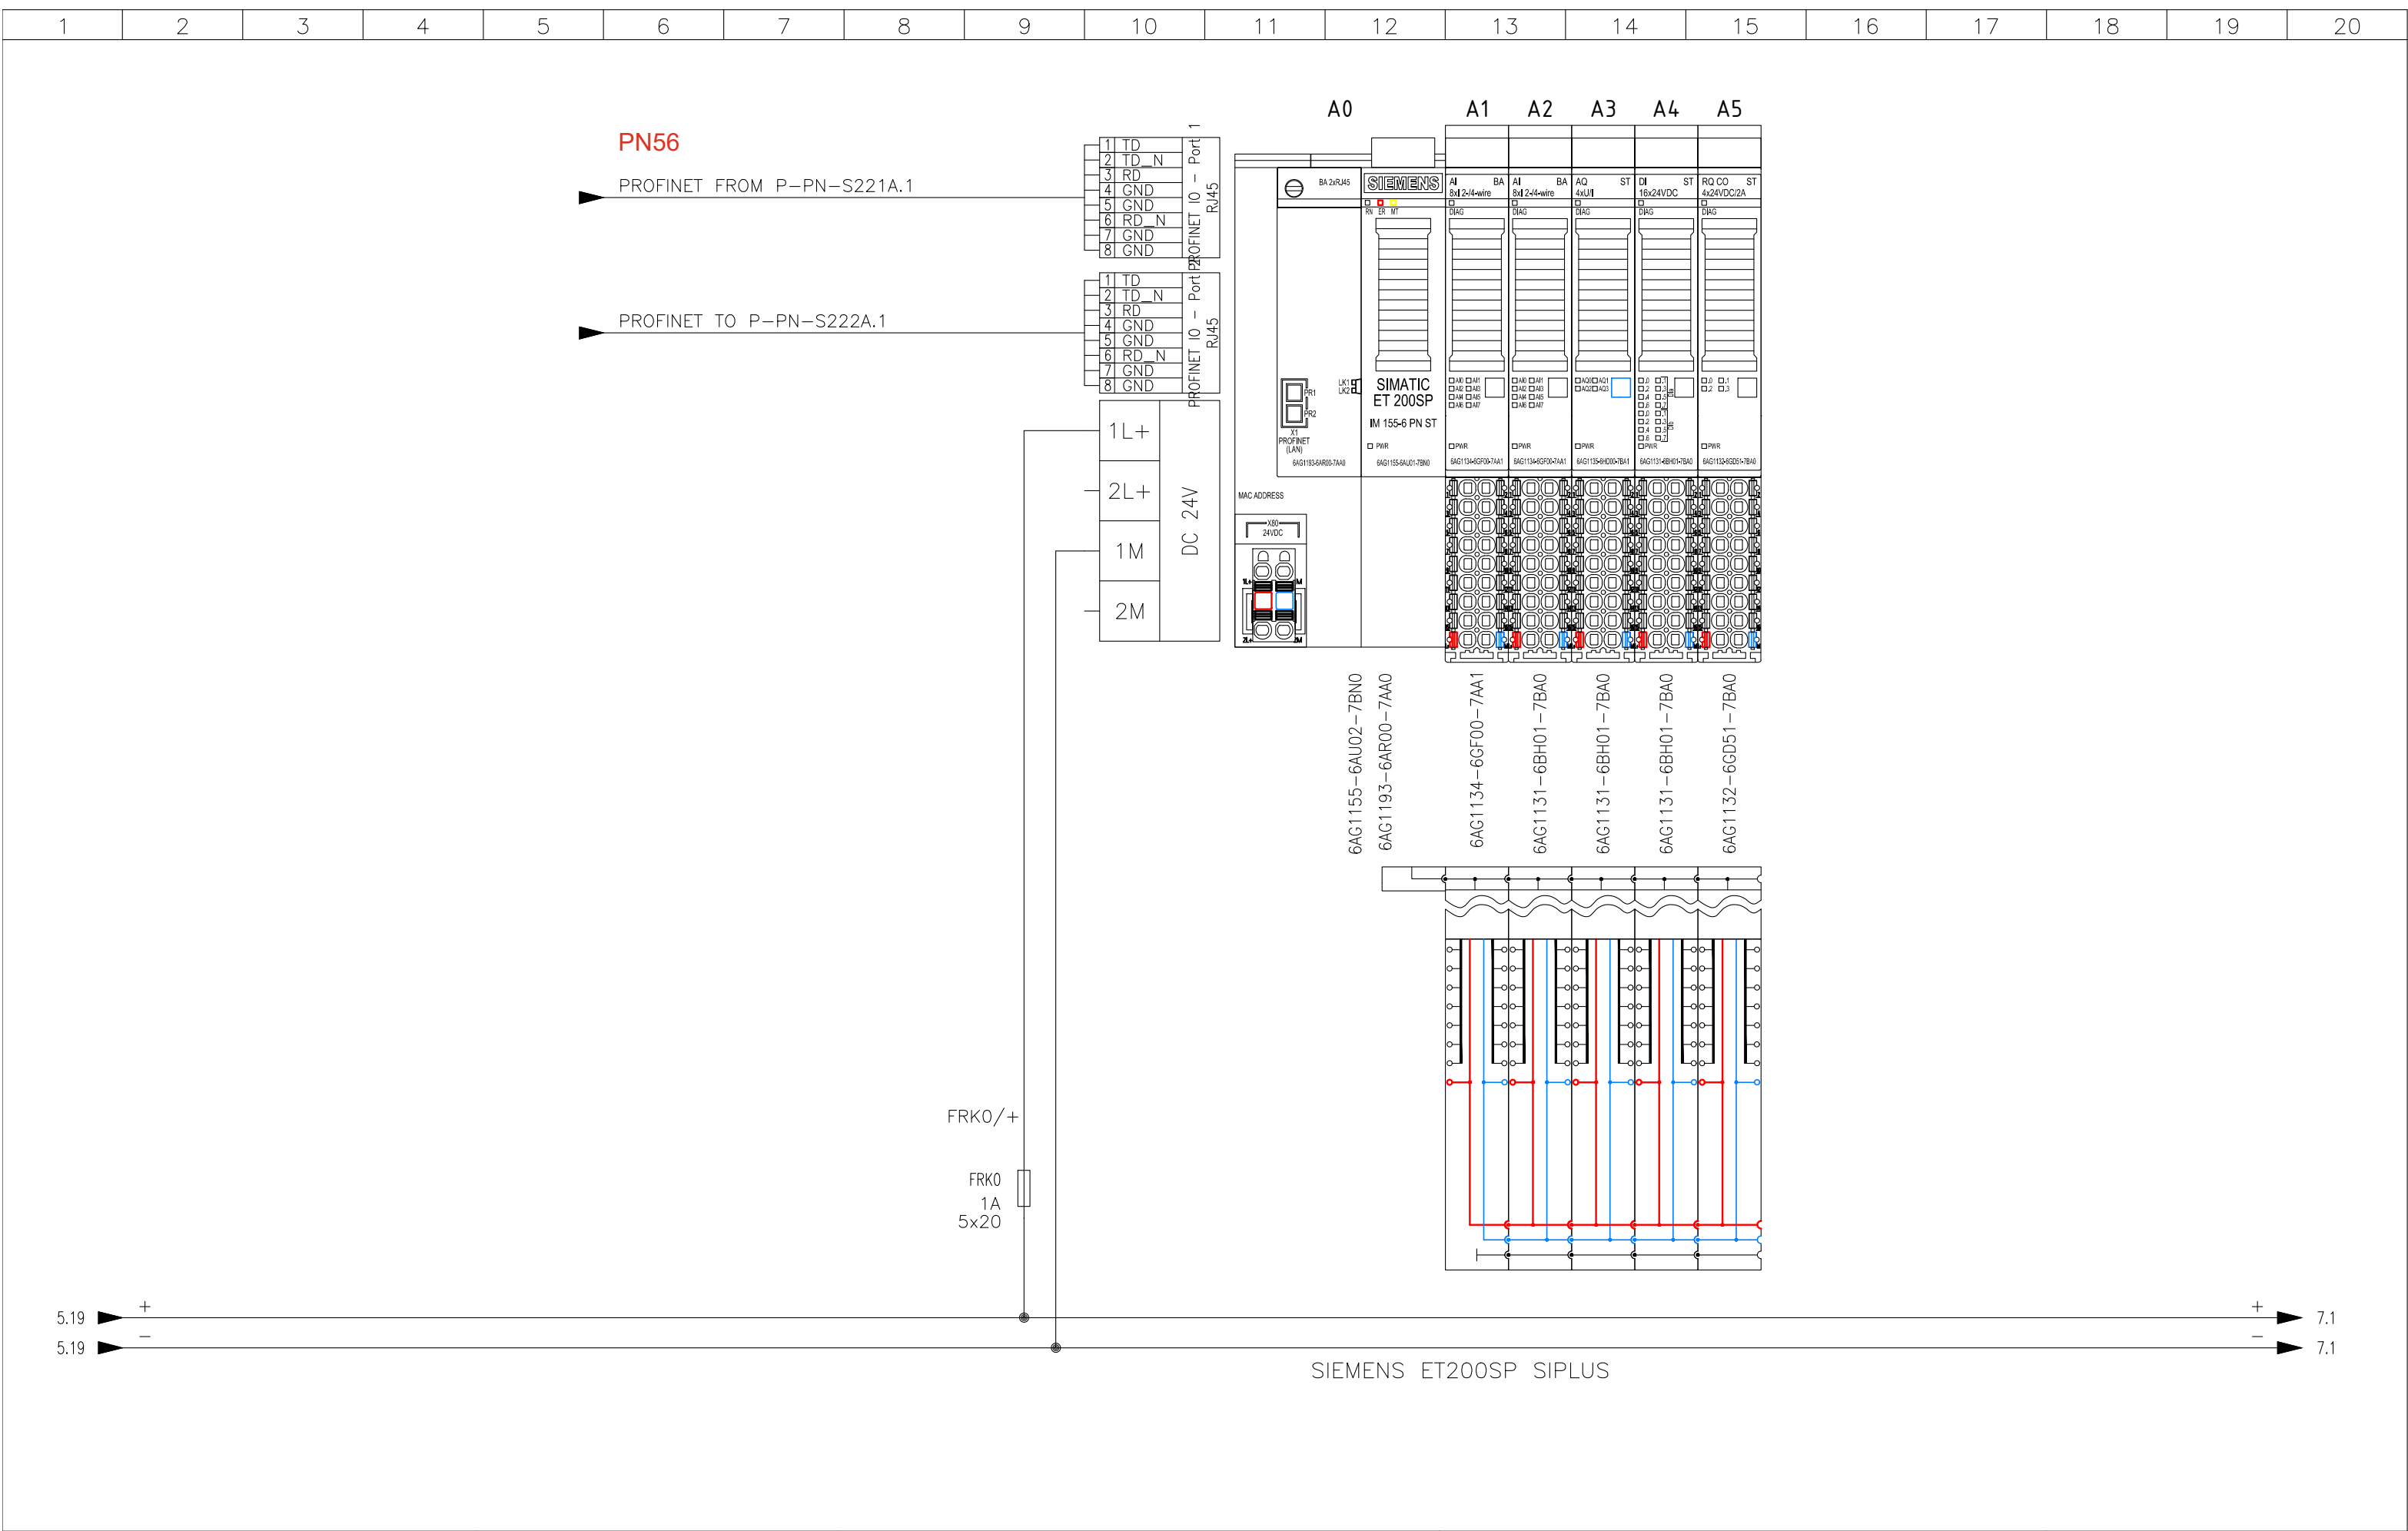



7.19	+															+	9.1
7.19	-															-	9.1

?

S343

Kg

4÷20mA

EEx-d

WT-2212

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-

+

-


+



-


+


-

+


General Contractor : Manufacture : 		Project : P-PN-TA221.1 LNG TANK	Customer :	Object :		By :	
				Rev. 2	Data : 11/04/2025	Date : 17/02/2025	
			Contract : IE25072	Rev. 3	Data : 17/04/2025	Sheet : 8	of : 13
			S/N : IE25072_SE03				

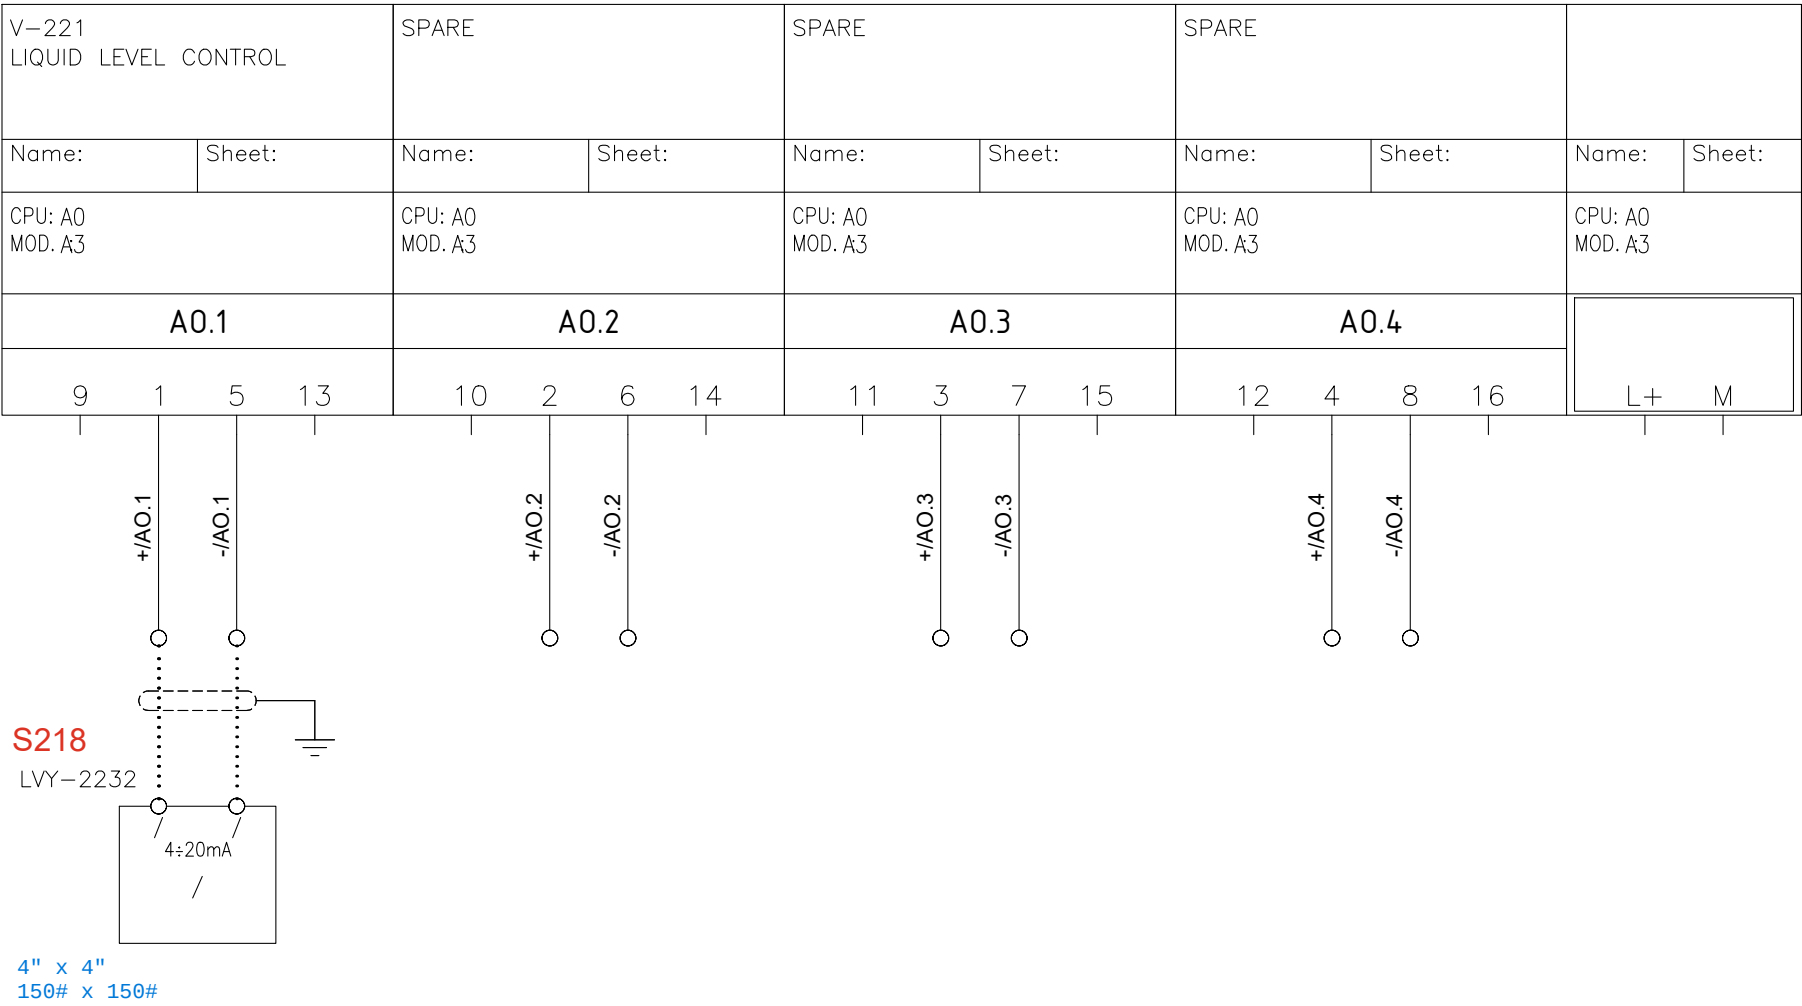

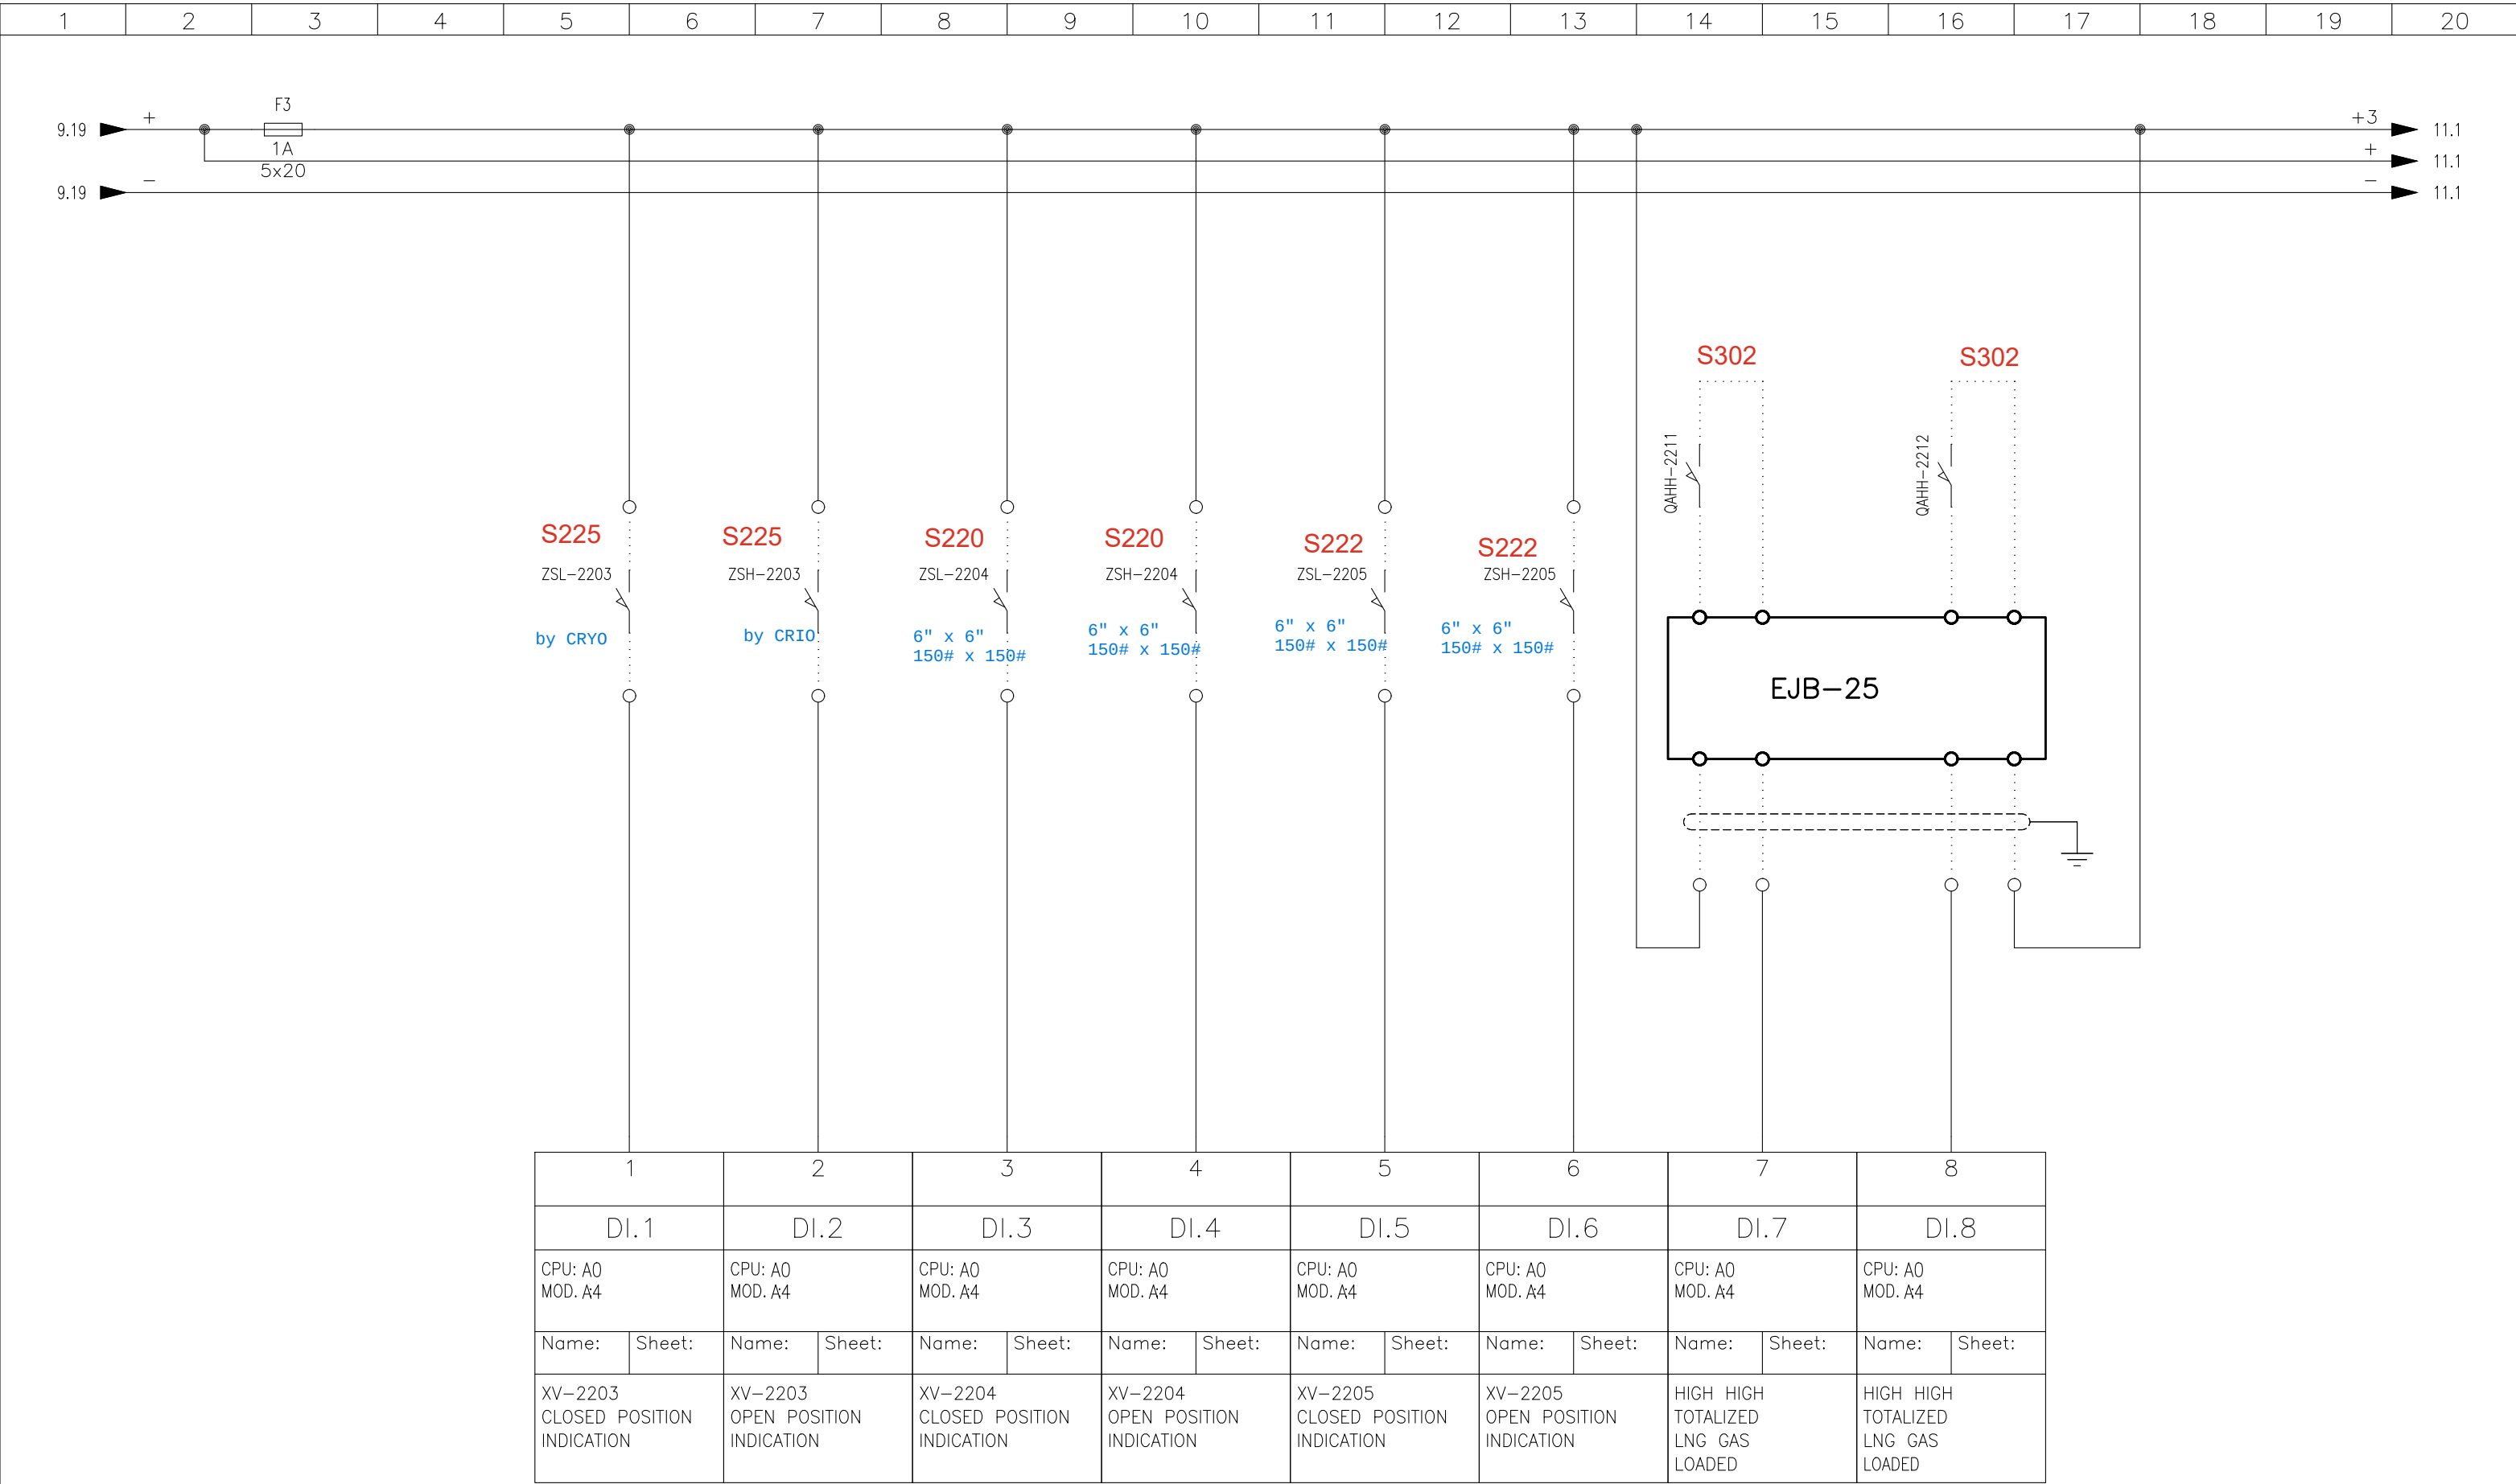



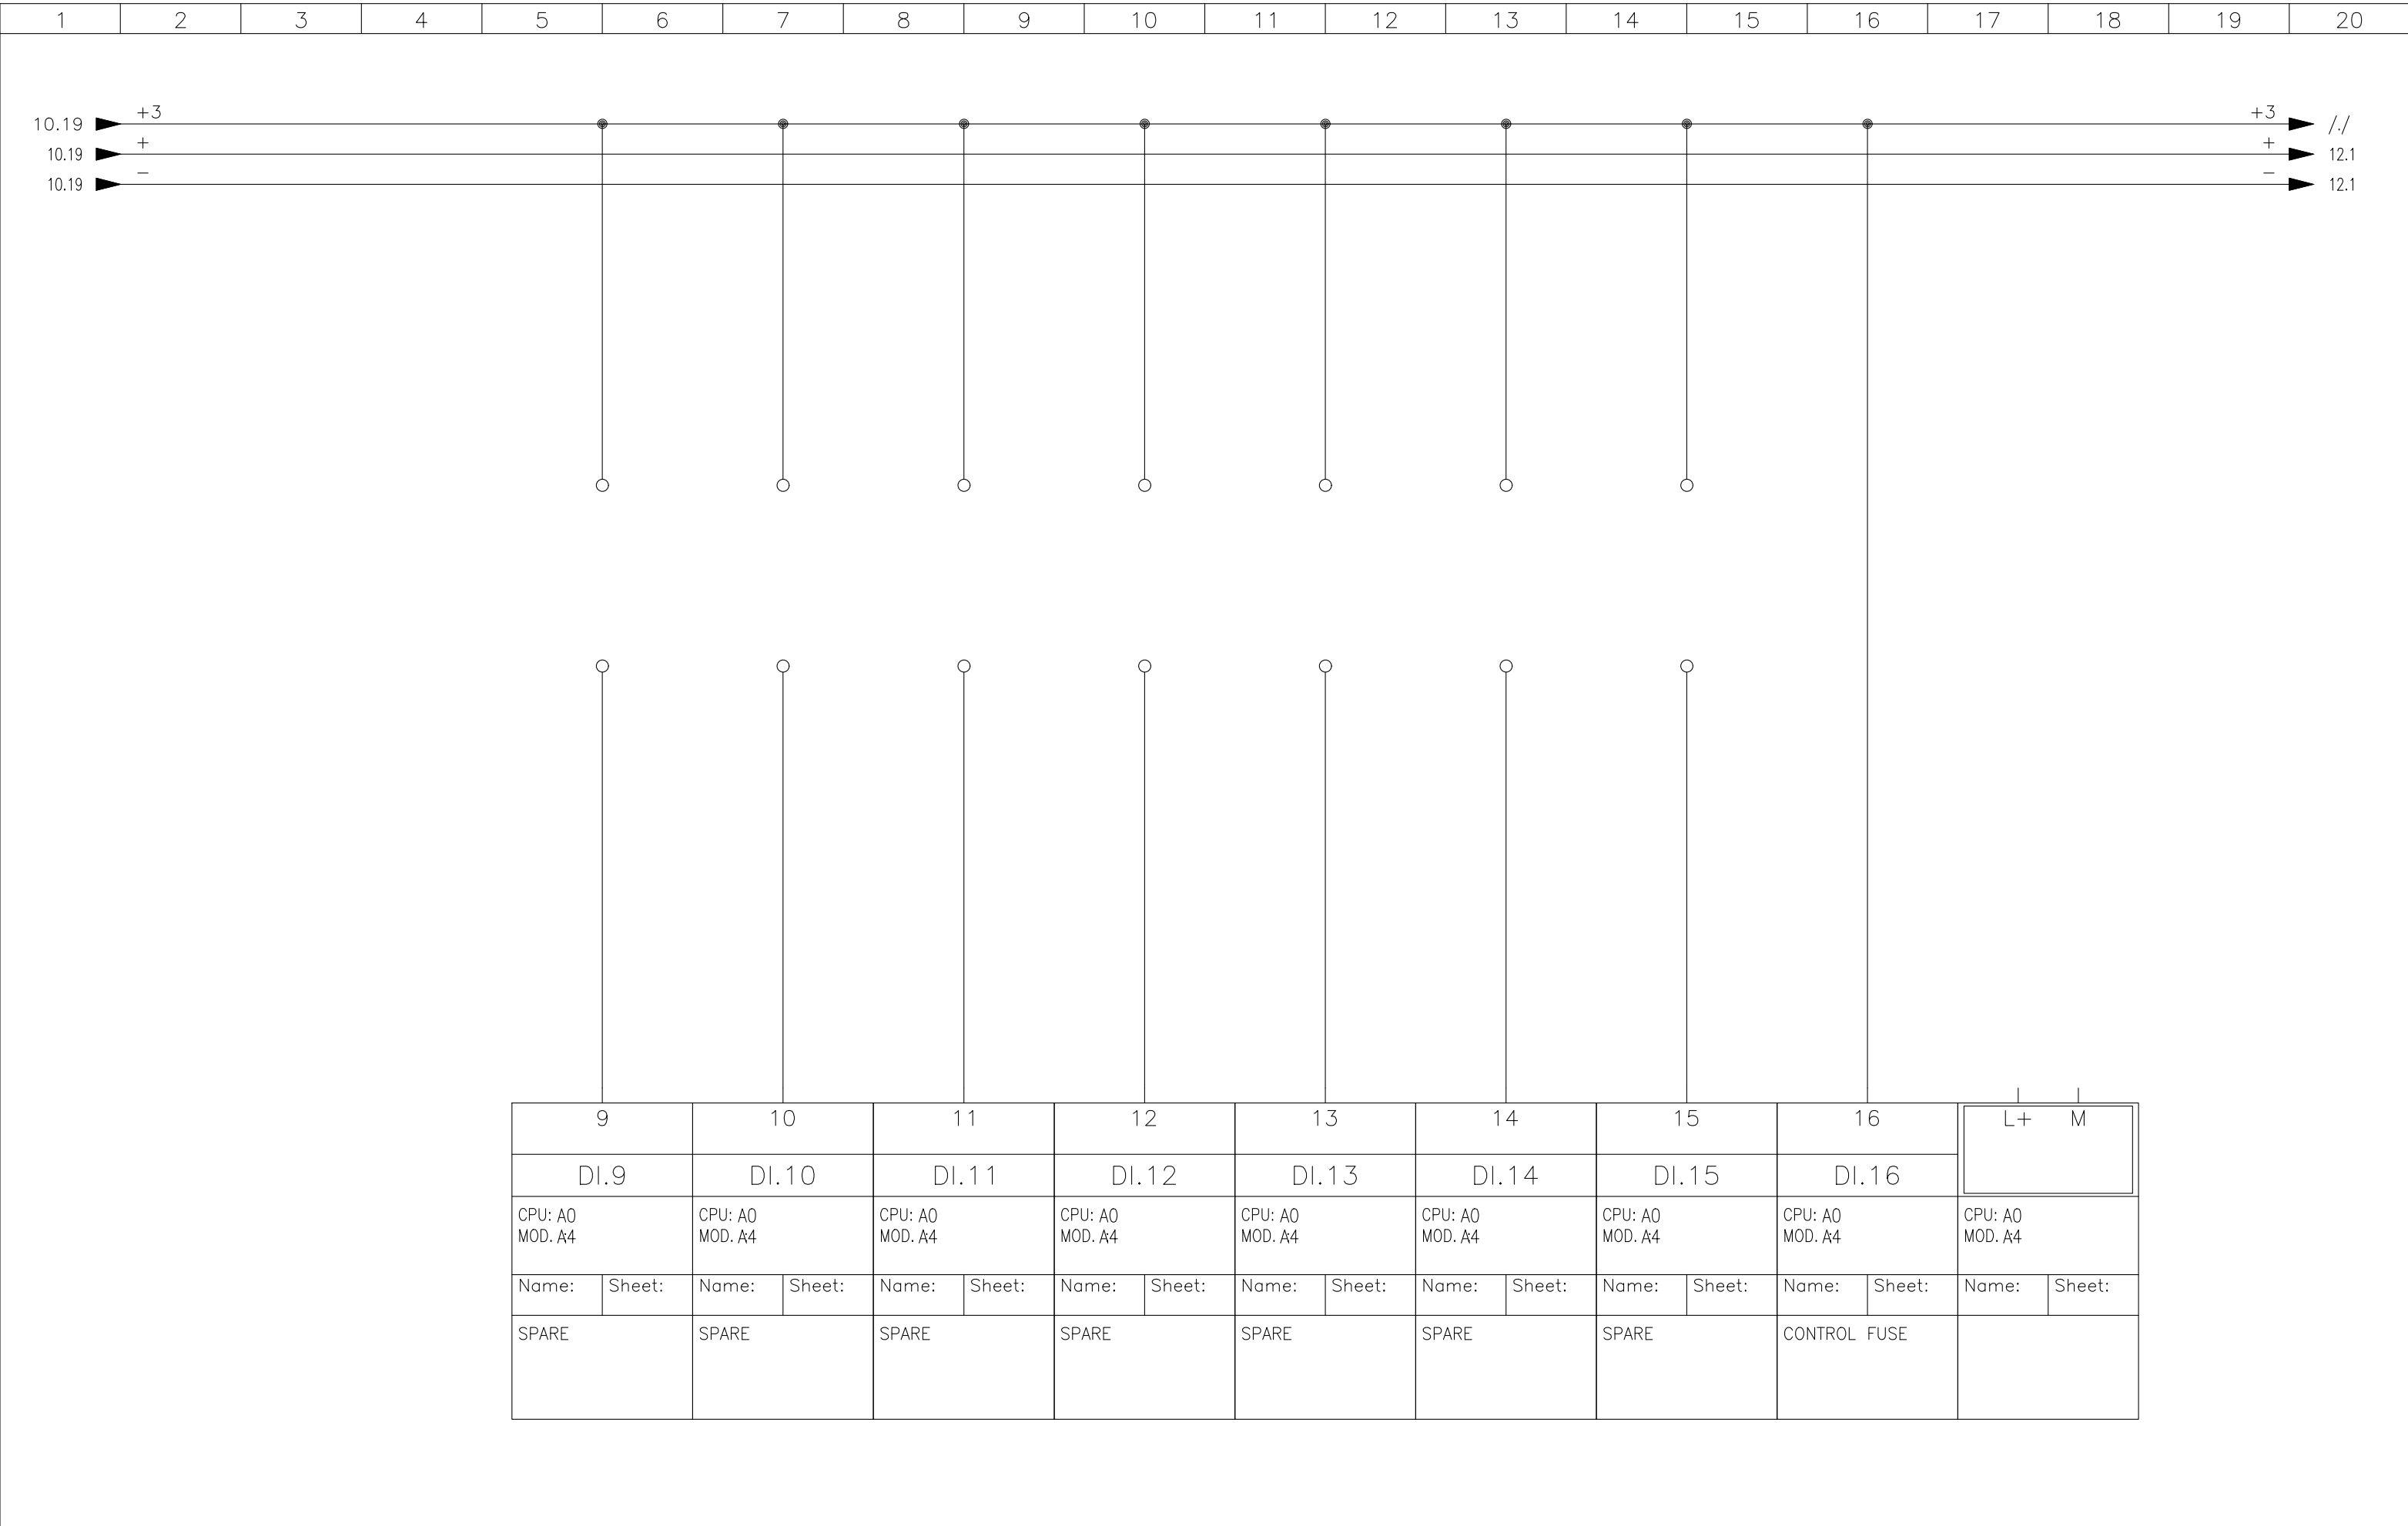


TA-221 VAPORIZER SUCTION SHUT DOWN			LNG TO P-221A/B SUCTION SHUT DOWN			LNG TO P-222A/B SUCTION SHUT DOWN			SPARE					
Name:		Sheet:	Name:		Sheet:	Name:		Sheet:	Name:		Sheet:	Name:		Sheet:
CPU: A0 MOD. A5			CPU: A0 MOD. A5			CPU: A0 MOD. A5			CPU: A0 MOD. A5			CPU: A0 MOD. A5		
D0.1			D0.2			D0.3			D0.4			L+M		
159			2610			3711			4812					


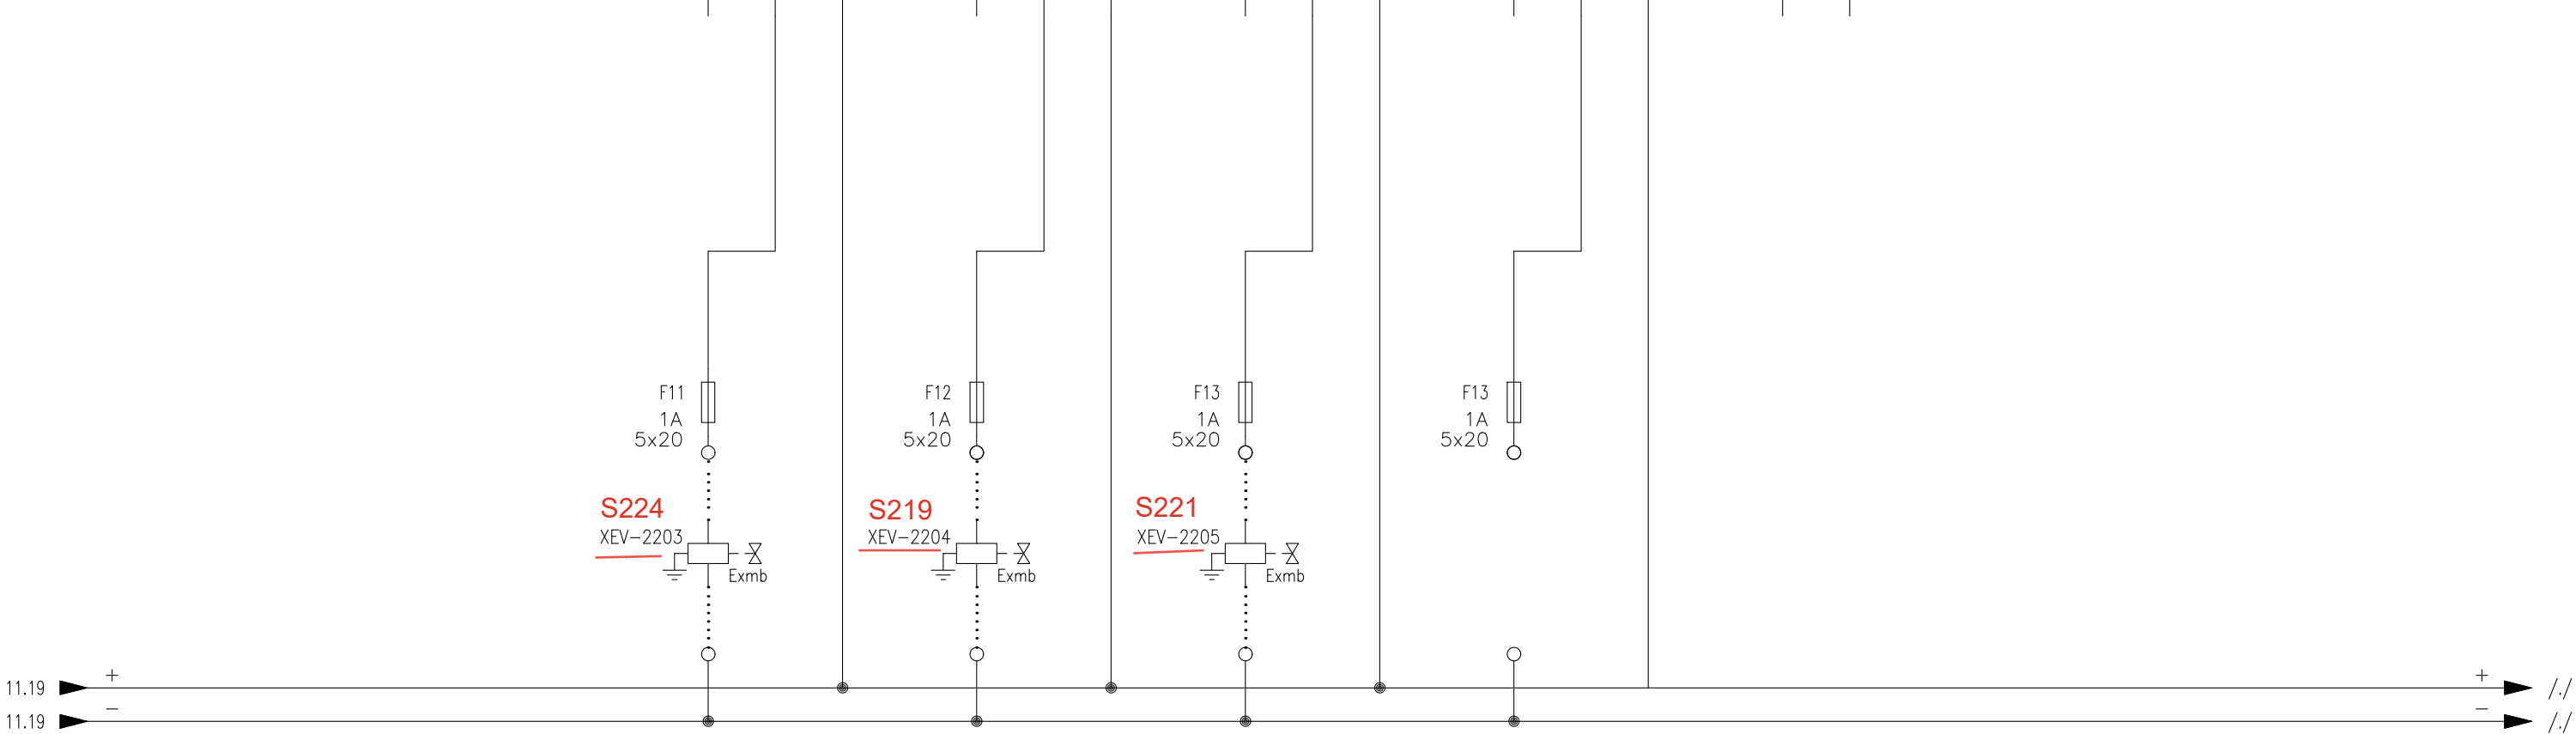


NOTE

- Type : EJB-G
- Ex-d [ia] IIB T6 IP65 ATEX -20/+50°C
- Installation area is zone 2 IIA T1
- Power dissipation 50W

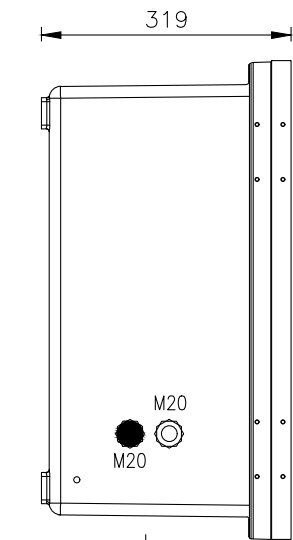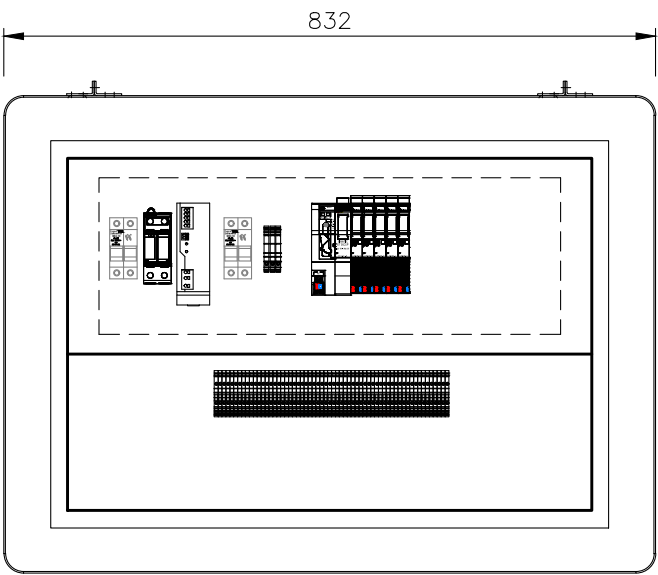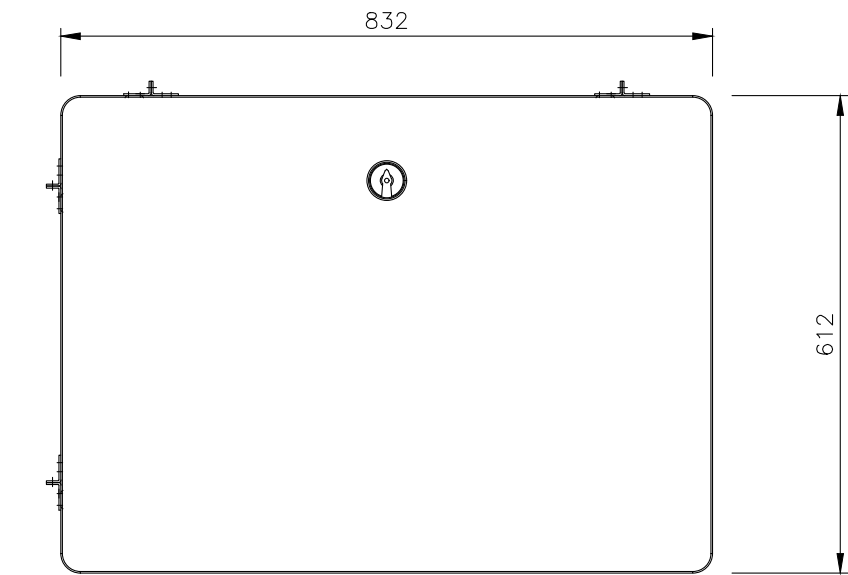

POWER SUPPLY

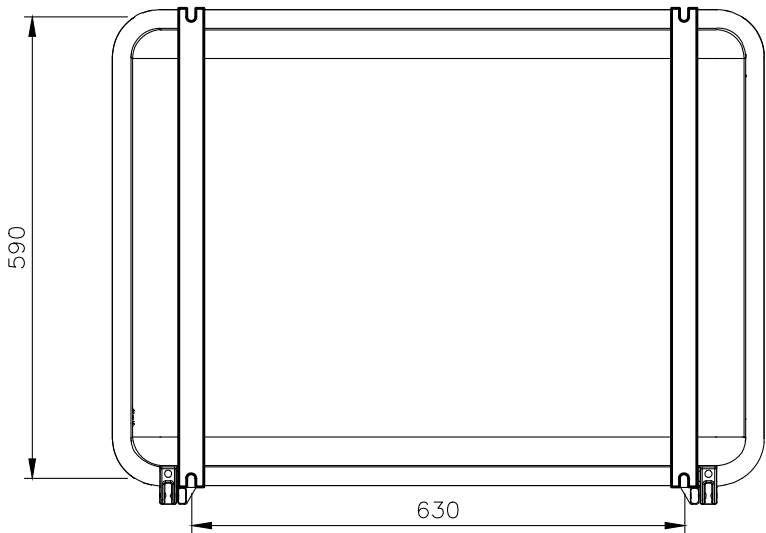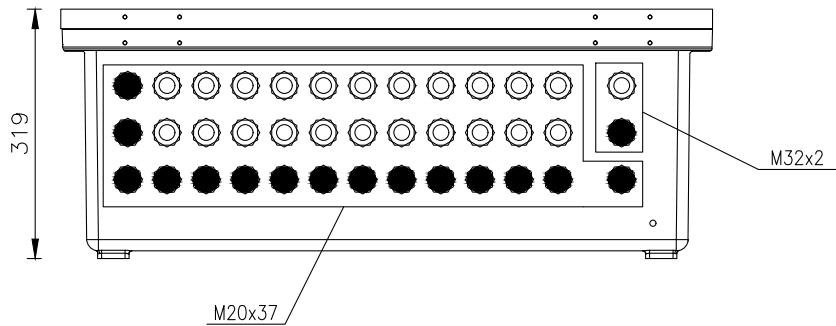

General Contractor : Manufacture : 		Project : P-PN-TA221.1 LNG TANK	Customer : Contract : IE25072 S/N : IE25072_SE03		Object : Rev. 2 Data : 11/04/2025 Rev. 3 Data : 17/04/2025		By :		Date : 17/02/2025	
							Sheet : 13		of : 13	