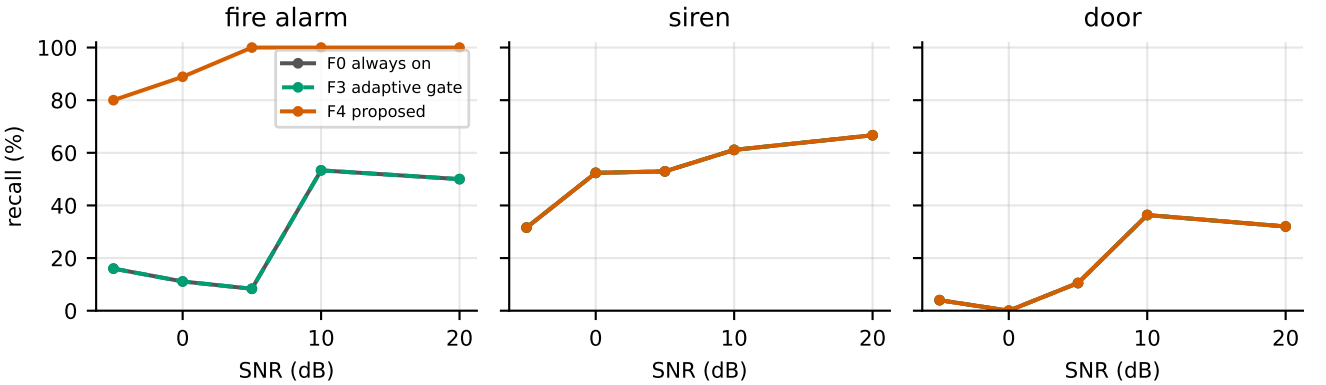
fire alarm
siren
door
recall (%)
F0 always on
F3 adaptive gate
F4 proposed
100
80
60
40
20
0
0
10
20
SNR (dB)